


ORIGINAL

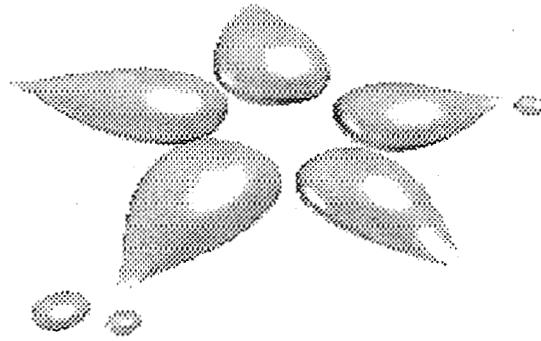

United Water

Before the

Florida Public Service Commission

Docket No. 980214-WS

Application for a General Rate Increase

H - 5 Schedule

Containing

25-30.440

Additional Engineering Information

Required of Class A & B

Water and Sewer Utilities

DOCUMENT NUMBER-DATE

05505 MAY 18 88

RECORDS/REPORTING

Book 2 of 7

**WATER
OPERATING REPORTS
1997**

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WWS ID NO. 2161326 CUP NO. 2-031-0028-N-1E2

NAME OF DRINKING WATER SYS: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : December, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Milton Devereaux, C.O., CERT. NO. C- 2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	MG/L	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE SAMPLE			
MONTHLY TOTAL	15581	1295	283.7	28.7	87.7	2.7	660.7	N/A	N/A
AVERAGE	502.6	41.8	9.5	7.2	2.8	0.9	21.3	4.9	0.04
MAXIMUM	887	82	12.2	7.2	3.5	1.0	37.4	7.2	0.05
MINIMUM	0	0	2.7	7.1	2.0	0.8	0.0	0.0	0.02
01	244	20	9.8		3.0		9.9	4.8	
02	134	3	2.7	7.2	2.5		2.2	1.9	
03	20	1	6.0		2.2		1.2	7.2	
04	134	10	8.9		2.0		5.2	4.7	0.05
05	73	7	11.5		2.5		3.6	5.9	
06	191	14	8.8		2.8		6.6	4.1	
07	281	22	9.4		2.5		12.6	5.4	
08	124	9	8.7		2.2		4.8	4.6	
09	218	17	9.4	7.1	3.0	1.0	9.0	5.0	
10	0	0			3.2		0.0		
11	10	1	6.0		2.8		0.0	0.0	
12	341	32	11.3		2.7		14.0	4.9	
13	672	53	9.5		3.5		28.4	5.1	
14	669	65	11.6		3.5		28.8	5.2	
15	770	54	8.4		3.0		32.4	5.0	
16	711	58	9.8	7.2	2.8	0.9	30.2	5.1	
17	710	59	10.0		2.4		30.0	5.1	
18	731	66	10.8		3.5		31.8	5.2	0.02
19	778	68	10.5		3.0		33.2	5.1	
20	745	66	10.6		2.8		31.8	5.1	
21	725	60	9.9		2.5		30.0	5.0	
22	695	71	12.2		3.5		30.0	5.2	
23	887	82	11.1		3.2		37.4	5.1	
24	589	58	11.8		2.5		25.8	5.3	
25	640	38	7.1		2.3		27.2	5.1	
26	781	61	9.4		2.5		33.6	5.2	
27	735	58	9.5		3.1		31.4	5.1	
28	707	63	10.7		3.0		33.3	5.6	
29	751	59	9.4	7.2	3.0	0.8	30.0	4.8	
30	740	57	9.2		3.2		32.8	5.3	
31	775	63	9.7		3.0		33.6	5.2	

- NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6 SAMPLE DATE: 12-02-97
- WELL ARTESIAN PRESSURES: (1) ON-SITE 4 psi (2) OFF-SITE 0 psi
- COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-152

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : November, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Jane L. Keys

, C.O., CERT. NO. B6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE SAMPLE	LBS. USED	MG/L	
MONTHLY TOTAL	8215	650	296.5	28.6	76.9	3.5	323.6	N/A	N/A
AVERAGE	273.8	21.7	9.9	7.2	2.6	0.9	10.8	4.6	0.74
MAXIMUM	583	47	27.1	7.3	3.5	1.0	25.2	7.3	1.06
MINIMUM	79	6	5.0	7.0	2.0	0.8	2.7	1.9	0.42
01	79	6	9.1		2.4		3.0	4.6	
02	261	21	9.6		2.5		11.1	5.1	
03	100	10	12.0		2.4		4.5	5.4	
04	253	17	8.1	7.0	2.0	1.0	9.6	4.5	
05	389	33	10.2		2.5		16.5	5.1	
06	411	31	9.0		3.0		16.8	4.9	1.06
07	304	21	8.3		3.5		11.7	4.6	
08	275	21	9.2		2.5		10.2	4.5	
09	367	29	9.5		3.5		15.3	5.0	
10	242	10	5.0		3.0		3.9	1.9	
11	170	11	7.8	7.2	2.7	0.8	6.3	4.4	
12	122	8	7.9		2.5		2.8	2.8	
13	100	7	8.4		2.0		3.0	3.6	
14	438	35	9.6		2.2		17.7	4.8	
15	583	47	9.7		2.0		25.2	5.2	
16	367	22	7.2		2.2		11.1	3.6	
17	265	19	8.6		2.0		9.6	4.3	
18	297	23	9.3		2.2		13.7	5.5	
19	147	10	8.2	7.3	2.0	0.8	3.6	2.9	0.42
20	174	17	11.7		2.2		7.2	5.0	
21	115	26	27.1		2.4		2.7	2.8	
22	314	26	9.9		3.3		13.8	5.3	
23	576	46	9.6		3.1		23.8	5.0	
24	379	28	8.9		2.8		15.0	4.7	
25	149	17	13.7	7.1	2.6	0.9	9.0	7.3	
26	576	46	9.6		2.5		24.0	5.0	
27	100	9	10.8		2.8		4.2	5.0	
28	190	12	7.6		2.6		6.4	4.0	
29	236	22	11.2		2.5		11.8	6.0	
30	236	20	10.2		3.0		9.9	5.0	

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6 SAMPLE DATE: 11-04-97
2. WELL ARTESIAN PRESSURES: (1) ON-SITE 4 psi (2) OFF-SITE 0 psi
3. COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-162

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : October, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : James L Keyes, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE SAMPLE		
MONTHLY TOTAL	13085	1107	307.5	28.9	83.7	4.3	545.0	N/A
AVERAGE	422.1	35.7	9.9	7.2	2.7	1.1	17.6	4.9
MAXIMUM	780	75	14.4	7.3	3.5	1.2	28.5	6.0
MINIMUM	84	6	5.7	7.1	1.7	1.0	3.0	2.9
01	633	63	11.9	7.2	3.2	1.0	27.3	5.2
02	323	32	11.9		3.0		14.1	5.2
03	562	57	12.2		3.5		20.7	4.4
04	427	41	11.5		3.0		19.2	5.4
05	428	41	11.5		2.5		19.2	5.4
06	599	61	12.2		2.7		28.5	5.7
07	623	75	14.4	7.3	2.5	1.2	28.2	5.4
08	592	56	11.3		2.7		22.8	4.6
09	569	49	10.3		3.0		27.9	5.9
10	636	51	9.6		3.5		26.4	5.0
11	554	43	9.3		2.5		22.5	4.9
12	550	44	9.6		3.0		23.2	5.1
13	339	30	10.6		3.2		15.4	5.4
14	780	47	7.2		2.8		27.0	4.2
15	653	47	8.6		3.0		27.4	5.0
16	268	27	12.1		2.8		11.8	5.3
17	84	6	8.6		2.6		3.0	4.3
18	133	11	9.9		3.1		6.6	6.0
19	630	30	5.7		1.7		15.3	2.9
20	269	18	8.0		2.6		8.4	3.7
21	339	27	9.5		2.5		15.3	5.4
22	325	23	8.5	7.3	3.5	1.1	10.5	3.9
23	439	36	9.8		2.5		19.2	5.2
24	156	11	8.5		2.2		5.8	4.5
25	186	14	9.0		2.6		8.4	5.4
26	467	41	10.5		2.2		23.1	5.9
27	545	50	11.0		2.0		26.4	5.8
28	117	7	7.2	7.1	2.3	1.0	3.3	3.4
29	482	41	10.2		2.2		22.8	5.7
30	102	6	7.1		2.3		3.3	3.9
31	275	22	9.6		2.5		11.7	5.1

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6 SAMPLE DATE: 10-13-97
 2. WELL ARTESIAN PRESSURES: (1) ON-SITE 3 psi (2) OFF-SITE 0 psi

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WS ID NO. 2161326 CUP NO. 2-031-0028-N-162

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : September, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : James L. Kuyk, C.O., CERT. NO. 6252

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE SAMPLE	LBS. USED	MG/L	
MONTHLY TOTAL	10685	1009	325.7	28.4	82.5	3.9	368.6	N/A	N/A
AVERAGE	356.2	33.6	11.2	7.1	2.8	1.0	12.3	4.3	0.19
MAXIMUM	710	72	15.3	7.2	3.5	1.2	24.9	5.5	0.20
MINIMUM	0	0	7.6	7.0	2.0	0.8	3.3	2.7	0.18
01	555	49	10.6		2.2		14.2	3.1	
02	710	72	12.2	7.2	2.8	0.9	17.9	3.0	
03	384	39	12.2		2.2		16.8	5.2	
04	0	0			2.4		3.3		0.18
05	112	11	11.8		2.0		4.5	4.8	
06	419	36	10.3		3.5		10.5	3.0	
07	382	35	11.0		2.0		16.6	5.2	
08	255	23	10.8		2.2		11.1	5.2	
09	309	28	10.9		3.5		11.1	4.3	
10	140	9	7.7		3.0		4.8	4.1	
11	316	36	13.7	7.1	3.0	0.8	13.0	4.9	
12	251	32	15.3		2.6		6.0	2.9	
13	450	32	8.5		2.1		11.6	3.1	
14	543	58	12.8		2.4		17.3	3.8	
15	302	22	8.7		2.1		13.5	5.4	
16	287	26	10.9		2.3		12.0	5.0	
17	236	21	10.7	7.1	2.0	1.0	10.5	5.3	
18	306	30	11.8		3.5		13.2	5.2	0.20
19	344	32	11.2		3.2		12.3	4.3	
20	473	47	11.9		3.0		13.1	3.3	
21	524	55	12.6		3.0		13.8	3.2	
22	571	50	10.5		3.2		12.6	2.7	
23	378	35	11.1	7.0	2.8	1.2	15.6	5.0	
24	190	20	12.6		2.5		7.8	4.9	
25	224	23	12.3		3.0		10.2	5.5	
26	478	49	12.3		3.5		12.1	3.0	
27	318	25	9.4		3.0		12.9	4.9	
28	380	39	12.3		3.0		17.4	5.5	
29	298	19	7.6		3.5		7.8	3.1	
30	550	56	12.2		3.0		24.9	5.4	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

S ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: James Z. Keyes, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE SAMPLE		
MONTHLY TOTAL	21786	1951	331.8	28.9	82.4	3.4	228.4	N/A
AVERAGE	702.8	62.9	10.7	7.2	2.7	0.9	20.8	3.2
MAXIMUM	961	98	12.7	7.3	3.5	0.9	31.5	3.9
MINIMUM	471	39	6.6	7.1	1.5	0.8	18.4	3.0
01	604	56	11.1		3.0			
02	667	59	10.6		2.0			
03	660	58	10.5		2.2			
04	687	54	9.4		2.2			
05	732	62	10.2	7.2	2.2	0.8		
06	732	64	10.5		2.4			
07	523	50	11.5		2.6			
08	471	39	9.9		2.6			
09	747	61	9.8		1.8			
10	743	62	10.0		2.3			
11	524	46	10.5	7.1	2.7	0.9		
12	689	63	11.0		2.3			
13	751	65	10.4		1.5			
14	527	46	10.5		2.2			
15	557	45	9.7		2.5			
16	725	60	9.9		2.5			
17	680	56	9.9		2.6			
18	715	68	11.4	7.3	3.0	0.8		
19	644	64	11.9		3.5			
20	777	70	10.8		3.0			
21	781	71	10.9		3.5		19.8	3.0
22	773	72	11.2		3.2		19.3	3.0
23	726	67	11.1		3.5		18.4	3.0
24	831	78	11.3		3.0		21.0	3.0
25	752	71	11.3	7.3	3.5	0.9	19.1	3.0
26	744	69	11.1		3.2		18.9	3.0
27	744	78	12.6		3.5		19.3	3.1
28	765	81	12.7		2.5		20.0	3.1
29	808	77	11.4		2.2		22.6	3.4
30	746	41	6.6		3.0		18.6	3.0
31	961	98	12.2		2.2		31.5	3.9

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6

SAMPLE DATE: 08-05-97

2. WELL ARTESIAN PRESSURES: (1) ON-SITE

7 psi (2) OFF-SITE

0 psi

DRINK. WATER TREATMENT PLANT DAILY OPERATION SUMMA

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : July, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Jane Z. Kuyper, C.O., CERT. NO. B 6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC PHOSPHATE CORROSION CTRL		ORTHO-PHOS REMOTE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE SAMPLE	LBS. USED	MG/L	
MONTHLY TOTAL	22449	1770	292.8	35.6	75.8	5.8		N/A	N/A
AVERAGE	724.2	57.1	9.4	7.1	2.4	1.2			
MAXIMUM	807	70	10.8	7.2	3.5	1.3			
MINIMUM	530	39	8.0	7.0	1.0	1.0			
01	769	60	9.4		2.0				
02	687	55	9.6	7.2	2.5	1.3			
03	754	56	8.9		2.6				
04	792	59	8.9		2.9				
05	691	55	9.5		3.1				
06	736	57	9.3		3.5				
07	717	54	9.0		2.5				
08	728	59	9.7	7.1	2.5	1.2			
09	687	46	8.0		2.2				
10	706	57	9.7		2.5				
11	770	55	8.6		2.2				
12	807	69	10.3		2.4				
13	637	51	9.6		2.5				
14	761	59	9.3		2.7				
15	766	57	8.9	7.2	2.2	1.1			
16	737	57	9.3		2.5				
17	699	53	9.1		2.0				
18	771	60	9.3		2.2				
19	700	54	9.2		1.8				
20	725	56	9.3		2.4				
21	530	39	8.8		2.4				
22	583	46	9.5	7.0	2.5	1.2			
23	742	58	9.4		2.2				
24	770	59	9.2		2.0				
25	784	66	10.1		1.0				
26	696	55	9.5		3.0				
27	734	59	9.6		2.0				
28	762	63	9.9		3.0				
29	751	66	10.5	7.1	2.0	1.0			
30	682	60	10.5		3.0				
31	775	70	10.8		3.5				

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : June, 1997

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : James L Keys, C.O., CERT. NO. B6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18059	1423	288.9	28.1	71.9	5.4	
AVERAGE	602.0	47.4	9.7	7.0	2.4	1.4	
MAXIMUM	945	81	17.9	7.1	3.3	1.5	
MINIMUM	0	0	6.5	7.0	0.8	1.1	
01	578	48	10.0		3.3		
02	0	0			2.5		
03	592	48	9.7		0.8		
04	722	57	9.5	7.1	2.2	1.5	
05	751	50	8.0		2.5		
06	460	45	11.7		2.6		
07	512	44	10.3		2.2		On-site well artesian pressure 4
08	711	61	10.3		2.4		Off-site well artesian pressure 4
09	453	35	9.3		2.9		
10	213	16	9.0		1.5		
11	339	28	9.9	7.0	1.8	1.4	
12	404	22	6.5		1.7		
13	127	19	17.9		2.2		
14	752	57	9.1		2.5		
15	451	34	9.0		2.3		
16	722	58	9.6		2.3		
17	730	59	9.7	7.0	2.2	1.4	
18	745	60	9.7		2.4		
19	591	50	10.1		3.0		
20	945	81	10.3		2.2		
21	665	55	9.9		2.5		
22	731	49	8.0		2.6		
23	688	51	8.9		3.0		
24	744	57	9.2	7.0	2.8	1.1	
25	792	60	9.1		2.5		
26	728	60	9.9		2.6		
27	846	59	8.4		2.4		
28	816	61	9.0		3.0		
29	539	43	9.6		2.8		
30	712	56	9.4		2.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : May, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Jans Z. Buys, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19747	1641	307.0	21.4	89.3	4.2	
AVERAGE	637.0	52.9	9.9	7.1	2.9	1.4	
MAXIMUM	819	67	13.7	7.2	3.5	1.5	
MINIMUM	79	5	6.5	7.1	2.1	1.3	
01	738	63	10.2		2.5		
02	490	56	13.7		3.5		
03	541	49	10.9		2.8		
04	697	60	10.3		3.0		
05	732	65	10.6		2.8		
06	721	56	9.3	7.1	3.5	1.4	
07	519	42	9.7		3.0		On-site well artesian pressure 0
08	580	48	9.9		3.0		Off-site well artesian pressure 0
09	580	47	9.7		2.5		
10	736	60	9.8		3.5		
11	692	57	9.9		3.5		
12	706	63	10.7	7.2	3.5	1.5	
13	350	19	6.5		3.5		
14	760	54	8.5		3.5		
15	538	48	10.7		2.8		
16	683	55	9.7		3.0		
17	819	67	9.8		2.5		
18	494	43	10.4		2.8		
19	702	55	9.4		2.7		
20	696	57	9.8	7.1	3.0	1.3	
21	762	63	9.9		3.0		
22	757	60	9.5		2.8		
23	696	59	10.2		2.5		
24	675	52	9.2		2.8		
25	615	54	10.5		2.1		
26	756	58	9.2		2.2		
27	79	5	7.6		2.4		
28	707	62	10.5		2.2		
29	544	48	10.6		2.4		
30	665	59	10.6		3.0		
31	717	57	9.5		3.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: LDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: James Z. Keys, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18179	1494	301.6	28.2	79.8	6.2	
AVERAGE	606.0	49.8	10.1	7.1	2.7	1.6	
MAXIMUM	870	63	19.1	7.1	3.5	1.7	
MINIMUM	205	12	7.0	7.0	2.0	1.4	
01	566	55	11.7		2.5		
02	749	63	10.1		2.4		
03	756	63	10.0	7.1	2.5	1.7	
04	725	62	10.3		2.5		
05	753	62	9.9		3.0		
06	708	58	9.8		3.0		
07	752	62	9.9		2.4		
08	592	50	10.1	7.0	2.5	1.6	On-site well artesian pressure 4 Off-site well artesian pressure 4
09	870	63	8.7		3.0		
10	545	46	10.1		2.8		
11	755	60	9.5		2.5		
12	712	56	9.4		2.5		
13	503	39	9.3		2.5		
14	622	51	9.8		2.5		
15	548	44	9.6	7.1	2.2	1.5	
16	299	26	10.4		2.5		
17	494	44	10.7		2.5		
18	700	53	9.1		3.5		
19	537	43	9.6		2.5		
20	658	52	9.5		2.2		
21	586	49	10.0		3.5		
22	744	52	8.4	7.0	3.0	1.4	
23	427	38	10.7		2.8		
24	488	44	10.8		3.5		
25	629	44	8.4		2.8		
26	761	62	9.8		2.2		
27	720	50	9.7		3.5		
28	220	35	19.1		2.0		
29	555	48	10.4		2.0		
30	205	12	7.0		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6

6

SAMPLE DATE: 04-09-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-162

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : March, 1997

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : James L. Keyes, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19012	1549	311.0	29.4	79.6	5.7	
AVERAGE	613.3	50.0	10.0	7.4	2.6	1.4	
MAXIMUM	851	68	18.9	7.4	3.5	1.5	
MINIMUM	19	3	8.9	7.3	1.8	1.3	
01	569	43	9.1		2.5		
02	478	38	9.5		2.5		
03	617	46	8.9		2.1		
04	537	42	9.4		2.5		
05	554	41	8.9	7.4	2.2	1.5	
06	541	43	9.5		2.2		
07	851	68	9.6		2.5		On-site well artesian pressure 4 p
08	632	56	10.6		2.0		Off-site well artesian pressure 2 p
09	747	63	10.1		2.8		
10	730	59	9.7		2.7		
11	733	66	10.8		3.0		
12	713	56	9.4	7.3	2.8	1.4	
13	701	59	10.1		2.2		
14	724	61	10.1		2.7		
15	711	61	10.3		2.5		
16	689	56	9.7		2.1		
17	720	62	10.3		2.6		
18	580	45	9.3		2.0		
19	576	43	9.0	7.3	3.5	1.3	
20	442	37	10.0		2.8		
21	19	3	18.9		1.8		
22	701	57	9.7		3.5		
23	557	46	9.9		3.1		
24	428	35	9.8		2.5		
25	522	47	10.8		2.2		
26	653	53	9.7	7.4	2.8	1.5	
27	807	65	9.7		2.8		
28	558	42	9.0		3.2		
29	571	43	9.0		2.8		
30	659	53	9.6		2.2		
31	692	60	10.4		2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : February, 1997

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : James L. Keyes, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14475	1235	288.3	22.5	82.1	4.1	
AVERAGE	517.0	44.1	10.3	7.5	2.9	1.4	
MAXIMUM	770	64	13.8	7.5	3.5	1.6	
MINIMUM	186	16	9.0	7.5	2.0	1.0	
01	694	60	10.4		3.0		
02	610	52	10.2		2.5		
03	488	39	9.6	7.5	3.0	1.0	
04	704	59	10.0		3.5		
05	497	42	10.1		3.5		
06	520	43	9.9		3.5		
07	517	44	10.2		3.0		On-site well artesian pressure 4
08	550	46	10.0		3.0		Off-site well artesian pressure 2
09	618	52	10.1		3.5		
10	600	52	10.4		2.8		
11	521	44	10.1	7.5	3.5	1.6	
12	424	38	10.7		3.0		
13	396	36	10.9		2.8		
14	480	47	11.7		3.0		
15	462	37	9.6		3.2		
16	553	45	9.8		2.1		
17	276	25	10.9		2.6		
18	637	53	10.0	7.5	3.5	1.5	
19	285	23	9.7		3.0		
20	218	21	11.6		2.0		
21	770	60	9.3		2.6		
22	502	44	10.5		2.6		
23	513	59	13.8		2.8		
24	742	64	10.3		2.8		
25	186	16	10.3		2.5		
26	520	42	9.7		3.5		
27	699	55	9.4		2.8		
28	493	37	9.0		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6

6

SAMPLE DATE: 02-24-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-162

NAME OF DRINKING WATER SYS ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : January, 1997

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18734	1596	316.4	30.0	99.8	7.0	
AVERAGE	604.3	51.5	10.2	7.5	3.2	1.8	
MAXIMUM	780	64	12.3	7.5	3.5	2.0	
MINIMUM	198	15	7.8	7.5	2.0	1.4	
01	588	55	11.2		3.5		
02	780	57	8.8		3.0		
03	620	54	10.4		3.5		
04	640	54	10.1		3.5		
05	432	37	10.3		3.5		
06	280	23	9.8	7.5	3.5	2.0	
07	697	58	10.0		3.5		On-site well artesian pressure 4
08	198	15	9.1		3.5		Off-site well artesian pressure 2
09	549	52	11.4		2.0		
10	582	38	7.8		2.6		
11	567	58	12.3		2.6		
12	753	64	10.2		2.9		
13	694	59	10.2	7.5	3.5	1.8	
14	688	59	10.3		3.5		
15	432	37	10.3		3.5		
16	665	58	10.5		3.5		
17	637	63	11.9		3.5		
18	735	62	10.1		2.8		
19	707	60	10.2		3.2		
20	658	54	9.8	7.5	3.5	1.8	
21	615	52	10.1		3.5		
22	500	42	10.1		3.5		
23	655	54	9.9		3.0		
24	575	50	10.4		3.0		
25	524	45	10.3		3.2		
26	714	60	10.1		3.0		
27	612	53	10.4	7.5	3.0	1.4	
28	681	58	10.2		3.5		
29	690	58	10.1		3.5		
30	586	49	10.0		3.0		
31	680	58	10.2		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

6

SAMPLE DATE: 01-20-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	13557	1318	360.9	29.0	84.3	3.4	664.0	N/A	N/A
AVERAGE	437.3	42.5	11.6	7.3	2.7	0.9	22.1	6.1	0.05
MAXIMUM	663	82	17.0	7.3	3.5	1.0	43.5	9.0	0.05
MINIMUM	218	22	7.7	7.2	1.8	0.7	11.2	3.8	0.04
01	546	59	13.0		3.0		26.6	5.8	
02	433	37	10.2	7.2	3.2	0.7	20.8	5.8	
03	400	32	9.6		2.8		20.5	6.1	
04	380	37	11.7		1.8		18.9	6.0	0.05
05	302	29	11.5		2.2		15.1	6.0	
06	500	82	17.0		2.5		43.5	9.0	
07	530	34	7.7		2.0		27.0	6.1	
08	502	48	11.5		2.2		25.9	6.2	
09	349	36	12.4	7.3	3.2	0.8	17.3	5.9	
10	585	61	12.5		3.0		30.2	6.2	
11	663	79	14.3		2.7		33.1	6.0	
12	466	50	12.9		2.5		24.5	6.3	
13	436	40	11.0		3.0		20.9	5.7	
14	381	36	11.3		2.0		23.7	7.5	
15	368	35	11.4		2.2		18.3	6.0	
16	413	37	10.7	7.2	2.2	0.9	20.5	6.0	
17	299	29	11.6		2.4		16.9	6.8	
18	363	28	9.2		3.0		16.0	5.3	0.04
19	487	50	12.3		2.8		25.2	6.2	
20	571	40	8.4		2.9		21.9	4.6	
21	466	43	11.1		2.6		23.4	6.0	
22	401	36	10.8		2.5				
23	483	47	11.7		2.6		24.8	6.2	
24	251	27	12.9		2.5		13.0	6.2	
25	218	22	12.1		3.5		11.2	6.2	
26	392	37	11.3		2.8		19.4	5.9	
27	412	44	12.8		3.5		20.8	6.1	
28	525	55	12.6		3.5		26.3	6.0	
29	328	35	12.8	7.3	3.0	1.0	18.0	6.6	
30	619	46	8.9		3.2		19.4	3.8	
31	408	47	13.8		3.0		20.9	6.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7
 WELL ARTESIAN PRESSURE: 0 psi

SAMPLE DATE: 12-17-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0020N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James S. Kuyus, C.O., CERT NO. B-6252

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	11281	1016	447.9	29.0	81.2	3.1	577.4	N/A	N/A
AVERAGE	376.0	33.9	14.9	7.3	2.7	0.8	19.2	5.8	0.60
MAXIMUM	602	58	119.9	7.3	3.5	0.8	32.1	8.4	0.60
MINIMUM	1	1	7.8	7.2	1.7	0.7	0.0	0.0	0.59
01	521	54	12.4		2.5		26.7	6.1	
02	572	57	11.9		2.7		28.5	6.0	
03	415	54	15.6		1.8		26.3	7.6	
04	457	58	15.2	7.2	2.0	0.8	28.8	7.6	
05	1	1	119.9		2.2		0.0	0.0	
06	63	7	13.3		3.5		3.6	6.9	0.60
07	139	12	10.4		3.5		6.8	5.9	
08	413	36	10.5		3.5		20.9	6.1	
09	523	37	8.5		2.5		20.9	4.8	
10	480	40	10.0		2.4		24.5	6.1	
11	489	48	11.8	7.3	2.8	0.8	32.1	7.9	
12	515	39	9.1		2.7		22.0	5.1	
13	232	23	11.9		2.5		16.2	8.4	
14	108	19	21.1		2.5		0.0	0.0	
15	74	8	13.0		3.5		3.6	5.8	
16	369	36	11.7		3.0		19.5	6.3	
17	428	41	11.5		3.0		20.9	5.9	
18	387	38	11.8		3.2		22.3	6.9	
19	556	41	8.8	7.3	2.8	0.7	27.0	5.8	0.59
20	384	30	9.4		2.6		18.7	5.8	
21	386	38	11.8		1.7		21.6	6.7	
22	469	36	9.2		2.0		24.5	6.3	
23	401	26	7.8		2.6		19.8	5.9	
24	303	25	9.9		2.4		15.5	6.1	
25	602	42	8.4	7.2	2.5	0.8	31.0	6.2	
26	76	8	12.6		3.0		3.6	5.7	
27	500	41	9.8		2.8		25.6	6.1	
28	479	42	10.5		3.0		21.6	5.4	
29	465	41	10.6		3.0		25.6	6.6	
30	474	38	9.6		3.0		19.5	4.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0020N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James Z Keyes, C.O., CERT NO. B 6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	8582	891	297.1	28.4	69.1	3.9	440.9	N/A	N/A
AVERAGE	276.8	28.7	14.1	7.1	2.3	1.0	14.2	9.4	0.32
MAXIMUM	775	86	60.0	7.2	3.5	1.2	40.7	79.9	0.34
MINIMUM	0	0	0.0	7.0	0.0	0.0	0.0	0.0	0.30
01	41	0	0.0	7.0	3.0	1.2	0.0	0.0	
02	578	58	12.0		3.5		28.5	5.9	
03	333	30	10.8		2.5		15.5	5.6	0.30
04	769	86	13.4		2.7		38.9	6.1	
05	402	48	14.3		2.5		23.1	6.9	
06	0	0			2.5		0.0		
07	0	0			2.7		0.0		
08	0	0		7.1	2.6	1.0	0.0		
09	0	0			0.0		0.0		
10	0	0			0.0		0.0		
11	0	0			0.0		0.0		
12	0	0			0.0		0.0		
13	489	40	9.8		3.5		21.6	5.3	
14	31	6	23.2		2.8		3.0	11.6	
15	6	3	60.0		2.6		4.0	79.9	
16	363	41	13.5		2.5		21.6	7.1	0.34
17	528	38	8.6		2.6		22.3	5.1	
18	775	86	13.3		3.5		40.7	6.3	
19	427	57	16.0		3.3		26.7	7.5	
20	527	55	12.5		2.4		27.8	6.3	
21	506	46	10.9	7.2	2.5	0.9	25.9	6.1	
22	208	27	15.6		2.0		13.3	7.7	
23	0	0			2.2		0.0		
24	422	47	13.4		2.2		21.6	6.1	
25	622	67	12.9		2.6		31.5	6.1	
26	480	52	13.0		3.0		24.1	6.0	
27	0	0			2.6		0.0		
28	478	51	12.8	7.1	2.4	0.8	24.5	6.1	
29	20	0	0.0		2.0		0.0	0.0	
30	577	53	11.0		2.4		26.3	5.5	
31	0	0					0.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028H

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James Z. Kuyse

, C.O., CERT NO. 6252

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	17019	1704	391.9	28.4	82.5	4.4	534.9	N/A	N/A
AVERAGE	567.3	56.8	13.1	7.1	2.8	1.1	17.8	3.8	0.25
MAXIMUM	943	90	36.9	7.2	3.5	1.6	37.5	6.9	0.27
MINIMUM	21	1	0.4	7.0	2.0	0.8	0.0	0.0	0.23
01	278	26	11.2		2.5		14.8	6.4	
02	196	18	11.0	7.2	3.5	0.9	10.5	6.4	
03	538	48	10.7		3.2		15.6	3.5	
04	844	79	11.2		3.0		25.4	3.6	0.23
05	943	71	9.0		2.8		37.5	4.8	
06	814	81	11.9		2.6		25.6	3.8	
07	787	64	9.8		2.4		18.5	2.8	
08	862	71	9.9		2.5		26.1	3.6	
09	799	76	11.4	7.1	2.5	0.8	24.0	3.6	
10	810	90	13.3		2.6		23.1	3.4	
11	310	35	13.5		2.6		16.9	6.5	
12	563	52	11.1		2.6		16.8	3.6	
13	793	68	10.3		3.5		23.1	3.5	
14	816	81	11.9		3.2		24.6	3.6	
15	547	55	12.1		2.0		16.4	3.6	
16	768	69	10.8	7.0	2.1	1.1	23.1	3.6	
17	786	83	12.7		2.5		23.1	3.5	
18	569	62	13.1		2.1		17.0	3.6	0.27
19	543	90	19.9		3.0		17.2	3.8	
20	532	61	13.7		2.6		17.1	3.9	
21	515	57	13.3		2.6		16.8	3.9	
22	26	8	36.9		3.2		0.0	0.0	
23	343	48	16.8	7.1	3.0	1.6	13.2	4.6	
24	754	82	13.0		2.5		22.3	3.5	
25	515	50	11.6		2.1		15.8	3.7	
26	21	1	5.7		2.5		0.0	0.0	
27	462	44	11.4		3.5		13.5	3.5	
28	357	71	23.8		3.5		20.6	6.9	
29	357	61	20.5		2.8		16.4	5.5	
30	571	2	0.4		3.0		0.0	0.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028H

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James L. Keyes

, C.O., CERT NO. B-6252

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	15315	1589	364.7	28.5	87.4	3.9	84.4	N/A	N/A
AVERAGE	494.0	51.3	12.2	7.1	2.8	1.0	7.7	3.5	
MAXIMUM	1010	105	14.5	7.2	3.5	1.1	13.2	3.8	
MINIMUM	0	0	10.0	7.0	2.0	0.8	0.0	3.1	
01	1010	105	12.5		2.5				
02	728	78	12.8		2.0				
03	633	65	12.3		2.2				
04	538	57	12.7		2.0				
05	629	67	12.8	7.1	3.3	1.0			
06	565	58	12.3		2.5				
07	810	86	12.7		3.0				
08	808	88	13.1		2.6				
09	535	58	13.0		3.3				
10	588	60	12.2		3.1				
11	642	73	13.6		3.5				
12	604	73	14.5	7.2	3.0	1.1			
13	569	52	11.0		3.5				
14	728	71	11.7		3.5				
15	873	100	13.7		2.0				
16	526	60	13.7		2.2				
17	569	63	13.3		2.4				
18	642	68	12.7		3.5				
19	448	48	12.8	7.2	3.5	1.0			
20	37	4	13.0		3.5				
21	96	8	10.0		3.0		2.5	3.1	
22	295	30	12.2		3.2		9.1	3.7	
23	383	35	11.0		2.5		11.6	3.6	
24	0	0			2.4		0.0		
25	121	12	11.9	7.0	2.5	0.8	3.2	3.2	
26	301	28	11.2		3.0		9.5	3.8	
27	347	30	10.4		2.5		10.1	3.5	
28	325	28	10.3		2.6		9.9	3.7	
29	245	21	10.3		2.6		6.9	3.4	
30	267	24	10.8		3.5		8.4	3.8	
31	453	39	10.3		2.5		13.2	3.5	

DRINK WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James L. Keys, C.O., CERT NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC PHOSPHATE CORROSION CTRL LBS. USED		ORTHO-PHOS REMOTE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	MG/L		
MONTHLY TOTAL	20571	2061	372.5	35.5	79.7	5.4		N/A	N/A
AVERAGE	663.6	66.5	12.0	7.1	2.6	1.1			
MAXIMUM	850	89	14.7	7.2	3.5	1.2			
MINIMUM	548	47	9.0	7.0	1.3	1.0			
01	672	63	11.2		3.5				
02	621	60	11.6	7.0	2.5	1.2			
03	556	57	12.3		2.6				
04	661	64	11.6		3.5				
05	738	80	13.0		3.1				
06	612	67	13.1		2.9				
07	618	61	11.8		3.5				
08	565	58	12.3	7.1	3.2	1.1			
09	665	60	10.8		2.5				
10	555	51	11.0		2.7				
11	733	80	13.1		2.6				
12	646	73	13.5		2.8				
13	626	47	9.0		2.5				
14	618	74	14.4		2.7				
15	764	73	11.5	7.2	2.5	1.0			
16	751	66	10.5		2.8				
17	638	55	10.3		2.2				
18	725	89	14.7		2.5				
19	583	59	12.1		1.3				
20	606	64	12.7		2.5				
21	757	76	12.0		2.3				
22	766	79	12.4	7.1	2.0	1.1			
23	796	69	10.4		2.0				
24	662	66	12.0		2.2				
25	593	61	12.3		2.0				
26	605	58	11.5		2.0				
27	665	65	11.7		3.0				
28	636	61	11.5		3.5				
29	850	86	12.1	7.1	2.3	1.0			
30	740	80	13.0		2.0				
31	548	59	12.9		2.0				

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 07-14-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1997

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James L. Keys, C.O., CERT NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19213	1993	375.5	28.1	81.9	4.7	
AVERAGE	640.4	66.4	12.5	7.0	2.7	1.2	
MAXIMUM	971	118	21.6	7.1	3.5	1.4	
MINIMUM	322	26	5.8	7.0	1.2	1.0	
01	629	64	12.2		3.0		
02	971	98	12.1		2.2		
03	551	53	11.5		2.0		
04	614	74	14.5	7.0	2.2	1.4	
05	627	75	14.3		3.0		
06	586	55	11.3		2.6		
07	704	65	11.1		2.5		Well artesian pressure 0 psi
08	554	58	12.6		2.6		
09	790	86	13.1	7.0	3.0	1.1	
10	780	82	12.6		2.4		
11	759	75	11.8		2.5		
12	619	64	12.4		1.2		
13	798	86	12.9		2.7		
14	545	58	12.8		2.5		
15	745	79	12.7		2.4		
16	533	56	12.6		3.0		
17	640	35	6.6	7.1	3.5	1.0	
18	388	70	21.6		3.0		
19	364	40	13.2		3.4		
20	706	76	12.9		3.5		
21	322	38	14.2		2.0		
22	624	69	13.3		3.5		
23	614	62	12.1		3.0		
24	686	73	12.8	7.0	3.0	1.2	
25	692	72	12.5		2.8		
26	623	67	12.9		2.6		
27	716	69	11.6		2.9		
28	956	118	14.8		2.9		
29	533	26	5.8		2.5		
30	544	50	11.0		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James L. Keyser, C.O., CERT NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	22098	2219	380.0	21.3	81.8	4.2	
AVERAGE	712.8	71.6	12.3	7.1	2.6	1.4	
MAXIMUM	958	101	20.1	7.2	3.5	1.5	
MINIMUM	490	54	8.3	7.0	1.5	1.3	
01	611	60	11.8		2.0		
02	789	70	10.6		3.5		
03	628	60	11.5		2.8		
04	890	74	10.0		3.0		
05	562	61	13.0		2.6		
06	645	82	15.2	7.0	2.7	1.4	
07	726	63	10.4		3.5		Well artesian pressure 0 psi
08	958	75	9.4		3.5		
09	604	101	20.1		3.0		
10	631	64	12.2		1.9		
11	647	56	10.4		2.5		
12	853	69	9.7		2.4		
13	618	90	17.5		3.5		
14	910	63	8.3	7.1	3.5	1.5	
15	820	97	14.2		2.5		
16	952	87	11.0		1.5		
17	864	92	12.8		3.5		
18	663	79	14.3		2.0		
19	731	70	11.5		2.5		
20	677	61	10.8	7.2	2.0	1.3	
21	666	73	13.1		2.3		
22	666	74	13.3		2.5		
23	884	83	11.3		2.4		
24	598	57	11.4		2.5		
25	490	59	14.4		2.7		
26	692	72	12.5		2.7		
27	860	85	11.9		2.4		
28	555	54	11.7		2.4		
29	659	74	13.5		2.2		
30	500	54	12.9		2.2		
31	749	60	9.6		3.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 05-01-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James L. Keys

, C.O., CERT NO. B 6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	22107	2429	395.8	28.2	74.6	5.8	
AVERAGE	736.9	81.0	13.2	7.1	2.5	1.5	
MAXIMUM	924	124	17.3	7.1	3.5	1.5	
MINIMUM	578	58	10.4	7.0	1.5	1.4	
01	825	97	14.1		2.8		
02	607	71	14.0		2.2		
03	627	66	12.6	7.0	3.5	1.5	
04	630	70	13.3		3.5		
05	599	67	13.4		1.6		
06	578	58	12.0		3.5		
07	690	74	12.9		2.8		Well artesian pressure 0 psi
08	743	83	13.4	7.1	2.5	1.4	
09	874	98	13.4		1.5		
10	878	124	16.9		1.8		
11	619	68	13.2		3.5		
12	631	91	17.3		3.5		
13	809	103	15.3		3.0		
14	924	97	12.6		2.5		
15	821	80	11.7	7.0	3.5	1.5	
16	919	99	12.9		1.5		
17	777	80	12.3		1.5		
18	758	77	12.2		2.5		
19	908	91	12.0		2.5		
20	625	64	12.3		1.8		
21	794	82	12.4		2.0		
22	666	67	12.1	7.1	3.0	1.4	
23	744	80	12.9		2.8		
24	737	81	13.2		2.6		
25	837	91	13.0		2.4		
26	637	78	14.7		2.1		
27	592	71	14.4		2.7		
28	816	71	10.4		1.5		
29	662	67	12.1		2.0		
30	780	83	12.8		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0.

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James L. Kuyper

, C.O., CERT NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	22050	2549	435.7	29.0	85.7	5.1	
AVERAGE	711.3	82.2	14.1	7.3	2.8	1.3	
MAXIMUM	980	118	24.5	7.3	3.5	1.5	
MINIMUM	469	46	8.6	7.2	2.0	1.1	
01	938	105	13.4		2.0		
02	880	92	12.5		2.0		
03	980	105	12.8		2.2		
04	891	103	13.9		2.0		
05	939	88	11.2	7.2	2.0	1.2	
06	808	92	13.7		2.5		
07	679	90	15.9		2.7		Well artesian pressure 0 psi
08	582	75	15.5		2.0		
09	728	90	14.8		3.5		
10	599	65	13.0		2.7		
11	643	86	16.0		2.8		
12	647	95	17.6	7.3	2.8	1.5	
13	520	54	12.5		3.5		
14	469	64	16.4		3.5		
15	577	118	24.5		3.5		
16	544	46	10.1		3.0		
17	578	78	16.2		3.5		
18	676	59	10.5		3.0		
19	813	58	8.6	7.3	3.5	1.3	
20	600	65	13.0		2.8		
21	884	112	15.2		3.0		
22	765	62	9.7		3.5		
23	858	98	13.7		3.5		
24	780	82	12.6		3.5		
25	841	93	13.3		3.0		
26	596	64	12.9	7.2	2.0	1.1	
27	674	90	16.0		2.0		
28	610	82	16.1		2.2		
29	731	90	14.8		2.5		
30	701	79	13.5		2.2		
31	519	69	15.9		2.8		

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1997

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James J. Kuzis

, C.O., CERT NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	24488	2634	364.5	22.5	81.8	3.8	
AVERAGE	874.6	94.1	13.0	7.5	2.9	1.3	
MAXIMUM	1070	115	16.4	7.5	3.5	1.6	
MINIMUM	722	84	9.7	7.5	2.0	0.8	
01	881	92	12.5		3.0		
02	936	97	12.4		2.0		
03	845	90	12.8	7.5	2.8	0.8	
04	857	91	12.7		3.0		
05	857	91	12.7		3.0		
06	868	96	13.3		3.5		
07	885	115	15.6		3.0		Well artesian pressure
08	1070	87	9.7		3.0		0 psi
09	824	86	12.5		3.0		
10	759	104	16.4		2.6		
11	968	85	10.5	7.5	3.5	1.6	
12	785	90	13.7		3.0		
13	847	91	12.9		2.8		
14	852	89	12.5		2.6		
15	825	92	13.4		2.9		
16	850	99	14.0		3.0		
17	932	90	11.6		2.8		
18	860	112	15.6	7.5	3.0	1.4	
19	1040	84	9.7		3.5		
20	722	95	15.8		2.8		
21	860	95	13.2		3.2		
22	897	98	13.1		2.8		
23	921	97	12.6		3.0		
24	913	85	11.2		2.5		
25	740	99	16.0		3.0		
26	915	96	12.6		3.3		
27	899	92	12.3		3.2		
28	880	96	13.1		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028.

NAME OF DRINKING WATER SYS1 COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1997

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

David E. Kimbrell

, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	26164	2704	382.4	29.9	95.3	5.9	
AVERAGE	844.0	87.2	12.3	7.5	3.1	1.5	
MAXIMUM	1065	115	13.2	7.5	3.5	2.2	
MINIMUM	528	42	8.9	7.4	2.1	0.7	
01	594	44	8.9		3.5		
02	623	68	13.1		3.5		
03	1065	115	12.9		3.5		
04	528	42	9.5		2.8		
05	757	80	12.7		3.5		
06	742	76	12.3	7.4	3.0	1.2	
07	635	70	13.2		3.5		Well artesian pressure 0 psi
08	899	93	12.4		3.5		
09	847	84	11.9		2.7		
10	943	98	12.5		2.6		
11	860	90	12.5		2.1		
12	978	102	12.5		2.5		
13	785	83	12.7	7.5	3.5	1.8	
14	852	92	12.9		3.5		
15	838	89	12.7		2.8		
16	940	103	13.1		3.5		
17	872	90	12.4		3.5		
18	854	91	12.8		3.0		
19	856	90	12.6		2.8		
20	916	95	12.4	7.5	2.6	0.7	
21	854	91	12.8		3.5		
22	888	94	12.7		3.0		
23	854	92	12.9		3.5		
24	893	83	11.1		2.2		
25	947	92	11.6		2.7		
26	945	89	11.3		2.5		
27	838	89	12.7	7.5	3.5	2.2	
28	940	100	12.8		3.0		
29	847	90	12.7		3.5		
30	830	90	13.0		3.0		
31	944	99	12.6		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 01-21-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SY: /IA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	20355	1444	262.7		75.9		999.9		
AVERAGE	656.6	46.6	8.5		2.4		32.3	5.9	0.04
MAXIMUM	883	68	11.1		2.9		44.4	6.4	0.05
MINIMUM	472	29	5.5		1.6		23.4	4.1	0.02
01	784	56	8.6		2.9		40.2	6.1	
02	841	64	9.1		2.6		32.4	4.6	
03	858	64	8.9		2.7		42.8	6.0	
04	801	62	9.3		2.5		40.5	6.1	0.05
05	839	60	8.6		2.5		39.7	5.7	
06	757	54	8.6		2.5		36.6	5.8	
07	801	57	8.5		2.3		40.5	6.1	
08	776	55	8.5		2.2		39.7	6.1	
09	732	50	8.2		2.4		36.6	6.0	
10	846	68	9.6		2.6		44.4	6.3	
11	883	64	8.7		2.5		43.6	5.9	
12	800	59	8.8		2.7		40.5	6.1	
13	498	37	8.9		2.5		24.5	5.9	
14	510	39	9.2		2.6		25.6	6.0	
15	472	29	7.4		1.6		23.4	5.9	
16	596	55	11.1		2.6		31.0	6.2	
17	697	38	6.5		2.4		24.1	4.1	
18	513	37	8.6		2.2		26.0	6.1	0.02
19	562	37	7.9		2.3		28.8	6.1	
20	567	41	8.7		2.4		28.4	6.0	
21	578	40	8.3		2.3		27.6	5.7	
22	511	37	8.7		2.2		25.6	6.0	
23	573	49	10.3		2.7		28.4	5.9	
24	573	36	7.5		2.5		29.1	6.1	
25	520	31	7.1		2.4		25.6	5.9	
26	630	44	8.4		2.4		32.7	6.2	
27	545	36	7.9		2.3		25.3	5.6	
28	555	34	7.3		2.7		27.6	6.0	
29	600	45	9.0		2.4		31.9	6.4	
30	484	36	8.9		2.4		23.4	5.8	
31	653	30	5.5		2.6		33.4	6.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 12-02-97

WELL ARTESIAN PRESSURE: 0 psi

COMMENTS:

DK 16 WATER TREATMENT PLANT DAILY OPERATION SU

PHS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James S. Keyser, C.O., CERT. NO. B 6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	RENOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	24842	1876	272.2	21.2	74.0	1.6	1273.6		
AVERAGE	828.1	62.5	9.1	7.1	2.5	0.5	42.5	6.2	0.58
MAXIMUM	1100	95	11.8	7.1	2.8	0.6	50.6	7.2	0.66
MINIMUM	533	40	6.0	7.0	2.0	0.5	28.0	4.7	0.49
01	866	81	11.2		2.4		45.6	6.3	
02	916	88	11.5		2.5		46.8	6.1	
03	684	60	10.5		2.7		33.9	5.9	
04	965	95	11.8		2.3		50.6	6.3	
05	802	57	8.5		2.5		39.0	5.8	
06	824	56	8.1		2.7		43.6	6.3	0.49
07	904	69	9.2		2.4		45.9	6.1	
08	840	59	8.4		2.4		42.1	6.0	
09	759	56	8.8		2.4		37.0	5.8	
10	815	55	8.1	7.1	2.0	0.5	39.0	5.7	
11	831	62	8.9		2.5		42.8	6.2	
12	793	40	6.0		2.5		42.8	6.5	
13	851	70	9.9		2.4		41.3	5.8	
14	986	67	8.1		2.6		50.2	6.1	
15	1014	69	8.2		2.4		50.6	6.0	
16	533	42	9.4		2.3		28.0	6.3	
17	855	67	9.4		2.4		41.7	5.8	
18	794	55	8.3		2.6		41.3	6.2	
19	748	53	8.5	7.0	2.6	0.6	35.0	5.6	0.66
20	708	57	9.7		2.8		42.4	7.2	
21	810	56	8.3		2.4		41.7	6.2	
22	776	68	10.5		2.3		44.4	6.9	
23	827	69	10.0		2.2		45.9	6.7	
24	824	60	8.7		2.4		42.1	6.1	
25	804	60	8.9		2.4		40.2	6.0	
26	1100	62	6.8		2.5		42.8	4.7	
27	787	57	8.7	7.1	2.4	0.5	42.1	6.4	
28	815	59	8.7		2.5		45.2	6.6	
29	887	70	9.5		2.7		46.8	6.3	
30	724	57	9.4		2.8		42.8	7.1	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1997

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

James L. Kuyse

, C.O., CERT. NO. B6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	-CHLORINE-		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	27152	2297	314.8	21.1	78.2	1.6	1372.4		
AVERAGE	875.9	74.1	10.2	7.0	2.5	0.5	44.3	6.1	0.22
MAXIMUM	1000	114	16.1	7.1	3.2	0.6	52.2	6.4	0.38
MINIMUM	693	45	6.9	7.0	2.0	0.5	33.2	5.4	0.06
01	916	114	14.9	7.0	2.0	0.5	45.6	6.0	
02	900	52	6.9		3.2		45.6	6.1	
03	954	82	10.3		2.3		49.2	6.2	0.38
04	728	70	11.5		2.6		35.5	5.8	
05	790	68	10.3		2.4		39.8	6.0	
06	915	71	9.3		2.5		48.0	6.3	
07	1000	71	7.9		2.6		48.8	5.4	
08	975	65	8.0		2.4		51.1	6.3	
09	928	78	10.1		2.6		46.0	5.9	
10	1036	88	10.2		2.7		52.2	6.0	
11	972	92	11.3		2.6		49.5	6.1	
12	911	79	10.4		3.0		46.4	6.1	
13	894	80	10.7	7.1	2.4	0.5	47.3	6.3	
14	910	74	9.8		2.5		45.7	6.0	
15	1001	90	10.8		2.6		49.9	6.0	
16	850	65	9.2		2.4		44.9	6.3	0.06
17	693	64	11.1		2.5		33.2	5.7	
18	740	59	9.6		2.5		38.7	6.3	
19	872	80	11.0		2.4		44.9	6.2	
20	784	61	9.3		2.5		40.2	6.1	
21	865	63	8.7		2.5		43.7	6.1	
22	857	69	9.7	7.0	2.6	0.6	44.0	6.2	
23	919	85	11.1		2.5		48.3	6.3	
24	928	84	10.9		2.5		45.9	5.9	
25	829	66	9.5		2.6		40.9	5.9	
26	761	61	9.6		2.8		39.0	6.1	
27	807	72	10.7		2.3		43.3	6.4	
28	759	45	7.1		2.4		37.0	5.8	
29	834	48	6.9		2.4		43.3	6.2	
30	803	108	16.1		2.5		40.9	6.1	
31	941	93	11.9		2.4		43.6	5.6	

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Jan I. Keys, C.O., CERT. NO. B-6252

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	24713	2105	305.6		75.5	3.7		740.1	
AVERAGE	823.8	70.2	10.2		2.5	1.2		24.7	0.69
MAXIMUM	1032	100	15.0		3.0	2.6		29.6	1.30
MINIMUM	523	44	7.5		2.0	0.5		16.0	0.08
01	583	46	9.5		2.2			17.5	3.6
02	728	54	8.9		2.0			21.8	3.6
03	816	51	7.5		2.6	0.5		23.7	3.5
04	734	54	8.8		2.5			22.0	3.7
05	791	57	8.6		2.2			22.0	3.5
06	730	52	8.5		2.6			21.7	3.6
07	523	44	10.1		2.5			17.8	4.1
08	791	51	7.7		2.7			23.5	3.6
09	824	62	9.0		2.4			24.3	3.5
10	718	90	15.0		2.4			23.0	3.8
11	857	64	9.0		2.5	0.6		26.2	3.7
12	875	67	9.2		2.5			26.6	3.6
13	835	59	8.5		2.7			23.0	3.3
14	874	76	10.4		2.6			26.9	3.7
15	970	77	9.5		2.4			29.4	3.6
16	871	78	10.7		2.5			25.1	3.5
17	843	72	10.2		2.3			25.3	3.6
18	912	79	10.4		2.6			26.9	3.5
19	1032	88	10.2		2.8			29.6	3.4
20	863	80	11.1		2.9			27.1	3.8
21	823	68	9.9		2.6			23.9	3.5
22	977	91	11.2		2.6			29.6	3.6
23	945	100	12.7		2.6	2.6		28.0	3.6
24	787	67	10.2		2.3			24.1	3.7
25	861	78	10.9		2.5			25.1	3.5
26	963	92	11.5		3.0			28.7	3.6
27	847	84	11.9		3.0			26.2	3.7
28	577	55	11.4		2.6			16.0	3.3
29	899	88	11.7		2.4			27.5	3.7
30	864	81	11.2		2.0			25.9	3.6

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C- 2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	20254	1646	297.3	21.2	78.0	1.6	309.1		
AVERAGE	653.4	53.1	9.6	7.1	2.5	0.5	23.8	3.7	
MAXIMUM	954	105	17.3	7.1	5.0	0.6	28.0	4.6	
MINIMUM	389	28	7.0	7.0	1.5	0.5	18.2	3.3	
01	670	48	8.6		2.5				
02	389	28	8.6		2.4				
03	561	37	7.9		2.7				
04	531	42	9.5		2.5				
05	583	45	9.3	7.1	2.4	0.5			
06	565	38	8.1		2.5				
07	498	37	8.9		2.3				
08	460	33	8.6		2.5				
09	599	49	9.8		2.1				
10	622	43	8.3		2.3				
11	586	48	9.8		2.6				
12	555	38	8.2	7.1	2.5	0.6			
13	665	48	8.7		2.7				
14	662	42	7.6		2.6				
15	452	31	8.2		2.4				
16	553	44	9.5		2.4				
17	612	50	9.8		2.8				
18	647	45	8.3		2.6				
19	569	33	7.0		2.6		21.8	4.6	
20	751	55	8.8		2.4		25.2	4.0	
21	834	61	8.8		2.3		25.3	3.6	
22	788	56	8.5		2.5		23.2	3.5	
23	780	56	8.6		2.4		26.5	4.1	
24	889	75	10.1		2.5		26.5	3.6	
25	726	105	17.3		2.4		22.5	3.7	
26	751	99	15.8	7.0	2.4	0.5	22.1	3.5	
27	688	67	11.7		2.4		19.9	3.5	
28	668	60	10.8		2.6		18.2	3.3	
29	872	99	13.6		1.5		26.9	3.7	
30	774	60	9.3		5.0		23.0	3.6	
31	954	74	9.3		2.2		28.0	3.5	

COMMENTS:

DR. WATER TREATMENT PLANT DAILY OPERATION SU

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton J Jewell

, C.O., CERT. NO. C-

2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE NG/L	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP
MONTHLY TOTAL	19538	1388	265.4	28.3	72.3	2.5
AVERAGE	630.3	44.8	8.6	7.1	2.3	0.6
MAXIMUM	718	56	11.1	7.1	2.7	0.8
MINIMUM	410	24	4.0	7.0	0.9	0.5
01	602	40	8.0	7.1	2.5	0.5
02	702	50	8.5		1.5	
03	604	43	8.5		1.7	
04	714	52	8.7		2.3	
05	552	41	8.9		2.3	
06	600	43	8.5		2.5	
07	551	38	8.3		2.5	
08	590	41	8.3		2.5	
09	629	44	8.4		2.6	
10	681	45	7.9		2.2	
11	476	35	8.8		2.2	
12	718	48	8.0		2.3	
13	678	53	9.4		2.3	
14	685	48	8.4	7.1	2.4	0.6
15	634	54	10.2		2.7	
16	619	44	8.5		2.5	
17	658	32	5.8		2.5	
18	410	30	8.8		0.9	
19	674	56	10.0		2.4	
20	714	24	4.0		2.3	
21	661	46	8.3		2.2	
22	690	47	8.2	7.0	2.6	0.8
23	698	48	8.2		2.6	
24	674	45	8.0		2.7	
25	683	54	9.5		2.5	
26	671	49	8.8		2.6	
27	571	47	9.9		2.6	
28	703	48	8.2		2.4	
29	541	42	9.3		2.6	
30	605	56	11.1		2.0	
31	542	45	10.0	7.1	2.4	0.6

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 07-10-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton Deneveaux

, C.O., CERT. NO. C-3850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17730	1288	264.6	21.2	74.6	2.1	
AVERAGE	591.0	42.9	8.8	7.1	2.5	0.7	
MAXIMUM	767	56	12.4	7.1	3.2	1.0	
MINIMUM	307	24	6.6	7.0	2.0	0.5	
01	599	38	7.6		2.3		
02	739	42	6.8	7.1	2.4	0.6	
03	529	33	7.5		2.3		
04	453	31	8.2		2.2		
05	307	24	9.4		2.5		
06	681	47	8.3		3.0		
07	520	47	10.8		2.5		Well artesian pressure 0 psi
08	522	37	8.5		2.7		
09	505	46	10.9		3.2		
10	710	55	9.3		2.0		
11	725	53	8.8		2.4		
12	623	45	8.7		2.4		
13	733	50	8.2		2.4		
14	571	38	8.0		2.4		
15	589	44	9.0		2.4		
16	583	46	9.5	7.0	2.5	0.5	
17	639	35	6.6		2.8		
18	541	56	12.4		2.4		
19	505	39	9.3		3.0		
20	767	50	7.8		2.3		
21	578	42	8.7		2.4		
22	590	44	8.9		2.5		
23	599	45	9.0		2.7		
24	658	39	7.1		2.5		
25	681	45	7.9		2.4		
26	535	39	8.7	7.1	2.5	1.0	
27	706	46	7.8		2.1		
28	582	52	10.7		2.4		
29	432	41	11.4		2.6		
30	528	39	8.9		2.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1997

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton Devereaux

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19821	1432	270.4	27.8	73.4	2.2	
AVERAGE	639.4	46.2	8.7	7.0	2.4	0.6	
MAXIMUM	794	70	12.8	7.0	2.7	0.6	
MINIMUM	329	29	6.6	6.9	1.0	0.5	
01	641	44	8.2		2.6		
02	652	45	8.3		2.5		
03	728	44	7.2	6.9	2.1	0.6	
04	675	52	9.2		2.6		
05	739	52	8.4		2.3		
06	679	54	9.5		2.2		
07	779	56	8.6		2.6		Well artesian pressure 0 psi
08	704	43	7.3		2.4		
09	723	53	8.8		2.6		
10	794	59	8.9		2.4		
11	704	48	8.2		2.6		
12	479	33	8.3	7.0	2.5	0.5	
13	649	45	8.3		2.7		
14	614	39	7.6		2.4		
15	589	45	9.2		1.0		
16	554	43	9.3		2.7		
17	788	70	10.7		2.5		
18	583	43	8.8		2.4		
19	597	45	9.0		2.4		
20	635	35	6.6	6.9	2.2	0.6	
21	623	45	8.7		2.2		
22	599	43	8.6		1.8		
23	717	51	8.5		2.6		
24	659	46	8.4		2.2		
25	432	29	8.0		2.4		
26	707	45	7.6		2.4		
27	668	51	9.2		2.5		
28	329	35	12.8		2.4		
29	611	45	8.8	7.0	2.2	0.5	
30	502	40	9.6		2.4		
31	668	54	9.7		2.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 05-01-00

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM VIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron Price, C.O., CERT. NO. C-3702

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16602	1333	333.7	28.0	82.3	2.2	
AVERAGE	553.4	44.4	11.1	7.0	2.7	0.6	
MAXIMUM	796	77	48.6	7.1	5.0	0.6	
MINIMUM	37	15	7.2	6.9	2.1	0.5	
01	498	38	9.1	7.1	2.6	0.5	
02	630	77	14.7		3.3		
03	705	54	9.2		2.4		
04	689	49	8.5		2.5		
05	796	58	8.7		2.5		
06	764	57	8.9		2.5		
07	690	42	7.3		3.1		
08	681	58	10.2	7.0	3.5	0.6	Well artesian pressure 0 psi
09	37	15	48.6		2.5		
10	315	31	11.8		5.0		
11	617	40	7.8		4.6		
12	721	55	9.1		2.5		
13	697	42	7.2		2.3		
14	210	21	12.0		2.4		
15	496	41	9.9		2.5		
16	359	36	12.0	6.9	2.1	0.5	
17	489	40	9.8		4.5		
18	692	62	10.7		2.5		
19	706	48	8.2		2.5		
20	628	50	9.5		2.3		
21	732	55	9.0		2.5		
22	611	42	8.2		2.4		
23	404	35	10.4		2.4		
24	502	40	9.6	7.0	2.6	0.6	
25	205	23	13.5		2.6		
26	566	44	9.3		2.1		
27	500	40	9.6		2.2		
28	490	40	9.8		2.7		
29	514	52	12.1		2.3		
30	658	48	8.7		2.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 04-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0020N NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: March, 1997

PLANT EFFLUENT pH: 7.0 (AVG.) NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19653	1487	284.7	28.0	82.6	4.0	
AVERAGE	634.0	48.0	9.2	7.0	2.7	1.0	
MAXIMUM	991	74	12.6	7.1	5.0	1.2	
MINIMUM	277	26	7.7	6.9	1.9	0.8	
01	756	56	8.9		2.4		
02	991	74	9.0		2.6		
03	767	60	9.4	7.0	2.5	1.0	
04	866	65	9.0		2.5		
05	915	69	9.0		2.6		
06	831	60	8.7		2.5		
07	698	52	8.9		2.5		Well artesian pressure 0 psi
08	846	61	8.6		2.7		
09	883	57	7.7		2.7		
10	757	57	9.0	6.9	2.6	1.0	
11	651	47	8.7		2.4		
12	619	47	9.1		2.7		
13	525	43	9.8		2.5		
14	624	43	8.3		2.5		
15	559	38	8.2		2.5		
16	530	36	8.1		2.4		
17	570	39	8.2	7.0	2.7	0.8	
18	626	40	7.7		2.5		
19	534	39	8.8		2.8		
20	490	41	10.0		1.9		
21	731	55	9.0		2.5		
22	635	42	7.9		2.3		
23	497	37	8.9		2.7		
24	602	52	10.4		3.9		
25	345	26	9.0		2.8		
26	277	29	12.6		2.9		
27	570	50	10.5		2.6		
28	670	65	11.6		2.5		
29	367	28	9.1		2.3		
30	471	43	10.9	7.1	2.6	1.2	
31	450	36	9.6		5.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

NO. 216-1326 C.U.P. NO. 2-031-00.

NAME OF DRINKING WATER SY. : WATER TREATMENT PLANT

ADDRESS: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1997

EFFLUENT pH: 6.9 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Milton Devereaux

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	MG/L REMOTE TAP	
MONTHLY TOTAL	19722	1518	258.8	20.8	71.3	2.4	
AVERAGE	704.4	54.2	9.2	6.9	2.5	0.8	
MAXIMUM	895	75	11.8	7.0	3.9	1.0	
MINIMUM	510	38	7.2	6.9	2.1	0.6	
01	527	52	11.8		2.4		
02	705	65	11.1		2.5		
03	646	39	7.2	6.9	2.3	0.6	
04	510	38	8.9		2.7		
05	824	74	10.8		3.9		
06	710	61	10.3		2.7		
07	774	68	10.5		2.5		Well artesian pressure 0 psi
08	725	63	10.4		2.6		
09	540	48	10.7		2.3		
10	731	55	9.0	7.0	2.3	0.8	
11	691	50	8.7		2.4		
12	680	47	8.3		3.0		
13	740	54	8.7		2.5		
14	726	51	8.4		2.5		
15	728	51	8.4		2.1		
16	895	68	9.1		2.6		
17	868	75	10.4		2.4		
18	789	56	8.5		2.6		
19	788	56	8.5	6.9	2.4	1.0	
20	712	50	8.4		2.5		
21	592	42	8.5		2.3		
22	809	56	8.3		2.6		
23	549	42	9.2		2.3		
24	545	40	8.8		3.0		
25	813	56	8.3		2.3		
26	740	54	8.7		2.9		
27	599	47	9.4		2.3		
28	766	60	9.4		2.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

IS ID NO. 216-1326 C.U.P. NO. 2-031-0020N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1997

PLANT EFFLUENT pH: 6.9 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton J. Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	MG/L REMOTE TAP	
MONTHLY TOTAL	18594	1417	286.6	20.8	77.5	1.9	
AVERAGE	599.8	45.7	9.2	6.9	2.5	0.6	
MAXIMUM	838	63	12.2	7.0	2.8	0.8	
MINIMUM	323	27	6.7	6.9	1.9	0.5	
01	528	38	8.6		2.6		
02	483	37	9.2		2.8		
03	605	46	9.1		2.7		
04	598	52	10.4		2.7		
05	636	46	8.7		2.2		
06	712	56	9.4		2.5		
07	455	44	11.6		2.4		Well artesian pressure
08	683	47	8.3	7.0	2.7	0.8	0 psi
09	692	53	9.2		2.3		
10	583	39	8.0		2.5		
11	544	50	11.0		2.6		
12	637	61	11.5		2.5		
13	610	52	10.2		2.2		
14	581	41	8.5		2.4		
15	628	45	8.6		2.7		
16	602	42	8.4		2.8		
17	717	53	8.9		2.5		
18	818	63	9.2		2.5		
19	547	33	7.2		2.2		
20	594	58	11.7	6.9	2.7	0.6	
21	659	44	8.0		2.2		
22	732	56	9.2		2.7		
23	449	34	9.1		2.4		
24	623	38	7.3		2.2		
25	714	54	9.1		1.9		
26	838	47	6.7		2.7		
27	641	46	8.6		2.8		
28	419	27	7.7	6.9	2.7	0.5	
29	323	30	11.1		2.5		
30	568	47	9.9		2.5		
31	375	38	12.2		2.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 01-21-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Ron J. Price C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	17762	2004	419.2	36.2	87.8	3.0	868.4	N/A	N/A
AVERAGE	573.0	65	13.5	7.2	2.8	0.8	28.0	5.9	0.04
MAXIMUM	706	88	18.5	7.4	3.5	1.0	33.4	6.1	0.05
MINIMUM	469	40	8.9	7.2	1.0	0.5	23.3	5.2	0.02
01	588	64	13.1	7.2	3.5	1.0	28.8	5.9	
02	582	88	18.1		1.5		28.2	5.8	
03	581	56	11.6		3.5		29.6	6.1	
04	588	69	14.1		2.0		28.8	5.9	0.05
05	561	65	13.9		3.0		27.4	5.9	
06	681	86	15.1		3.1		33.4	5.9	
07	537	40	8.9		3.0		27.4	6.1	
08	588	66	13.5	7.4	1.0	0.7	28.8	5.9	
09	614	69	13.5		3.0		29.6	5.8	
10	566	70	14.8		3.5		28.8	6.1	
11	592	71	14.4		3.5		29.1	5.9	
12	686	77	13.5		1.0		32.8	5.7	
13	530	63	14.3		3.5		26.2	5.9	
14	472	54	13.7		3.5		23.6	6.0	
15	566	63	13.3		3.5		28.0	5.9	
16	580	61	12.6	7.2	2.8	0.8	28.6	5.9	
17	533	53	11.9		2.0		25.7	5.8	
18	561	70	15.0		2.2		27.7	5.9	0.02
19	706	71	12.1		2.5		31.6	5.4	
20	469	53	13.5		2.8		23.3	6.0	
21	529	54	12.2		2.6		25.1	5.7	
22	562	53	11.3	7.2	2.0		28.0	6.0	
23	579	64	13.3		2.5		28.2	5.8	
24	567	61	12.9		3.5		27.7	5.9	
25	476	53	13.4		3.5		23.9	6.0	
26	647	69	12.8		3.3		31.6	5.9	
27	546	62	13.6		3.1		25.7	5.6	
28	551	62	13.5		3.5		27.9	6.1	
29	588	63	12.8	7.2	3.0	0.5	25.7	5.2	
30	578	68	14.1		3.2		28.8	6.0	
31	558	86	18.5		3.2		28.4	6.1	

- 1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8 SAMPLE DATE: 12-17-97
- 2. WELL ARTESIAN PRESSURE: 0 psi
- 3. COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Ron D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	17736	1786	363.7	28.7	87.8	3.7	897.6	N/A
AVERAGE	591.2	60	12.1	7.2	2.9	0.9	29.9	6.1
MAXIMUM	758	75	16.8	7.3	3.5	1.0	37.7	8.6
MINIMUM	400	31	6.6	7.0	2.5	0.8	25.7	5.5
01	585	59	12.1		3.0		29.1	6.0
02	559	31	6.6		2.7		32.2	6.9
03	578	60	12.4	7.2	3.5	1.0	29.1	6.0
04	583	62	12.8		3.5		29.7	6.1
05	588	58	11.8		3.0		28.8	5.9
06	671	69	12.3		3.5		33.1	5.9
07	645	67	12.5		3.5		32.5	6.0
08	686	59	11.7		3.5		30.5	6.0
09	562	54	11.5		2.5		27.1	5.8
10	603	58	11.5	7.0	3.0		29.7	5.9
11	616	60	11.7		3.0		30.8	6.0
12	400	56	16.8		2.5	0.8	28.6	8.6
13	664	65	11.7		2.6		34.2	6.2
14	758	73	11.5		2.8		37.7	6.0
15	546	55	12.1		2.6		26.8	5.9
16	545	55	12.1		2.8		27.4	6.0
17	563	56	11.9		3.0		28.2	6.0
18	640	60	11.2		3.2		31.4	5.9
19	596	55	11.1		2.5		29.1	5.9
20	613	58	11.3		2.5	0.9	28.5	5.6
21	574	50	10.4		3.5		28.5	6.0
22	592	60	12.2		3.5		29.1	5.9
23	581	59	12.2		3.5		29.7	6.1
24	509	58	13.7	7.3	2.5		29.6	7.0
25	623	67	12.9		2.5		28.8	5.5
26	596	71	14.3		2.5		31.4	6.3
27	555	58	12.5		2.5		25.7	5.6
28	590	63	12.8		2.5		28.8	5.9
29	646	75	13.9		2.6		34.2	6.3
30	549	55	12.0	7.2	3.0	1.0	27.4	6.0

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8
 2. WELL ARTESIAN PRESSURE: 0 psi

SAMPLE DATE: 11-06-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

O. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

JN: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : October, 1997

AT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH

SIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

CERTIFY THIS REPORT IS CORRECT :

Ron D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	19083	2186	426.6	28.5	86.3	2.4	647.5	N/A
AVERAGE	615.6	71	13.8	7.1	2.8	0.8	30.8	6.0
MAXIMUM	721	88	16.8	7.2	3.5	1.0	35.4	6.2
MINIMUM	510	50	10.0	7.0	1.0	0.5	26.5	5.5
01	623	70	13.5		2.8			
02	607	69	13.6		2.5			
03	721	79	13.1		2.7			0.05
04	593	72	14.6		2.5			
05	510	65	15.3		2.7			
06	628	73	13.9	7.0	3.5			
07	627	73	14.0		3.0			
08	613	69	13.5		3.5			
09	641	74	13.8		3.0		32.2	6.0
10	630	67	12.8		3.5		31.4	6.0
11	646	71	13.2		2.0		33.1	6.1
12	594	64	12.9		2.0		30.0	6.0
13	589	68	13.8	7.2	1.0	0.5	28.8	5.9
14	630	77	14.7		3.0		31.9	6.1
15	650	88	16.2		2.5		32.5	6.0
16	607	79	15.6		2.6		30.5	6.0
17	594	77	15.5		3.0		30.0	6.0
18	590	76	15.4		3.5		28.8	5.9
19	606	85	16.8		3.5		30.5	6.0
20	599	58	11.6	7.1	3.5	1.0		
21	707	72	12.2		3.5		35.4	6.0
22	520	63	14.5		2.0		26.5	6.1
23	626	65	12.5		2.2		31.1	6.0
24	628	77	14.7		2.4		32.3	6.2
25	623	72	13.9		2.6		28.6	5.5
26	592	71	14.4		2.6			
27	588	67	13.7	7.2	1.5	0.9	29.4	6.0
28	598	50	10.0		3.5		29.6	5.9
29	647	67	12.4		3.0		33.4	6.2
30	559	58	12.4		3.5		27.4	5.9
31	697	70	12.0		3.2		34.2	5.9

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 10-20-97

2. WELL ARTESIAN PRESSURE: 0 psi

3. COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : September, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ron D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	17696	2050	416.9	28.5	80.2	3.5	237.8	N/A	N/A
AVERAGE	589.9	68	13.9	7.1	2.7	0.9	17.0	3.5	0.18
MAXIMUM	669	91	17.0	7.2	3.5	0.9	18.5	3.6	0.31
MINIMUM	449	51	11.9	7.0	1.7	0.8	12.6	3.2	0.05
01	449	53	14.2		3.0		12.6	3.4	
02	627	62	11.9	7.2	3.5	0.9	18.5	3.5	
03	576	60	12.5		1.8		16.7	3.5	
04	602	65	12.9		2.2		17.8	3.5	0.31
05	667	71	12.8		2.2		18.0	3.2	
06	600	62	12.4		2.5		17.4	3.5	
07	476	51	12.8		2.2		14.1	3.6	
08	614	68	13.3	7.2	1.8	0.9	17.6	3.4	
09	613	67	13.1		3.0		17.8	3.5	
10	516	58	13.5		3.0		15.5	3.6	
11	626	67	12.8		3.5		18.3	3.5	
12	629	70	13.3		1.8		18.1	3.5	
13	591	74	15.0		2.7		17.5	3.5	
14	602	72	14.3		2.3		17.8	3.5	
15	516	73	17.0	7.0	2.5				
16	571	70	14.7		2.8				
17	596	69	13.9		3.0				
18	602	74	14.7		3.2				0.05
19	626	78	14.9		3.0				
20	562	58	12.4		3.2				
21	574	71	14.8		1.8				
22	615	67	13.1		3.5	0.9			
23	599	69	13.8		3.5				
24	602	71	14.1		3.0				
25	579	69	14.3		2.7				
26	669	91	16.3		2.0				
27	617	70	13.6		1.7				
28	548	65	14.2		2.5				
29	618	84	16.3	7.1	3.5	0.8			
30	614	71	13.9		2.8				

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028X

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Ron Di Pina

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	MG/L	TOTAL PHOSPHATE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	18392	2109	426.0	28.1	87.4	2.8	214.3	N/A	N/A
AVERAGE	593.3	68	13.7	7.0	2.8	0.9	17.9	3.5	
MAXIMUM	739	89	15.2	7.1	3.5	1.0	20.6	3.7	
MINIMUM	445	52	12.2	7.0	2.0	0.8	14.0	3.3	
01	733	89	14.6		2.8				
02	580	59	12.2		2.1				
03	445	52	14.0		2.4				
04	540	65	14.4		3.5				
05	615	70	13.6	7.0	3.5	1.0			
06	565	65	13.8		3.5				
07	557	67	14.4		3.5				
08	592	75	15.2		3.5				
09	558	66	14.2		3.5				
10	615	76	14.8		3.5				
11	560	63	13.5	7.1	3.0	0.8			
12	594	73	14.7		2.0				
13	548	59	12.9		2.8				
14	593	68	13.7		2.5				
15	597	67	13.5		2.4				
16	602	69	13.7		2.6				
17	549	60	13.1		2.5				
18	598	68	13.6	7.0	3.0	1.0			
19	582	67	13.8		2.0				
20	593	67	13.5		2.5		17.0	3.4	
21	607	68	13.4		2.0		18.1	3.6	
22	678	77	13.6		3.5		19.5	3.4	
23	560	64	13.7		3.5		16.1	3.5	
24	739	89	14.4		3.0		20.6	3.3	
25	470	56	14.3		2.6		14.0	3.6	
26	579	62	12.8		3.0		17.0	3.5	
27	583	60	12.3	7.0	2.5		17.1	3.5	
28	610	65	12.8		2.0		16.6	3.3	
29	620	68	13.2		2.2		19.1	3.7	
30	635	74	14.0		2.5		18.5	3.5	
31	695	81	14.0		3.5		20.6	3.6	

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 08-06-97

2. WELL ARTESIAN PRESSURE: 0 psi

3. COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Milton D. Dureauux

C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC PHOSPHATE CORROSION CTRL LBS. USED	ORTHO-PHOS REMOTE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	MG/L REMOTE TAP		
MONTHLY TOTAL	17476	2053	444.5	36.1	84.9	3.3	N/A	N/A
AVERAGE	563.7	66	14.3	7.2	2.7	0.8		
MAXIMUM	657	80	23.0	7.3	3.5	0.9		
MINIMUM	94	18	12.0	7.1	1.0	0.7		
01	565	62	13.2	7.2	3.5			
02	657	66	12.0		3.5	0.9		
03	558	59	12.7		3.0			
04	638	68	12.8		3.3			
05	94	18	23.0		3.5			
06	500	60	14.4		2.6			
07	498	61	14.7		2.2			
08	609	63	12.4		2.4			
09	500	65	15.6		2.6			
10	539	58	12.9	7.2	2.4	0.8		
11	595	62	12.5		2.6			
12	617	80	15.5		2.4			
13	582	66	13.6		2.6			
14	553	65	14.1	7.3	1.5	0.9		
15	600	70	14.0		3.5			
16	610	74	14.5		3.5			
17	599	72	14.4		2.5			
18	578	78	16.2		2.2			
19	571	76	16.0		2.7			
20	590	77	15.6		1.2			
21	610	73	14.3	7.3	1.0	0.7		
22	579	73	15.1		2.5			
23	578	72	14.9		1.0			
24	593	69	14.0		3.0			
25	603	72	14.3		3.5			
26	566	67	14.2		3.5			
27	587	68	13.9		3.5			
28	599	80	16.0	7.1	3.0			
29	570	60	12.6		3.5			
30	580	60	12.4		3.5			
31	558	59	12.7		3.2			

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8
 2. WELL ARTESIAN PRESSURE: 0 psi

SAMPLE DATE: 07-10-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LVD.

JACKSONVILLE, FLA., DUVAL COUNTY

ER FLORIDA, INC.

REPORTING MONTH: June, 1997

: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

PHONE NO. (MAIN OFFICE) (904) 725-2865

THIS REPORT IS CORRECT :

Ron D. Pina

C.O., CERT. NO. C-3902

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17656	2032	415.0	21.7	85.2	2.7	
AVERAGE	588.5	68	13.8	7.2	2.8	0.9	
MAXIMUM	802	98	20.3	7.3	3.5	1.0	
MINIMUM	355	42	11.6	7.2	1.0	0.8	
01	532	58	13.1		2.9		
02	746	82	13.2	7.2	2.5	1.0	
03	482	54	13.4		3.0		
04	627	72	13.8		2.5		
05	576	66	13.7		2.6		
06	576	57	11.9		2.6		
07	596	67	13.5		2.8		Well artesian pressure 0 psi
08	580	98	20.3		3.0		
09	573	59	12.3	7.3	3.5	0.9	
10	588	65	13.3		3.5		
11	622	71	13.7		2.5		
12	584	67	13.8		3.0		
13	541	69	15.3		2.8		
14	638	74	13.9		2.5		
15	584	69	14.2		3.0		
16	583	65	13.4		2.5		
17	669	76	13.6		3.0		
18	537	52	11.6		2.7		
19	484	69	17.1		3.2		
20	802	87	13.0		3.4		
21	479	56	14.0		2.6		
22	602	67	13.3		2.5		
23	589	66	13.4	7.2	2.5	0.8	
24	589	69	14.0		3.0		
25	657	73	13.3		3.5		
26	533	63	14.2		3.3		
27	684	76	13.3		3.0		
28	696	85	14.6		3.1		
29	355	42	14.2		3.2		
30	552	58	12.6		1.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

ID NO. 2161326 CUP NO. 2-031-0028N NAME OF DRINKING WATER SYSTEM. LAKE LUCINA WTP
 LOCATION: 2530 CESERY BLVD. JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: May, 1997
 PLANT EFFLUENT pH: 7.1 (AVG) NO. OF SERVICES AT END OF MONTH
 DESIGN FLOW: PHONE NO. (MAIN OFFICE) (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT: Ron D. Price C.O., CERT. NO. C- 3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18238	1995	413.8	21.4	91.1	2.7	
AVERAGE	588.3	64	13.3	7.1	2.9	0.9	
MAXIMUM	711	85	22.2	7.2	3.5	1.0	
MINIMUM	178	33	10.2	7.1	1.5	0.8	
01	618	60	11.6		3.0		
02	601	58	11.6		2.8		
03	629	62	11.8		3.2		
04	582	58	11.9		2.8		
05	600	60	12.0		2.6		
06	574	71	14.8		3.0		
07	711	70	11.8		3.0		Well artesian pressure 0 psi
08	606	65	12.9		3.5		
09	681	85	15.0		2.5		
10	570	71	14.9		3.5		
11	558	65	14.0		3.5		
12	579	62	12.8	7.2	3.5	0.9	
13	611	52	10.2		2.5		
14	606	70	13.9		1.5		
15	651	75	13.8		2.5		
16	543	63	13.9		2.5		
17	639	73	13.7		3.5		
18	606	70	13.9		3.0		
19	578	64	13.3	7.1	3.5	1.0	
20	613	64	12.5		3.0		
21	695	68	11.7		3.0		
22	581	70	14.4		3.0		
23	695	74	12.8		2.8		
24	638	69	13.0		3.5		
25	509	56	13.2		3.0		
26	567	58	12.3		2.7		
27	495	57	13.8	7.1	1.5	0.8	
28	564	63	13.4		3.0		
29	641	71	13.3		3.5		
30	519	58	13.4		3.0		
31	178	33	22.2		3.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ron Prid

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17641	2069	422.5	28.3	93.9	3.8	
AVERAGE	588.0	69	14.1	7.1	3.1	1.0	
MAXIMUM	692	84	16.0	7.2	3.5	1.0	
MINIMUM	396	46	11.3	7.0	1.5	0.8	
01	631	68	12.9		3.5		
02	544	59	13.0		2.0		
03	624	68	13.1		2.5		
04	605	68	13.5		3.5		
05	573	54	11.3		3.0		
06	530	70	15.8		3.5		
07	624	73	14.0	7.0	3.5	1.0	Well artesian pressure 0 psi
08	545	63	13.9		2.5		
09	680	76	13.4		3.5		
10	611	73	14.3		3.2		
11	651	68	12.5		3.5		
12	609	70	13.8		3.5		
13	591	70	14.2		3.5		
14	597	77	15.5		3.5		
15	396	46	13.9	7.1	3.5	0.8	
16	612	75	14.7		3.5		
17	575	71	14.8		3.5		
18	677	84	14.9		3.5		
19	622	76	14.7		3.5		
20	535	69	15.5		3.0		
21	625	78	15.0	7.0	3.0	1.0	
22	692	83	14.4		3.5		
23	598	71	14.2		3.0		
24	515	61	14.2		1.5		
25	556	66	14.2		2.5		
26	621	72	13.9		2.9		
27	548	63	13.8		3.0		
28	616	66	12.8	7.2	3.5	1.0	
29	550	66	14.4		2.8		
30	488	65	16.0		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 04-08-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028H

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1997

PLANT EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ren A. Prid

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	13563	1550	343.9	29.0	76.3	3.4	
AVERAGE	437.5	50	13.8	7.3	2.5	0.9	
MAXIMUM	684	88	19.2	7.3	3.5	1.0	
MINIMUM	0	0	10.7	7.2	0.0	0.6	
01	0	0			0.0		PLANT PUT BACK ON LINE 3/7/97
02	0	0			0.0		
03	0	0			0.0		
04	0	0			0.0		
05	0	0			0.0		
06	0	0			0.0		
07	229	33	17.3		3.5		Well artesian pressure 0 psi
08	394	35	10.7		2.7		
09	339	32	11.3		3.5		
10	616	66	12.8	7.2	3.5	1.0	
11	558	59	12.7		2.5		
12	615	88	17.2		2.5		
13	578	65	13.5		2.7		
14	648	73	13.5		3.5		
15	551	69	15.0		3.5		
16	497	60	14.5		3.0		
17	517	83	19.2	7.3	3.5	0.8	
18	518	57	13.2		2.0		
19	525	71	16.2		3.0		
20	530	58	13.1		3.0		
21	614	67	13.1		3.5		
22	553	60	13.0		3.5		
23	553	60	13.0		3.3		
24	582	63	13.0		2.5		
25	549	59	12.9	7.3	3.3	1.0	
26	684	62	10.9		2.5		
27	587	65	13.3		3.0		
28	607	70	13.8		2.6		
29	582	69	14.2		3.0		
30	561	63	13.5		3.2		
31	576	63	13.1	7.2	3.5	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1997

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ron D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL							
AVERAGE							
MAXIMUM							
MINIMUM							
01							PLANT OFF LINE FOR PAINTING 1/8/97
02							
03							
04							
05							
06							
07							Well artesian pressure 0 psi
08							
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYS.: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : January, 1997

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Ken D. Price C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4437	438	83.5		23.7		
AVERAGE	633.9	63	11.9		3.0		
MAXIMUM	761	78	13.0		3.5		
MINIMUM	514	55	9.9		2.5		
01	514	55	12.8		3.5		PLANT OFF LINE FOR PAINTING 1/8/97 TO 1/31/97.
02	638	60	11.3		2.5		
03	726	78	12.9		2.6		
04	580	60	12.4		3.0		
05	555	60	13.0		3.5		
06	663	62	11.2		2.8		
07	761	63	9.9		2.8		Well artesian pressure 0 psi
08					3.0		
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							
31							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM, UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1997

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron D. Rice, C.O., CERT. NO. C-_____

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	5917	539	334.0	35.9	92.4	3.5	253.6	N/A	N/A
AVERAGE	190.9	17.4	10.8	7.2	3.0	0.9	8.2	5.2	0.07
MAXIMUM	332	40	18.7	7.2	3.5	1.0	14.1	6.7	0.08
MINIMUM	107	8	7.5	7.1	1.0	0.5	3.9	4.1	0.06
01	310	27	10.4	7.2	2.5	1.0	13.2	5.1	
02	263	23	10.5		3.5		11.1	5.1	
03	332	29	10.5		3.5		13.8	5.0	
04	258	22	10.2		2.5		11.1	5.2	0.08
05	257	40	18.7		3.5		10.8	5.0	
06	329	39	14.2		3.0		13.5	4.9	
07	325	31	11.4		3.2		14.1	5.2	
08	326	25	9.2	7.2	3.5	1.0	14.1	5.2	
09	259	23	10.6		1.8		10.6	4.9	
10	228	18	9.5		3.5		9.6	5.0	
11	223	21	11.3		3.0		10.0	5.4	
12	253	18	8.5		3.5		10.0	4.7	
13	113	12	12.7		1.0		3.9	4.1	
14	136	15	13.2		2.5		6.0	5.3	
15	139	14	12.1		2.4		6.0	5.2	
16	157	15	11.5		2.6		6.0	4.6	
17	131	15	13.7	7.1	2.5	1.0	6.4	5.9	
18	108	10	11.1		2.5		6.0	6.7	0.06
19	150	10	8.0		3.0		6.0	4.8	
20	160	10	7.5		3.0		7.6	5.7	
21	152	17	13.4		2.8		6.0	4.7	
22	123	9	8.8	7.2	3.5		6.0	5.8	
23	112	9	9.6		3.5		6.0	6.4	
24	114	9	9.5		3.5		4.6	4.8	
25	107	8	9.0		3.5		4.6	5.2	
26	155	13	10.1		2.9		6.0	4.6	
27	125	9	8.6		3.5		5.4	5.2	
28	156	13	10.0		3.5		6.0	4.6	
29	124	10	9.7	7.2	3.0	0.5	6.4	6.2	
30	173	15	10.4		3.2		6.4	4.4	
31	119	10	10.1		3.0		6.4	6.4	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4
WELL ARTESIAN PRESSURE: 0 psi

SAMPLE DATE: 12-08-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326

C.U.P. NO. 2-031-00208

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron D. Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	9595	918	344.1	28.4	84.4	3.6	398.1	N/A	N/A
AVERAGE	319.8	30.6	11.5	7.1	2.8	0.9	13.3	5.0	0.59
MAXIMUM	468	53	18.0	7.2	3.5	1.0	15.9	5.9	0.64
MINIMUM	251	15	5.1	7.0	1.0	0.7	10.2	3.7	0.54
01	251	27	12.9		2.5		10.8	5.2	
02	426	31	8.7		1.0		14.4	4.1	
03	307	21	8.2	7.0	3.0	1.0	12.9	5.0	
04	329	31	11.3		2.7		13.8	5.0	
05	350	32	11.0		3.0		15.9	5.5	
06	326	37	13.6		3.5		13.8	5.1	0.54
07	374	36	11.5		3.0	0.7	15.6	5.0	
08	320	32	12.0		2.0		13.8	5.2	
09	327	32	11.7		3.5		14.4	5.3	
10	296	28	11.3	7.0	3.5		12.9	5.2	
11	351	33	11.3		3.5		15.0	5.1	
12	292	23	9.4		2.5		10.2	4.2	
13	281	25	10.7		3.0		13.8	5.9	
14	468	53	13.6		2.8		14.4	3.7	
15	298	33	13.3		2.6		12.6	5.1	
16	286	35	14.7		2.8		10.2	4.3	
17	301	30	12.0		2.6		12.4	4.9	
18	300	45	18.0		2.5		14.7	5.9	
19	253	23	10.9		2.0		10.5	5.0	0.64
20	255	22	10.3		3.5	1.0	10.8	5.1	
21	285	25	10.5		3.5		12.0	5.1	
22	303	45	17.8		1.0		12.6	5.0	
23	354	51	17.3		3.5		15.0	5.1	
24	310	32	12.4	7.2	3.5		12.0	4.6	
25	325	30	11.1		3.0		15.4	5.7	
26	353	25	8.5		2.8		15.4	5.2	
27	347	35	12.1		3.0		15.0	5.2	
28	300	15	6.0		3.0		12.0	4.8	
29	350	15	5.1		3.0		13.6	4.7	
30	277	16	6.9	7.2	2.6	0.9	12.0	5.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4
WELL ARTESIAN PRESSURE: 0 psi

SAMPLE DATE: 11-06-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1997

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	9344	902	363.0	28.7	74.8	2.3	479.4	N/A	N/A
AVERAGE	301.4	29.1	11.7	7.2	2.4	0.8	16.0	6.5	0.47
MAXIMUM	495	51	38.3	7.2	3.5	0.9	73.3	24.8	0.75
MINIMUM	84	5	4.7	7.1	1.0	0.6	6.0	3.7	0.18
01	383	37	11.6		2.0		17.1	5.4	
02	341	32	11.3		2.5		15.3	5.4	
03	147	47	38.3		3.5		16.5	13.5	0.18
04	266	28	12.6		3.0		12.0	5.4	
05	319	23	8.6		2.4		15.9	6.0	
06	423	45	12.8	7.1	1.0	0.8	16.8	4.8	
07	469	47	12.0		3.0		21.0	5.4	
08	457	47	12.3		1.5		20.7	5.4	
09	495	48	11.6		2.5		22.2	5.4	
10	334	48	17.2		1.5		19.5	7.0	
11	460	51	13.3		3.5		20.7	5.4	
12	353	36	12.2		1.0		15.9	5.4	
13	267	28	12.6	7.2	3.5		12.6	5.7	
14	276	30	13.0		3.5		11.7	5.1	
15	259	28	13.0		2.5		11.2	5.2	
16	84	5	7.1		3.0		6.0	8.6	0.75
17	240	13	6.5		2.6		8.7	4.4	
18	193	14	8.7		2.1		8.7	5.4	
19	293	23	9.4		3.0		13.2	5.4	
20	227	29	15.3	7.2	1.0	0.6	9.9	5.2	
21	147	10	8.2		2.2		10.6	8.6	
22	288	15	6.2		2.6		12.0	5.0	
23	354	44	14.9		2.8		73.3	24.8	
24	286	15	6.3		2.6		12.1	5.1	
25	255	10	4.7		2.6		12.0	5.6	
26	312	13	5.0		2.8				
27	329	17	6.2		1.0	0.9	14.1	5.1	
28	197	15	9.1		2.5		6.0	3.7	
29	245	35	17.1		2.2		16.2	7.9	
30	267	29	13.0	7.2	2.5		11.1	5.0	
31	378	40	12.7		2.4		16.2	5.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 10-06-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.
 LOCATION: 3703 CAVANAUGH DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: September, 1997
 PLANT EFFLUENT pH: 7.1 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	9898	914	335.2	28.2	76.3	3.3	261.0	N/A	N/A
AVERAGE	329.9	30.5	11.2	7.1	2.5	0.8	8.7	3.2	0.28
MAXIMUM	557	49	17.0	7.2	3.5	1.0	15.1	3.5	0.30
MINIMUM	179	13	6.7	7.0	1.0	0.6	4.6	2.8	0.26
01	259	25	11.6		3.0		7.5	3.5	
02	305	30	11.8	7.2	1.5	0.7	8.1	3.2	
03	297	30	12.1		1.8		7.0	2.8	
04	267	30	13.5		2.0		7.0	3.1	0.26
05	360	20	6.7		2.2		10.0	3.3	
06	268	38	17.0		2.4		7.0	3.1	
07	243	26	12.8		2.2		6.5	3.2	
08	321	24	9.0	7.0	1.5	0.6	8.4	3.1	
09	348	31	10.7		3.0		9.1	3.1	
10	263	32	14.6		2.0		6.8	3.1	
11	395	24	7.3		2.0		10.3	3.1	
12	361	32	10.6		3.0		9.5	3.1	
13	359	37	12.4		2.0		9.5	3.2	
14	349	35	12.0		2.7		10.3	3.5	
15	362	35	11.6	7.0	2.0		8.8	2.9	
16	356	35	11.8		3.5		9.0	3.0	
17	350	35	12.0		3.2		8.6	2.9	
18	474	45	11.4		3.0		14.0	3.5	0.30
19	488	40	9.8		3.2		12.5	3.1	
20	470	40	10.2		3.0		12.5	3.2	
21	557	48	10.3		2.8		15.1	3.2	
22	427	49	13.8	7.0	2.6	1.0	11.4	3.2	
23	275	27	11.8		3.0		6.7	2.9	
24	219	22	12.0		3.5		6.3	3.4	
25	179	13	8.7		2.2		4.6	3.0	
26	248	23	11.1		1.0		6.3	3.0	
27	250	24	11.5		3.0		6.7	3.2	
28	247	20	9.7		3.0		6.5	3.1	
29	242	17	8.4		3.5	1.0	6.0	2.9	
30	359	27	9.0		2.5		9.3	3.1	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Lon D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	MG/L	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	7378	708	361.1	21.2	89.2	2.7	107.3	N/A	N/A
AVERAGE	238.0	22.8	11.6	7.1	2.9	0.9	8.9	3.3	
MAXIMUM	401	38	19.5	7.1	3.5	1.0	10.5	4.4	
MINIMUM	118	10	8.2	7.0	2.0	0.8	7.2	3.0	
01	167	21	15.1		2.8				
02	190	24	15.1		2.2				
03	160	20	15.0		2.4				
04	118	12	12.2		3.5				
05	172	28	19.5	7.0	3.5	0.8			
06	165	14	10.2		3.5				
07	130	10	9.2		3.5				
08	134	11	9.8		3.5				
09	168	12	8.6		3.5				
10	232	19	9.8		3.0				
11	133	12	10.8	7.1	2.5	0.9			
12	201	20	11.9		2.0				
13	143	14	11.7		3.5				
14	146	12	9.9		3.5				
15	196	19	11.6		3.0				
16	212	15	8.5		2.6				
17	267	25	11.2		2.8				
18	259	20	9.3	7.1	3.5	1.0			
19	304	30	11.8		3.0				
20	323	22	8.2		2.0		8.2	3.1	
21	355	29	9.8		2.3		9.3	3.1	
22	401	28	8.4		3.0		10.3	3.1	
23	273	31	13.6		3.2		7.2	3.2	
24	331	33	12.0		3.0		10.5	3.8	
25	328	28	10.2		2.6		9.5	3.5	
26	293	38	15.6		3.0		7.9	3.2	
27	314	30	11.5		2.0		7.9	3.0	
28	329	30	10.9		2.2		9.1	3.3	
29	330	30	10.9		2.6		9.1	3.3	
30	246	33	16.1		2.0		8.9	4.4	
31	358	38	12.7		3.5		9.5	3.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1914.0	61.0	116.7	162.0	51.4	11.8	
AVERAGE	61.7	2.0	3.8	7.4	1.7	0.5	
MAXIMUM	80.0	4.0	7.0	7.4	2.0	0.7	
MINIMUM	33.0	1.0	1.7	7.3	1.4	0.4	
01	67.0	2.0	3.6	7.3	1.4	0.5	
02	78.0	3.0	4.6	7.3	2.0	0.6	
03	48.0	1.0	2.5	7.3	2.0	0.6	
04	74.0	3.0	4.9		1.8		
05	56.0	2.0	4.3		1.8		
06	69.0	4.0	7.0		1.8		
07	67.0	2.0	3.6	7.3	1.5	0.5	
08	61.0	1.0	2.0	7.3	1.6	0.5	
09	67.0	3.0	5.4	7.3	1.4	0.4	
10	54.0	2.0	4.4	7.3	1.5	0.4	
11	80.0	2.0	3.0	7.3	1.7	0.5	
12	48.0	1.0	2.5		1.6		
13	74.0	2.0	3.2		1.6		
14	67.0	3.0	5.4	7.4	1.5	0.5	
15	64.0	2.0	3.8	7.4	1.6	0.4	
16	52.0	1.0	2.3	7.4	1.6	0.6	
17	58.0	2.0	4.1	7.4	1.6	0.6	
18	61.0	1.0	2.0	7.4	1.6	0.6	
19	57.0	2.0	4.2		1.5		
20	68.0	3.0	5.3		1.5		
21	68.0	2.0	3.5	7.4	1.6	0.4	
22	69.0	1.0	1.7	7.4	1.5	0.4	
23	33.0	1.0	3.6	7.4	1.5	0.6	
24	66.0	2.0	3.6	7.4	1.6	0.6	
25	67.0	2.0	3.6	7.4	2.0	0.6	
26	54.0	2.0	4.4		1.8		
27	68.0	3.0	5.3		1.9		
28	56.0	2.0	4.3	7.4	1.7	0.7	
29	66.0	2.0	3.6	7.4	1.8	0.7	
30	53.0	1.0	2.3	7.4	1.8	0.5	
31	44.0	1.0	2.7	7.4	1.6	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Jeveraux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC PHOSPHATE CORROSION CTRL		ORTHO-PHOS REMOTE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	7370	720	398.9	35.6	91.3	2.9		N/A	N/A
AVERAGE	237.7	23.2	12.9	7.1	2.9	0.7			
MAXIMUM	404	34	50.0	7.2	3.5	0.9			
MINIMUM	36	10	6.4	7.0	1.5	0.5			
01	116	10	10.3	7.2	3.5				
02	214	20	11.2		3.5	0.7			
03	228	18	9.5		3.0				
04	261	24	11.0		3.5				
05	223	22	11.8		3.5				
06	225	16	8.5		3.5				
07	100	10	12.0		2.2				
08	187	10	6.4		2.3				
09	204	20	11.8		2.6				
10	175	20	13.7	7.1	2.5	0.5			
11	166	15	10.8		2.5				
12	257	25	11.7		2.6				
13	343	29	10.1		2.8				
14	256	23	10.0	7.1	2.5				
15	404	33	9.8		2.5				
16	220	25	13.1		1.5	0.9			
17	235	31	15.8		2.5				
18	183	24	15.7		2.5				
19	227	29	15.3		3.5				
20	293	29	11.9		3.5				
21	209	23	13.2		3.0				
22	314	32	12.2		3.5				
23	336	29	10.3		3.5				
24	312	33	12.7	7.2	3.5	0.8			
25	201	21	12.5		3.5				
26	346	24	8.3		3.5				
27	269	25	11.1		3.5				
28	243	21	10.4	7.0	2.5				
29	332	34	12.3		2.0				
30	247	30	14.6		3.5				
31	36	15	50.0		2.8				

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 07-18-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1997

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Lon D. Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5540	587	417.8	21.7	84.5	2.3	
AVERAGE	184.7	19.6	13.9	7.2	2.8	0.8	
MAXIMUM	371	40	57.1	7.3	3.5	0.9	
MINIMUM	78	8	7.4	7.2	1.0	0.6	
01	246	19	9.3		3.2		
02	236	19	9.7	7.3	1.0	0.6	
03	148	13	10.5		3.5		
04	143	12	10.1		3.0		
05	101	10	11.9		2.6		
06	130	15	13.8		2.4		
07	163	10	7.4		2.2		Well artesian pressure 0 psi
08	247	20	9.7		2.4		
09	177	16	10.8	7.2	2.0	0.8	
10	285	24	10.1		3.5		
11	219	18	9.9		3.0		
12	198	22	13.3		3.0		
13	158	13	9.9		2.4		
14	134	10	8.9		3.5		
15	259	32	14.8		3.5		
16	164	18	13.2		2.5		
17	95	11	13.9		2.4		
18	88	8	10.9		3.0		
19	78	11	16.9		3.5		
20	195	16	9.8		3.5		
21	146	14	11.5		2.2		
22	291	25	10.3		3.5		
23	166	17	12.3	7.2	2.2	0.9	
24	186	20	12.9		3.0		
25	273	25	11.0		2.5		
26	178	22	14.8		3.0		
27	252	29	13.8		2.8		
28	371	38	12.3		3.0		
29	84	40	57.1		2.7		
30	129	40	37.2		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.
 LOCATION: 3703 CAVANAUGH DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: May, 1997
 PLANT EFFLUENT pH: 7.2 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7294	742	373.0	21.5	86.5	1.7	
AVERAGE	235.3	23.9	12.0	7.2	2.8	0.9	
MAXIMUM	352	47	18.4	7.2	3.5	0.9	
MINIMUM	67	7	8.0	7.1	0.5	0.8	
01	165	13	9.4		2.8		
02	146	17	14.0		3.0		
03	257	25	11.7		3.2		
04	300	46	18.4		2.8		
05	250	20	9.6		3.0		
06	259	25	11.6		2.6		
07	324	37	13.7		3.0		Well artesian pressure
08	325	36	13.3		3.5		0 psi
09	352	45	15.3		3.5		
10	346	32	11.1		0.5		
11	324	30	11.1		2.7		
12	84	9	12.8	7.2	3.5	0.9	
13	206	18	10.5		3.5		
14	179	16	10.7		3.5		
15	322	27	10.1		3.0		
16	172	15	10.5		1.5		
17	304	30	11.8		3.5		
18	337	36	12.8		3.0		
19	203	21	12.4	7.2	2.0		
20	302	30	11.9		3.5		
21	247	25	12.1		2.4		
22	200	20	12.0		2.6		
23	329	47	17.1		3.0		
24	235	26	13.3		2.8		
25	67	7	12.5		2.4		
26	283	23	9.7		3.0		
27	239	22	11.0	7.1	2.0	0.8	
28	90	9	12.0		2.5		
29	120	11	11.0		3.5		
30	73	7	11.5		2.0		
31	254	17	8.0		2.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7174	644	327.7	28.5	83.9	3.6	
AVERAGE	239.1	21.5	10.9	7.1	2.8	0.9	
MAXIMUM	457	50	19.0	7.2	3.5	1.0	
MINIMUM	89	6	4.3	7.0	2.0	0.8	
01	259	22	10.2		3.5		
02	202	17	10.1		2.5		
03	188	16	10.2		3.5		
04	341	31	10.9		3.5		
05	315	50	19.0		2.5		
06	359	28	9.4		2.0		
07	293	24	9.8	7.0	2.5	0.8	Well artesian pressure 0 psi
08	207	18	10.4		3.5		
09	457	31	8.1		3.0		
10	274	26	11.4		2.5		
11	184	21	13.7		2.0		
12	260	23	10.6		3.5		
13	373	31	10.0		2.0		
14	214	22	12.3		2.0		
15	127	12	11.3	7.1	3.5	1.0	
16	256	14	6.6		3.5		
17	232	20	10.3		3.0		
18	209	28	16.1		2.8		
19	294	32	13.1		2.4		
20	331	25	9.1		2.0		
21	274	22	9.6	7.2	3.0	0.8	
22	149	11	8.9		3.0		
23	256	14	6.6		2.0		
24	162	11	8.1		2.0		
25	89	10	13.5		2.1		
26	167	6	4.3		3.5		
27	236	28	14.2		3.5		
28	160	18	13.5	7.2	3.5	1.0	
29	135	18	16.0		2.8		
30	171	15	10.5		2.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8057	792	374.2	28.4	93.5	3.5	
AVERAGE	259.9	25.5	12.1	7.1	3.0	0.9	
MAXIMUM	674	49	23.4	7.3	3.5	1.0	
MINIMUM	96	6	6.0	6.9	1.5	0.7	
01	439	26	7.1		3.5		
02	674	48	8.5		3.5		
03	238	21	10.6	7.2	2.0	0.8	
04	368	35	11.4		2.5		
05	347	45	15.5		1.5		
06	271	38	16.8		2.2		
07	431	28	7.8		2.4		Well artesian pressure 0 psi
08	251	49	23.4		3.5		
09	347	42	14.5		3.5		
10	228	25	13.1	6.9	3.5	1.0	
11	294	18	7.3		3.0		
12	222	22	11.9		3.5		
13	96	6	7.5		3.0		
14	102	10	11.8		2.0		
15	194	25	15.5		2.7		
16	199	10	6.0		2.5		
17	175	21	14.4		3.0		
18	121	12	11.9		3.5		
19	233	19	9.8		3.5		
20	179	18	12.1		3.5		
21	182	20	13.2	7.0	3.5	1.0	
22	238	20	10.1		3.5		
23	289	30	12.4		3.5		
24	185	21	13.6		3.0		
25	237	25	12.6		3.3		
26	253	31	14.7		3.5		
27	200	20	12.0		3.5		
28	240	25	12.5		2.8		
29	310	25	9.7		3.0		
30	288	33	13.7		2.6		
31	226	24	12.7	7.3	3.0	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1997

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Bon D. Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7927	833	355.8	21.5	77.6	2.9	
AVERAGE	283.1	29.8	12.7	7.2	2.8	1.0	
MAXIMUM	425	38	19.4	7.2	3.5	1.2	
MINIMUM	188	21	10.6	7.1	1.5	0.8	
01	329	30	10.9		3.0		
02	425	38	10.7		3.5		
03	251	24	11.5		3.0		
04	358	36	12.1	7.1	2.5	0.9	
05	270	28	12.4		2.0		
06	263	30	13.7		2.3		
07	302	34	13.5		2.2		Well artesian pressure 0 psi
08	295	33	13.4		2.0		
09	241	29	14.4		3.5		
10	290	32	13.2	7.2	3.5	1.2	
11	283	31	13.1		2.5		
12	238	24	12.1		3.0		
13	252	26	12.4		3.0		
14	220	22	12.0		2.5		
15	252	23	10.9		3.0		
16	305	35	13.8		3.5		
17	322	30	11.2		2.8		
18	340	34	12.0		1.5		
19	188	21	13.4		2.0		
20	312	30	11.5		2.6		
21	273	32	14.1		2.8		
22	294	28	11.4		2.6		
23	319	34	12.8		2.8		
24	229	37	19.4	7.2	3.5	0.8	
25	283	25	10.6		3.0		
26	247	23	11.2		3.5		
27	277	30	13.0		2.5		
28	269	34	15.2		3.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0020N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1997

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Lon D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	MG/L REMOTE TAP	
MONTHLY TOTAL	7410	706	278.2	21.4	66.4	2.7	
AVERAGE	308.8	29.4	11.6	7.1	2.8	0.9	
MAXIMUM	410	40	17.0	7.2	3.5	1.0	
MINIMUM	202	17	7.9	7.0	1.5	0.8	
01							PLANT OFF LINE FOR PAINTING
02							1/01/97 TO 1/08/97
03							
04							
05							
06							
07							Well artesian pressure 0 psi
08	361	32	10.6		3.5		
09	235	23	11.7		2.5		
10	302	31	12.3		3.5		
11	295	27	11.0		3.0		
12	410	35	10.2		2.5		
13	342	31	10.9	7.2	2.5		
14	408	27	7.9		2.5	0.9	
15	202	17	10.1		2.7		
16	256	25	11.7		3.0		
17	335	35	12.5		2.6		
18	396	35	10.6		3.0		
19	385	30	9.3		3.2		
20	359	30	10.0	7.0	1.5		
21	328	29	10.6		2.0	0.8	
22	265	26	11.8		1.8		
23	281	27	11.5		2.5		
24	256	27	12.6		2.5		
25	321	40	14.9		2.7		
26	334	35	12.6		2.9		
27	254	25	11.8	7.2	2.5		
28	283	27	11.4		3.0	1.0	
29	292	31	12.7		3.5		
30	226	32	17.0		3.5		
31	284	29	12.2		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 01-21-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160381 C.U.P. NO. 2-031-0040X

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

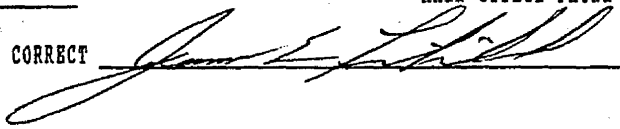

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL VCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1313.0	60.0	172.6	155.4	47.5	11.1	
AVERAGE	42.4	1.9	5.6	7.4	1.5	0.5	
MAXIMUM	61.0	4.0	12.0	7.4	2.2	0.6	
MINIMUM	30.0	1.0	2.8	7.4	1.2	0.5	
01	47.0	3.0	7.7	7.4	1.5	0.6	
02	35.0	2.0	6.9	7.4	1.6	0.5	
03	31.0	1.0	3.9	7.4	1.5	0.5	
04	59.0	2.0	4.1	7.4	1.5	0.5	
05	56.0	2.0	4.3	7.4	1.6	0.6	
06	55.0	4.0	8.7		1.8		
07	56.0	2.0	4.3		2.1		
08	43.0	1.0	2.8	7.4	1.5	0.6	
09	44.0	2.0	5.5	7.4	1.5	0.5	
10	39.0	2.0	6.2	7.4	2.2	0.6	
11	41.0	2.0	5.9	7.4	1.4	0.5	
12	49.0	3.0	7.3	7.4	1.6	0.5	
13	44.0	2.0	5.5		1.5		
14	37.0	1.0	3.2		1.5		
15	46.0	2.0	5.2	7.4	1.6	0.6	
16	39.0	1.0	3.1	7.4	1.4	0.5	
17	33.0	3.0	10.9	7.4	1.5	0.5	
18	30.0	3.0	12.0	7.4	1.5	0.6	
19	60.0	3.0	6.0	7.4	1.6	0.5	
20	38.0	1.0	3.2		1.6		
21	33.0	2.0	7.3		1.5		
22	40.0	2.0	6.0	7.4	1.5	0.5	
23	35.0	1.0	3.4	7.4	1.4	0.5	
24	34.0	2.0	7.1	7.4	1.4	0.5	
25	32.0	2.0	7.5		1.5		
26	36.0	1.0	3.3		1.4		
27	53.0	2.0	4.5		1.6		
28	40.0	2.0	6.0		1.6		
29	32.0	1.0	3.8	7.4	1.2	0.5	
30	35.0	1.0	3.4	7.4	1.2	0.5	
31	61.0	2.0	3.9	7.4	1.2	0.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 12-03-97

DI WATER TREATMENT PLANT DAILY OPERATIONAL

WS ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1305.0	55.0	154.5	132.4	55.7	12.2	
AVERAGE	43.5	1.8	5.2	7.4	1.9	0.7	
MAXIMUM	68.0	4.0	10.9	7.4	2.5	0.9	
MINIMUM	23.0	1.0	2.6	7.3	1.2	0.5	
01	51.0	2.0	4.7		1.8		
02	45.0	1.0	2.7		1.7		
03	41.0	1.0	2.9	7.4	1.8	0.7	
04	39.0	1.0	3.1	7.4	1.8	0.6	
05	44.0	3.0	8.2	7.4	1.7	0.6	
06	41.0	3.0	8.8	7.4	2.2	0.7	
07	33.0	3.0	10.9	7.4	2.2	0.6	
08	37.0	3.0	9.7		1.8		
09	68.0	3.0	5.3		2.0		
10	44.0	1.0	2.7	7.4	2.2	0.6	
11	46.0	1.0	2.6	7.4	2.2	0.6	
12	44.0	1.0	2.7	7.4	1.2	0.5	
13	45.0	1.0	2.7	7.4	1.4	0.6	
14	31.0	1.0	3.9	7.4	1.6	0.6	
15	48.0	2.0	5.0		1.3		
16	59.0	2.0	4.1		2.5		
17	44.0	1.0	2.7	7.3	2.1	0.8	
18	43.0	1.0	2.8	7.3	2.2	0.8	
19	45.0	1.0	2.7	7.3	1.8	0.7	
20	40.0	1.0	3.0	7.3	1.8	0.7	
21	23.0	1.0	5.2	7.3	2.0	0.6	
22	47.0	2.0	5.1		1.2		
23	62.0	2.0	3.9		2.4		
24	39.0	3.0	9.2	7.3	1.9	0.8	
25	39.0	2.0	6.2	7.3	2.2	0.9	
26	42.0	3.0	8.6	7.3	2.0	0.8	
27	54.0	4.0	8.9		2.1		
28	33.0	2.0	7.3		1.6		
29	41.0	2.0	5.9		1.5		
30	37.0	1.0	3.2		1.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997


AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

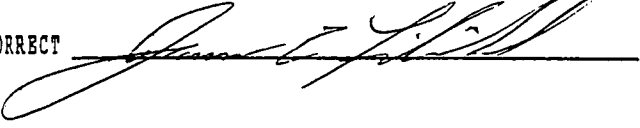

, C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1370.0	-67.0	182.8	170.2	58.1	14.0	
AVERAGE	44.2	2.2	5.9	7.4	1.9	0.6	
MAXIMUM	67.0	3.0	8.2	7.4	2.2	0.8	
MINIMUM	27.0	1.0	2.4	7.4	1.0	0.4	
01	43.0	2.0	5.6	7.4	2.2	0.7	
02	44.0	3.0	8.2	7.4	2.2	0.7	
03	58.0	3.0	6.2	7.4	1.8	0.7	
04	46.0	2.0	5.2		1.8		
05	50.0	1.0	2.4		1.8		
06	39.0	2.0	6.2	7.4	1.7	0.7	
07	34.0	2.0	7.1	7.4	2.2	0.7	
08	43.0	2.0	5.6	7.4	2.2	0.7	
09	54.0	2.0	4.4	7.4	2.2	0.8	
10	46.0	2.0	5.2	7.4	2.2	0.6	
11	43.0	2.0	5.6		2.0		
12	67.0	3.0	5.4		2.2		
13	46.0	3.0	7.8	7.4	2.2	0.6	
14	51.0	2.0	4.7	7.4	2.1	0.5	
15	31.0	2.0	7.7	7.4	2.1	0.7	
16	46.0	3.0	7.8	7.4	1.8	0.6	
17	42.0	2.0	5.7	7.4	1.8	0.5	
18	39.0	2.0	6.2		2.0		
19	44.0	3.0	8.2		1.8		
20	49.0	3.0	7.3	7.4	1.4	0.5	
21	36.0	1.0	3.3	7.4	1.3	0.6	
22	38.0	2.0	6.3	7.4	1.5	0.6	
23	46.0	2.0	5.2	7.4	1.6	0.6	
24	27.0	1.0	4.4	7.4	1.8	0.6	
25	48.0	2.0	5.0		1.8		
26	47.0	2.0	5.1		1.8		
27	51.0	3.0	7.1	7.4	1.0	0.4	
28	42.0	2.0	5.7	7.4	2.0	0.6	
29	44.0	2.0	5.5	7.4	1.8	0.5	
30	39.0	2.0	6.2	7.4	1.8	0.5	
31	37.0	2.0	6.5	7.4	2.0	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160381 C.U.P. NO. 2-031-00...

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.


REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

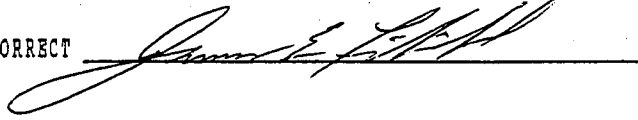I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1632.0	91.0	202.3	155.4	62.5	13.3	
AVERAGE	54.4	3.0	6.7	7.4	2.1	0.6	
MAXIMUM	76.0	8.0	15.7	7.4	2.2	0.7	
MINIMUM	28.0	1.0	3.5	7.4	1.0	0.5	
01	66.0	5.0	9.1		2.2		
02	56.0	4.0	8.6	7.4	2.2	0.6	
03	55.0	4.0	8.7	7.4	2.2	0.6	
04	34.0	2.0	7.1	7.4	2.2	0.7	
05	54.0	6.0	13.3	7.4	2.2	0.7	
06	61.0	8.0	15.7		2.0		
07	60.0	2.0	4.0		2.2		
08	35.0	3.0	10.3	7.4	2.2	0.7	
09	66.0	3.0	5.5	7.4	2.2	0.7	
10	47.0	3.0	7.7	7.4	2.0	0.6	
11	59.0	4.0	8.1	7.4	2.2	0.6	
12	70.0	5.0	8.6	7.4	2.2	0.6	
13	71.0	4.0	6.8		2.1		
14	50.0	2.0	4.8		2.2		
15	63.0	2.0	3.8	7.4	2.2	0.6	
16	45.0	2.0	5.3	7.4	2.2	0.6	
17	76.0	3.0	4.7	7.4	1.0	0.5	
18	59.0	2.0	4.1	7.4	2.2	0.6	
19	70.0	3.0	5.1	7.4	2.2	0.6	
20	68.0	2.0	3.5		2.0		
21	43.0	3.0	8.4		2.0		
22	71.0	3.0	5.1	7.4	2.0	0.6	
23	45.0	2.0	5.3	7.4	2.2	0.6	
24	38.0	2.0	6.3	7.4	2.2	0.7	
25	53.0	2.0	4.5	7.4	2.2	0.7	
26	28.0	1.0	4.3	7.4	2.2	0.7	
27	39.0	2.0	6.2		2.0		
28	53.0	2.0	4.5		2.0		
29	55.0	2.0	4.4	7.4	2.0	0.7	
30	42.0	3.0	8.6	7.4	1.6	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SURVEY

AS ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1561.0	93.0	220.1	155.4	60.4	13.0	
AVERAGE	50.4	3.0	7.1	7.4	1.9	0.6	
MAXIMUM	75.0	6.0	11.4	7.4	2.4	0.8	
MINIMUM	32.0	1.0	3.1	7.4	1.0	0.4	
01	49.0	2.0	4.9	7.4	2.0	0.7	
02	68.0	4.0	7.1		2.0		
03	63.0	6.0	11.4		2.0		
04	59.0	4.0	8.1	7.4	1.7	0.4	
05	44.0	2.0	5.5	7.4	1.8	0.5	
06	61.0	3.0	5.9	7.4	1.7	0.5	
07	40.0	2.0	6.0	7.4	1.7	0.6	
08	32.0	1.0	3.8	7.4	1.8	0.6	
09	51.0	2.0	4.7		1.7		
10	75.0	4.0	6.4		1.7		
11	52.0	2.0	4.6	7.4	1.8	0.7	
12	56.0	2.0	4.3	7.4	1.8	0.6	
13	37.0	2.0	6.5	7.4	1.0	0.4	
14	66.0	5.0	9.1	7.4	2.4	0.6	
15	42.0	2.0	5.7	7.4	2.4	0.7	
16	44.0	3.0	8.2		2.2		
17	46.0	4.0	10.4		1.8		
18	66.0	3.0	5.5	7.4	1.6	0.8	
19	40.0	2.0	6.0	7.4	2.0	0.6	
20	47.0	4.0	10.2	7.4	1.8	0.6	
21	47.0	3.0	7.7	7.4	1.8	0.6	
22	39.0	1.0	3.1	7.4	2.2	0.7	
23	55.0	4.0	8.7		2.0		
24	49.0	4.0	9.8		2.1		
25	60.0	3.0	6.0	7.4	2.2	0.7	
26	48.0	3.0	7.5	7.4	2.2	0.7	
27	37.0	3.0	9.7	7.4	2.0	0.6	
28	58.0	4.0	8.3	7.4	2.2	0.7	
29	49.0	3.0	7.3	7.4	2.2	0.7	
30	41.0	3.0	8.8		2.2		
31	40.0	3.0	9.0		2.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 08-14-97

DR. G. V. TREATMENT PLANT DAILY OPERATIONAL REPORT

PWS ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLAKE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

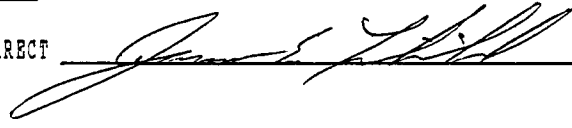

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1580.0	100.0	239.5	161.8	62.9	15.7	
AVERAGE	51.0	3.2	7.7	7.4	2.0	0.7	
MAXIMUM	89.0	5.0	12.0	7.4	2.8	1.4	
MINIMUM	22.0	2.0	4.5	7.3	1.6	0.5	
01	44.0	2.0	5.5	7.4	1.8	0.7	
02	36.0	2.0	6.7	7.4	2.0	0.6	
03	58.0	5.0	10.3	7.4	2.2	0.7	
04	55.0	3.0	6.5		2.2		
05	42.0	3.0	8.6		2.2		
06	48.0	3.0	7.5		2.2		
07	49.0	4.0	9.8	7.4	2.5	0.9	
08	50.0	3.0	7.2	7.3	2.5	1.4	
09	48.0	2.0	5.0	7.3	1.8	0.9	
10	40.0	4.0	12.0	7.3	1.9	0.9	
11	54.0	4.0	8.9	7.3	2.0	0.9	
12	30.0	2.0	8.0		2.0		
13	62.0	3.0	5.8		1.8		
14	50.0	2.0	4.8	7.3	1.8	0.7	
15	53.0	2.0	4.5	7.3	1.9	0.6	
16	48.0	3.0	7.5	7.3	2.8	0.6	
17	52.0	3.0	6.9	7.3	2.2	0.6	
18	45.0	3.0	8.0	7.3	2.0	0.6	
19	41.0	3.0	8.8		2.2		
20	59.0	3.0	6.1		1.9		
21	52.0	3.0	6.9	7.3	1.8	0.5	
22	63.0	5.0	9.5	7.4	2.0	0.7	
23	22.0	2.0	10.9	7.4	2.0	0.6	
24	60.0	5.0	10.0	7.4	1.6	0.6	
25	89.0	4.0	5.4	7.4	2.0	0.7	
26	46.0	4.0	10.4		2.0		
27	60.0	3.0	6.0		2.0		
28	53.0	3.0	6.8	7.4	1.8	0.5	
29	66.0	5.0	9.1	7.4	1.8	0.7	
30	53.0	4.0	9.1	7.4	2.0	0.7	
31	52.0	3.0	6.9	7.4	2.0	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160381 C.U.P. NO. 2-031-0

NAME OF DRINKING WATER SYSTEM: WEST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

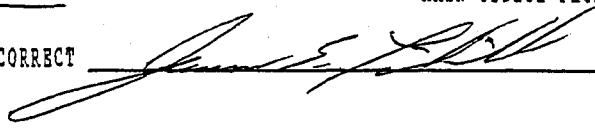

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1304.0	84.0	245.2	155.4	49.6	12.4	
AVERAGE	43.5	2.8	8.2	7.4	1.7	0.6	
MAXIMUM	71.0	5.0	24.0	7.4	2.0	0.8	
MINIMUM	20.0	1.0	3.6	7.4	1.1	0.4	
01	31.0	2.0	7.7		1.8		
02	44.0	2.0	5.5	7.4	1.6	0.5	
03	40.0	3.0	9.0	7.4	1.6	0.7	
04	35.0	2.0	6.9	7.4	1.8	0.7	
05	50.0	2.0	4.8	7.4	1.6	0.6	
06	28.0	1.0	4.3	7.4	1.8	0.7	
07	38.0	3.0	9.5		1.6		
08	59.0	3.0	6.1		1.6		
09	41.0	2.0	5.9	7.4	1.6	0.5	
10	43.0	2.0	5.6	7.4	1.8	0.7	
11	36.0	2.0	6.7	7.4	1.6	0.5	
12	39.0	5.0	15.4	7.4	1.6	0.5	
13	20.0	4.0	24.0	7.4	1.8	0.7	
14	48.0	4.0	10.0		1.8		
15	59.0	3.0	6.1		1.6		
16	41.0	3.0	8.8	7.4	1.8	0.6	
17	39.0	3.0	9.2	7.4	1.7	0.5	
18	40.0	2.0	6.0	7.4	1.4	0.5	
19	51.0	3.0	7.1	7.4	1.1	0.4	
20	37.0	4.0	13.0	7.4	1.6	0.5	
21	56.0	2.0	4.3		1.6		
22	33.0	1.0	3.6		1.7		
23	54.0	4.0	8.9	7.4	1.5	0.6	
24	71.0	3.0	5.1	7.4	1.4	0.7	
25	59.0	3.0	6.1	7.4	1.4	0.8	
26	44.0	3.0	8.2	7.4	1.8	0.6	
27	44.0	2.0	5.5	7.4	2.0	0.6	
28	40.0	2.0	6.0		2.0		
29	46.0	4.0	10.4		1.8		
30	38.0	5.0	15.8	7.4	1.6	0.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

ON: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997


EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

IN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

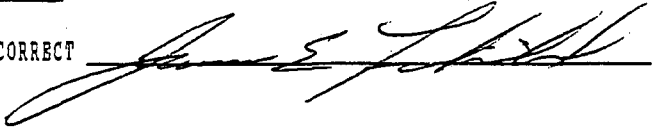

, C.O., CBRT. NO. C-7537

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1578.0	93.0	222.5	199.8	54.5	13.6	
AVERAGE	50.9	3.0	7.2	7.4	1.8	0.6	
MAXIMUM	78.0	5.0	14.1	7.4	2.8	1.1	
MINIMUM	28.0	1.0	2.6	7.4	1.4	0.5	
01	44.0	2.0	5.5	7.4	1.8	0.7	
02	49.0	2.0	4.9	7.4	1.8	0.7	
03	48.0	2.0	5.0	7.4	1.8		
04	55.0	4.0	8.7	7.4	1.8		
05	54.0	4.0	8.9	7.4	1.6	0.6	
06	52.0	4.0	9.2	7.4	1.8	0.8	
07	54.0	3.0	6.7	7.4	1.8	0.6	
08	51.0	4.0	9.4	7.4	1.8	0.7	
09	47.0	1.0	2.6	7.4	2.8	1.1	
10	62.0	3.0	5.8		1.5		
11	77.0	4.0	6.2		1.7		
12	45.0	2.0	5.3	7.4	1.7	0.8	
13	45.0	3.0	8.0	7.4	1.6	0.6	
14	51.0	3.0	7.1	7.4	1.7	0.7	
15	58.0	3.0	6.2	7.4	1.6	0.7	
16	34.0	4.0	14.1	7.4	1.5	0.7	
17	78.0	5.0	7.7		1.7		
18	62.0	3.0	5.8		1.6		
19	59.0	3.0	6.1	7.4	1.6	0.5	
20	62.0	4.0	7.7	7.4	1.5	0.5	
21	42.0	2.0	5.7	7.4	1.4	0.6	
22	47.0	2.0	5.1	7.4	1.8	0.6	
23	62.0	5.0	9.7	7.4	2.0	0.6	
24	45.0	3.0	8.0	7.4	2.2		
25	54.0	3.0	6.7	7.4	2.0		
26	54.0	3.0	6.7	7.4	2.0		
27	41.0	2.0	5.9	7.4	1.8	0.5	
28	32.0	3.0	11.3	7.4	1.4	0.5	
29	28.0	2.0	8.6	7.4	1.4	0.5	
30	42.0	3.0	8.6	7.4	2.0	0.6	
31	44.0	2.0	5.5	7.4	1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 05-05-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160381 C.U.P. NO. 2-031-004

NAME OF DRINKING WATER SYSTEM: FOR BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1454.0	123.0	297.0	162.2	57.5	15.1	
AVERAGE	48.5	4.1	9.9	7.4	1.9	0.7	
MAXIMUM	67.0	9.0	16.2	7.4	2.2	0.8	
MINIMUM	23.0	2.0	4.7	7.3	1.6	0.5	
01	59.0	4.0	8.1	7.4	1.6	0.6	
02	39.0	2.0	6.2	7.3	1.6	0.5	
03	52.0	3.0	6.9	7.3	1.8	0.5	
04	51.0	2.0	4.7	7.4	2.0	0.5	
05	51.0	2.0	4.7		1.8		
06	67.0	9.0	16.1		2.0		
07	59.0	7.0	14.2	7.4	2.0	0.8	
08	46.0	5.0	13.0	7.4	2.2	0.8	
09	56.0	3.0	6.4	7.4	1.8	0.6	
10	58.0	5.0	10.3	7.4	2.2	0.7	
11	53.0	4.0	9.1	7.4	2.2	0.7	
12	42.0	4.0	11.4		2.2		
13	64.0	6.0	11.3		2.2		
14	41.0	5.0	14.6	7.4	2.0	0.8	
15	43.0	4.0	11.2	7.4	1.8	0.8	
16	37.0	3.0	9.7	7.3	1.9	0.7	
17	42.0	4.0	11.4	7.3	1.8	0.8	
18	27.0	2.0	8.9	7.3	1.8	0.6	
19	67.0	6.0	10.7		1.8		
20	52.0	7.0	16.2		1.6		
21	64.0	8.0	15.0	7.3	1.8	0.8	
22	62.0	8.0	15.5	7.4	2.0	0.7	
23	30.0	2.0	8.0	7.4	2.0	0.8	
24	44.0	3.0	8.2	7.4	2.2	0.7	
25	40.0	2.0	6.0	7.4	2.2	0.7	
26	49.0	4.0	9.8		2.0		
27	23.0	2.0	10.4		1.8		
28	41.0	2.0	5.9	7.4	1.6	0.6	
29	61.0	3.0	5.9	7.4	1.8	0.6	
30	34.0	2.0	7.1	7.4	1.8	0.8	

WATER TREATMENT PLANT DAILY OPERATION REPORT

WS ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

PLANT EFFLUENT PH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

_____, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				mg/l	REMOTE TAP	

(MONTHLY

TOTAL	1351.0	80.0	217.9	148.0	50.7	11.7
-------	--------	------	-------	-------	------	------

AVERAGE

	43.6	2.6	7.0	7.4	1.6	0.6
--	------	-----	-----	-----	-----	-----

(MAXIMUM

	64.0	5.0	15.8	7.4	1.8	0.7
--	------	-----	------	-----	-----	-----

(MINIMUM

	19.0	1.0	4.9	7.4	1.2	0.5
--	------	-----	-----	-----	-----	-----

01

	62.0	4.0	7.7		1.4	
--	------	-----	-----	--	-----	--

02

	42.0	2.0	5.7		1.6	
--	------	-----	-----	--	-----	--

03

	48.0	3.0	7.5	7.4	1.6	0.5
--	------	-----	-----	-----	-----	-----

04

	48.0	3.0	7.5	7.4	1.6	0.6
--	------	-----	-----	-----	-----	-----

05

	50.0	3.0	7.2	7.4	1.4	0.6
--	------	-----	-----	-----	-----	-----

06

	41.0	3.0	8.8	7.4	1.6	0.6
--	------	-----	-----	-----	-----	-----

07

	57.0	4.0	8.4	7.4	1.8	0.6
--	------	-----	-----	-----	-----	-----

08

	44.0	3.0	8.2		1.6	
--	------	-----	-----	--	-----	--

09

	55.0	5.0	10.9		1.6	
--	------	-----	------	--	-----	--

10

	46.0	3.0	7.8	7.4	1.8	0.6
--	------	-----	-----	-----	-----	-----

11

	60.0	4.0	8.0	7.4	1.6	0.5
--	------	-----	-----	-----	-----	-----

12

	38.0	5.0	15.8	7.4	1.4	0.5
--	------	-----	------	-----	-----	-----

13

	42.0	2.0	5.7	7.4	1.8	0.6
--	------	-----	-----	-----	-----	-----

14

	24.0	1.0	5.0	7.4	1.8	0.7
--	------	-----	-----	-----	-----	-----

15

	64.0	3.0	5.6		1.8	
--	------	-----	-----	--	-----	--

16

	20.0	1.0	6.0		1.8	
--	------	-----	-----	--	-----	--

17

	49.0	2.0	4.9	7.4	1.7	0.6
--	------	-----	-----	-----	-----	-----

18

	35.0	2.0	6.9	7.4	1.8	0.6
--	------	-----	-----	-----	-----	-----

19

	45.0	2.0	5.3	7.4	1.6	0.5
--	------	-----	-----	-----	-----	-----

20

	39.0	2.0	6.2	7.4	1.8	0.7
--	------	-----	-----	-----	-----	-----

21

	19.0	1.0	6.3	7.4	1.8	0.6
--	------	-----	-----	-----	-----	-----

22

	54.0	3.0	6.7		1.7	
--	------	-----	-----	--	-----	--

23

	46.0	2.0	5.2		1.8	
--	------	-----	-----	--	-----	--

24

	34.0	2.0	7.1	7.4	1.6	0.6
--	------	-----	-----	-----	-----	-----

25

	37.0	2.0	6.5	7.4	1.6	0.5
--	------	-----	-----	-----	-----	-----

26

	41.0	2.0	5.9	7.4	1.5	0.6
--	------	-----	-----	-----	-----	-----

27

	39.0	2.0	6.2	7.4	1.2	0.5
--	------	-----	-----	-----	-----	-----

28

	49.0	3.0	7.3		1.4	
--	------	-----	-----	--	-----	--

29

	45.0	2.0	5.3		1.6	
--	------	-----	-----	--	-----	--

30

	37.0	2.0	6.5		1.6	
--	------	-----	-----	--	-----	--

31

	41.0	2.0	5.9	7.4	1.8	0.7
--	------	-----	-----	-----	-----	-----

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 03-17-97

PWS ID NO. 2160381 C.U.P. NO. 2-031-0046

NAME OF DRINKING WATER SYST POP BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James E. [Signature]*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1121.0	55.0	165.8	175.2	37.8	9.8	
AVERAGE	40.0	2.0	5.9	7.3	1.4	0.5	
MAXIMUM	52.0	4.0	12.6	7.3	1.6	0.6	
MINIMUM	22.0	1.0	2.4	7.3	1.0	0.4	
01	38.0	1.0	3.2	7.3	1.4		
02	51.0	1.0	2.4	7.3	1.5		
03	46.0	2.0	5.2	7.3	1.2	0.5	
04	39.0	2.0	6.2	7.3	1.2	0.5	
05	27.0	1.0	4.4	7.3	1.2	0.5	
06	45.0	2.0	5.3	7.3	1.0	0.4	
07	44.0	2.0	5.5	7.3	1.4	0.5	
08	45.0	2.0	5.3	7.3	1.4		
09	41.0	1.0	2.9	7.3	1.3		
10	47.0	3.0	7.7	7.3	1.4	0.5	
11	40.0	3.0	9.0	7.3	1.3	0.6	
12	29.0	1.0	4.1	7.3	1.4	0.6	
13	46.0	1.0	2.6	7.3	1.2	0.6	
14	22.0	1.0	5.5	7.3	1.2	0.5	
15	45.0	2.0	5.3		1.2		
16	52.0	2.0	4.6		1.4		
17	47.0	3.0	7.7	7.3	1.2		
8	40.0	2.0	6.0	7.3	1.2	0.4	
	47.0	2.0	5.1	7.3	1.4	0.6	
	38.0	4.0	12.6	7.3	1.4	0.5	
	22.0	1.0	5.5	7.3	1.6	0.5	
	40.0	4.0	12.0		1.5		
	49.0	2.0	4.9		1.5		
	35.0	2.0	6.9	7.3	1.6	0.5	
	32.0	1.0	3.8	7.3	1.4	0.5	
	33.0	2.0	7.3	7.3	1.4	0.6	
	50.0	3.0	7.2	7.3	1.5	0.5	
	31.0	2.0	7.7	7.3	1.4	0.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160381 C.U.P. NO. 2-031-0040X

NAME OF DRINKING WATER SYSTEM: WEST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1326.0	90.0	259.4	225.6	53.0	16.3	
AVERAGE	42.8	2.9	8.4	7.3	1.7	0.7	
MAXIMUM	69.0	6.0	19.4	7.3	2.2	1.1	
MINIMUM	28.0	1.0	3.2	7.2	1.4	0.5	
01	56.0	3.0	6.4	7.3	2.0		
02	50.0	2.0	4.8	7.3	1.8	1.0	
03	30.0	3.0	12.0	7.3	1.8	0.8	
04	40.0	4.0	12.0	7.3	2.0		
05	45.0	2.0	5.3	7.3	2.0		
06	35.0	3.0	10.3	7.3	1.7	0.8	
07	52.0	4.0	9.2	7.3	1.8	0.7	
08	28.0	2.0	8.6	7.3	2.0	0.7	
09	39.0	2.0	6.2	7.3	2.0	0.8	
10	49.0	2.0	4.9	7.3	2.0	0.7	
11	43.0	2.0	5.6	7.3	2.0		
12	48.0	3.0	7.5	7.3	1.8		
13	41.0	5.0	14.6	7.2	1.8	1.0	
14	31.0	5.0	19.4	7.2	2.2	1.1	
15	34.0	3.0	10.6	7.2	1.6	0.7	
16	41.0	4.0	11.7	7.2	1.5	0.6	
17	63.0	5.0	9.5	7.3	1.4	0.6	
18	69.0	2.0	3.5	7.3	1.5		
19	63.0	6.0	11.4	7.3	1.6		
20	41.0	3.0	8.8	7.3	1.9	1.0	
21	32.0	2.0	7.5	7.3	1.8	0.8	
22	40.0	3.0	9.0	7.3	1.6	0.7	
23	37.0	1.0	3.2	7.3	1.5	0.5	
24	31.0	2.0	7.7	7.3	1.4	0.6	
25	46.0	3.0	7.8	7.3	1.4		
26	41.0	3.0	8.8	7.3	1.4		
27	46.0	2.0	5.2	7.3	1.5	0.6	
28	40.0	3.0	9.0	7.3	1.5	0.7	
29	37.0	2.0	6.5	7.2	1.6	0.6	
30	40.0	2.0	6.0	7.2	1.5	0.6	
31	38.0	2.0	6.3	7.2	1.4	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy A. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	RENOTE TAP	
MONTHLY TOTAL						4.0	
AVERAGE						0.8	
MAXIMUM						1.0	
MINIMUM						0.6	
01						0.6	
02							
03							
04							
05							
06							
07							Well artesian pressure 0 psi
08						1.0	
09						0.8	
10						1.0	
11						0.6	
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
9							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Jane Z. Kuyse, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						3.7	
AVERAGE						0.5	
MAXIMUM						0.8	
MINIMUM						0.2	
01						0.5	Plant out of service.
02						0.6	
03						0.2	
04							
05							
06							
07							Well artesian pressure 6 psi
08							
09							
10						0.4	
11						0.6	
12							
13							
14							
15							
16							
17							
18							
19						0.8	
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30						0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015M

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy A. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL					4.5		
AVERAGE					0.5		
MAXIMUM					0.6		
MINIMUM					0.3		
01					0.5		
02					0.6		
03					0.5		
04							
05							
06					0.5		
07							Well artesian pressure 0 psi
08							
09					0.5		
10							
11							
12							
13					0.3		
14							
15							
16							
17							
18							
19							
20					0.5		
21					0.6		
22					0.5		
23							
24							
25							
26							
27							
28							
29							
30							
31							

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy A. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						7.6	
AVERAGE						0.5	
MAXIMUM						1.3	
MINIMUM						0.2	
01							Plant out of service.
02						0.4	
03						0.3	
04						1.3	
05							
06							
07							Well artesian pressure 5 psi
08						0.5	
09						0.4	
10						0.5	
11						0.2	
12							
13							
14							
15						0.4	
16							
17							
18						0.8	
19							
20							
21							
22						0.4	
23						0.4	
24						0.5	
25						0.9	
26							
27							
28							
29						0.6	
30							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015W

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL					17.7		
AVERAGE					0.9		
MAXIMUM					3.5		
MINIMUM					0.1		
01					0.3		
02							
03							
04					0.4		
05					3.5		
06					1.5		
07					0.1		Well artesian pressure 5 psi
08					1.2		
09							
10							
11					1.0		
12					0.8		
13					2.0		
14					0.7		
15					0.7		
16							
17							
18					0.5		
19					0.6		
20					0.5		
21					0.8		
22					0.8		
23					1.0		
24					0.4		
25							
26					0.4		
27					0.5		
28							
29							
30							
31							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy G Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						7.1	
AVERAGE						0.5	
MAXIMUM						1.0	
MINIMUM						0.2	
01						0.6	
02						0.6	
03							
04							
05							
06							
07						0.3	Well artesian pressure 5 psi
08						0.4	PLANT OUT OF SERVICE
09							
10							
11							
12							
13							
14						0.6	
15						0.8	
16						0.5	
17						0.2	
18						0.2	
19						0.2	
20						1.0	
21						0.6	
22						0.5	
23						0.6	
24							
25							
26							
27							
28							
29							
30							
31							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton Javeraux

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						11.2	
AVERAGE						0.6	
MAXIMUM						1.0	
MINIMUM						0.0	
01							
02						0.8	
03						0.6	
04						0.5	
05						0.5	
06							
07							Well artesian pressure 5 psi
08							
09						1.0	
10						0.6	
11						0.5	
12						0.7	
13						0.5	
14							
15							
16							
17						0.5	
18						0.5	
19						0.6	
20						0.4	
21						0.0	
22							
23						0.6	
24						0.5	
25						1.0	
26							
27						0.6	
28							
29						0.8	
30							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Deveraux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						17.3	
AVERAGE						0.7	
MAXIMUM						1.9	
MINIMUM						0.2	
01						1.9	WTF is off line , water supplied from Monument RD. WTF
02						0.3	
03							
04							
05						0.3	
06						0.7	
07						0.3	Well artesian pressure 5 psi
08						0.8	
09						0.9	
10						0.4	
11						0.3	
12						0.6	
13						0.5	
14						0.8	
15						0.5	
16						0.6	
17						0.5	
18						0.6	
19						0.5	
20						0.6	
21						0.5	
22						0.2	
23						0.5	
24						0.5	
25						0.4	
26							
27						1.9	
28						0.8	
29						1.4	
30							
31							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy D. Olson*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL					19.1		<i>Plant in standby; all equipment is off line.</i>
AVERAGE					0.7		
MAXIMUM					1.2		
MINIMUM					0.2		
01					1.0		<i>Well artesian pressure 6 psi</i>
02					0.5		
03					0.3		
04					0.2		
05					1.1		
06					0.3		
07					0.6		
08					0.8		
09					1.0		
10					0.6		
11					0.8		
12					0.7		
13					0.6		
14					0.6		
15					1.0		
16					0.6		
17					0.8		
18					0.6		
19					0.7		
20					0.6		
21					0.5		
22					0.8		
23					0.6		
24					1.2		
25					1.0		
26							
27							
28					0.5		
29					0.5		
30					0.6		

DRI WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL					21.3		
AVERAGE					0.8		
MAXIMUM					1.5		
MINIMUM					0.4		
01							
02							
03					1.0		
04					1.2		
05					0.8		
06					1.5		
07					1.4		Well artesian pressure 5 psi
08					0.7		
09					0.5		
10					0.8		
11					1.2		
12					0.8		
13					0.5		
14					0.4		
15					0.5		
16					0.4		
17					1.0		
18					0.8		
19					1.1		
20					0.5		
21					0.5		
22							
23							
24					0.8		
25					1.0		
26					0.8		
27					0.5		
28					0.6		
29					0.6		
30					0.8		
31					0.6		

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015H

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton Devereaux

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						27.0	
AVERAGE						1.3	
MAXIMUM						3.5	
MINIMUM						0.8	
01							
02							
03						1.0	
04						0.8	
05						1.2	
06						3.5	
07						2.0	Well artesian pressure
08						1.7	6 psi
09						1.2	
10						1.0	
11						1.0	
12						1.4	
13						1.5	
14						1.2	
15							
16							
17						1.2	
18						1.0	
19						1.1	
20						1.6	
21							
22						1.4	
23						1.0	
24						1.2	
25						1.0	
26							
27							
28							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015h

NAME OF DRINKING WATER SYST... HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1997

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Deveraux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL					25.3	25.1	
AVERAGE					1.3	1.3	
MAXIMUM					2.5	2.5	
MINIMUM					0.8	0.8	
01					2.4	2.4	PLANT IS OFF LINE
02					1.2	1.2	
03					1.2	1.2	
04					1.4	1.4	
05					1.2	1.2	
06					1.0	1.0	
07							Well artesian pressure 0 psi
08					0.8	0.8	
09							
10							
11							
12							
13					1.0	1.0	
14					1.2	1.2	
15					1.0	1.0	
16					1.2	1.2	
17							
18							
19							
20							
21							
22					1.9	1.9	
23					2.5	2.5	
24					1.9	1.9	
25							
26							
27					0.8	1.0	
28					1.0	0.8	
29					1.2	1.0	
30					1.2	1.2	
31					1.2	1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 01-16-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015H

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1997

PLANT EFFLUENT pH: 7.7 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy S. Perkins

, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	29340.0	1866	237.1	23.2	83.7	2.0		N/A	N/A
AVERAGE	946.5	60	7.6	7.7	2.7	2.0			
MAXIMUM	1192.0	73	8.6	7.9	4.1	2.0			
MINIMUM	761.0	42	5.4	7.6	0.8	2.0			
01	942.0	64	8.1		2.3				
02	954.0	68	8.5		0.8				
03	846.0	57	8.1	7.9	3.0				
04	761.0	53	8.4		3.5				
05	857.0	57	8.0		3.5				
06	878.0	57	7.8		2.1				
07	1067.0	65	7.3		2.6				
08	818.0	55	8.2		3.5				
09	931.0	42	5.4		3.0				
10	1098.0	57	6.2		4.1				
11	839.0	53	7.6		2.5				
12	967.0	64	7.9	7.6	3.9	2.0			
13	847.0	54	7.6		2.6				
14	959.0	60	7.5		2.3				
15	914.0	59	7.7		3.5				
16	922.0	66	8.6		3.3				
17	924.0	62	8.0		3.2				
18	934.0	60	7.7		2.4				
19	1000.0	69	8.3		2.6				
20	957.0	64	8.0		2.0				
21	1008.0	57	6.8		2.2				
22	997.0	65	7.8		2.0				
23	1018.0	69	8.1		2.2				
24	870.0	55	7.6		2.4				
25	881.0	55	7.5		2.4				
26	1005.0	61	7.3		2.9				
27	915.0	56	7.3		2.5				
28	1192.0	73	7.3		3.1				
29	867.0	54	7.5		2.5				
30	1185.0	72	7.3	7.7	2.6				
31	987.0	62	7.5		2.2				

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 12-17-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: 7.6 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James L. Kuyse, C.O., CERT. NO. 18-6752

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	30767.0	2117	248.6	30.4	66.6	2.3	568	N/A	N/A
AVERAGE	1025.6	71	8.3	7.6	2.2	0.6	33	4.0	
MAXIMUM	1301.0	87	10.1	7.6	3.3	0.8	41	4.4	
MINIMUM	816.0	54	7.3	7.6	1.1	0.5	27	3.5	
01	1027.0	74	8.6		3.0		33	3.9	
02	1236.0	87	8.4		2.3		41	4.0	
03	856.0	62	8.7		3.2		29	4.1	
04	1219.0	86	8.5	7.6	2.8	0.5	40	3.9	
05	823.0	62	9.0		3.3		27	4.0	
06	1014.0	77	9.1		2.3		37	4.4	
07	1003.0	70	8.4		2.7		30	3.6	
08	1016.0	71	8.4		1.7		33	3.9	
09	1012.0	71	8.4		1.2		34	4.1	
10	1007.0	72	8.6	7.6	2.6	0.8	33	3.9	
11	1000.0	77	8.5		2.5		36	4.0	
12	943.0	67	8.5		3.0		28	3.5	
13	879.0	65	8.9		3.2		29	4.0	
14	827.0	70	10.1		2.6		30	4.4	
15	1296.0	79	7.3		2.2		39	3.6	
16	996.0	66	7.9		2.0		34	4.0	
17	1026.0	68	7.9		2.2		34	4.0	
18	1114.0	75	8.1	7.6	1.7	0.5			
19	928.0	63	8.1		1.2				
20	1023.0	68	8.0		1.2				
21	919.0	61	8.0		1.1				
22	1092.0	72	7.9		1.8				
23	1301.0	84	7.7		2.3				
24	1017.0	67	7.9		2.2				
25	1105.0	73	7.9	7.6	2.4	0.5			
26	1144.0	71	7.4		2.6				
27	1013.0	70	8.3		1.1				
28	1014.0	67	7.9		2.2				
29	1021.0	68	8.0		2.0				
30	816.0	54	7.9		2.0				

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WS ID NO. 216-0924 C.U.P. NO. 2-031-0015N NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.
 LOCATION: 1258 MONUMENT ROAD JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: October, 1997
 PLANT EFFLUENT pH: 7.7 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT *Randy B. Adams*, C.O., CERT. NO. C-3234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS USED MG/L		TOTAL PHOSPHATE SAMPLE MG/L
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	32806.0	2730	309.7	30.7	97.2	2.0	1103	N/A	N/A
AVERAGE	1058.3	88	10.0	7.7	3.1	1.0	36	4.0	
MAXIMUM	1334.0	112	11.4	7.7	4.5	1.5	45	4.8	
MINIMUM	830.0	63	8.3	7.6	1.9	0.5	29	3.7	
01	1052.0	84	9.6		2.0		37	4.3	
02	1266.0	93	8.8		3.7		42	4.0	
03	1331.0	103	9.3		2.6		45	4.0	
04	894.0	70	9.4		3.5		31	4.1	
05	1068.0	80	9.0		2.5		37	4.1	
06	1185.0	101	10.2	7.6	3.1	0.5	40	4.1	
07	1299.0	110	10.2		3.3		44	4.1	
08	1073.0	93	10.4		3.5		36	4.1	
09	1155.0	100	10.4		3.0		39	4.0	
10	1334.0	112	10.1		2.9		45	4.1	
11	1002.0	84	10.1		3.0		34	4.0	
12	1045.0	88	10.1		2.3		35	4.0	
13	1079.0	89	9.9	7.7	3.5		37	4.1	
14	1095.0	95	10.4		3.0		37	4.0	
15	971.0	85	10.5		3.2		33	4.0	
16	913.0	82	10.8		3.5		30	4.0	
17	873.0	78	10.7		3.5		29	3.9	
18	950.0	80	10.1		3.5		30	3.8	
19	1118.0	93	10.0		3.3		36	3.9	
20	1032.0	88	10.2	7.7	3.4		35	4.1	
21	1113.0	96	10.3		3.5		35	3.8	
22	911.0	63	8.3		3.4		33	4.3	
23	1187.0	102	10.3		2.5		39	3.9	
24	1096.0	104	11.4		3.5		36	3.9	
25	1052.0	90	10.3		3.6		35	4.0	
26	1047.0	90	10.3		2.1		34	3.9	
27	830.0	77	11.1		3.4		34	4.8	
28	1102.0	81	8.8		4.5		34	3.7	
29	832.0	68	9.8	7.7	3.5		29	4.2	
30	990.0	75	9.1		3.0	1.5	32	3.9	
31	911.0	76	10.0		1.9		32	4.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-8924 C.U.P. NO. 2-031-0015H

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1997

PLANT EFFLUENT pH: 7.6 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy S. Adams*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS USED MG/L		TOTAL PHOSPHATE SAMPLE MG/L
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	36663.0	2756	272.0	53.2	78.9	4.3	1226	N/A	N/A
AVERAGE	1222.1	92	9.1	7.6	2.6	1.1	41	4.0	
MAXIMUM	1905.0	130	12.2	7.7	3.5	1.5	56	4.4	
MINIMUM	585.0	42	7.7	7.4	1.9	0.8	18	3.3	
01	1057.0	79	9.0		2.4		36	4.0	
02	585.0	42	8.6		3.0		18	3.7	
03	994.0	75	9.0		2.9		34	4.1	
04	1029.0	80	9.3	7.6	3.5	1.0	34	4.0	
05	1031.0	84	9.8		2.0		34	4.0	
06	1169.0	87	8.9		2.3		37	3.8	
07	1201.0	77	7.7		2.1		40	4.0	
08	1089.0	72	7.9		2.6		37	4.0	
09	1293.0	83	7.7		2.7		44	4.0	
10	1084.0	85	9.4		2.2		37	4.1	
11	1242.0	90	8.7		2.6		42	4.0	
12	1077.0	110	12.2		2.7		37	4.1	
13	1365.0	103	9.0		2.4		47	4.1	
14	1655.0	123	8.9		2.0		56	4.1	
15	1222.0	93	9.1		2.0		42	4.1	
16	1367.0	102	8.9		3.3		47	4.1	
17	1367.0	105	9.2	7.4	2.2		51	4.4	
18	1543.0	111	8.6	7.6	2.8	0.8	49	3.8	
19	1905.0	130	8.2	7.7	1.9		53	3.3	
20	1641.0	124	9.1		2.7		53	3.9	
21	1589.0	115	8.7		2.0		53	4.0	
22	1487.0	111	9.0	7.6	2.6	1.5	52	4.2	
23	1423.0	107	9.0	7.7	2.9		49	4.1	
24	1143.0	87	9.1		3.5		39	4.1	
25	1027.0	80	9.3		3.5		36	4.2	
26	926.0	79	10.2		3.5		32	4.1	
27	1043.0	82	9.4		2.2		36	4.1	
28	1076.0	82	9.1		2.9		36	4.0	
29	974.0	78	9.6	7.6	3.5	1.0	33	4.1	
30	1059.0	80	9.1		2.0		36	4.1	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015K

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.6 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy H. Allen, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE NG/L
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	33725.0	3152	354.9	30.2	90.9	6.7	822	N/A	N/A
AVERAGE	1087.9	102	11.4	7.6	2.9	1.7	27	3.0	
MAXIMUM	1556.0	198	20.7	7.7	4.2	2.5	51	8.0	
MINIMUM	663.0	72	7.3	7.4	1.2	1.2	15	1.9	
01	1171.0	198	20.3		3.5		25	2.5	
02	988.0	143	17.4		3.5		16	2.0	
03	922.0	159	20.7		2.5		15	1.9	
04	1050.0	111	12.7		3.0		17	2.0	
05	1197.0	131	13.1	7.4	3.5	1.5	20	2.0	
06	992.0	100	12.1		1.5		17	2.1	
07	1101.0	115	12.5		3.5		18	2.0	
08	982.0	100	12.2		3.5		17	2.0	
09	1085.0	110	12.2		3.1		18	2.0	
10	1277.0	122	11.5		3.5		21	2.0	
11	1034.0	104	12.1	7.5	3.5	2.5	17	2.0	
12	1108.0	102	11.0		3.5		18	2.0	
13	977.0	82	10.1		3.5		16	2.0	
14	1189.0	72	7.3		2.7		20	2.0	
15	1392.0	101	8.7		1.8		23	2.0	
16	1010.0	80	9.5		1.4		16	1.9	
17	1089.0	85	9.4		1.9		18	2.0	
18	1111.0	87	9.4	7.6	2.9	1.2	18	2.0	
19	1127.0	85	9.0		3.5		37	3.9	
20	1004.0	81	9.7		3.5		34	4.0	
21	1085.0	82	9.1		3.5		36	3.9	
22	1077.0	80	8.9		2.7		35	3.9	
23	1222.0	90	8.8		2.1		41	4.0	
24	1274.0	94	8.8		3.0		42	4.0	
25	989.0	76	9.2	7.7	3.5	1.5	33	4.0	
26	1139.0	86	9.1		3.0		37	3.9	
27	957.0	92	11.5		3.0		35	4.3	
28	1205.0	83	8.3		3.2		41	4.0	
29	1556.0	116	8.9		2.2		51	3.9	
30	752.0	86	13.7		1.2		27	4.2	
31	663.0	99	17.9		4.2		44	8.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

7

SAMPLE DATE: 09-09-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015X

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1997

PLANT EFFLUENT pH: 7.4 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy G. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS USED MG/L		ORTHO-PHOS REMOTE SAMPLE MG/L
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	35579.0	4944	484.6	37.0	81.4	5.6	606	N/A	N/A
AVERAGE	1186.0	159	16.2	7.4	2.6	1.1	20	2.0	
MAXIMUM	1467.0	241	24.8	7.4	3.5	2.0	24	2.5	
MINIMUM	956.0	100	12.0	7.4	0.6	0.4	15	1.7	
01	1070.0	135	15.1		2.7		17	2.0	
02	1101.0	139	15.1	7.4	3.1	0.7	18	1.9	
03	1197.0	120	12.0		1.5		19	1.9	
04	1340.0	135	12.1		0.6		22	2.0	
05	984.0	100	12.2		2.7		16	1.9	
06	1185.0	150	15.2		1.9		20	2.0	
07	974.0	123	15.1	7.4	3.5	0.5	16	1.9	
08	1120.0	143	15.3		3.1		18	1.9	
09	989.0	127	15.4		3.5		16	1.9	
10	1068.0	139	15.6		3.5		17	2.0	
11	1116.0	150	16.1		3.5		17	1.9	
12	1181.0	151	15.3		2.8		20	2.0	
13	1263.0	161	15.3		1.9		21	2.0	
14	1225.0	155	15.2	7.4	2.1	0.4	20	2.0	
15	1359.0	174	15.4		2.0		23	2.0	
16	1323.0	168	15.2		1.5		22	2.0	
17	1401.0	174	14.9		3.0		23	2.0	
18	971.0	126	15.6		3.5		16	1.9	
19	1282.0	160	15.0		2.9		21	2.0	
20	1235.0	157	15.2		3.5		20	2.0	
21	1107.0	142	15.4	7.4	3.5	2.0	18	2.0	
22	1218.0	156	15.4		3.5		20	2.0	
23	1132.0	150	15.9		3.5		20	2.2	
24	1450.0	150	12.4		0.9		24	2.0	
25	1326.0	230	20.8		1.2		22	2.0	
26	1117.0	191	20.5		2.5		18	2.0	
27	1257.0	209	19.9		1.6		20	1.9	
28	1467.0	230	18.8	7.4	3.5	2.0	21	1.7	
29	1165.0	241	24.8		2.3		24	2.5	
30	956.0	195	24.5		3.5		20	2.5	
31		163			2.6		15		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015H

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy A. Adams* , C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE		ORTHO-PHOS REMOTE SAMPLE MG/L
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	31593.0	3782	428.5	29.2	78.9	2.4	516	N/A	N/A
AVERAGE	1053.1	126	14.3	7.3	2.6	0.6	17	2.0	0.12
MAXIMUM	1281.0	180	19.3	7.4	3.8	0.8	23	2.2	0.16
MINIMUM	851.0	85	11.2	7.2	1.0	0.5	14	1.6	0.09
01	1006.0	100	11.9		3.2		16	1.9	0.10
02	1231.0	125	12.2	7.4	2.2	0.6	20	1.9	0.10
03	992.0	100	12.1		3.5		16	2.0	0.10
04	927.0	95	12.3		3.0		14	1.9	0.10
05	917.0	100	13.1		3.5		14	1.9	0.11
06	1054.0	120	13.7		3.8		14	1.6	0.11
07	943.0	110	14.0		2.6		15	1.9	0.12
08	914.0	100	13.1		1.9		16	2.1	0.11
09	1001.0	110	13.2		3.4		15	1.8	0.11
10	1008.0	120	14.3	7.2	3.4	0.8	17	2.0	0.12
11	1111.0	110	11.9		3.3		18	1.9	0.10
12	855.0	85	11.9		2.5		15	2.1	0.10
13	1119.0	180	19.3		3.3		18	1.9	0.16
14	994.0	158	19.1		2.1		16	2.0	0.16
15	918.0	110	14.4		2.5		17	2.2	0.12
16	1088.0	140	15.4		3.4		18	2.0	0.13
17	1096.0	150	16.4		3.4		18	1.9	0.14
18	956.0	130	16.3	7.2	1.5	0.5	15	1.9	0.14
19	851.0	85	12.0		2.0		14	1.9	0.10
20	1138.0	151	15.9		2.5		18	1.9	0.13
21	1218.0	173	17.0		1.0		20	2.0	0.14
22	1122.0	160	17.1		2.0		17	1.8	0.14
23	1250.0	170	16.3		2.7		22	2.1	0.14
24	1242.0	160	15.4		2.6		23	2.2	0.13
25	1281.0	160	15.0		1.5		22	2.0	0.12
26	1062.0	150	16.9		1.7		17	1.9	0.14
27	1267.0	120	11.4		3.4		21	2.0	0.09
28	1179.0	110	11.2		2.3		19	1.9	0.09
29	956.0	100	12.5		2.0		16	2.0	0.10
30	897.0	100	13.4	7.4	2.7	0.5	14	1.9	0.11

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-8924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1997


PLANT EFFLUENT pH: 7.4 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	38319.0	3820	371.0	29.6	87.4	4.7	570	55.9	
AVERAGE	1236.1	123	12.0	7.4	2.8	1.2	18	1.8	
MAXIMUM	1751.0	170	12.6	7.4	3.9	1.9	27	2.0	
MINIMUM	862.0	85	10.2	7.4	0.7	0.5	0	0.0	
01	1414.0	140	11.9		1.9		23	1.9	
02	1280.0	130	12.2		2.2		20	1.9	
03	1336.0	140	12.6		0.7		20	1.8	
04	1368.0	135	11.8		2.8		16	1.4	
05	1256.0	125	11.9		3.4		20	2.0	
06	1323.0	130	11.8	7.4	3.5	0.5	22	2.0	
07	1244.0	125	12.0		3.1		20	1.9	Well artesian pressure
08	1250.0	125	12.0		3.1		20	1.9	
09	1349.0	135	12.0		1.9		0	0.0	
10	1448.0	145	12.0		1.0		0	0.0	
11	1456.0	145	11.9		2.2		24	2.0	
12	981.0	100	12.2		3.5		16	1.9	
13	958.0	95	11.9	7.4	3.5	1.8	16	2.0	
14	939.0	90	11.5		2.7		15	2.0	
15	1290.0	110	10.2		2.7		21	1.9	
16	1447.0	145	12.0		2.1		24	2.0	
17	1520.0	150	11.8		1.9		25	2.0	
18	1409.0	140	11.9		3.2		23	2.0	
19	1113.0	115	12.4		3.5		18	1.9	
20	1315.0	130	11.9		3.5		22	2.0	
21	1301.0	130	12.0		3.3		22	2.0	
22	1284.0	130	12.1	7.4	2.4	0.5	21	2.0	
23	1751.0	170	11.6		3.2		27	1.9	
24	1120.0	115	12.3		2.3		19	2.0	
25	862.0	85	11.8		3.9		14	1.9	
26	1410.0	140	11.9		3.2		23	2.0	
27	985.0	100	12.2	7.4	3.5	1.9	16	1.9	
28	901.0	90	12.0		3.5		15	2.0	
29	1000.0	100	12.0		3.5		16	1.9	
30	956.0	100	12.5		3.0		15	1.9	
31	1053.0	110	12.5		3.2		17	1.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-8924 C.U.P. NO. 2-831-0015N

NAME OF DRINKING WATER SYSTEM. MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.4 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy A. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	33631.0	3360	360.1	22.2	79.4	2.5	429	45.8	
AVERAGE	1121.0	112	12.0	7.4	2.6	0.8	14	1.5	
MAXIMUM	1493.0	150	13.0	7.4	3.8	1.0	24	2.0	
MINIMUM	857.0	90	10.8	7.4	0.8	0.5	0	0.0	
01	1012.0	105	12.4		2.2		16	1.9	
02	1094.0	110	12.1		0.8		17	1.9	
03	1134.0	115	12.2		1.7		18	1.9	
04	1156.0	115	11.9		1.0		19	1.9	
05	1295.0	130	12.0		3.0		20	1.9	
06	1358.0	135	11.9		2.3		22	1.9	
07	1189.0	120	12.1		3.5		19	1.9	Well artesian pressure
08	1268.0	125	11.8		2.8		20	1.9	
09	1130.0	115	12.2		3.5		0	0.0	
10	1116.0	120	12.9		2.9		0	0.0	
11	1115.0	110	11.8		3.8		0	0.0	
12	1207.0	120	11.9		2.3		0	0.0	
13	1308.0	130	11.9		1.5		0	0.0	
14	857.0	90	12.6		3.6		0	0.0	
15	873.0	95	13.0		2.0		14	1.9	
16	1080.0	110	12.2	7.4	3.2	1.0	17	1.9	
17	1113.0	110	11.9		2.6		18	1.9	
18	1218.0	110	10.8		3.2		19	1.9	
19	1363.0	130	11.4		1.4		22	1.9	
20	1493.0	150	12.0		0.8		24	1.9	
21	1219.0	120	11.8		2.9		20	1.9	
22	1308.0	130	11.9	7.4	2.7	1.0	21	2.0	
23	879.0	90	12.3		3.5		14	1.9	
24	1122.0	110	11.8		3.0		18	2.0	
25	898.0	90	12.0		3.3		14	1.9	
26	1075.0	100	11.2		3.5		17	1.9	
27	1011.0	100	11.9		3.5		16	1.9	
28	883.0	90	12.2	7.4	3.5	0.5	14	1.8	
29	954.0	95	11.9		3.5		15	1.9	
30	903.0	90	12.0		1.9		14	1.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

File Copy

ID NO. 216-0924 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy S. Adams*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	32300.0	3297	379.9	29.1	76.4	4.5	503	58.0	
AVERAGE	1041.9	106	12.3	7.3	2.5	1.1	16	1.9	
MAXIMUM	1452.0	145	14.5	7.3	3.5	1.8	23	2.3	
MINIMUM	829.0	85	11.6	7.2	1.2	0.7	12	1.3	
01	1144.0	120	12.6		1.3		17	1.8	
02	1270.0	130	12.3		2.6		20	1.8	
03	1019.0	100	11.8		3.5		16	1.8	
04	1078.0	110	12.2	7.3	3.5	1.0	17	1.8	
05	1139.0	115	12.1		3.5		17	1.8	
06	961.0	100	12.5		3.5		15	1.9	
07	957.0	100	12.5		2.4		15	1.9	Well artesian pressure 0 ps
08	1326.0	135	12.2		2.2		21	1.9	
09	1452.0	145	12.0		1.2		23	1.9	
10	1050.0	105	12.0	7.3	2.6	1.0	17	1.9	
11	1107.0	110	11.9		1.5		17	1.9	
12	1057.0	105	11.9		2.9		17	1.9	
13	940.0	95	12.1		2.4		14	1.8	
14	930.0	93	12.0		3.3		14	1.9	
15	998.0	99	11.9		2.4		16	1.9	
16	1097.0	110	12.0		2.6		17	1.9	
17	992.0	100	12.1	7.3	2.7	0.7	16	1.9	
18	935.0	95	12.2		2.6		14	1.8	
19	1016.0	100	11.8		2.9		17	2.1	
20	859.0	85	11.9		2.4		13	1.8	
21	847.0	85	12.0		2.3		13	1.9	
22	1137.0	110	11.6		2.2		12	1.3	
23	1086.0	120	13.2		1.2		17	1.9	
24	981.0	100	12.2		1.2		14	1.8	
25	933.0	100	12.9	7.2	3.5	1.8	15	2.0	
26	829.0	100	14.5		2.2		13	1.9	
27	1097.0	120	13.1		1.9		17	1.9	
28	1089.0	110	12.1		2.5		18	2.0	
29	977.0	100	12.3		2.2		19	2.3	
30	955.0	95	11.9		2.6		15	1.9	
31	1042.0	105	12.1		2.6		16	1.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 03-19-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015K

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Charles H. Johnson Sr.* , C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS USED MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	26228.0	2701	346.2	29.2	82.9	3.5	401	51.3	
AVERAGE	936.7	96	12.4	7.3	3.0	0.9	14	1.8	
MAXIMUM	1240.0	136	10.4	7.3	4.4	1.0	19	1.9	
MINIMUM	821.0	80	11.4	7.3	1.2	0.7	13	1.8	
01	887.0	136	10.4		3.5		14	1.8	
02	1002.0	100	12.0		2.2		15	1.8	
03	999.0	100	12.0		3.5		15	1.8	
04	889.0	90	12.1		3.5		14	1.8	
05	1021.0	105	12.3		3.5		15	1.8	
06	834.0	85	12.2		2.5		13	1.8	
07	1027.0	105	12.3	7.3	3.5	1.0	16	1.8	Well artesian pressure
08	1015.0	100	11.8		3.5		16	1.9	
09	884.0	90	12.2		2.5		14	1.8	
10	895.0	90	12.0		3.0		14	1.8	
11	981.0	100	12.2		3.5		15	1.8	
12	844.0	90	12.0		3.5		13	1.8	
13	851.0	85	12.0	7.3	2.9	0.8	13	1.8	
14	826.0	80	11.6		3.1		13	1.9	
15	870.0	85	11.7		2.7		13	1.8	
16	1095.0	110	12.0		1.8		16	1.8	
17	876.0	90	12.3		1.2		14	1.9	
18	950.0	100	12.5		4.4		15	1.8	
19	901.0	90	12.0	7.3	3.5	1.0	14	1.8	
20	821.0	85	12.4		3.1		13	1.9	
21	1240.0	130	12.6		2.9		19	1.8	
22	863.0	90	12.5		2.4		13	1.8	
23	891.0	90	12.1		2.6		14	1.8	
24	873.0	90	12.4		3.5		14	1.9	
25	921.0	95	12.4		3.2		15	1.9	
26	842.0	85	12.1		3.0		13	1.8	
27	950.0	95	11.9		3.1		15	1.8	
28	1159.0	110	11.4	7.3	1.3	0.7	18	1.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1997

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy S. Perkins Sr., C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	RENOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	29214.0	3039	384.7	36.0	88.2	4.4	448	57.0	
AVERAGE	942.4	98	12.4	7.2	2.8	0.9	14	1.8	
MAXIMUM	1176.0	171	19.1	7.2	5.0	1.2	18	2.0	
MINIMUM	759.0	75	10.0	7.2	0.9	0.5	11	1.7	
01	937.0	95	12.2		3.5		14	1.9	
02	909.0	90	11.9	7.2	2.4	0.5	14	1.8	
03	970.0	85	10.5		2.5		15	1.8	
04	960.0	80	10.0		1.0		15	1.9	
05	966.0	95	11.8		3.0		15	1.8	
06	799.0	80	12.0		0.9		12	1.9	
07	904.0	90	11.9		1.2		14	1.8	
08	759.0	75	11.8	7.2	2.8	0.7	11	1.7	Well artesian pressure
09	831.0	85	12.3		1.7		13	1.8	
10	840.0	85	12.1		1.7		13	1.8	
11	811.0	80	11.8		2.4		14	2.0	
12	1060.0	105	11.9		3.2		17	1.9	
13	873.0	85	11.7		2.6		13	1.8	
14	869.0	85	11.7		1.0		13	1.8	
15	975.0	95	11.7	7.2	3.5	1.1	15	1.8	
16	824.0	80	11.6		3.5		12	1.8	
17	1176.0	120	12.2		2.8		18	1.8	
18	1135.0	120	12.7		3.5		18	1.9	
19	996.0	100	12.0		3.2		15	1.8	
20	986.0	100	12.2	7.2	2.8	0.9	15	1.8	
21	961.0	95	11.9		3.5		14	1.8	
22	988.0	100	12.1		3.5		15	1.9	
23	959.0	95	11.9		2.7		15	1.9	
24	982.0	100	12.2	7.2	3.5	1.2	14	1.7	
25	864.0	85	11.8		3.0		13	1.8	
26	1021.0	105	12.3		3.5		16	1.8	
27	970.0	100	12.4		3.5		15	1.8	
28	1054.0	168	19.1		3.5		16	1.8	
29	912.0	100	13.1		3.7		14	1.8	
30	841.0	90	12.8		5.0		13	1.8	
31	1082.0	171	18.9		3.6		17	1.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: WEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1997

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy S. Cidemo, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	4191.0	364.0	323.3	15.0	81.2	2.0	171.5	N/A	
AVERAGE	135.2	11.7	10.4	7.5	2.6	1.0	5.5	4.9	0.11
MAXIMUM	161.0	14.0	11.8	7.5	3.2	1.0	6.6	5.4	0.10
MINIMUM	109.0	5.0	4.3	7.5	0.5	1.0	4.6	4.5	0.10
01	119.0	10.0	10.1		1.5		4.8	4.8	
02	133.0	12.0	10.8		1.8		5.3	4.8	
03	129.0	11.0	10.2	7.5	3.0	1.0	5.3	4.9	
04	139.0	12.0	10.4		3.0		5.8	5.0	0.12
05	153.0	13.0	10.2		2.5		6.5	5.1	
06	131.0	11.0	10.1		2.8		5.4	4.9	
07	161.0	14.0	10.4		2.5		6.3	4.7	
08	132.0	12.0	10.9		2.5		5.5	5.0	
09	140.0	13.0	11.1		2.8		5.3	4.5	
10	144.0	13.0	10.8		2.5		5.9	4.9	
11	124.0	12.0	11.6		2.8		5.2	5.0	
12	151.0	13.0	10.3		3.0		6.4	5.1	
13	131.0	11.0	10.1		2.0		5.3	4.9	
14	150.0	13.0	10.4		3.0		6.4	5.1	
15	119.0	11.0	11.1		3.0		4.6	4.6	
16	137.0	13.0	11.4	7.5	3.0	1.0	5.6	4.9	
17	132.0	13.0	11.8		3.2		5.6	5.1	
18	125.0	11.0	10.6		3.0		5.0	4.8	0.10
19	139.0	5.0	4.3		3.2		5.8	5.0	
20	133.0	12.0	10.8		3.0		6.0	5.4	
21	145.0	12.0	9.9		3.2		5.7	4.7	
22	144.0	12.0	10.0		3.0		5.6	4.7	
23	127.0	11.0	10.4		3.2		5.3	5.0	
24	124.0	11.0	10.6		3.0		5.1	4.9	
25	125.0	11.0	10.6		0.5		5.0	4.8	
26	138.0	12.0	10.4		2.3		5.6	4.9	
27	129.0	12.0	11.2		2.1		5.2	4.8	
28	158.0	14.0	10.6		2.1		6.6	5.0	
29	109.0	10.0	11.0		2.5		4.7	5.2	
30	155.0	14.0	10.8		2.7		6.1	4.7	
31	115.0	10.0	10.4		2.5		4.6	4.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 12-02-97

WELL ARTESIAN PRESSURE: 0 psi

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James S. Keys, C.O., CERT. NO. B-6752

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	2358.0	179.0	271.1	22.5	89.7	3.6	87.8	N/A	
AVERAGE	78.6	6.0	9.0	7.5	3.0	0.9	2.9	4.4	0.90
MAXIMUM	125.0	10.0	10.5	7.5	3.5	1.0	5.0	5.7	0.85
MINIMUM	38.0	2.0	6.3	7.5	1.5	0.7	0.8	2.5	0.85
01	90.0	7.0	9.3		3.0		3.5	4.7	
02	125.0	10.0	9.6		1.5		4.9	4.7	
03	49.0	4.0	9.8		1.9		1.6	3.9	
04	56.0	4.0	8.6	7.5	3.0	1.0	2.2	4.6	
05	63.0	5.0	9.5		3.0		2.3	4.3	
06	59.0	4.0	8.1		2.8		1.6	3.3	0.95
07	38.0	3.0	9.5		3.0		1.3	4.0	
08	87.0	7.0	9.6		3.5		3.7	5.0	
09	107.0	9.0	10.1		3.5		4.2	4.7	
10	68.0	5.0	8.8	7.5	3.0	0.9	2.2	3.8	
11	91.0	8.0	10.5		3.0		4.0	5.2	
12	65.0	5.0	9.2		3.0	0.7	2.2	4.0	
13	61.0	4.0	7.9		3.2		1.8	3.6	
14	38.0	2.0	6.3		3.0		0.8	2.5	
15	115.0	7.0	7.3		3.0		4.6	4.8	
16	102.0	8.0	9.4		3.0		4.1	4.8	
17	81.0	6.0	8.9		3.0		2.5	3.7	
18	62.0	5.0	9.7		3.5		2.1	4.0	
19	70.0	6.0	10.3		3.2		2.6	4.5	0.85
20	121.0	10.0	9.9		3.0		5.0	5.0	
21	59.0	4.0	8.1		3.0		1.7	3.5	
22	88.0	7.0	9.5		3.5		3.8	5.1	
23	123.0	9.0	8.8		3.0		4.3	4.2	
24	75.0	5.0	8.0	7.5	3.5	1.0	2.7	4.4	
25	79.0	5.0	7.6		3.2		2.7	4.2	
26	89.0	7.0	9.4		3.0		3.5	4.7	
27	72.0	6.0	10.0		3.0		3.4	5.7	
28	50.0	4.0	9.6		2.6		1.7	4.1	
29	83.0	6.0	8.7		2.8		3.2	4.6	
30	92.0	7.0	9.1		3.0		3.7	4.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3
 WELL ARTESIAN PRESSURE: 0 psi

SAMPLE DATE: 11-06-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-001

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1997

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Charles H. Adams*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	MG/L	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	2304.0	188.0	286.6	30.0	94.5	5.2	89.8	N/A	
AVERAGE	74.3	5.8	9.2	7.5	3.0	1.3	2.9	4.5	0.54
MAXIMUM	117.0	10.0	10.4	7.5	3.5	1.5	5.1	5.5	0.24
MINIMUM	23.0	1.0	4.8	7.5	1.5	1.0	0.4	1.7	0.24
01	80.0	6.0	9.0		3.5		3.2	4.8	
02	88.0	6.0	8.2		3.2		3.4	4.6	
03	117.0	10.0	10.2		3.0		5.1	5.3	0.24
04	89.0	7.0	9.4		3.2		3.5	4.8	
05	99.0	8.0	9.7		3.0		4.3	5.2	
06	51.0	4.0	9.4	7.5	3.0	1.5	2.2	5.1	
07	76.0	6.0	9.5		3.5		2.9	4.5	
08	60.0	5.0	10.0		1.5		2.6	5.3	
09	67.0	5.0	8.9		3.0		2.6	4.7	
10	106.0	8.0	9.0		3.0		4.5	5.0	
11	96.0	8.0	10.0		3.5		4.0	5.0	
12	92.0	8.0	10.4		3.5		3.9	5.1	
13	86.0	7.0	9.8	7.5	3.5	1.0	3.9	5.4	
14	72.0	5.0	8.3		3.5		1.0	1.7	
15	72.0	6.0	10.0		3.5		3.3	5.5	
16	70.0	5.0	8.6		3.5		1.7	2.9	0.85
17	23.0	2.0	10.4	7.5	3.0	1.5	0.5	2.4	
18	65.0	5.0	9.2		2.7		2.7	5.1	
19	111.0	9.0	9.7		3.2		5.0	5.4	
20	52.0	4.0	9.2		3.0		1.9	4.5	
21	77.0	6.0	9.3		3.0		3.4	5.3	
22	67.0	5.0	8.9		3.0		2.6	4.7	
23	74.0	6.0	9.7		2.3		2.7	4.4	
24	74.0	6.0	9.7		2.9		2.5	4.1	
25	79.0	6.0	9.1		2.8		3.5	5.3	
26	112.0	9.0	9.6		2.6		4.5	4.8	
27	55.0	4.0	8.7	7.5	3.5	1.2	1.8	3.9	
28	55.0	4.0	8.7		2.6		1.7	3.7	
29	54.0	4.0	8.9		3.0		2.3	5.1	
30	60.0	5.0	10.0		3.0		2.1	4.1	
31	25.0	1.0	4.8		3.0		0.4	1.7	

ENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1997

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Charles B. Adams*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	3111.0	248.0	298.2	37.6	97.4	8.6	77.3	N/A	
AVERAGE	103.7	8.3	9.9	7.5	3.2	1.7	2.6	3.0	0.39
MAXIMUM	298.0	20.0	21.8	7.6	3.5	3.0	7.1	3.6	0.35
MINIMUM	33.0	4.0	8.0	7.5	2.3	0.9	0.7	2.7	0.35
01	110.0	9.0	9.8		2.5		2.6	2.8	
02	298.0	20.0	8.0		3.0		7.1	2.8	
03	144.0	11.0	9.2		3.2		3.9	3.3	
04	68.0	5.0	8.8		3.5		1.7	2.9	0.43
05	88.0	6.0	8.2	7.6	3.5	1.5	2.1	2.9	
06	117.0	8.0	8.2		3.5		3.5	3.6	
07	94.0	7.0	8.9		3.2		2.3	2.9	
08	98.0	7.0	8.6	7.5	2.3		2.3	2.9	
09	74.0	6.0	9.7		3.5		1.7	2.8	
10	59.0	5.0	10.2		3.0		1.6	3.3	
11	67.0	5.0	8.9		3.5		1.6	2.9	
12	75.0	6.0	9.6		2.9		1.7	2.7	
13	91.0	8.0	10.5		3.2		2.2	2.9	
14	82.0	7.0	10.2		3.5		2.1	3.0	
15	89.0	7.0	9.4	7.5	3.5	1.2	2.3	3.1	
16	60.0	5.0	10.0		3.5		1.4	2.8	
17	95.0	8.0	10.1		3.5		2.5	3.1	
18	172.0	14.0	9.8		3.5		4.3	3.0	0.35
19	161.0	12.0	8.9		3.2		3.7	2.8	
20	134.0	11.0	9.8		3.0		3.4	3.0	
21	166.0	14.0	10.1		2.8		4.2	3.0	
22	129.0	11.0	10.2	7.5	2.6	2.0	3.1	2.9	
23	137.0	11.0	9.6		3.5	0.9	3.5	3.0	
24	56.0	4.0	8.6		3.5		1.3	2.8	
25	93.0	8.0	10.3		3.5		2.4	3.1	
26	33.0	6.0	21.8		3.5		0.7	2.7	
27	93.0	8.0	10.3		3.5		2.2	2.8	
28	112.0	9.0	9.6		3.0		3.0	3.2	
29	59.0	5.0	10.2	7.5	3.5	3.0	1.5	3.0	
30	57.0	5.0	10.5		3.5		1.4	2.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015W

NAME OF DRINKING WATER SYSTEM: QUEEN-AXERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.4 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy S. Adams*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	MG/L	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	2588.0	187.0	275.8	29.7	103.0	8.7	60.9	N/A	
AVERAGE	80.9	6.0	8.9	7.4	3.3	2.2	2.0	2.9	0.42
MAXIMUM	131.0	11.0	10.8	7.5	3.5	3.0	3.4	3.2	0.35
MINIMUM	39.0	3.0	7.4	7.3	2.5	1.9	0.9	2.1	0.35
01	59.0	4.0	8.1		3.5		1.3	2.6	
02	89.0	8.0	10.8		3.5		2.4	3.2	
03	100.0	8.0	9.6		3.0		2.7	3.2	
04	61.0	4.0	7.9		2.8		1.1	2.1	
05	64.0	5.0	9.4	7.3	3.5	3.0	1.7	3.1	
06	96.0	7.0	8.7		3.5		2.3	2.9	
07	67.0	5.0	8.9		3.5		1.7	3.0	
08	70.0	5.0	8.6		3.5		1.7	2.9	0.35
09	104.0	8.0	9.2		3.5		2.4	2.7	
10	126.0	9.0	8.6		3.1		3.0	2.9	
11	87.0	7.0	9.6	7.4	3.5	1.9	2.3	3.1	
12	82.0	6.0	8.8		3.5		2.0	2.9	
13	70.0	5.0	8.6		3.5		1.6	2.7	
14	75.0	6.0	9.6		3.5		1.9	3.0	
15	70.0	5.0	8.6		3.5		1.7	2.9	
16	101.0	8.0	9.5		3.2		2.3	2.8	
17	124.0	9.0	8.7		3.0		3.1	3.0	
18	64.0	5.0	9.4	7.5	3.5	1.9	1.4	2.6	
19	62.0	5.0	9.7		3.5		1.6	3.1	
20	77.0	6.0	9.3		3.5		2.0	3.1	
21	55.0	4.0	8.7		3.5		1.3	2.7	
22	91.0	6.0	7.9		3.5		2.3	3.0	0.49
23	86.0	6.0	8.4		3.5		1.9	2.6	
24	131.0	9.0	8.2		3.5		3.4	3.1	
25	68.0	5.0	8.8	7.5	3.5	1.9	1.5	2.7	
26	60.0	4.0	8.0		3.5		1.6	3.2	
27	65.0	4.0	7.4		3.0		1.6	3.0	
28	43.0	3.0	8.4		2.8		0.9	2.6	
29	93.0	7.0	9.0		2.6		2.2	2.8	
30	39.0	3.0	9.2		2.5		0.9	2.9	
31	129.0	11.0	10.2		3.5		3.4	3.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3
WELL ARRESTAN PRESSURE: 0 psi

SAMPLE DATE: 08-19-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015H

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1997

PLANT EFFLUENT pH: 7.4 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy G. Adams

, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC PHOSPHATE CORROSION CTRL		ORTHO-PROS REMOTE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	2597.0	203.6	294.0	37.0	87.9	5.1	63.5	N/A	
AVERAGE	83.8	6.6	9.5	7.4	2.8	1.0	2.0	3.0	0.38
MAXIMUM	183.0	15.0	14.4	7.4	3.5	1.8	4.5	6.5	0.35
MINIMUM	5.0	0.6	8.4	7.4	0.9	0.5	0.3	2.6	0.35
01	77.0	6.0	9.3		3.0		1.7	2.7	
02	71.0	5.0	8.4	7.4	3.5	1.0	1.6	2.7	
03	128.0	10.0	9.4		1.8		3.3	3.1	
04	93.0	7.0	9.0		2.7		2.1	2.7	
05	77.0	6.0	9.3		2.3		1.9	3.0	
06	131.0	10.0	9.2		3.0		3.1	2.8	
07	91.0	7.0	9.2	7.4	2.0	0.7	2.3	3.1	
08	69.0	5.0	8.7		2.5		1.7	2.9	
09	78.0	6.0	9.2		1.8		1.9	3.0	
10	68.0	5.0	8.8		2.5		1.5	2.6	
11	42.0	3.0	8.6		3.0		1.0	2.9	0.41
12	118.0	10.0	10.2		2.6		2.7	2.8	
13	75.0	6.0	9.6		2.8		1.9	3.1	
14	113.0	9.0	9.5	7.4	3.5	1.1	2.7	2.8	
15	28.0	2.0	8.6		3.0		0.7	2.9	
16	5.0	0.6	14.4		0.9		0.3	6.5	
17	61.0	5.0	9.8		3.0		1.5	2.9	
18	97.0	8.0	9.9		3.5		2.4	3.0	
19	75.0	6.0	9.6		3.5		1.7	2.8	
20	183.0	15.0	9.8		3.5		4.5	2.9	
21	90.0	8.0	10.7	7.4	2.3	0.5	2.4	3.2	
22	52.0	4.0	9.2		2.5		1.3	3.1	
23	75.0	6.0	9.6		3.0		1.6	2.6	
24	70.0	5.0	8.6		2.6		1.8	3.1	
25	102.0	8.0	9.4		2.6		2.7	3.1	0.35
26	97.0	7.0	8.7		3.5		2.3	2.8	
27	85.0	6.0	8.5		3.0		2.1	2.9	
28	86.0	7.0	9.8	7.4	3.5	1.8	2.2	3.1	
29	92.0	7.0	9.1		3.5		2.1	2.8	
30	84.0	7.0	10.0		3.5		2.2	3.1	
31	84.0	7.0	10.0		3.5		2.3	3.3	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: GREEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1997

PLANT EFFLUENT PH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy H. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE		ZINC PHOSPHATE CORROSION CTRL		ORTHO-PHOS REMOTE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	2645.0	201.0	279.9	29.2	86.2	3.4	56.1	N/A	
AVERAGE	88.2	6.7	9.3	7.3	2.9	0.9	2.2	3.0	0.05
MAXIMUM	156.0	11.0	16.2	7.4	3.5	1.0	3.1	5.2	0.05
MINIMUM	37.0	3.0	6.7	7.2	2.4	0.6	0.9	2.3	0.05
01	123.0	9.0	8.8		3.1				
02	73.0	5.0	8.2	7.4	3.5	1.0			
03	70.0	5.0	8.6		3.5				
04	70.0	4.0	6.9		3.0				
05	54.0	3.0	6.7		3.5		1.6	3.6	
06	46.0	3.0	7.8		2.4		0.9	2.3	
07	98.0	6.0	7.3		2.6		2.4	2.9	
08	134.0	10.0	8.9		2.8		3.0	2.7	
09	72.0	5.0	8.3		2.8		2.1	3.5	
10	72.0	5.0	8.3	7.2	2.6	0.6	1.5	2.5	
11	78.0	6.0	9.2		2.8		1.7	2.6	
12	65.0	6.0	11.1		3.5		1.5	2.8	<0.05
13	37.0	5.0	16.2		3.5		1.6	5.2	
14	156.0	9.0	6.9		3.0		3.1	2.4	
15	124.0	8.0	7.7		2.5		3.0	2.9	
16	89.0	7.0	9.4		2.6		2.3	3.1	
17	100.0	8.0	9.6		2.8		2.3	2.8	
18	69.0	6.0	10.4	7.2	2.6	0.8	1.7	3.0	
19	67.0	9.0	16.1		2.4		1.4	2.5	
20	89.0	7.0	9.4		3.5		2.2	3.0	
21	118.0	8.0	8.1		2.5		2.7	2.7	
22	93.0	6.0	7.7		2.5		2.4	3.1	
23	98.0	6.0	7.3		2.6		2.0	2.4	
24	79.0	6.0	9.1		2.8		2.4	3.6	
25	102.0	10.0	11.8		3.0		2.7	3.2	
26	87.0	8.0	11.0		2.6		2.0	2.8	<0.05
27	103.0	7.0	8.1		2.5		2.7	3.1	
28	105.0	11.0	12.6		2.7		2.5	2.9	
29	111.0	8.0	8.6		3.0		2.7	2.9	
30	63.0	5.0	9.5	7.4	3.0	1.0	1.7	3.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 06-03-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1997

PLANT EFFLUENT pH: 7.4 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT _____

Randy S. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2486.0	189.0	285.8	29.6	96.0	4.9	
AVERAGE	80.2	6.1	9.2	7.4	3.1	1.2	
MAXIMUM	148.0	10.0	12.0	7.4	3.5	1.5	
MINIMUM	10.0	1.0	8.1	7.4	2.0	1.0	
01	10.0	1.0	12.0		3.5		
02	101.0	8.0	9.5		3.5		
03	102.0	7.0	8.2		2.8		
04	55.0	4.0	8.7		2.6		
05	91.0	7.0	9.2	7.4	3.5	1.0	
06	66.0	5.0	9.1		3.5		
07	95.0	7.0	8.8		3.4		Well artesian pressure 0 psi
08	79.0	6.0	9.1		3.2		
09	73.0	5.0	8.2		3.5		
10	67.0	5.0	8.9		3.5		
11	80.0	6.0	9.0		3.5		
12	65.0	5.0	9.2		3.5		
13	61.0	5.0	9.8	7.4	2.5	1.0	
14	148.0	10.0	8.1		3.5		
15	74.0	6.0	9.7		2.6		
16	86.0	6.0	8.4		2.8		
17	80.0	6.0	9.0		3.0		
18	67.0	5.0	8.9		3.5		
19	92.0	7.0	9.1	7.4	3.0	1.4	
20	82.0	6.0	8.8		2.9		
21	82.0	6.0	8.8		2.0		
22	78.0	6.0	9.2		2.0		
23	116.0	10.0	10.3		3.0		
24	71.0	7.0	11.8		3.5		
25	82.0	6.0	8.8		2.7		
26	96.0	7.0	8.7		2.7		
27	76.0	6.0	9.5		2.9		
28	66.0	5.0	9.1	7.4	3.5	1.5	
29	90.0	7.0	9.3		3.5		
30	54.0	4.0	8.9		2.9		
31	101.0	8.0	9.5		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: JEEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.4 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy A. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2634.0	223.0	305.1	29.6	83.2	6.1	
AVERAGE	87.8	7.4	10.2	7.4	2.8	1.5	
MAXIMUM	133.0	12.0	13.3	7.4	3.5	2.5	
MINIMUM	54.0	4.0	7.9	7.4	1.0	1.0	
01	89.0	8.0	10.8		2.5		
02	81.0	7.0	10.4		1.0		
03	105.0	9.0	10.3		3.5		
04	99.0	9.0	10.9	7.4	2.3	1.1	
05	118.0	10.0	10.2		2.0		
06	133.0	12.0	10.8		2.3		
07	96.0	8.0	10.0		2.0		Well artesian pressure 0 psi
08	116.0	9.0	9.3		1.5		
09	100.0	8.0	9.6		3.5		
10	82.0	7.0	10.2		3.0		
11	106.0	9.0	10.2		2.6		
12	102.0	9.0	10.6		3.5		
13	105.0	9.0	10.3		2.5		
14	81.0	7.0	10.4		2.7		
15	79.0	6.0	9.1	7.4	3.5	2.5	
16	65.0	5.0	9.2		3.0		
17	65.0	6.0	11.1		3.0		
18	91.0	7.0	9.2		2.5		
19	105.0	9.0	10.3		2.2		
20	74.0	7.0	11.3		2.0		
21	75.0	6.0	9.6	7.4	2.3	1.0	
22	58.0	5.0	10.3		2.5		
23	57.0	5.0	10.5		3.5		
24	54.0	6.0	13.3		2.8		
25	82.0	7.0	10.2		3.5		
26	97.0	8.0	9.9		3.5		
27	121.0	10.0	9.9		3.5		
28	60.0	5.0	10.0	7.4	3.5	1.5	
29	77.0	6.0	9.3		3.5		
30	61.0	4.0	7.9		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-01

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy G. Adams, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2737.0	236.0	321.7	29.1	89.9	4.3	
AVERAGE	88.3	7.6	10.4	7.3	2.9	1.1	
MAXIMUM	123.0	11.0	13.3	7.3	3.5	2.5	
MINIMUM	43.0	4.0	7.7	7.2	1.0	0.5	
01	101.0	9.0	10.7		3.5		
02	109.0	10.0	11.0		3.5		
03	67.0	6.0	10.7		3.5		
04	78.0	7.0	10.8	7.3	3.5	2.5	
05	79.0	7.0	10.6		3.5		
06	80.0	7.0	10.5		3.5		
07	63.0	5.0	9.5		3.0		Well artesian pressure 0 psi
08	104.0	9.0	10.4		3.5		
09	123.0	11.0	10.7		3.5		
10	120.0	10.0	10.0	7.3	3.5	0.8	
11	87.0	8.0	11.0		3.5		
12	85.0	7.0	9.9		3.5		
13	73.0	7.0	11.5		3.5		
14	54.0	6.0	13.3		3.5		
15	109.0	7.0	7.7		3.5		
16	114.0	10.0	10.5		3.0		
17	75.0	6.0	9.6	7.3	2.5	0.5	
18	77.0	7.0	10.9		2.0		
19	78.0	7.0	10.8		1.5		
20	61.0	5.0	9.8		1.0		
21	43.0	4.0	11.2		2.5		
22	118.0	10.0	10.2		2.9		
23	122.0	10.0	9.8		2.7		
24	73.0	6.0	9.9		2.6		
25	63.0	5.0	9.5	7.2	2.5	0.5	
26	80.0	6.0	9.0		2.5		
27	80.0	6.0	9.0		2.0		
28	93.0	8.0	10.3		2.2		
29	113.0	10.0	10.6		2.4		
30	120.0	11.0	11.0		2.8		
31	95.0	9.0	11.4		2.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 03-03-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015.

NAME OF DRINKING WATER SYSTEM... QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1997

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Candy S. Adams Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2600.0	--	179.0	255.8	36.3	80.5	4.8
AVERAGE	83.9		5.8	8.3	7.3	2.6	1.0
MAXIMUM	137.0		10.0	9.5	7.3	3.2	1.5
MINIMUM	52.0		2.0	3.8	7.2	1.0	0.7
01	116.0		8.0	8.3		1.8	
02	65.0		5.0	9.2	7.2	2.5	0.7
03	94.0		7.0	8.9		2.7	
04	108.0		7.0	7.8		3.2	
05	117.0		8.0	8.2		2.4	
06	73.0		5.0	8.2		2.5	
07	76.0		6.0	9.5	7.2	2.8	0.9
08	71.0		5.0	8.4		2.5	
09	69.0		5.0	8.7		2.8	
10	61.0		4.0	7.9		2.5	
11	81.0		6.0	8.9		1.6	
12	97.0		7.0	8.7		2.1	
13	69.0		5.0	8.7	7.3	2.8	0.7
14	72.0		5.0	8.3		2.5	
15	71.0		5.0	8.4		2.9	
16	71.0		5.0	8.4		2.5	
17	52.0		2.0	4.6		2.5	
18	95.0		3.0	3.8		3.0	
19	137.0		10.0	8.8		2.6	
20	100.0		7.0	8.4	7.3	2.8	1.0
21	56.0		4.0	8.6		2.8	
22	81.0		6.0	8.9		3.2	
23	73.0		5.0	8.2		3.0	
24	73.0		5.0	8.2		3.0	
25	100.0		7.0	8.4		3.1	
26	127.0		8.0	7.6	7.3	3.0	1.5
27	72.0		5.0	8.3		3.2	
28	85.0		6.0	8.5		3.0	
29	79.0		6.0	9.1		1.0	
30	67.0		5.0	8.9		2.2	
31	92.0		7.0	9.1		2.0	

Well artesian pressure 0 psi

DRINKING TREATMENT PLANT DAILY OPERATIONAL SUMMA

PWS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Hillland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3537.0	194.0	207.6	153.3	56.2	16.1	
AVERAGE	114.1	6.3	6.7	7.3	1.8	0.8	
MAXIMUM	188.0	12.0	12.9	7.3	2.1	0.9	
MINIMUM	65.0	4.0	4.5	7.3	1.5	0.6	
01	141.0	7.0	6.0	7.3	1.9	0.9	
02	142.0	7.0	5.9	7.3	1.9	0.9	
03	188.0	8.0	5.1	7.3	1.8	0.8	
04	126.0	12.0	11.4	7.3	1.8	0.7	
05	118.0	7.0	7.1	7.3	1.9	0.8	
06	119.0	8.0	8.1		1.8		
07	119.0	7.0	7.1		1.8		
08	101.0	7.0	8.3	7.3	1.8	0.8	
09	138.0	8.0	7.0	7.3	1.8	0.8	
10	128.0	6.0	5.6	7.3	1.8	0.7	
11	65.0	7.0	12.9	7.3	2.1	0.7	
12	107.0	5.0	5.6	7.3	1.9	0.7	
13	123.0	6.0	5.9		2.0		
14	116.0	6.0	6.2		1.9		
15	102.0	8.0	9.4	7.3	1.9	0.8	
16	107.0	4.0	4.5	7.3	1.8	0.8	
17	99.0	6.0	7.3	7.3	1.9	0.8	
18	132.0	6.0	5.5	7.3	1.9	0.8	
19	112.0	5.0	5.4	7.3	1.9	0.9	
20	107.0	5.0	5.6		1.8		
21	101.0	5.0	5.9		1.9		
22	95.0	4.0	5.1	7.3	1.5	0.7	
23	94.0	6.0	7.7	7.3	1.5	0.6	
24	131.0	8.0	7.3	7.3	1.8	0.7	
25	105.0	4.0	4.6		1.5		
26	99.0	5.0	6.1		1.6		
27	113.0	5.0	5.3		1.8		
28	117.0	6.0	6.2		1.8		
29	98.0	4.0	4.9	7.3	1.9	0.8	
30	103.0	6.0	7.0	7.3	1.7	0.7	
31	91.0	6.0	7.9	7.3	1.8	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 12-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160529 C.U.P. NO. 2-031-0035A

NAME OF DRINKING WATER SYSTEM: HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland

, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3938.0	219.0	206.0	131.4	55.6	13.0	
AVERAGE	131.3	7.3	6.9	7.3	1.9	0.7	
MAXIMUM	254.0	11.0	9.0	7.3	2.3	0.9	
MINIMUM	69.0	3.0	2.4	7.3	1.4	0.4	
01	116.0	6.0	6.2		1.8		
02	98.0	6.0	7.3		1.7		
03	158.0	6.0	4.6	7.3	1.8	0.7	
04	132.0	7.0	6.4	7.3	1.8	0.8	
05	254.0	5.0	2.4	7.3	1.8	0.6	
06	112.0	6.0	6.4	7.3	2.0	0.8	
07	69.0	3.0	5.2	7.3	1.8	0.7	
08	175.0	6.0	4.1		1.7		
09	87.0	5.0	6.9		1.7		
10	133.0	6.0	5.4	7.3	1.4	0.4	
11	80.0	6.0	9.0	7.3	1.7	0.6	
12	165.0	10.0	7.3	7.3	1.6	0.6	
13	123.0	7.0	6.8	7.3	1.7	0.6	
14	113.0	6.0	6.4	7.3	1.7	0.8	
15	119.0	8.0	8.1		1.9		
16	92.0	6.0	7.8		2.3		
17	133.0	9.0	8.1	7.3	2.1	0.9	
18	107.0	7.0	7.9	7.3	2.2	0.9	
19	120.0	8.0	8.0	7.3	2.0	0.8	
20	136.0	9.0	7.9	7.3	1.9	0.8	
21	163.0	10.0	7.4	7.3	1.9	0.7	
22	151.0	10.0	7.9		1.6		
23	120.0	8.0	8.0		2.0		
24	131.0	9.0	8.2	7.3	1.8	0.8	
25	160.0	8.0	6.0	7.3	1.8	0.7	
26	147.0	8.0	6.5	7.3	2.1	0.8	
27	126.0	7.0	6.7		2.0		
28	160.0	11.0	8.2		2.0		
29	158.0	10.0	7.6		1.8		
30	100.0	6.0	7.2		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 11-10-97

WWS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: WYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. [Signature], C.O., CERT. NO. C-7255

MAY MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4159.0	251.0	225.1	167.9	52.0	15.9	
AVERAGE	134.2	8.1	7.3	7.3	1.7	0.7	
MAXIMUM	192.0	16.0	14.0	7.3	2.0	0.9	
MINIMUM	96.0	2.0	1.5	7.3	0.8	0.4	
01	144.0	7.0	5.8	7.3	1.8	0.9	
02	135.0	6.0	5.3	7.3	1.5	0.9	
03	128.0	5.0	4.7	7.3	1.7	0.8	
04	96.0	5.0	6.3		1.8		
05	105.0	4.0	4.6		1.6		
06	192.0	3.0	1.9	7.3	1.4	0.6	
07	163.0	2.0	1.5	7.3	1.6	0.5	
08	136.0	9.0	7.9	7.3	0.8	0.4	
09	161.0	13.0	9.7	7.3	1.6	0.7	
10	139.0	11.0	9.5	7.3	1.8	0.6	
11	117.0	8.0	8.2		1.7		
12	139.0	11.0	9.5		1.8		
13	178.0	15.0	10.1	7.3	1.8	0.7	
14	137.0	16.0	14.0	7.3	1.3	0.8	
15	124.0	6.0	5.8	7.3	1.5	0.6	
16	96.0	5.0	6.3	7.3	1.6	0.7	
17	121.0	6.0	6.0	7.3	1.7	0.7	
18	116.0	5.0	5.2		1.7		
19	159.0	11.0	8.3		1.6		
20	124.0	8.0	7.7	7.3	1.8	0.8	
21	128.0	9.0	8.4	7.3	1.8	0.7	
22	164.0	10.0	7.3	7.3	1.8	0.7	
23	136.0	8.0	7.1	7.3	1.6	0.5	
24	102.0	5.0	5.9	7.3	1.8	0.7	
25	130.0	8.0	7.4		2.0		
26	183.0	13.0	8.5		1.8		
27	118.0	11.0	11.2	7.3	1.8	0.8	
28	118.0	7.0	7.1	7.3	1.9	0.8	
29	137.0	8.0	7.0	7.3	1.8	0.6	
30	103.0	9.0	10.5	7.3	1.8	0.7	
31	130.0	7.0	6.5	7.3	1.8	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160529 C.U.P. NO. 2-031-0035n

NAME OF DRINKING WATER SYSTEM: HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l.		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4367.0	304.0	250.4	168.4	55.1	15.7	
AVERAGE	145.6	10.1	8.3	7.3	1.8	0.8	
MAXIMUM	196.0	15.0	11.7	7.4	2.1	1.0	
MINIMUM	87.0	5.0	5.7	7.3	1.6	0.5	
01	169.0	11.0	7.8		1.6		
02	139.0	9.0	7.8	7.3	1.7	0.7	
03	93.0	7.0	9.0	7.3	1.8	0.9	
04	173.0	10.0	6.9	7.3	1.8	0.7	
05	98.0	7.0	8.6	7.3	2.0	1.0	
06	120.0	11.0	11.0		2.0		
07	142.0	9.0	7.6		1.9		
08	169.0	12.0	8.5	7.3	2.0	0.8	
09	140.0	13.0	11.1	7.3	1.8	0.8	
10	196.0	13.0	8.0	7.3	2.1	1.0	
11	155.0	12.0	9.3	7.3	2.0	0.9	
12	156.0	10.0	7.7	7.4	2.0	1.0	
13	105.0	6.0	6.9		1.9		
14	167.0	12.0	8.6		2.1		
15	162.0	11.0	8.1	7.4	1.8	0.8	
16	139.0	10.0	8.6	7.4	1.8	0.7	
17	166.0	10.0	7.2	7.4	2.0	0.7	
18	181.0	12.0	8.0	7.4	1.7	0.5	
19	137.0	11.0	9.6	7.3	1.9	0.8	
20	172.0	12.0	8.4	7.3	1.8		
21	188.0	15.0	9.6	7.3	1.8		
22	112.0	7.0	7.5	7.3	1.7	0.6	
23	190.0	15.0	9.5	7.3	1.7		
24	133.0	13.0	11.7	7.3	1.8	0.8	
25	127.0	11.0	10.4	7.3	1.8	0.8	
26	87.0	5.0	6.9	7.3	1.8	0.9	
27	114.0	6.0	6.3		1.8		
28	168.0	10.0	7.1		1.6		
29	121.0	7.0	6.9	7.3	1.7	0.7	
30	148.0	7.0	5.7	7.3	1.7	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2

SAMPLE DATE: 09-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160529 C.U.P. NO. 2-031-0035H

NAME OF DRINKING WATER SYSTEM: HYDS GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Shilland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4054.0	282.0	261.1	151.2	62.8	20.8	
AVERAGE	130.8	9.1	8.4	7.2	2.0	1.0	
MAXIMUM	186.0	14.0	12.0	7.2	2.2	1.4	
MINIMUM	50.0	5.0	5.8	7.2	1.6	0.7	
01	77.0	5.0	7.8	7.2	1.8	0.9	
02	119.0	8.0	8.1		1.6		
03	170.0	12.0	8.5		2.0		
04	50.0	5.0	12.0	7.2	1.9	0.9	
05	114.0	8.0	8.4	7.2	2.1	1.1	
06	117.0	10.0	10.3	7.2	2.2	1.3	
07	138.0	10.0	8.7	7.2	1.9	1.2	
08	134.0	9.0	8.1	7.2	2.1	1.4	
09	126.0	10.0	9.5		2.2		
10	169.0	10.0	7.1		2.2		
11	123.0	10.0	9.8	7.2	2.0	0.9	
12	125.0	8.0	7.7	7.2	2.2	1.1	
13	104.0	5.0	5.8	7.2	2.2	1.0	
14	167.0	10.0	7.2	7.2	2.1	1.0	
15	124.0	9.0	8.7	7.2	2.2	0.8	
16	113.0	7.0	7.4		2.2		
17	148.0	10.0	8.1		2.0		
18	116.0	8.0	8.3	7.2	2.1	0.9	
19	134.0	9.0	8.1	7.2	2.0	0.7	
20	148.0	9.0	7.3	7.2	2.0	0.9	
21	138.0	9.0	7.8	7.2	1.8	0.9	
22	126.0	8.0	7.6	7.2	2.0	0.8	
23	129.0	10.0	9.3		2.1		
24	170.0	14.0	9.9		2.2		
25	135.0	9.0	8.0	7.2	2.0	0.9	
26	157.0	13.0	9.9	7.2	1.9	1.0	
27	85.0	7.0	9.9	7.2	1.9	1.2	
28	160.0	12.0	9.0	7.2	2.0	1.0	
29	186.0	12.0	7.7	7.2	2.1	0.9	
30	130.0	8.0	7.4		2.0		
31	122.0	8.0	7.9		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 08-13-97

DRINKING TREATMENT PLANT DAILY OPERATIONAL SUMMA

PLANT ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3927.0	293.0	277.8	159.1	60.6	22.8	
AVERAGE	126.7	9.5	9.0	7.2	2.0	1.0	
MAXIMUM	173.0	17.0	13.3	7.3	2.2	1.3	
MINIMUM	77.0	6.0	5.5	7.2	1.8	0.7	
01	153.0	11.0	8.6	7.2	1.8	0.9	
02	138.0	11.0	9.6	7.2	1.8	0.7	
03	101.0	7.0	8.3	7.2	2.0	0.8	
04	153.0	11.0	8.6		2.2		
05	93.0	8.0	10.3		2.2		
06	153.0	17.0	13.3		2.0		
07	77.0	7.0	10.9	7.2	2.0	1.1	
08	172.0	14.0	9.8	7.2	1.9	1.1	
09	87.0	6.0	8.3	7.2	1.8	1.1	
10	169.0	10.0	7.1	7.2	2.0	1.3	
11	98.0	7.0	8.6	7.2	2.1	1.3	
12	105.0	7.0	8.0		2.0		
13	134.0	9.0	8.1		2.1		
14	118.0	8.0	8.1	7.3	2.0	1.2	
15	173.0	8.0	5.5	7.3	2.0	1.0	
16	137.0	9.0	7.9	7.2	1.9	1.0	
17	147.0	12.0	9.8	7.2	2.0	0.9	
18	95.0	6.0	7.6	7.2	1.8	1.0	
19	126.0	12.0	11.4		1.8		
20	77.0	6.0	9.4		2.0		
21	125.0	10.0	9.6	7.3	2.0	1.3	
22	157.0	12.0	9.2	7.3	2.0	1.1	
23	145.0	12.0	9.9	7.3	1.9	1.1	
24	144.0	12.0	10.0	7.3	1.9	1.1	
25	128.0	10.0	9.4	7.3	2.0	1.1	
26	105.0	7.0	8.0		2.0		
27	97.0	6.0	7.4		2.0		
28	146.0	11.0	9.0	7.2	1.8	0.9	
29	129.0	10.0	9.3	7.2	1.8	1.0	
30	96.0	7.0	8.8	7.2	1.8	0.9	
31	149.0	10.0	8.1	7.2	2.0	0.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 07-10-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER SYSTEM ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: WOOD GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Stickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3816.0	251.0	239.5	151.2	59.1	21.9	
AVERAGE	127.2	8.4	8.0	7.2	2.0	1.0	
MAXIMUM	209.0	13.0	12.3	7.2	2.2	1.3	
MINIMUM	62.0	4.0	5.6	7.2	1.5	0.7	
01	143.0	11.0	9.2		2.0		
02	62.0	4.0	7.7	7.2	2.2	1.3	
03	179.0	13.0	8.7	7.2	2.2	1.2	
04	99.0	6.0	7.3	7.2	2.0	1.2	
05	110.0	6.0	6.5	7.2	2.0	1.0	
06	76.0	5.0	7.9	7.2	2.2	1.1	
07	107.0	5.0	5.6		1.6		
08	113.0	7.0	7.4		1.6		
09	127.0	8.0	7.6	7.2	1.9	1.1	
10	138.0	8.0	7.0	7.2	2.1	1.1	
11	126.0	7.0	6.7	7.2	2.1	1.2	
12	122.0	7.0	6.9	7.2	2.2	1.0	
13	80.0	7.0	10.5	7.2	1.9	0.8	
14	143.0	8.0	6.7		2.0		
15	155.0	10.0	7.7		2.2		
16	108.0	7.0	7.8	7.2	2.2	1.3	
17	119.0	8.0	8.1	7.2	1.8	1.0	
18	143.0	9.0	7.6	7.2	1.5	0.8	
19	124.0	8.0	7.7	7.2	1.8	0.7	
20	127.0	9.0	8.5	7.2	2.0	0.9	
21	140.0	11.0	9.4		2.0		
22	124.0	10.0	9.7		2.2		
23	109.0	9.0	9.9	7.2	1.9	0.9	
24	123.0	9.0	8.8	7.2	1.8	1.0	
25	166.0	10.0	7.2	7.2	2.0	1.2	
26	107.0	11.0	12.3	7.2	2.0	1.2	
27	145.0	7.0	5.8	7.2	1.9	1.0	
28	119.0	10.0	10.1		1.8		
29	173.0	9.0	6.2		2.0		
30	209.0	12.0	6.9	7.2	2.0	0.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 06-19-97

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

275 ID NO. 2160529 C.E.P. NO. 2-031-00335 NAME OF DRINKING WATER SYSTEM: C.W. ADAMS WATER TREATMENT PLANT

LOCATION: 6927 HANCOX DRIVE NORR JACKSONVILLE, FLA., DUVAL COUNTY

ORISO BT: UNITED WATER FLORIDA INC. REPORTING MONTH: MAY 1997

PLANT EFFICIENCY PT: 7.2(AVG) NO. OF SERVICES AT END OF MONTH: _____

DESIGNER FIRM: _____ WATER OFFICE: PEOPLE SD7 (904) 725-2455

I CERTIFY THIS REPORT IS CORRECT *Barbara E. DeStefano*, C.O., CERP, NO. C-7255

DATE	POPUL WATER	CELOSITE	EFFLUENT	RESIDUAL CELOSITE	BACTERIOLOGICAL
OF	TREATED IN	GALS. OR	PH	AS/1	NOVI TITRATIONS
MONTH	PROCESSES OF	USE. USED	MG/L	PLANT	AND COMMENTS
	CALCUSE			EFFLUENT	

MONTH	TOTAL	335.0	269.7	165.6	64.6	25.6
AVERAGE	152.2	10.8	8.7	7.2	2.1	1.2
MINIMUM	225.0	19.0	12.7	7.2	2.4	1.5
	73.0	5.0	5.0	7.2	1.6	1.0
01	169.0	9.0	6.4	7.2	2.1	1.3
02	195.0	12.0	7.4	7.2	2.4	1.3
03	174.0	14.0	9.7	7.2	2.4	
04	152.0	12.0	5.5	7.2	2.1	
05	162.0	12.0	8.9	7.2	2.1	1.4
06	196.0	13.0	6.0	7.2	1.9	1.4
07	175.0	12.0	8.2	7.2	2.2	1.5
08	200.0	10.0	6.0	7.2	2.2	1.4
09	167.0	12.0	8.5	7.2	2.0	1.4
10	180.0	12.0	2.0	7.2	2.0	1.3
11	173.0	11.0	7.6	7.2	1.4	
12	99.0	5.0	19.5	7.2	2.2	1.8
13	103.0	8.0	5.3	7.2	2.4	1.2
14	164.0	12.0	8.6	7.2	1.8	1.0
15	127.0	9.0	0.5	7.2	2.4	1.4
16	225.0	18.0	9.6	7.2	2.2	1.1
17	100.0	9.0	10.8	7.2	2.2	
18	127.0	11.0	10.4	7.2	2.2	
19	134.0	10.0	9.0	7.2	2.0	1.3
20	185.0	12.0	7.8	7.2	2.0	1.1
21	165.0	11.0	7.2	7.2	2.1	1.1
22	120.0	8.0	3.9	7.2	2.2	1.0
23	100.0	12.0	6.6	7.2	2.0	1.1
24	196.0	15.0	9.2	7.2	2.2	
25	85.0	5.0	12.7	7.2	2.2	
26	154.0	9.0	7.0	7.2	2.0	1.2
27	166.0	12.0	8.7	7.2	2.0	1.2
28	73.0	6.0	9.9	7.2	2.2	1.2
29	150.0	12.0	3.1	7.2	2.0	1.2
30	95.0	6.0	7.5	7.2	2.0	1.1
31	110.9	8.0	8.7	7.2	2.0	1.1

DRINKING WATER TREATMENT PLANT DAILY-OPERATIONAL SUMMARY

FWS ID NO. 2160529 C.U.P. NO. 2-031-88358
 NAME OF DRINKING WATER SYSTEM: DUVAL WATER TREATMENT PLANT
 LOCATION: 6927 HAYSON DRIVE NORTH JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: April 1997
 PLANT EFFLUENT pH: 7.2(AVG) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2863
 I CERTIFY THIS REPORT IS CORRECT Bruce E. Stille, C.O., CERT. NO. C-7255

DATE OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4380.0	290.0	241.3	7.3	60.1	74.1	
AVERAGE	146.0	9.7	8.0	7.2	2.0	1.1	
MAXIMUM	201.0	14.0	10.9	7.3	2.2	1.4	
MINIMUM	80.0	5.0	3.3	7.2	1.7	0.7	
01	147.0	10.0	8.2	7.2	1.7	0.8	
02	105.0	14.0	9.1	7.2	1.6	0.8	
03	154.0	12.0	9.4	7.2	1.8	0.8	
04	133.0	12.0	10.0	7.2	1.8	0.7	
05	136.0	10.0	8.0	7.2	2.0		
06	132.0	11.0	10.0	7.2	1.8		
07	179.0	10.0	6.7	7.2	1.0	0.9	
08	201.0	12.0	7.2	7.2	1.7	0.9	
09	188.0	12.0	7.7	7.2	2.2	1.3	
10	153.0	10.0	7.9	7.2	2.0	0.9	
11	80.0	7.0	9.5	7.3	2.0	1.0	
12	147.0	10.0	8.2		2.2		
13	153.0	12.0	9.4		2.0		
14	114.0	9.0	9.5	7.2	2.2	1.3	
15	158.0	10.0	7.6	7.2	2.2	1.4	
16	160.0	5.0	3.3	7.2	2.0	1.2	
17	113.0	7.0	7.4	7.2	2.0	1.3	
18	113.0	10.0	10.6	7.2	2.1	1.3	
19	100.0	11.0	7.3		1.9		
20	143.0	9.0	7.6		2.0		
21	154.0	14.0	10.9	7.3	2.0	1.4	
22	148.0	9.0	7.3	7.3	2.0	1.2	
23	160.0	5.0	6.0	7.3	2.0	1.2	
24	119.0	5.0	6.1	7.3	2.2	1.0	
25	136.0	8.0	7.1	7.3	2.2	1.2	
26	130.0	8.0	7.4		2.0		
27	111.0	5.0	5.5		2.0		
28	141.0	9.0	7.7	7.3	2.2	1.0	
29	149.0	9.0	7.2	7.3	2.2	1.2	
30	135.0	8.0	7.1	7.3	2.2	1.3	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-07-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160529 C.U.P. NO. 2-031-0035X NAME OF DRINKING WATER SYSTEM: H208 GROVE WATER TREATMENT PLANT
 LOCATION: 6927 HANSON DRIVE NORTH JACKSONVILLE, FLA., DUVAL COUNTY
 USED BY: UNITED WATER FLORIDA LLC. REPORTING MONTH: March 1997

DATE REPORTED BY: 7.2(AVG) NO. OF SERVICES BY END OF MONTH: _____
 ENGINE NO.: _____ MAIN OFFICE PHONE NO. (904) 725-2865

CHECK THIS REPORT IS CORRECT *Banner E. Strickland* C.O. CERT. NO. C-7233

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE CALS. OR LBS. USED	REDFISH PE	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL AND VIOLATIONS AND COMMENTS
TOTAL	3674.0	260.0	146.0	53.6	19.3
AVERAGE	129.0	8.4	7.2	1.7	1.0
MINIMUM	100.0	5.0	7.2	1.5	0.8
MAXIMUM	180.0	10.0	7.2	1.7	1.1
01	120.0	8.0	7.2	1.6	0.0
02	90.0	8.0	7.2	1.7	1.0
03	155.0	11.0	7.2	1.8	1.2
04	123.0	6.0	7.2	1.8	1.0
05	152.0	8.0	7.2	1.0	1.0
06	163.0	12.0	7.2	1.6	0.9
07	134.0	8.0	7.2	1.9	1.1
08	126.0	7.0	7.2	1.7	0.0
09	155.0	10.0	7.2	1.7	1.0
10	100.0	8.0	7.2	1.0	1.0
11	100.0	15.0	7.2	1.9	1.0
12	120.0	7.0	7.2	1.0	0.9
13	107.0	6.0	7.2	1.0	0.6
14	64.0	6.0	7.2	1.6	0.6
15	146.0	9.0	7.2	1.6	0.0
16	70.0	8.0	7.2	1.5	0.0
17	143.0	10.0	7.2	1.6	0.8
18	137.0	9.0	7.2	1.6	0.9
19	122.0	11.0	7.2	1.8	1.1
20	104.0	8.0	7.2	1.6	1.1
21	107.0	8.0	7.2	1.8	1.2
22	160.0	10.0	7.2	1.8	0.9
23	93.0	5.0	7.2	1.6	0.9
24	121.0	5.0	7.2	1.7	0.9
25	126.0	9.0	7.2	1.6	0.9
26	166.0	7.0	7.2	1.9	1.0
27	107.0	7.0	7.2	1.7	0.8
28	130.0	10.0	7.2	1.8	0.0
29	125.0	6.0	7.2	1.0	0.0
30	102.0	10.0	7.2	1.6	0.0
31	102.0	7.0	7.2	1.7	0.9

PWS ID NO. 2169529 C.U.P. NO. 2-031-00358

NAME OF DRINKING WATER SYSTEM: LAKE ARTHUR WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Littlefield, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3342.0	206.0	208.5	165.6	46.8	20.5	
AVERAGE	119.4	7.4	7.4	7.2	1.7	1.0	
MAXIMUM	257.0	15.0	15.6	7.2	1.6	1.3	
MINIMUM	73.0	2.0	3.0	7.2	1.5	0.8	
01	111.0	4.0	4.3	7.2	1.8		
02	147.0	7.0	5.7	7.2	1.9		
03	79.0	2.0	3.0	7.2	1.6	1.1	
04	100.0	7.0	8.4	7.2	1.5	1.0	
05	100.0	13.0	15.6	7.2	1.5	1.0	
06	152.0	7.0	5.5	7.2	1.7	1.1	
07	105.0	6.0	6.9	7.2	1.8	1.2	
08	119.0	7.0	7.1	7.2	1.6		
09	109.0	8.0	8.8	7.2	1.8		
10	99.0	8.0	9.7	7.2	1.7	1.0	
11	107.0	8.0	9.0	7.2	1.7	1.3	
12	257.0	15.0	7.0	7.2	1.6	1.0	
13	100.0	8.0	8.9	7.2	1.6	0.9	
14	73.0	4.0	6.6	7.2	1.7	0.8	
15	104.0	7.0	8.1		1.6		
16	115.0	7.0	7.3		1.6		
17	85.0	5.0	7.1		1.6	1.0	
18	110.0	5.0	6.1	7.2	1.8	1.0	
19	110.0	8.0	8.1	7.2	1.7	0.9	
20	136.0	10.0	8.8	7.2	1.8	1.2	
21	120.0	6.0	5.6	7.2	1.8		
22	130.0	3.0	8.3		1.8		
23	89.0	6.0	8.1		1.6	1.1	
24	124.0	8.0	7.7	7.2	1.7	1.0	
25	121.0	6.0	6.0	7.2	1.7	1.0	
26	166.0	11.0	8.0	7.2	1.7	1.0	
27	130.0	7.0	6.5	7.2	1.6	1.0	
28	112.0	6.0	6.4	7.2	1.6	0.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 02-20-97

COMMENTS:

AS TO NO. 2168526 C.O.P. NO. 2-031-98351

NAME OF DRINKING WATER SYSTEM: GROVE VALLEY TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTE

JACKSONVILLE, FLA., DUAL COUNTY

USED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

APP REPURPOSE PR: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

STICS FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2855

CERTIFY THIS REPORT IS CORRECT

Banner E. Steinhilber

, G.O., CERT. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT OR	RESIDUAL CHLORINE mg/l	PLANT EFFLUENT	REPORTED	BACTERIOLOGICAL WCL VIOLATIONS AND COMMENTS
TOTAL	3658.0	320.0	233.4	57.2	21.8		
AVERAGE	117.7	7.1	7.3	1.8	1.8		
MINIMUM	196.0	11.0	7.3	2.1	1.3		
MAXIMUM	85.0	4.0	7.2	1.5	0.7		
01	120.0	6.0	7.2	1.8			
02	116.0	6.0	7.2	2.0	0.9		
03	121.0	7.0	7.3	2.0	1.2		
04	112.0	5.0	7.3	1.8			
05	124.0	7.0	7.2	1.8			
06	97.0	5.0	7.2	2.0			
07	97.0	6.0	7.2	2.1	1.1		
08	106.0	7.0	7.2	1.9	1.0		
09	85.0	6.0	7.2	1.9	1.0		
10	115.0	7.0	7.2	1.8	1.0		
11	103.0	6.0	7.2	2.0			
12	110.0	8.0	7.2	2.0			
13	89.0	6.0	7.2	1.9	1.2		
14	115.0	7.0	7.2	1.8	1.2		
15	115.0	8.0	7.2	1.8	1.0		
16	154.0	10.0	7.2	1.8	1.0		
17	130.0	7.0	7.2	1.9	0.8		
18	153.0	11.0	7.2	1.8			
19	139.0	11.0	7.2	1.8			
20	86.0	4.0	7.2	1.8	0.9		
21	102.0	9.0	7.2	1.7	0.8		
22	114.0	5.0	7.2	1.8	0.7		
23	119.0	6.0	7.2	1.8	0.8		
24	116.0	6.0	7.2	1.6	0.7		
25	135.0	7.0	7.2	1.7			
26	111.0	7.0	7.2	1.9			
27	106.0	10.0	7.2	1.9	1.3		
28	111.0	6.0	7.2	1.8	1.0		
29	104.0	6.0	7.2	1.8	1.2		
30	110.0	6.0	7.2	1.7	0.9		
31	92.0	5.0	7.2	1.8	1.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 01-15-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: G FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

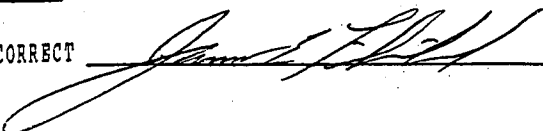

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	1579.0	48.0	85.9	152.7	46.1	13.5	41.2	33.0	0.07	
AVERAGE	131.6	4.4	7.8	7.3	1.5	0.6	4.1	3.3	0.04	
MAXIMUM	388.0	10.0	26.7	7.3	2.2	0.8	9.0	9.5	0.05	
MINIMUM	1.0	1.0	1.7	7.2	1.2	0.5	0.1	1.5	0.02	
01	288.0	4.0	1.7	7.3	1.5	0.6	7.1	3.0		
02	388.0	9.0	2.8	7.3	1.2	0.5	9.0	2.8		
03	305.0	10.0	3.9	7.3	1.8	0.7	7.7	3.0		
04	55.0	4.0	8.7	7.2	2.2	0.8	4.3	9.5	0.05	
05	90.0	3.0	4.0	7.2	1.9	0.7	2.1	2.8		
06	23.0	2.0	10.4		1.7		0.3	1.5		
07	13.0	1.0	9.2		1.8		0.3	2.6		
08	99.0	2.0	2.4	7.2	1.8	0.7	2.4	2.9		
09	298.0	10.0	4.0	7.2	1.7	0.7	7.8	3.2		
10	9.0	2.0	26.7	7.2	1.9	0.8	0.1	1.9		
11				7.2	1.6	0.8				
12				7.3	1.5	0.7				
13					1.5					
14	10.0	1.0	12.0		1.4					
15				7.3	1.4	0.7				
16				7.3	1.2	0.6				
17				7.3	1.5	0.7				
18	1.0			7.3	1.4	0.5			0.02	
19				7.3	1.2	0.5				
20					1.4					
21					1.3					
22				7.3	1.2	0.6				
23				7.3	1.4	0.5				
24				7.3	1.4	0.5				
25					1.2					
26					1.5					
27					1.3					
28					1.4					
29				7.3	1.2	0.7				
30				7.3	1.2	0.6				
31				7.3	1.4	0.6				

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 12-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE	BACTERIOLOGICAL MCL VIOLATION AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	6436.0	-226.0	127.7	131.4	46.9	10.5	166.3	93.1	0.59	
AVERAGE	214.5	7.5	4.3	7.3	1.6	0.6	5.5	3.1	0.30	
MAXIMUM	320.0	15.0	10.0	7.3	1.7	0.7	8.3	4.0	0.32	
MINIMUM	148.0	4.0	2.6	7.3	1.2	0.4	3.5	2.8	0.27	
01	185.0	5.0	3.2		1.6		4.8	3.1		
02	236.0	9.0	4.6		1.7		6.2	3.1		
03	227.0	7.0	3.7	7.3	1.6	0.7	5.9	3.1		
04	212.0	7.0	4.0	7.3	1.6	0.6	5.5	3.1		
05	297.0	9.0	3.6	7.3	1.5	0.6	7.7	3.1		
06	241.0	6.0	3.0	7.3	1.6	0.6	6.2	3.1		
07	213.0	8.0	4.5	7.3	1.6	0.6	5.6	3.2	0.27	
08	163.0	10.0	7.4		1.5		3.9	2.9		
09	231.0	9.0	4.7		1.5		6.0	3.1		
10	187.0	8.0	5.1	7.3	1.5	0.6	4.9	3.1		
11	148.0	5.0	4.1	7.3	1.3	0.7	3.5	2.8		
12	320.0	15.0	5.6	7.3	1.4	0.7	8.3	3.1		
13	242.0	10.0	5.0	7.3	1.4	0.6	6.3	3.1		
14	204.0	7.0	4.1	7.3	1.6	0.5	5.2	3.0		
15	182.0	4.0	2.6		1.6		4.8	3.1		
16	162.0	7.0	5.2		1.6		5.5	4.0		
17	204.0	8.0	4.7	7.3	1.7	0.6	5.3	3.1		
18	281.0	7.0	3.0	7.3	1.6	0.6	7.3	3.1		
19	198.0	5.0	3.0	7.3	1.2	0.4	4.9	3.0	0.32	
20	239.0	7.0	3.5	7.3	1.6	0.5	6.2	3.1		
21	187.0	5.0	3.2	7.3	1.7	0.6	4.9	3.1		
22	212.0	5.0	2.8		1.6		5.0	2.9		
23	247.0	8.0	3.9		1.6		6.3	3.1		
24	178.0	5.0	3.4	7.3	1.7	0.5	4.5	3.0		
25	182.0	6.0	4.0	7.3	1.6	0.6	4.6	3.0		
26	217.0	7.0	3.9	7.3	1.6	0.5	5.9	3.3		
27	253.0	9.0	4.3		1.7		6.2	2.9		
28	211.0	6.0	3.4		1.5		5.5	3.1		
29	197.0	7.0	4.3		1.6		5.0	3.1		
30	180.0	15.0	10.0		1.6		4.8	3.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	7065.0	261.0	136.3	170.2	50.2	13.2	183.1	96.5		
AVERAGE	227.9	8.4	4.4	7.4	1.6	0.6	5.9	3.1		
MAXIMUM	326.0	15.0	6.4	7.4	1.8	0.7	8.3	3.5		
MINIMUM	161.0	4.0	2.9	7.4	1.2	0.4	4.3	2.8		
01	209.0	7.0	4.0	7.4	1.6	0.7	5.3	3.1		
02	228.0	10.0	5.3	7.4	1.6	0.5	6.2	3.2		
03	222.0	9.0	4.9	7.4	1.8	0.7	6.4	3.5		
04	260.0	9.0	4.2		1.7		6.0	2.8		
05	192.0	5.0	3.1		1.7		4.9	3.1		
06	193.0	7.0	4.4	7.4	1.7	0.6	4.9	3.0		
07	249.0	10.0	4.8	7.4	1.6	0.7	6.7	3.2		
08	270.0	10.0	4.4	7.4	1.7	0.7	6.9	3.0		
09	215.0	11.0	6.1	7.4	1.6	0.5	5.6	3.1		
10	215.0	8.0	4.5	7.4	1.6	0.6	5.6	3.1		
11	192.0	5.0	3.1		1.7		4.9	3.1		
12	161.0	4.0	3.0		1.7		4.3	3.2		
13	210.0	5.0	2.9	7.4	1.5	0.5	5.3	3.0		
14	247.0	7.0	3.4	7.4	1.2	0.4	6.4	3.1		
15	244.0	7.0	3.4	7.4	1.3	0.4	6.4	3.2		
16	220.0	9.0	4.9	7.4	1.6	0.6	5.6	3.1		
17	310.0	12.0	4.6	7.4	1.5	0.5	8.3	3.2		
18	220.0	8.0	4.4		1.6		5.6	3.1		
19	218.0	9.0	5.0		1.6		5.7	3.2		
20	239.0	8.0	4.0	7.4	1.7	0.6	6.0	3.0		
21	190.0	8.0	5.1	7.4	1.6	0.6	4.9	3.1		
22	252.0	9.0	4.3	7.4	1.6	0.5	6.6	3.1		
23	176.0	7.0	4.8	7.4	1.7	0.5	4.6	3.2		
24	227.0	7.0	3.7	7.4	1.6	0.6	5.9	3.1		
25	207.0	8.0	4.6		1.8		5.2	3.0		
26	244.0	13.0	6.4		1.6		6.4	3.2		
27	176.0	6.0	4.1	7.4	1.7	0.6	4.6	3.2		
28	326.0	15.0	5.5	7.4	1.6	0.6	8.3	3.0		
29	321.0	13.0	4.9	7.4	1.7	0.7	8.3	3.1		
30	183.0	8.0	5.2	7.4	1.7	0.6	4.9	3.2		
31	249.0	7.0	3.4	7.4	1.6	0.5	6.3	3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 10-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

File Copy

PWS ID NO. 2160565 C.U.P. NO. 2-031-003

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James E. Gill*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE	BACTER MCL VI. AND C
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	8520.0	310.0	134.3	169.8	48.0	12.8	173.3	69.2		
AVERAGE	284.0	10.3	4.5	7.4	1.6	0.6	7.9	3.1		
MAXIMUM	557.0	21.0	6.6	7.4	1.8	0.7	15.0	3.3		
MINIMUM	181.0	5.0	3.0	7.3	1.4	0.4	4.6	3.1		
01	219.0	12.0	6.6		1.8					
02	286.0	10.0	4.2	7.4	1.7	0.6				
03	303.0	12.0	4.8	7.4	1.7	0.7				
04	212.0	9.0	5.1	7.4	1.6	0.5				
05	219.0	8.0	4.4	7.4	1.7	0.6				
06	232.0	9.0	4.7		1.6					
07	222.0	10.0	5.4		1.6					
08	237.0	11.0	5.6	7.4	1.6	0.5				
09	263.0	10.0	4.6	7.3	1.7	0.7	6.7	3.1		
10	212.0	10.0	5.7	7.3	1.6	0.7	5.6	3.2		
11	268.0	7.0	3.1	7.3	1.8	0.6	7.0	3.1		
12	282.0	7.0	3.0	7.3	1.6	0.4	7.3	3.1		
13	250.0	7.0	3.4		1.4		6.6	3.2		
14	288.0	10.0	4.2		1.5		7.6	3.2		
15	267.0	11.0	4.9	7.4	1.5	0.5	7.0	3.1		
16	238.0	9.0	4.5	7.4	1.4	0.5	6.2	3.1		
17	258.0	10.0	4.7	7.4	1.6	0.7	6.7	3.1		
18	244.0	9.0	4.4	7.4	1.6	0.6	6.6	3.2		
19	262.0	10.0	4.6	7.4	1.5	0.6	6.7	3.1		
20	337.0	13.0	4.6	7.4	1.6	0.5	9.0	3.2		
21	445.0	16.0	4.3	7.4	1.6		11.6	3.1		
22	544.0	21.0	4.6	7.4	1.8	0.5	15.0	3.3		
23	557.0	15.0	3.2	7.4	1.6	0.5	14.8	3.2		
24	540.0	14.0	3.1	7.4	1.7	0.6	14.1	3.1		
25	234.0	10.0	5.1	7.4	1.4	0.6	6.3	3.2		
26	187.0	5.0	3.2	7.4	1.6	0.5	4.9	3.1		
27	238.0	8.0	4.0		1.5		6.2	3.1		
28	256.0	10.0	4.7		1.6		6.6	3.1		
29	239.0	10.0	5.0	7.4	1.6	0.7	6.3	3.2		
30	181.0	7.0	4.6	7.4	1.5	0.7	4.6	3.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16241.0	624.0	141.3	153.3	52.0	11.8	
AVERAGE	523.9	20.1	4.6	7.3	1.7	0.6	
MAXIMUM	766.0	33.0	6.0	7.3	2.2	0.8	
MINIMUM	199.0	6.0	2.0	7.3	1.2	0.3	
01	539.0	18.0	4.0	7.3	1.6	0.5	
02	674.0	27.0	4.8		2.0		
03	689.0	33.0	5.7		2.0		
04	561.0	26.0	5.6	7.3	1.8	0.7	
05	582.0	18.0	3.7	7.3	2.2	0.8	
06	665.0	23.0	4.2	7.3	1.8	0.6	
07	499.0	19.0	4.6	7.3	1.7	0.5	
08	513.0	20.0	4.7	7.3	1.7	0.6	
09	523.0	24.0	5.5		1.7		
10	766.0	32.0	5.0		1.7		
11	515.0	22.0	5.1	7.3	1.8	0.7	
12	601.0	10.0	2.0	7.3	1.6	0.5	
13	559.0	18.0	3.9	7.3	1.2	0.5	
14	607.0	20.0	4.0	7.3	1.4	0.4	
15	453.0	17.0	4.5	7.3	1.8	0.7	
16	548.0	23.0	5.0		1.6		
17	548.0	24.0	5.3		1.8		
18	639.0	32.0	6.0	7.3	1.8	0.6	
19	524.0	18.0	4.1	7.3	2.2	0.8	
20	711.0	31.0	5.2	7.3	1.4	0.5	
21	558.0	17.0	3.7	7.3	1.4	0.5	
22	542.0	20.0	4.4	7.3	1.6	0.5	
23	481.0	19.0	4.7		1.8		
24	558.0	21.0	4.5		1.8		
25	684.0	28.0	4.9	7.3	1.2	0.4	
26	560.0	24.0	5.1	7.3	1.4	0.5	
27	199.0	6.0	3.6	7.3	1.2	0.3	
28	252.0	8.0	3.8	7.3	1.6	0.5	
29	275.0	10.0	4.4	7.3	1.8	0.7	
30	217.0	8.0	4.4		1.8		
31	199.0	8.0	4.8		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 08-13-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GARDEN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17740.0	610.0	128.1	162.0	53.0	12.8	
AVERAGE	572.3	19.7	4.1	7.4	1.7	0.6	
MAXIMUM	730.0	37.0	7.2	7.4	2.2	0.8	
MINIMUM	388.0	11.0	2.7	7.3	1.4	0.4	
01	672.0	19.0	3.4	7.4	1.6	0.5	
02	665.0	20.0	3.6	7.4	1.4	0.5	
03	394.0	11.0	3.4	7.4	1.6	0.7	
04	730.0	22.0	3.6		1.6		
05	512.0	18.0	4.2		1.4		
06	588.0	20.0	4.1		1.4		
07	692.0	23.0	4.0	7.4	1.5	0.4	
08	458.0	12.0	3.1	7.4	1.5	0.5	
09	506.0	16.0	3.8	7.4	1.6	0.5	
10	632.0	21.0	4.0	7.4	1.5	0.5	
11	702.0	23.0	3.9	7.4	1.6	0.5	
12	458.0	17.0	4.5		1.6		
13	439.0	19.0	5.2		1.4		
14	710.0	24.0	4.1	7.4	1.5	0.5	
15	619.0	18.0	3.5	7.4	1.5	0.4	
16	493.0	11.0	2.7	7.4	1.6	0.5	
17	657.0	22.0	4.0	7.4	1.6	0.7	
18	447.0	17.0	4.6	7.4	1.5	0.6	
19	540.0	23.0	5.1		1.8		
20	636.0	21.0	4.0		2.0		
21	618.0	37.0	7.2	7.4	2.0	0.7	
22	671.0	19.0	3.4	7.3	2.2	0.8	
23	388.0	12.0	3.7	7.3	2.0	0.8	
24	571.0	21.0	4.4	7.3	2.0	0.7	
25	542.0	14.0	3.1	7.3	2.0	0.7	
26	536.0	23.0	5.1		2.1		
27	601.0	27.0	5.4		2.0		
28	547.0	23.0	5.0	7.3	2.0	0.8	
29	644.0	20.0	3.7	7.3	1.8	0.5	
30	568.0	19.0	4.0	7.3	1.8	0.4	
31	504.0	18.0	4.3	7.3	1.9	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 07-10-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GALT FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

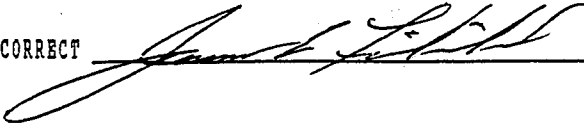

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16499.0	452.0	98.8	155.0	48.0	11.4	
AVERAGE	550.0	15.1	3.3	7.4	1.6	0.5	
MAXIMUM	724.0	25.0	5.0	7.4	2.2	0.7	
MINIMUM	397.0	6.0	1.6	7.2	1.0	0.4	
01	425.0	14.0	4.0		2.2		
02	724.0	11.0	1.8	7.4	2.0	0.6	
03	484.0	12.0	3.0	7.4	1.6	0.6	
04	557.0	16.0	3.4	7.4	2.0	0.7	
05	553.0	16.0	3.5	7.2	1.8	0.6	
06	397.0	11.0	3.3	7.2	1.8	0.5	
07	538.0	17.0	3.8		1.4		
08	706.0	25.0	4.2		1.4		
09	509.0	18.0	4.2	7.4	1.6	0.4	
10	553.0	23.0	5.0	7.4	1.6	0.6	
11	456.0	12.0	3.2	7.4	1.7	0.6	
12	612.0	16.0	3.1	7.4	1.7	0.5	
13	399.0	11.0	3.3	7.4	1.6	0.6	
14	574.0	18.0	3.8		1.9		
15	550.0	17.0	3.7		1.8		
16	608.0	19.0	3.8	7.4	1.7	0.5	
17	536.0	19.0	4.3	7.4	1.8	0.7	
18	608.0	21.0	4.1	7.4	1.2	0.6	
19	552.0	19.0	4.1	7.4	1.4	0.7	
20	552.0	10.0	2.2	7.4	1.4	0.5	
21	617.0	13.0	2.5		1.0		
22	462.0	6.0	1.6		1.6		
23	597.0	11.0	2.2	7.4	1.6	0.4	
24	624.0	11.0	2.1	7.4	1.7	0.4	
25	634.0	15.0	2.8	7.4	1.5	0.5	
26	419.0	10.0	2.9	7.4	1.5	0.5	
27	675.0	20.0	3.6	7.4	1.5	0.5	
28	534.0	15.0	3.4		1.6		
29	518.0	14.0	3.2		1.4		
30	526.0	12.0	2.7	7.4	1.0	0.4	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	11501.0	415.0	88.0	133.2	49.1	10.6	
AVERAGE	575.1	20.8	4.4	7.4	2.5	0.7	
MAXIMUM	766.0	34.0	7.5	7.4	3.2	0.9	
MINIMUM	300.0	10.0	1.6	7.4	2.0	0.6	
01							
02							
03							
04							
05							
06							
07							
08							
09							
10							
11							
12	499.0	16.0	3.8	7.4	2.5	0.8	
13	614.0	27.0	5.3	7.4	2.2	0.6	
14	414.0	26.0	7.5	7.4	2.0	0.8	
15	620.0	33.0	6.4	7.4	3.2	0.8	
16	413.0	10.0	2.9		2.6		
17	752.0	10.0	1.6	7.4	2.4	0.6	
18	726.0	18.0	3.0		2.8		
19	514.0	15.0	3.5	7.4	2.6	0.7	
20	656.0	26.0	4.8	7.4	2.5	0.8	
21	593.0	25.0	5.1	7.4	2.6	0.6	
22	690.0	34.0	5.9	7.4	2.8	0.8	
23	500.0	23.0	5.5	7.4	2.8	0.9	
24	616.0	27.0	5.3	7.4	2.6		
25	565.0	14.0	3.0	7.4	2.0		
26	512.0	16.0	3.8	7.4	2.1	0.6	
27	766.0	23.0	3.6	7.4	2.1	0.6	
28	300.0	12.0	4.8	7.4	2.5	0.6	
29	593.0	20.0	4.0	7.4	2.3	0.7	
30	587.0	21.0	4.3	7.4	2.2	0.7	
31	571.0	19.0	4.0	7.4	2.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James L. Smith*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1972.0	65.0	35.1	65.8	15.3	3.8	
AVERAGE	219.1	7.2	3.9	7.3	1.5	0.5	
MAXIMUM	331.0	15.0	5.4	7.4	1.7	0.6	
MINIMUM	129.0	3.0	1.8	7.3	1.2	0.4	
01	250.0	9.0	4.3	7.3	1.6	0.5	
02	331.0	15.0	5.4	7.3	1.6	0.6	
03	249.0	10.0	4.8	7.3	1.7	0.6	
04	180.0	8.0	5.3	7.3	1.6	0.6	
05	129.0	5.0	4.7	7.3	1.6		
06	219.0	6.0	3.3		1.6		
07	267.0	4.0	1.8		1.5	0.6	
08	200.0	5.0	3.0	7.3	1.2	0.5	
09	147.0	3.0	2.4	7.3	1.4	0.4	
10				7.3	1.5		
11				7.4			
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 04-10-97

COMMENTS: Plant off line 4/10 - 4/30/97 for painting. Water provided by grid facilities

DRINKING-WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.


REPORTING MONTH: March 1997

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

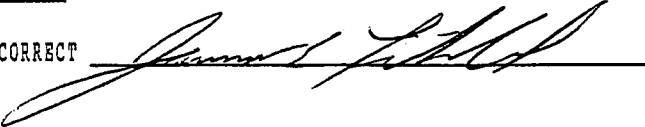CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8066.0	243.0	112.7	146.0	46.8	10.8	
AVERAGE	260.2	7.8	3.6	7.3	1.5	0.5	
MAXIMUM	560.0	19.0	5.0	7.3	1.8	0.7	
MINIMUM	119.0	4.0	2.4	7.3	1.2	0.4	
01	141.0	5.0	4.3		1.5		
02	190.0	5.0	3.2		1.4		
03	280.0	9.0	3.9	7.3	1.2	0.5	
04	201.0	7.0	4.2	7.3	1.4	0.4	
05	238.0	6.0	3.0	7.3	1.4	0.4	
06	289.0	9.0	3.7	7.3	1.4	0.4	
07	297.0	10.0	4.0	7.3	1.5	0.5	
08	119.0	5.0	5.0		1.3		
09	206.0	5.0	2.9		1.5		
10	206.0	8.0	4.7	7.3	1.2	0.4	
11	321.0	9.0	3.4	7.3	1.4	0.4	
12	210.0	6.0	3.4	7.3	1.4	0.6	
13	303.0	12.0	4.8	7.3	1.6	0.6	
14	218.0	6.0	3.3	7.3	1.6	0.5	
15	560.0	19.0	4.1		1.6		
16	120.0	4.0	4.0		1.6		
17	273.0	10.0	4.4	7.3	1.8	0.7	
18	318.0	12.0	4.5	7.3	1.6	0.5	
19	276.0	6.0	2.6	7.3	1.5	0.6	
20	324.0	12.0	4.4	7.3	1.5	0.6	
21	232.0	5.0	2.6	7.3	1.5	0.6	
22	170.0	5.0	3.5		1.4		
23	306.0	6.0	2.4		1.5		
24	326.0	7.0	2.6	7.3	1.5	0.7	
25	245.0	7.0	3.4	7.3	1.6	0.5	
26	402.0	10.0	3.0	7.3	1.6	0.6	
27	293.0	10.0	4.1	7.3	1.8	0.7	
28	304.0	8.0	3.2		1.8		
29	173.0	5.0	3.5		1.6		
30	183.0	5.0	3.3		1.6		
31	342.0	10.0	3.5	7.3	1.5	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 03-12-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

LOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I HEREBY CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
	8137.0	268.0	108.9	185.0	42.1	9.9	
B	290.6	9.6	3.9	7.4	1.5	0.5	
M	480.0	17.0	5.0	7.4	1.8	0.7	
N	187.0	4.0	2.6	7.4	1.3	0.4	
01	262.0	6.0	2.7	7.4	1.4		
02	480.0	17.0	4.3	7.4	1.5		
03	187.0	4.0	2.6	7.4	1.4	0.4	
04	358.0	14.0	4.7	7.4	1.5	0.6	
05	202.0	5.0	3.0	7.4	1.5	0.4	
06	275.0	9.0	3.9	7.4	1.3	0.4	
07	268.0	7.0	3.1	7.4	1.6	0.6	
08	295.0	10.0	4.1	7.4	1.5		
09	250.0	8.0	3.8	7.4	1.6		
10	295.0	9.0	3.7	7.4	1.4	0.7	
11	287.0	9.0	3.8	7.4	1.4	0.5	
12	269.0	10.0	4.5	7.4	1.5	0.6	
13	266.0	11.0	5.0	7.4	1.4	0.6	
14	192.0	6.0	3.8	7.4	1.4	0.5	
15	358.0	12.0	4.0		1.8		
16	418.0	14.0	4.0	7.4	1.7		
17	293.0	7.0	2.9	7.4	1.8		
18	362.0	11.0	3.6	7.4	1.6	0.4	
19	266.0	11.0	5.0	7.4	1.6	0.6	
20	252.0	6.0	2.9	7.4	1.5	0.6	
21	342.0	14.0	4.9	7.4	1.4	0.5	
22	233.0	7.0	3.6		1.4		
23	349.0	13.0	4.5		1.4		
24	282.0	10.0	4.3	7.4	1.5	0.5	
25	235.0	9.0	4.6	7.4	1.5	0.5	
26	345.0	13.0	4.5	7.4	1.5	0.5	
27	245.0	7.0	3.4	7.4	1.6	0.4	
28	271.0	9.0	4.0	7.4	1.4	0.6	

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8498.0	269.0	116.2	228.0	48.6	14.9	
AVERAGE	274.1	8.7	3.7	7.4	1.6	0.7	
MAXIMUM	443.0	15.0	5.9	7.4	2.0	1.2	
MINIMUM	184.0	4.0	2.4	7.3	1.4	0.4	
01	369.0	12.0	3.9	7.4	1.8		
02	213.0	7.0	3.9	7.4	2.0	1.2	
03	294.0	8.0	3.3	7.4	1.7	1.0	
04	275.0	9.0	3.9	7.4	1.8		
05	308.0	10.0	3.9	7.4	1.8		
06	211.0	7.0	4.0	7.4	1.6	0.7	
07	239.0	9.0	4.5	7.4	1.6	0.5	
08	211.0	9.0	5.1	7.4	1.4	0.6	
09	217.0	6.0	3.3	7.4	1.5	0.6	
10	247.0	7.0	3.4	7.4	1.7	0.5	
11	298.0	10.0	4.0	7.4	1.6		
12	292.0	12.0	4.9	7.4	1.6		
13	255.0	5.0	2.4	7.4	1.4	0.6	
14	184.0	4.0	2.6	7.4	1.4	0.5	
15	257.0	7.0	3.3	7.4	1.5	0.4	
16	324.0	10.0	3.7	7.4	1.6	0.7	
17	238.0	6.0	3.0	7.4	1.6	0.5	
18	375.0	11.0	3.5	7.3	1.5		
19	443.0	15.0	4.1	7.3	1.5		
20	198.0	6.0	3.6	7.3	1.6	0.8	
21	217.0	7.0	3.9	7.3	1.6	0.9	
22	330.0	9.0	3.3	7.3	1.4	0.6	
23	306.0	15.0	5.9	7.3	1.5	0.7	
24	197.0	5.0	3.0	7.3	1.5	0.6	
25	366.0	13.0	4.3	7.3	1.5		
26	358.0	13.0	4.4	7.3	1.6		
27	288.0	10.0	4.2	7.3	1.4	0.8	
28	292.0	10.0	4.1	7.3	1.6	0.8	
29	244.0	7.0	3.4	7.3	1.4	0.7	
30	203.0	5.0	3.0	7.3	1.4	0.5	
31	249.0	5.0	2.4	7.3	1.5	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 01-23-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	POLYPHOSPHATE LBS	mg/l		
MONTHLY TOTAL	9028.0	531.0	219.3	154.7	59.4	14.1	194.1	80.0	8.28	
AVERAGE	291.2	17.1	7.1	7.4	1.9	0.7	6.3	2.6	4.14	
MAXIMUM	417.0	30.0	14.2	7.4	2.2	0.8	8.9	2.7	8.25	
MINIMUM	205.0	5.0	2.5	7.3	1.7	0.6	4.6	2.5	0.03	
01	301.0	15.0	6.0	7.4	1.8	0.6	6.6	2.6		
02	249.0	13.0	6.3	7.4	1.7	0.6	5.5	2.7		
03	274.0	15.0	6.6	7.4	1.7	0.8	5.9	2.6		
04	263.0	18.0	8.2	7.4	1.8	0.7	5.7	2.6	8.25	
05	314.0	24.0	9.2	7.4	1.8	0.6	6.8	2.6		
06	317.0	20.0	7.6		2.0		6.8	2.6		
07	272.0	15.0	6.6		1.8		6.1	2.7		
08	364.0	28.0	9.2	7.4	2.0	0.7	8.0	2.6		
09	248.0	16.0	7.7	7.4	1.7	0.6	5.3	2.6		
10	246.0	16.0	7.8	7.4	1.8	0.6	5.3	2.6		
11	291.0	14.0	5.8	7.4	2.2	0.6	6.2	2.5		
12	205.0	9.0	5.3	7.4	2.2	0.6	4.7	2.7		
13	417.0	14.0	4.0		2.0		8.9	2.6		
14	246.0	22.0	10.7		2.1		5.4	2.6		
15	274.0	19.0	8.3	7.4	2.0	0.7	5.8	2.5		
16	286.0	6.0	2.5	7.4	2.0	0.6	6.1	2.6		
17	315.0	13.0	5.0	7.4	1.7	0.6	6.8	2.6		
18	218.0	8.0	4.4	7.4	1.8	0.8	4.6	2.5	0.03	
19	365.0	26.0	8.5	7.3	1.8	0.7	7.9	2.6		
20	315.0	22.0	8.4		2.0		6.7	2.5		
21	275.0	18.0	7.9		2.1		5.9	2.6		
22	254.0	30.0	14.2	7.3	2.0	0.8	5.5	2.6		
23	267.0	18.0	8.1	7.3	2.2	0.7	5.6	2.5		
24	330.0	20.0	7.3	7.3	2.1	0.8	7.1	2.6		
25	321.0	12.0	4.5		2.0		6.8	2.5		
26	238.0	5.0	2.5		1.8		5.0	2.5		
27	313.0	16.0	6.1		1.8		6.6	2.5		
28	362.0	21.0	7.0		1.9		7.7	2.6		
29	270.0	20.0	8.9	7.3	1.8	0.7	5.8	2.6		
30	301.0	20.0	8.0	7.3	1.8	0.6	6.4	2.5		
31	317.0	18.0	6.8	7.3	2.0	0.7	6.7	2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	8943.0	475.0	191.9	132.6	56.5	11.3	192.2	77.2	0.19	
AVERAGE	298.1	15.8	6.4	7.4	1.9	0.6	6.4	2.6	0.10	
MAXIMUM	427.0	27.0	9.9	7.4	2.4	0.8	9.5	2.7	0.14	
MINIMUM	167.0	6.0	3.0	7.3	1.0	0.4	2.5	1.8	0.05	
01	305.0	22.0	8.7		1.8		6.8	2.7		
02	329.0	20.0	7.3		1.8		7.2	2.6		
03	182.0	10.0	6.6	7.4	2.0	0.8	4.1	2.7		
04	348.0	22.0	7.6	7.4	1.9	0.8	7.7	2.7		
05	317.0	21.0	7.9	7.4	1.8	0.6	7.2	2.7		
06	284.0	21.0	8.9	7.4	2.0	0.7	6.2	2.6		
07	167.0	10.0	7.2	7.4	1.9	0.7	2.5	1.8	0.14	
08	260.0	11.0	5.1		1.9		5.8	2.7		
09	423.0	20.0	5.7		1.8		9.4	2.7		
10	303.0	15.0	5.9	7.4	2.0	0.7	6.7	2.6		
11	202.0	10.0	5.9	7.4	2.0	0.6	4.5	2.7		
12	342.0	25.0	8.8	7.4	2.0	0.6	6.7	2.3		
13	264.0	15.0	6.8	7.4	2.2	0.7	5.9	2.7		
14	333.0	10.0	3.6	7.4	1.9	0.6	7.2	2.6		
15	312.0	14.0	5.4		2.4		7.0	2.7		
16	243.0	6.0	3.0		2.3		5.3	2.6		
17	297.0	17.0	6.9	7.4	1.6	0.5	6.6	2.7		
18	314.0	13.0	5.0	7.4	1.8	0.5	6.8	2.6		
19	320.0	15.0	5.6	7.3	1.8	0.6	4.9	1.8	< 0.05	
20	372.0	24.0	7.7	7.3	2.0	0.5	8.2	2.6		
21	178.0	10.0	6.7	7.3	2.2	0.7	4.0	2.7		
22	320.0	8.0	3.0		1.8		6.9	2.6		
23	427.0	15.0	4.2		1.6		9.5	2.7		
24	297.0	8.0	3.2	7.3	1.6	0.6	6.7	2.7		
25	327.0	14.0	5.1	7.3	1.0	0.4	6.1	2.2		
26	281.0	18.0	7.7	7.3	1.8	0.7	6.2	2.6		
27	349.0	27.0	9.3		2.0		7.8	2.7		
28	256.0	15.0	7.0		1.8		5.6	2.6		
29	313.0	16.0	6.1		1.8		6.8	2.6		
30	278.0	23.0	9.9		2.0		6.1	2.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: JAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENBEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	POLYPHOSPHATE LBS	mg/l		
MONTHLY TOTAL	9195.0	-517.0	217.9	169.6	57.8	15.1	204.1	89.2		
AVERAGE	296.6	16.7	7.0	7.4	1.9	0.7	6.6	2.9		
MAXIMUM	531.0	29.0	14.8	7.4	2.4	0.8	9.0	8.6		
MINIMUM	100.0	6.0	1.8	7.3	1.2	0.3	4.8	1.1		
01	276.0	10.0	4.3	7.3	1.8	0.6	6.2	2.7		
02	384.0	27.0	8.4	7.3	1.7	0.5	8.7	2.7		
03	317.0	12.0	4.5	7.3	1.8	0.7	7.0	2.7		
04	328.0	24.0	8.8		1.6		7.3	2.7		
05	227.0	12.0	6.3		1.8		5.2	2.8		
06	402.0	29.0	8.7	7.3	2.2	0.7	8.9	2.7		
07	317.0	19.0	7.2	7.3	2.0	0.7	7.2	2.7		
08	333.0	20.0	7.2	7.3	1.8	0.6	7.5	2.7		
09	299.0	20.0	8.0	7.4	1.8	0.6	6.6	2.6		
10	327.0	25.0	9.2	7.4	1.8	0.6	7.4	2.7		
11	258.0	17.0	7.9		2.0		5.8	2.7		
12	319.0	20.0	7.5		1.8		7.3	2.8		
13	297.0	12.0	4.8	7.4	2.4	0.8	6.7	2.7		
14	284.0	16.0	6.8	7.4	2.0	0.8	6.3	2.6		
15	274.0	13.0	5.7	7.4	2.0	0.8	6.3	2.7		
16	210.0	11.0	6.3	7.4	1.8	0.7	4.8	2.7		
17	343.0	18.0	6.3	7.4	1.8	0.8	7.7	2.7		
18	362.0	15.0	5.0		2.0		5.7	1.9		
19	317.0	13.0	4.9		1.8		7.0	2.7		
20	299.0	12.0	4.8	7.4	1.8	0.7	6.7	2.7		
21	122.0	15.0	14.8	7.4	1.6	0.5	4.9	4.9		
22	100.0	6.0	7.2	7.4	1.2	0.3	7.1	8.6		
23	531.0	8.0	1.8	7.4	1.4	0.5	4.9	1.1		
24	235.0	20.0	10.2	7.4	2.0	0.7	5.2	2.7		
25	301.0	24.0	9.6		2.2		6.8	2.7		
26	399.0	22.0	6.6		2.2		9.0	2.7		
27	244.0	15.0	7.4	7.4	2.2	0.8	5.5	2.7		
28	251.0	13.0	6.2	7.4	2.0	0.7	5.5	2.6		
29	310.0	13.0	5.0	7.4	1.8	0.7	7.0	2.7		
30	271.0	18.0	8.0	7.4	1.7	0.7	6.0	2.7		
31	258.0	18.0	8.4	7.4	1.8	0.6	5.9	2.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 10-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE LBS mg/l	TOTAL PHOSPHATE mg/l	BACTERIOLOGIC MCL VIOLATION AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	10595.0	534.0	182.0	168.3	56.6	13.6	176.4	59.9	
AVERAGE	353.2	17.8	6.1	7.3	1.9	0.6	8.0	2.7	
MAXIMUM	463.0	31.0	11.5	7.4	2.2	0.8	10.5	2.8	
MINIMUM	202.0	8.0	3.1	7.3	1.6	0.5	4.6	2.7	
01	431.0	31.0	8.6		1.8				
02	382.0	21.0	6.6	7.3	1.8	0.6			
03	243.0	15.0	7.4	7.3	1.9	0.5			
04	272.0	13.0	5.7	7.3	1.8	0.7			
05	361.0	10.0	3.3	7.3	2.0	0.7			
06	341.0	14.0	4.9		2.0				
07	401.0	23.0	6.9		2.0				
08	389.0	17.0	5.2	7.4	1.8	0.6			
09	395.0	26.0	7.9	7.4	1.8	0.7	8.9	2.7	
10	345.0	20.0	7.0	7.4	2.0	0.8	7.7	2.7	
11	336.0	18.0	6.4	7.4	2.2	0.7	7.7	2.8	
12	374.0	18.0	5.8	7.3	1.8	0.7	8.5	2.7	
13	410.0	21.0	6.1		1.8		9.2	2.7	
14	362.0	22.0	7.3		2.0		8.2	2.7	
15	426.0	21.0	5.9	7.3	2.1	0.8	9.7	2.7	
16	363.0	18.0	6.0	7.3	2.0	0.7	8.4	2.8	
17	387.0	12.0	3.7	7.3	1.8	0.7	8.7	2.7	
18	373.0	10.0	3.2	7.3	1.8	0.5	8.6	2.8	
19	351.0	16.0	5.5	7.3	1.8	0.6	7.9	2.7	
20	402.0	22.0	6.6	7.3	2.0		9.3	2.8	
21	463.0	20.0	5.2	7.3	2.0		10.5	2.7	
22	328.0	26.0	9.5	7.3	2.1	0.7	7.6	2.8	
23	322.0	15.0	5.6	7.3	2.0	0.7	7.2	2.7	
24	316.0	12.0	4.6	7.3	1.8	0.6	7.3	2.8	
25	312.0	8.0	3.1	7.3	1.8	0.5	6.9	2.7	
26	202.0	8.0	4.8	7.3	1.8	0.5	4.6	2.7	
27	304.0	10.0	3.9		1.6		6.9	2.7	
28	410.0	17.0	5.0		1.6		9.2	2.7	
29	312.0	23.0	8.8	7.3	1.7	0.6	7.0	2.7	
30	282.0	27.0	11.5	7.3	2.0	0.7	6.4	2.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James E. [Signature], C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	mg/l	EFFLUENT pH	RESIDUAL CHLORINE mg/l PLANT EFFLUENT	REMOTE TAP	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	10055.0	411.0	152.1	155.4	51.4	10.7	
AVERAGE	324.4	13.3	4.9	7.4	1.7	0.5	
MAXIMUM	450.0	37.0	10.8	7.4	2.0	0.7	
MINIMUM	208.0	3.0	1.1	7.4	1.2	0.3	
01	282.0	19.0	8.1	7.4	1.6	0.5	
02	400.0	28.0	8.4		1.6		
03	373.0	32.0	10.3		2.0		
04	331.0	15.0	5.4	7.4	1.8	0.6	
05	208.0	16.0	9.2	7.4	1.8	0.4	
06	400.0	12.0	3.6	7.4	1.6	0.5	
07	273.0	8.0	3.5	7.4	1.8	0.5	
08	250.0	9.0	4.3	7.4	1.6	0.3	
09	322.0	14.0	5.2		1.6		
10	450.0	10.0	2.7		1.7		
11	298.0	6.0	2.4	7.4	1.5	0.5	
12	294.0	13.0	5.3	7.4	1.5	0.4	
13	313.0	5.0	1.9	7.4	1.8	0.6	
14	339.0	5.0	1.8	7.4	1.5	0.4	
15	279.0	6.0	2.6	7.4	1.2	0.4	
16	303.0	9.0	3.6		1.5		
17	430.0	16.0	4.5		1.8		
18	288.0	6.0	2.5	7.4	2.0	0.6	
19	299.0	7.0	2.8	7.4	1.5	0.5	
20	337.0	3.0	1.1	7.4	1.6	0.6	
21	318.0	5.0	1.9	7.4	1.5	0.5	
22	255.0	23.0	10.8	7.4	1.8	0.6	
23	400.0	14.0	4.2		1.8		
24	414.0	37.0	10.7		1.7		
25	312.0	10.0	3.8	7.4	1.6	0.5	
26	325.0	15.0	5.5	7.4	1.8	0.6	
27	301.0	20.0	8.0	7.4	1.4	0.4	
28	351.0	20.0	6.8	7.4	1.8	0.7	
29	300.0	12.0	4.8	7.4	1.8	0.6	
30	312.0	9.0	3.5		1.6		
31	298.0	7.0	2.8		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 08-12-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.


REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

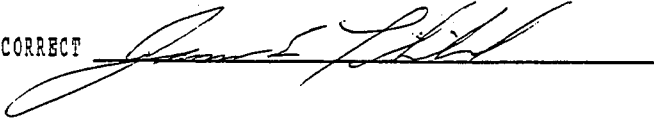CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

MAY MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10008.0	432.0	178.3	162.8	57.4	13.0	
AVERAGE	322.8	15.5	5.8	7.4	1.9	0.6	
MAXIMUM	440.0	27.0	8.1	7.4	2.2	0.8	
MINIMUM	209.0	7.0	3.3	7.4	1.5	0.5	
01	335.0	15.0	5.4	7.4	1.8	0.7	
02	362.0	16.0	5.3	7.4	2.0	0.5	
03	209.0	10.0	5.7	7.4	1.6	0.5	
04	392.0	22.0	6.7		1.6		
05	272.0	17.0	7.5		2.0		
06	341.0	23.0	8.1		2.2		
07	328.0	22.0	8.0	7.4	2.0	0.8	
08	295.0	20.0	8.1	7.4	2.0	0.6	
09	371.0	18.0	5.8	7.4	2.0	0.7	
10	276.0	8.0	3.5	7.4	1.7	0.7	
11	440.0	27.0	7.4	7.4	1.9	0.6	
12	261.0	12.0	5.5		2.0		
13	364.0	20.0	6.6		1.8		
14	391.0	23.0	7.1	7.4	1.9	0.7	
15	345.0	17.0	5.9	7.4	2.1	0.6	
16	315.0	20.0	7.6	7.4	1.8	0.6	
17	355.0	18.0	6.1	7.4	2.0	0.5	
18	256.0	10.0	4.7	7.4	1.8	0.5	
19	375.0	14.0	4.5		1.8		
20	288.0	16.0	6.7		1.8		
21	319.0	14.0	5.3	7.4	1.8	0.5	
22	364.0	10.0	3.3	7.4	2.0	0.6	
23	244.0	16.0	7.9	7.4	1.8	0.6	
24	257.0	12.0	5.6	7.4	1.9	0.6	
25	387.0	16.0	5.0	7.4	2.0	0.6	
26	292.0	10.0	4.1		1.8		
27	369.0	15.0	4.9		1.8		
28	347.0	15.0	5.2	7.4	1.7	0.6	
29	300.0	9.0	3.6	7.4	1.6	0.5	
30	336.0	10.0	3.6	7.4	1.7	0.5	
31	222.0	7.0	3.8	7.4	1.5	0.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 07-16-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	9469.0	463.0	174.3	154.4	54.7	12.9	
AVERAGE	315.6	15.4	5.8	7.4	1.8	0.6	
MAXIMUM	431.0	32.0	9.9	7.4	2.2	0.7	
MINIMUM	201.0	6.0	2.9	7.3	1.5	0.4	
01	301.0	13.0	5.2		1.8		
02	277.0	11.0	4.8	7.4	2.2	0.7	
03	364.0	12.0	4.0	7.4	1.8	0.5	
04	337.0	16.0	5.7	7.3	1.8	0.6	
05	299.0	13.0	5.2	7.3	2.2	0.6	
06	205.0	8.0	4.7	7.3	2.0	0.7	
07	301.0	18.0	7.2		1.5		
08	409.0	30.0	8.8		1.8		
09	312.0	18.0	6.9	7.3	1.8	0.5	
10	239.0	9.0	4.5	7.4	2.0	0.7	
11	310.0	15.0	5.8	7.4	1.8	0.6	
12	356.0	19.0	6.4	7.4	1.6	0.5	
13	201.0	11.0	6.6	7.4	1.7	0.7	
14	343.0	10.0	3.5		1.7		
15	321.0	13.0	4.9		1.7		
16	387.0	32.0	9.9	7.4	1.8	0.5	
17	270.0	16.0	7.1	7.4	1.8	0.7	
18	355.0	21.0	7.1	7.4	1.8	0.4	
19	300.0	14.0	5.6	7.4	2.0	0.7	
20	331.0	14.0	5.1	7.3	1.8	0.7	
21	357.0	11.0	3.7		2.2		
22	270.0	8.0	3.6		2.0		
23	406.0	20.0	5.9	7.3	1.8	0.6	
24	246.0	6.0	2.9	7.4	1.8	0.7	
25	354.0	17.0	5.8	7.3	1.8	0.7	
26	246.0	19.0	9.3	7.3	1.7	0.7	
27	431.0	19.0	5.3	7.3	1.7	0.7	
28	302.0	15.0	6.0		1.8		
29	348.0	20.0	6.9		1.8		
30	291.0	15.0	6.2	7.3	1.5	0.4	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034K

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

 , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10459.0	487.0	175.7	176.1	86.4	12.4	
AVERAGE	337.4	15.7	5.7	7.3	2.8	0.6	
MAXIMUM	502.0	25.0	9.2	7.4	32.0	0.8	
MINIMUM	182.0	9.0	2.9	7.3	1.4	0.4	
01	279.0	19.0	8.2	7.3	2.0	0.7	
02	359.0	18.0	6.0	7.3	32.0	0.8	
03	318.0	12.0	4.5	7.3	1.8		
04	397.0	10.0	3.0	7.3	1.8		
05	407.0	22.0	6.5	7.3	2.0	0.6	
06	293.0	17.0	7.0	7.3	2.2	0.8	
07	378.0	24.0	7.6	7.3	2.0	0.6	
08	373.0	20.0	6.4	7.3	2.0	0.7	
09	223.0	14.0	7.5	7.3	2.2	0.6	
10	396.0	22.0	6.7		1.6		
11	454.0	11.0	2.9		2.2		
12	300.0	10.0	4.0	7.3	2.2	0.7	
13	311.0	12.0	4.6	7.3	1.4	0.4	
14	284.0	13.0	5.5	7.3	1.7	0.6	
15	286.0	15.0	6.3	7.3	1.8	0.6	
16	286.0	22.0	9.2	7.3	1.8	0.6	
17	443.0	16.0	4.3		1.6		
18	378.0	20.0	6.3		1.6		
19	340.0	16.0	5.6	7.3	1.7	0.6	
20	363.0	17.0	5.6	7.4	1.8	0.6	
21	365.0	12.0	3.9	7.4	1.8	0.7	
22	301.0	10.0	4.0	7.4	1.6	0.6	
23	327.0	13.0	4.8	7.4	1.6	0.5	
24	502.0	25.0	6.0		1.8		
25	223.0	9.0	4.8		2.0		
26	318.0	15.0	5.7	7.4	1.8	0.4	
27	380.0	18.0	5.7	7.4	1.9	0.4	
28	182.0	10.0	6.6	7.4	1.6	0.4	
29	320.0	12.0	4.5	7.4	1.5	0.5	
30	361.0	18.0	6.0	7.4	1.7		
31	312.0	15.0	5.8		1.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 05-01-97

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM:

WELL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10193.0	480.0	173.8	161.1	60.7	15.0	
AVERAGE	339.8	16.0	5.8	7.3	2.0	0.7	
MAXIMUM	486.0	35.0	9.7	7.4	2.4	0.9	
MINIMUM	189.0	6.0	2.2	7.3	1.2	0.5	
01	361.0	16.0	5.3	7.3	1.6	0.6	
02	309.0	8.0	3.1	7.3	2.2	0.7	
03	418.0	11.0	3.2	7.3	2.2	0.7	
04	321.0	9.0	3.4	7.3	2.2	0.6	
05	348.0	13.0	4.5		2.1		
06	408.0	10.0	2.9		2.1		
07	370.0	23.0	7.5	7.3	2.2	0.9	
08	299.0	17.0	6.8	7.3	2.0	0.7	
09	437.0	8.0	2.2	7.3	2.0	0.6	
10	355.0	12.0	4.1	7.3	1.8	0.7	
11	284.0	8.0	3.4	7.3	1.8	0.5	
12	303.0	6.0	2.4		2.0		
13	398.0	16.0	4.8		2.2		
14	352.0	22.0	7.5	7.3	1.9	0.7	
15	315.0	22.0	8.4	7.4	2.0	0.6	
16	279.0	18.0	7.7	7.4	2.0	0.7	
17	296.0	18.0	7.3	7.3	2.0	0.7	
18	300.0	12.0	4.8	7.3	2.0	0.7	
19	486.0	14.0	3.5		1.8		
20	375.0	17.0	5.4		2.1		
21	328.0	22.0	8.0	7.3	2.1	0.7	
22	456.0	35.0	9.2	7.3	2.2	0.7	
23	264.0	18.0	8.2	7.3	2.2	0.6	
24	271.0	22.0	9.7	7.3	2.0	0.8	
25	338.0	18.0	6.4	7.3	2.2	0.6	
26	396.0	14.0	4.2		2.2		
27	189.0	11.0	7.0		1.2		
28	315.0	20.0	7.6	7.4	1.8	0.7	
29	429.0	28.0	7.8	7.4	2.2	0.8	
30	193.0	12.0	7.5	7.4	2.4	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 04-07-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	9699.0	-557.0	213.4	145.8	49.3	11.7	
AVERAGE	312.9	18.0	6.9	7.3	1.6	0.6	
MAXIMUM	523.0	29.0	11.3	7.3	2.0	0.8	
MINIMUM	165.0	5.0	1.9	7.2	1.0	0.4	
01	455.0	28.0	7.4		1.0		
02	284.0	19.0	8.0		1.8		
03	326.0	18.0	6.6	7.3	1.6	0.6	
04	227.0	9.0	4.8	7.3	1.8	0.5	
05	346.0	11.0	3.8	7.3	1.6	0.5	
06	309.0	15.0	5.8	7.3	1.6	0.5	
07	376.0	25.0	8.0	7.3	1.4	0.6	
08	315.0	22.0	8.4		1.6		
09	384.0	29.0	9.1		1.5		
10	272.0	21.0	9.3	7.3	1.5	0.5	
11	379.0	23.0	7.3	7.3	1.6	0.6	
12	319.0	5.0	1.9	7.3	1.6	0.7	
13	244.0	10.0	4.9	7.3	2.0	0.8	
14	214.0	10.0	5.6	7.3	1.8	0.7	
15	523.0	28.0	6.4		1.4		
16	165.0	7.0	5.1		1.4		
17	327.0	18.0	6.6	7.3	1.5	0.6	
18	302.0	22.0	8.7	7.3	1.2	0.4	
19	294.0	22.0	9.0	7.3	1.6	0.4	
20	234.0	15.0	7.7	7.3	1.5	0.6	
21	269.0	18.0	8.0	7.3	1.7	0.6	
22	443.0	28.0	7.6		1.7		
23	256.0	24.0	11.3		1.4		
24	324.0	10.0	3.7	7.2	1.5	0.6	
25	283.0	18.0	7.6	7.2	1.5	0.5	
26	274.0	19.0	8.3	7.3	1.8	0.7	
27	318.0	23.0	8.7	7.3	1.8	0.6	
28	290.0	21.0	8.7		1.6		
29	295.0	18.0	7.3		1.8		
30	365.0	11.0	3.6		1.8		
31	287.0	10.0	4.2	7.3	1.7	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 03-17-97

PNS ID NO. 2150565 C.U.P. NO. 2-031-00347

NAME OF DRINKING WATER SYSTEM: OAKHILL WATER TREATMENT PLANT -
 JAX HEIGHTS GRID

LOCATION: 4805 BUCKENHAW DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2855

I CERTIFY THIS REPORT IS CORRECT

, C.O., CERT. NO. C-7537

DATE OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		CALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7548.0	392.0	174.2				
AVERAGE	273.1	14.0	6.2				
MAXIMUM	421.0	24.0	11.8				
MINIMUM	158.0	4.0	2.2				
01	158.0	11.0	0.4				
02	421.0	20.0	5.7				
03	161.0	4.0	3.0				
04	205.0	5.0	2.5				
05	255.0	15.0	6.8				
06	235.0	15.0	7.7				
07	301.0	20.0	8.0				
08	284.0	20.0	8.5				
09	253.0	19.0	8.7				
10	279.0	17.0	7.3				
11	262.0	12.0	5.5				
12	262.0	7.0	3.2				
13	203.0	20.0	11.8				
14	197.0	10.0	6.1				
15	321.0	16.0	6.7				
16	335.0	24.0	8.6				
17	293.0	21.0	8.6				
18	242.0	17.0	8.4				
19	251.0	19.0	8.7				
20	320.0	8.0	3.0				
21	191.0	9.0	5.7				
22	333.0	20.0	7.2				
23	203.0	11.0	4.7				
24	311.0	15.0	5.8				
25	313.0	9.0	3.5				
26	298.0	12.0	4.8				
27	295.0	8.0	3.3				
28	276.0	5.0	2.2				

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 02-12-97

COMMENTS:

WS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: MILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CBRT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8423.0	332.0	149.8	225.8	52.4	18.2	
AVERAGE	271.7	10.7	4.8	7.3	1.7	0.8	
MAXIMUM	401.0	17.0	9.5	7.3	1.9	1.2	
MINIMUM	170.0	5.0	1.7	7.2	1.4	0.5	
01	359.0	5.0	1.7	7.3	1.8		
02	252.0	6.0	2.9	7.3	1.6	0.7	
03	242.0	10.0	5.0	7.3	1.4	0.6	
04	244.0	5.0	2.5	7.3	1.6		
05	288.0	5.0	2.1	7.3	1.5		
06	261.0	16.0	7.4	7.3	1.8	0.9	
07	246.0	14.0	6.8	7.3	1.8	0.7	
08	203.0	16.0	9.5	7.3	1.9	0.8	
09	236.0	14.0	7.1	7.3	1.8	0.8	
10	305.0	10.0	3.9	7.3	1.7	0.8	
11	255.0	12.0	5.6	7.3	1.8	1.0	
12	289.0	13.0	5.4	7.3	1.8		
13	254.0	13.0	6.1	7.3	1.5	0.6	
14	259.0	9.0	4.2	7.3	1.6	0.5	
15	174.0	5.0	3.4	7.3	1.5	0.7	
16	281.0	7.0	3.0	7.3	1.4	0.6	
17	308.0	10.0	3.9	7.3	1.6	0.8	
18	401.0	11.0	3.3	7.3	1.6		
19	299.0	10.0	4.0	7.3	1.5		
20	259.0	10.0	4.6	7.3	1.6	0.7	
21	194.0	7.0	4.3	7.3	1.9	0.9	
22	291.0	6.0	2.5	7.3	1.9	1.2	
23	299.0	14.0	5.6	7.3	1.9	1.0	
24	170.0	8.0	5.6	7.3	1.9	1.0	
25	328.0	17.0	6.2	7.3	1.6		
26	295.0	8.0	3.3	7.3	1.6		
27	319.0	17.0	6.4	7.2	1.8	1.0	
28	289.0	17.0	7.1	7.2	1.8	0.8	
29	261.0	16.0	7.4	7.2	1.6	0.7	
30	267.0	14.0	6.3	7.2	1.8	0.8	
31	295.0	7.0	2.8	7.2	1.8	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 01-15-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	24980.0	1620.0	242.2	152.3	62.2	17.5	623.8	93.1		
AVERAGE	805.8	52.3	7.8	7.3	2.0	0.8	20.1	3.0		
MAXIMUM	1103.0	75.0	11.4	7.3	3.0	1.3	27.2	3.4		
MINIMUM	264.0	25.0	4.5	7.2	1.6	0.5	7.6	2.7		
01	552.0	40.0	8.7	7.3	2.4	0.8	13.4	2.9		
02	264.0	25.0	11.4	7.2	3.0	1.0	7.6	3.4		
03	735.0	40.0	6.5	7.2	2.3	0.7	17.9	2.9		
04	965.0	65.0	8.1	7.2	2.0	0.7	24.4	3.0		
05	922.0	65.0	8.5	7.2	1.8	0.7	22.4	2.9		
06	802.0	60.0	9.0		1.7		20.2	3.0		
07	788.0	50.0	7.6		1.9		20.2	3.1		
08	894.0	60.0	8.1	7.2	2.5	1.0	22.1	3.0		
09	671.0	25.0	4.5	7.2	1.7	1.2	15.1	2.7		
10	805.0	50.0	7.5	7.2	2.2	1.3	20.2	3.0		
11	578.0	35.0	7.3	7.3	2.0	1.2	15.4	3.2		
12	1103.0	75.0	8.2	7.3	2.0	1.0	27.2	3.0		
13	888.0	65.0	8.8		1.9		22.1	3.0		
14	820.0	60.0	8.8		1.8		20.4	3.0		
15	713.0	35.0	5.9	7.3	2.1	0.9	16.8	2.8		
16	930.0	65.0	8.4	7.3	1.9	0.8	23.8	3.1		
17	755.0	45.0	7.2	7.3	2.0	0.8	19.0	3.0		
18	780.0	50.0	7.7	7.3	1.6	0.7	19.3	3.0		
19	1015.0	65.0	7.7	7.3	1.7	0.7	25.8	3.0		
20	744.0	50.0	8.1		1.6		17.9	2.9		
21	897.0	55.0	7.4		1.6		23.5	3.1		
22	769.0	40.0	6.2	7.2	1.7	0.6	18.2	2.8		
23	876.0	55.0	7.5	7.2	1.6	0.5	23.0	3.1		
24	788.0	50.0	7.6	7.2	1.7	0.7	19.3	2.9		
25	758.0	45.0	7.1		2.0		18.8	3.0		
26	834.0	55.0	7.9		2.4		21.0	3.0		
27	848.0	60.0	8.5		2.0		21.8	3.1		
28	891.0	60.0	8.1		2.6		21.8	2.9		
29	964.0	65.0	8.1	7.3	2.4	0.8	23.8	3.0		
30	902.0	60.0	8.0	7.3	1.9	0.6	23.5	3.1		
31	729.0	50.0	8.2	7.3	2.2	0.8	17.9	2.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	18022.0	945.0	193.4	130.9	71.0	15.1	435.1	89.1	0.13	
AVERAGE	600.7	31.5	6.4	7.3	2.4	0.8	14.5	3.0	0.07	
MAXIMUM	1050.0	55.0	9.1	7.3	3.1	1.2	22.1	3.6	0.08	
MINIMUM	304.0	15.0	2.3	7.2	1.4	0.6	7.6	1.6	0.05	
01	801.0	45.0	6.7		2.0		20.4	3.1		
02	1050.0	40.0	4.6		1.9		14.6	1.7		
03	1050.0	20.0	2.3	7.3	2.3	0.8	13.7	1.6		
04	460.0	35.0	9.1	7.3	2.5	0.7	10.9	2.8		
05	490.0	15.0	3.7	7.3	1.8	0.6	13.7	3.4		
06	500.0	25.0	6.0	7.3	3.0	0.8	11.8	2.8		
07	304.0	15.0	5.9	7.3	2.8	0.7	7.6	3.0	0.05	
08	570.0	30.0	6.3		1.7		14.3	3.0		
09	898.0	55.0	7.3		1.5		22.1	3.0		
10	641.0	35.0	6.6	7.3	2.8	0.9	16.5	3.1		
11	448.0	25.0	6.7	7.3	2.3	0.9	11.5	3.1		
12	551.0	30.0	6.5	7.3	2.5	0.8	14.3	3.1		
13	525.0	25.0	5.7	7.3	3.0	0.9	12.6	2.9		
14	546.0	30.0	6.6	7.3	1.4	0.8	14.3	3.1		
15	537.0	35.0	7.8		2.3		16.2	3.6		
16	485.0	30.0	7.4		2.6		11.5	2.8		
17	524.0	30.0	6.9	7.2	2.8	1.0	13.4	3.1		
18	606.0	35.0	6.9	7.2	3.0	0.9	14.8	2.9		
19	638.0	35.0	6.6	7.2	3.1	1.2	16.2	3.1	0.08	
20	613.0	30.0	5.9	7.2	2.8	0.8	16.0	3.1		
21	345.0	20.0	7.0	7.2	2.4	0.8	9.0	3.1		
22	670.0	30.0	5.4		2.5		16.8	3.0		
23	874.0	45.0	6.2		2.3		21.8	3.0		
24	564.0	30.0	6.4	7.3	2.4	0.9	13.7	2.9		
25	469.0	25.0	6.4	7.3	2.7	0.9	11.8	3.0		
26	637.0	45.0	8.5	7.3	2.4	0.7	19.3	3.6		
27	628.0	35.0	6.7		2.3		16.2	3.1		
28	603.0	35.0	7.0		2.4		14.8	3.0		
29	470.0	25.0	6.4		1.8		11.5	2.9		
30	525.0	35.0	8.0		1.7		13.7	3.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

7 SAMPLE DATE: 11-10-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	17618.0	1025.0	286.6	167.2	76.8	18.3	459.9	127.4		
AVERAGE	568.3	33.1	9.2	7.3	2.5	0.8	14.8	4.1		
MAXIMUM	869.0	60.0	85.7	7.3	3.1	1.0	22.4	36.6		
MINIMUM	56.0	20.0	5.1	7.2	1.8	0.6	8.4	2.4		
01	651.0	40.0	7.4	7.3	2.7	1.0	15.7	2.9		
02	869.0	50.0	6.9	7.3	2.4	0.8	22.1	3.1		
03	671.0	60.0	10.7	7.3	2.4	0.9	13.2	2.4		
04	512.0	30.0	7.0		2.2		16.8	3.9		
05	633.0	40.0	7.6		2.4		15.7	3.0		
06	775.0	55.0	8.5	7.3	2.8	0.8	22.1	3.4		
07	56.0	40.0	85.7	7.3	3.1	1.0	17.1	36.6		
08	518.0	30.0	6.9	7.3	3.0	0.9	13.4	3.1		
09	618.0	30.0	5.8	7.3	2.7	0.8	15.7	3.0		
10	660.0	30.0	5.5	7.3	2.3	0.8	16.7	3.0		
11	468.0	25.0	6.4		1.8		11.5	2.9		
12	852.0	45.0	6.3		2.0		22.4	3.2		
13	538.0	35.0	7.8	7.3	2.1	0.7	13.2	2.9		
14	620.0	30.0	5.8	7.2	3.0	0.9	14.8	2.9		
15	586.0	25.0	5.1	7.2	3.1	0.9	12.3	2.5		
16	406.0	25.0	7.4	7.3	2.7	0.8	10.4	3.1		
17	661.0	30.0	5.4	7.3	2.5	0.7	17.4	3.2		
18	525.0	30.0	6.9		2.1		12.9	2.9		
19	670.0	35.0	6.3		2.0		16.5	3.0		
20	655.0	40.0	7.3	7.3	2.4	0.8	17.1	3.1		
21	397.0	20.0	6.0	7.3	2.2	0.8	10.4	3.1		
22	573.0	30.0	6.3	7.2	2.4	0.6	14.0	2.9		
23	541.0	30.0	6.7	7.2	2.8	0.7	14.0	3.1		
24	416.0	20.0	5.8	7.2	2.0	0.8	10.6	3.1		
25	649.0	35.0	6.5		2.5		16.5	3.1		
26	782.0	40.0	6.1		2.4		19.3	3.0		
27	418.0	20.0	5.7	7.3	2.7	0.6	10.6	3.1		
28	462.0	30.0	7.8	7.3	2.4	0.8	12.0	3.1		
29	495.0	25.0	6.1	7.3	2.3	0.7	12.0	2.9		
30	574.0	30.0	6.3	7.2	3.0	0.8	15.1	3.2		
31	367.0	20.0	6.5	7.2	2.4	0.7	8.4	2.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

7 SAMPLE DATE: 10-09-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-06000

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	LBS	mg/l		
MONTHLY TOTAL	18297.0	1020.0	185.6	146.7	54.2	13.7	336.3	60.2		
AVERAGE	677.7	34.0	6.9	7.3	2.0	0.7	17.7	3.2		
MAXIMUM	1040.0	55.0	11.2	7.4	3.0	1.1	25.8	5.4		
MINIMUM	427.0	0.0	4.8	7.3	1.2	0.4	10.9	2.6		
01	741.0	35.0	5.7		2.5					
02	652.0	40.0	7.4	7.3	2.5	0.8				
03	603.0	30.0	6.0	7.3	3.0	1.1				
04	574.0	35.0	7.3	7.3	2.8	0.9				
05	608.0	30.0	5.9	7.3	2.6	0.7				
06	561.0	40.0	8.6		2.1					
07	934.0	40.0	5.1		2.1					
08	672.0	40.0	7.1	7.3	2.3	0.7				
09	427.0	40.0	11.2	7.3	2.5	0.6	19.3	5.4		
10	427.0	40.0	11.2	7.4	2.1	0.7	10.9	3.1		
11	832.0	45.0	6.5	7.4	1.8	0.7	20.2	2.9		
12	705.0	40.0	6.8	7.4	1.9	0.5	18.5	3.1		
13	478.0	25.0	6.3		1.5		11.8	3.0		
14	893.0	45.0	6.0		2.1		23.2	3.1		
15	1040.0	55.0	6.3	7.4	1.8	0.5	25.8	3.0		
16	574.0	30.0	6.3	7.4	1.6	0.7	14.3	3.0		
17	732.0	45.0	7.4	7.4	1.6	0.6	18.8	3.1		
18	835.0	40.0	5.7	7.4	1.8	0.6	20.7	3.0		
19	554.0	30.0	6.5	7.3	1.7	0.4	13.7	3.0		
20	743.0	30.0	4.8	7.3	1.9		19.0	3.1		
21	683.0	40.0	7.0	7.3	1.2		18.8	3.3		
22		0.0				0.8				
23		0.0				0.7				
24		0.0				0.5				
25	483.0	30.0	7.5	7.3	1.8	0.5	14.6	3.6		
26	513.0	25.0	5.8	7.3	1.6	0.5	10.9	2.6		
27	746.0	40.0	6.4		1.8		17.4	2.8		
28	937.0	50.0	6.4		1.7		23.5	3.0		
29	730.0	45.0	7.4	7.3	1.6	0.4	18.5	3.0		
30	620.0	35.0	6.8	7.3	2.3	0.8	16.5	3.2		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

7 SAMPLE DATE: 09-15-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0039W

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3278.0	165.0	30.1	37.0	13.5	2.3	
AVERAGE	655.6	33.0	6.0	7.4	2.7	0.8	
MAXIMUM	764.0	40.0	6.5	7.4	3.3	0.9	
MINIMUM	587.0	25.0	5.1	7.4	2.1	0.6	
01							
02							
03							
04							
05							
06							
07							
08							
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27	587.0	25.0	5.1	7.4	3.3	0.6	
28	694.0	35.0	6.1	7.4	2.7	0.9	
29	764.0	40.0	6.3	7.4	2.5	0.8	
30	587.0	30.0	6.1	7.4	2.1		
31	646.0	35.0	6.5	7.4	2.9		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7 SAMPLE DATE: 08-14-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James E. T. Hill*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL							
AVERAGE							
MAXIMUM							
MINIMUM							
01							
02							
03							
04							
05							
06							
07							
08							
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							
31							

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997


PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

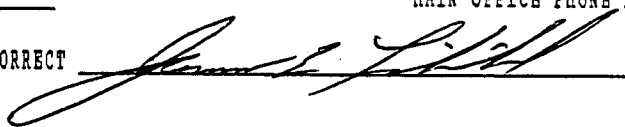

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL

AVERAGE

MAXIMUM

MINIMUM

- 01
- 02
- 03
- 04
- 05
- 06
- 07
- 08
- 09
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24
- 25
- 26
- 27
- 28
- 29
- 30

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

SAMPLE DATE: 06-23-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160565 C.U.P. NO. 2-031-0039A

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.


REPORTING MONTH: May 1997

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

SIGNATURE FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

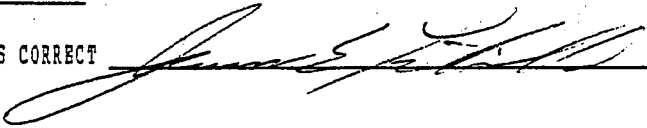CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	11134.0	590.0	77.0	73.5	22.7	14.3	
AVERAGE	927.8	49.2	6.4	7.4	1.9	0.7	
MINIMUM	1203.0	65.0	7.3	7.4	2.2	0.8	
MAXIMUM	444.0	25.0	4.5	7.3	1.6	0.5	
01	836.0	45.0	6.5	7.3	2.2	0.8	
02	1031.0	55.0	6.4	7.3	2.0	0.8	
03	899.0	55.0	7.3	7.3	1.6		
04	957.0	50.0	6.3	7.3	1.7		
05	903.0	50.0	6.6	7.3	1.9	0.7	
06	1061.0	60.0	6.8	7.4	2.1	0.8	
07	991.0	50.0	6.1	7.4	1.7	0.6	
08	845.0	45.0	6.4	7.4	1.9	0.6	
09	812.0	45.0	6.7	7.4	1.8	0.7	
10	1152.0	65.0	6.8		2.1		
11	1203.0	45.0	4.5		1.8		
12	444.0	25.0	6.8	7.4	1.9	0.8	
13						0.6	
14						0.7	
15						0.8	
16						0.6	
17							
18							
19						0.6	
20						0.5	
21						0.6	
22						0.7	
23						0.7	
24							
25							
26							
27						0.7	
28						0.6	
29						0.7	
30						0.7	
31							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

7 SAMPLE DATE: 05-05-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM: W. ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	27243.0	1490.0	197.4	163.1	49.4	13.6	
AVERAGE	908.1	49.7	6.6	7.4	1.6	0.6	
MAXIMUM	1358.0	80.0	8.3	7.5	2.5	0.8	
MINIMUM	634.0	35.0	5.1	7.4	1.2	0.5	
01	763.0	35.0	5.5	7.4	2.4	0.7	
02	750.0	45.0	7.2	7.4	2.0	0.6	
03	807.0	45.0	6.7	7.4	2.2	0.7	
04	788.0	40.0	6.1	7.4	1.8	0.6	
05	941.0	50.0	6.4		1.4		
06	1015.0	45.0	5.3		1.7		
07	879.0	50.0	6.8	7.4	1.3	0.6	
08	864.0	55.0	7.6	7.4	1.2	0.5	
09	858.0	50.0	7.0	7.4	2.5	0.8	
10	927.0	55.0	7.1	7.5	1.5	0.6	
11	907.0	50.0	6.6	7.5	1.2	0.5	
12	998.0	60.0	7.2		1.2		
13	1268.0	80.0	7.6		1.2		
14	821.0	55.0	8.0	7.5	1.6	0.6	
15	860.0	50.0	7.0	7.4	1.8	0.5	
16	799.0	55.0	8.3	7.4	1.9	0.7	
17	918.0	40.0	5.2	7.4	1.5	0.6	
18	768.0	50.0	7.8	7.4	1.6	0.6	
19	1358.0	80.0	7.1		1.7		
20	1064.0	45.0	5.1		1.5		
21	1072.0	50.0	5.6	7.4	1.3	0.5	
22	1100.0	55.0	6.0	7.4	1.2	0.5	
23	680.0	35.0	6.2	7.4	1.5	0.6	
24	799.0	40.0	6.0	7.4	1.8	0.8	
25	929.0	45.0	5.8	7.4	1.6	0.5	
26	1082.0	55.0	6.1		1.2		
27	634.0	35.0	6.6		1.5		
28	834.0	45.0	6.5	7.4	1.6	0.7	
29	860.0	45.0	6.3	7.4	2.5	0.8	
30	900.0	50.0	6.7	7.4	2.0	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 04-16-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	22212.0	1095.0	188.3	147.9	53.9	11.8	
AVERAGE	716.5	35.3	6.1	7.4	1.7	0.6	
MAXIMUM	1166.0	60.0	8.6	7.4	2.5	0.8	
MINIMUM	398.0	15.0	2.6	7.3	1.1	0.3	
01	1166.0	25.0	2.6		1.2		
02	797.0	25.0	3.8		1.6		
03	650.0	15.0	2.8	7.4	2.1	0.6	
04	724.0	35.0	5.8	7.4	1.6	0.4	
05	715.0	30.0	5.0	7.4	1.5	0.5	
06	712.0	35.0	5.9	7.4	1.1	0.5	
07	917.0	35.0	4.6	7.4	1.3	0.6	
08	889.0	35.0	4.7		1.1		
09	951.0	30.0	3.8		1.4		
10	704.0	40.0	6.8	7.4	1.1	0.3	
11	833.0	60.0	8.6	7.4	2.5	0.6	
12	691.0	35.0	6.1	7.4	1.6	0.5	
13	599.0	30.0	6.0	7.4	1.6	0.6	
14	484.0	30.0	7.4	7.4	2.1	0.8	
15	766.0	50.0	7.8		1.9		
16	398.0	25.0	7.5		1.8		
17	733.0	40.0	6.5	7.4	2.4	0.8	
18	613.0	30.0	5.9	7.4	2.1	0.7	
19	655.0	35.0	6.4	7.4	2.2	0.5	
20	576.0	30.0	6.3	7.4	1.4	0.7	
21	489.0	30.0	7.4	7.4	1.8	0.7	
22	1057.0	55.0	6.2		1.8		
23	579.0	35.0	7.3		2.1		
24	723.0	40.0	6.6	7.4	2.3	0.6	
25	482.0	25.0	6.2	7.4	2.0	0.4	
26	669.0	40.0	7.2	7.4	2.0	0.6	
27	576.0	30.0	6.3	7.4	2.2	0.8	
28	645.0	35.0	6.5		1.9		
29	826.0	45.0	6.5		1.4		
30	880.0	45.0	6.1		1.4		
31	713.0	45.0	7.6	7.3	1.4	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.


REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	15299.0	420.0	93.7	169.5	47.5	11.5	
AVERAGE	546.4	15.0	3.3	7.4	1.7	0.6	
MAXIMUM	774.0	25.0	5.3	7.4	2.2	0.8	
MINIMUM	354.0	10.0	1.9	7.3	1.0	0.4	
01	488.0	15.0	3.7	7.4	1.9		
02	774.0	20.0	3.1	7.4	1.7		
03	354.0	15.0	5.1	7.4	1.7	0.7	
04	703.0	15.0	2.6	7.4	2.0	0.8	
05	388.0	10.0	3.1	7.4	1.4	0.6	
06	552.0	15.0	3.3	7.4	1.0	0.5	
07	554.0	15.0	3.2	7.4	1.5	0.5	
08	616.0	15.0	2.9	7.4	1.6		
09	551.0	20.0	4.4	7.4	1.8		
10	610.0	15.0	3.0	7.4	1.6	0.6	
11	578.0	20.0	4.2	7.4	1.6	0.4	
12	530.0	15.0	3.4	7.4	1.7	0.6	
13	527.0	10.0	2.3	7.4	1.9	0.8	
14	412.0	15.0	4.4	7.4	1.4	0.5	
15	562.0	25.0	5.3		1.8		
16	638.0	20.0	3.8		1.8		
17	487.0	10.0	2.5		1.7	0.5	
18	623.0	15.0	2.9	7.4	1.6	0.7	
19	514.0	10.0	2.3	7.3	1.9	0.6	
20	472.0	15.0	3.8	7.3	1.3	0.6	
21	617.0	10.0	1.9	7.3	1.4		
22	433.0	15.0	4.2		1.7		
23	537.0	20.0	4.5		1.7	0.7	
24	534.0	15.0	3.4	7.3	2.2	0.7	
25	490.0	10.0	2.4	7.3	2.1	0.6	
26	613.0	15.0	2.9	7.3	1.9	0.5	
27	563.0	15.0	3.2	7.3	1.7	0.6	
28	579.0	10.0	2.1	7.4	1.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-00?

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17700.0	630.0	130.4	228.6	72.0	18.5	
AVERAGE	571.0	20.3	4.2	7.4	2.3	0.8	
MAXIMUM	786.0	55.0	9.4	7.4	3.6	1.5	
MINIMUM	437.0	10.0	2.2	7.3	0.6	0.5	
01	707.0	55.0	9.3	7.4	2.7		
02	465.0	35.0	9.0	7.4	3.1	1.4	
03	638.0	50.0	9.4	7.4	3.4	1.2	
04	546.0	40.0	8.8	7.4	3.6		
05	571.0	40.0	8.4	7.4	3.5		
06	534.0	10.0	2.2	7.4	3.6	1.5	
07	786.0	30.0	4.6	7.4	0.6	0.8	
08	511.0	10.0	2.3	7.4	1.8	0.6	
09	437.0	15.0	4.1	7.4	1.6	0.6	
10	610.0	25.0	4.9	7.4	2.5	1.1	
11	554.0	20.0	4.3	7.4	2.4		
12	548.0	20.0	4.4	7.4	3.1		
13	640.0	20.0	3.8	7.4	2.0	0.8	
14	449.0	10.0	2.7	7.4	2.2	0.7	
15	561.0	15.0	3.2	7.4	2.8	0.9	
16	668.0	15.0	2.7	7.4	2.6	0.8	
17	508.0	15.0	3.5	7.4	2.8	0.7	
18	668.0	20.0	3.6	7.4	2.1		
19	710.0	25.0	4.2	7.4	2.0		
20	521.0	15.0	3.5	7.4	2.3	1.0	
21	554.0	20.0	4.3	7.4	2.8	1.1	
22	500.0	10.0	2.4	7.3	2.3	0.8	
23	598.0	15.0	3.0	7.3	2.2	0.7	
24	442.0	10.0	2.7	7.3	2.1	0.7	
25	646.0	15.0	2.8	7.3	1.4		
26	546.0	10.0	2.2	7.3	1.9		
27	586.0	15.0	3.1	7.3	1.6	0.7	
28	619.0	15.0	2.9	7.3	1.7	0.7	
29	489.0	10.0	2.5	7.3	1.8	0.6	
30	498.0	10.0	2.4	7.4	1.8	0.5	
31	590.0	15.0	3.1	7.4	1.7	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7 SAMPLE DATE: 01-23-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Skidland, C.O., CBRT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				131.4		20.5	
AVERAGE				7.3		1.1	
MAXIMUM				7.3		1.2	
MINIMUM				7.3		1.0	
01				7.3		1.2	
02				7.3		1.2	
03							
04							
05							
06							
07							
08				7.3		1.2	
09				7.3		1.0	
10				7.3		1.2	
11				7.3		1.1	
12				7.3		1.2	
13							
14							
15				7.3		1.2	
16				7.3		1.1	
17				7.3		1.1	
18				7.3		1.1	
19				7.3		1.1	
20							
21							
22				7.3		1.1	
23				7.3		1.1	
24				7.3		1.0	
25							
26							
27							
28							
29				7.3		1.2	
30				7.3		1.2	
31				7.3		1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 12-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM. LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Stillman

, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						20.1	
AVERAGE						1.1	
MAXIMUM						1.2	
MINIMUM						0.9	
01							
02							
03						1.2	
04						1.2	
05						0.9	
06						1.1	
07						1.0	
08							
09							
10						1.1	
11						1.1	
12						1.1	
13						1.1	
14						1.2	
15							
16							
17						1.2	
18						1.2	
19						1.0	
20						1.1	
21						1.1	
22							
23							
24						1.2	
25						1.2	
26						1.1	
27							
28							
29							
30							

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Hubbard

, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				167.9		25.4	
AVERAGE				7.3		1.1	
MAXIMUM				7.3		1.2	
MINIMUM				7.3		0.9	
01				7.3		1.1	
02				7.3		1.1	
03				7.3		1.1	
04							
05							
06				7.3		1.1	
07				7.3		1.2	
08				7.3		1.1	
09				7.3		1.2	
10				7.3		1.1	
11							
12							
13				7.3		1.1	
14				7.3		1.1	
15				7.3		1.1	
16				7.3		1.1	
17				7.3		1.0	
18							
19							
20				7.3		1.0	
21				7.3		1.0	
22				7.3		1.2	
23				7.3		1.2	
24				7.3		1.1	
25							
26							
27				7.3		1.2	
28				7.3		1.2	
29				7.3		0.9	
30				7.3		1.1	
31				7.3		1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 10-14-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160634 C.U.P. NO. 2-031-0042X

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

AVERAGE EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland

, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						22.0	
AVERAGE						1.0	
MAXIMUM						1.2	
MINIMUM						0.9	
01							
02						1.1	
03						1.1	
04						1.1	
05						1.0	
06							
07							
08						1.0	
09						0.9	
10						1.1	
11						1.1	
12						1.1	
13							
14							
15						1.2	
16						1.0	
17						1.0	
18						1.0	
19						1.0	
20							
21							
22						0.9	
23						1.0	
24						1.0	
25						1.1	
26						1.1	
27							
28							
29						1.1	
30						1.1	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

2160634 C.U.P. NO. 2-031-0042H

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

VERIFY THIS REPORT IS CORRECT Banner E. Steinfeld, C.O., CERT. NO. C-7255

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						
AVERAGE						
MAXIMUM						
MINIMUM						
01						
02						
03						
04						
05						
06						
07						
08						
09						
10						
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						
31						

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 08-12-97

COMMENTS: Plant off line for testing. Water provided by city in tank.

DRINKING TREATMENT PLANT DAILY OPERATIONAL SUMMAR

NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Littlewood, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL

AVERAGE

MAXIMUM

MINIMUM

- 01
- 02
- 03
- 04
- 05
- 06
- 07
- 08
- 09
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24
- 25
- 26
- 27
- 28
- 29
- 30
- 31

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 07-28-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: FOREST WATER TREATMENT PLANT

7111 BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

A FLORIDA INC.

REPORTING MONTH: June 1997

(AVG)

NO. OF SERVICES AT END OF MONTH: _____

MAIN OFFICE PHONE NO. (904) 725-2865

REPORT IS CORRECT

Banner E. Stuckland, C.O., CERT. NO. C-7255

RAW WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE MG/L	PLANT EFFLUENT	RENOTE TAP	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
--	-----------------------------------	----------------	---------------------------	-------------------	---------------	---

01

02

03

04

05

06

07

08

09

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 06-23-97

COMMENTS: LPWTP: Off line for modifications

Water provided by city in terra

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

FED WATER FLORIDA INC.

REPORTING MONTH: May 1997

pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

MAIN OFFICE PHONE NO. (904) 725-2865

REPORT IS CORRECT

Banner E. Strickland, C.O., CERT. NO. C-7255

TAP WATER TAKEN IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
					22.7	
					1.1	
					1.2	
					0.9	
					1.0	
					1.0	
					1.2	
					1.0	
					0.9	
					1.1	
					1.1	
					1.1	
					1.1	
					1.2	
					1.1	
					1.0	
					1.1	
					1.1	
					1.0	
					1.0	
					1.0	
					1.2	

WFO ID NO. 2158634 C.U.P. NO. 2-031-08425 NAME OF DRINKING WATER SYSTEM: LAKE JOER RESERVOIR PLANT

LOCATION: 1282 BUNKER HILL BLVD. JACKSONVILLE, FLA., DUYAL COUNTY

WATER BY: UNITED WATER FLORIDA INC. REPORTING MONTH: April 1997

PLANT EFFLUENT PH: 7.3(AVG) NO. OF SERVICES AT END OF MONTH: _____

ISSUE FROM: _____ MILK OFFICE PERMITS (80) (984) 723-2863

I CERTIFY THIS REPORT IS CORRECT *Bryan E. Stittland*, C.O., GRN. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CELOSINE 89/1	SEDIMENT PH	RESIDUAL CELOSINE 89/1 PLANT EFFLUENT	BACTERIOLOGICAL USE VIOLATIONS AND COMMENTS
MONTHLY TOTAL	150.6			22.6	
AVERAGE	7.3			1.0	
MINIMUM	7.3			1.3	
MAXIMUM	7.3			0.1	
01	7.3			0.3	
02	7.3			1.0	
03	7.3			0.1	
04	7.3			1.0	
05					
06					
07	7.3			1.0	
08	7.3			1.0	
09	7.3			0.8	
10	7.3			1.2	
11	7.3			0.3	
12					
13					
14	7.3			1.1	
15	7.3			1.1	
16	7.3			1.1	
17	7.3			1.3	
18	7.3			1.3	
19					
20					
21	7.3			1.7	
22	7.3			1.2	
23	7.3			1.2	
24	7.3			1.1	
25	7.3			0.9	
26					
27					
28	7.3			1.1	
29	7.3			1.1	
30	7.3			1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 04-15-97

COMMENTS:

DRINKING-WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160634 C.U.P. NO. 2-031-0042X NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT
 LOCATION: 1202 BUNKER HILL BLVD. JACKSONVILLE, FLA., DUVAL COUNTY
 OPERATED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: March 1997
 AVERAGE EFFLUENT pH: 7.3(AVG) NO. OF SERVICES AT END OF MONTH: _____
 HIGH FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				146.0		20.2	
AVERAGE				7.3		1.0	
MINIMUM				7.3		1.2	
MINIMUM				7.3		0.9	
01							
02							
03				7.3		1.0	
04				7.3		1.0	
05				7.3		1.0	
06				7.3		1.0	
07				7.3		1.1	
08							
09							
10				7.3		1.1	
11				7.3		1.1	
12				7.3		0.9	
13				7.3		0.9	
14				7.3		1.1	
15							
16							
17				7.3		1.2	
18				7.3		1.0	
19				7.3		1.0	
20				7.3		1.0	
21				7.3		1.0	
22							
23							
24				7.3		0.9	
25				7.3		0.9	
26				7.3		1.0	
27				7.3		0.9	
28							
29							
30							
31				7.3		1.1	

C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM:

BEST WATER TREATMENT PLANT

AKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

WATER FLORIDA INC.

REPORTING MONTH: February 1997

1: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

MAIN OFFICE PHONE NO. (904) 725-2865

REPORT IS CORRECT

Banner E. Strickland

, C.O., CERT. NO. C-7255

TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	

GE

.NUM

AINUM

- 01
- 02
- 03
- 04
- 05
- 06
- 07
- 08
- 09
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24
- 25
- 26
- 27
- 28

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 02-05-97

COMMENTS: PLANT IS OFF LINE FOR MODIFICATIONS. WATER IS PROVIDED BY CITY INTERTIE.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Stille, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL			160.6		23.6	
AVERAGE			7.3		1.1	
MAXIMUM			7.3		1.4	
MINIMUM			7.3		0.8	
01						
02			7.3		1.0	
03			7.3		1.1	
04						
05						
06			7.3		1.4	
07			7.3		1.2	
08			7.3		1.1	
09			7.3		1.1	
10			7.3		0.9	
11						
12						
13			7.3		1.2	
14			7.3		1.1	
15			7.3		1.2	
16			7.3		1.0	
17			7.3		1.0	
18						
19						
20			7.3		0.9	
21			7.3		0.9	
22			7.3		1.1	
23			7.3		0.8	
24			7.3		1.0	
25						
26						
27			7.3		1.2	
28			7.3		1.2	
29			7.3		1.1	
30			7.3		1.1	
31			7.3		1.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

SAMPLE DATE: 01-23-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WIS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LO... OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth R. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1159.0	162.0	542.7	151.2	60.8	15.7	
AVERAGE	37.4	5.2	17.5	7.2	2.0	0.7	
MAXIMUM	78.0	10.0	28.6	7.2	2.2	0.8	
MINIMUM	19.0	4.0	12.0	7.2	1.7	0.6	
01	49.0	6.0	14.7	7.2	1.8	0.8	
02	26.0	4.0	18.5	7.2	2.0	0.8	
03	36.0	7.0	23.3	7.2	2.1	0.8	
04	78.0	10.0	15.4	7.2	2.1	0.8	
05	19.0	4.0	25.3	7.2	2.1	0.8	
06	38.0	7.0	22.1		2.0		
07	52.0	7.0	16.2		2.1		
08	35.0	4.0	13.7	7.2	2.2	0.8	
09	44.0	6.0	16.4	7.2	1.9	0.7	
10	29.0	5.0	20.7	7.2	1.9	0.7	
11	37.0	6.0	19.5	7.2	2.1	0.8	
12	37.0	5.0	16.2	7.2	2.0	0.8	
13	40.0	4.0	12.0		2.0		
14	36.0	4.0	13.3		2.1		
15	21.0	5.0	28.6	7.2	2.2	0.7	
16	38.0	4.0	12.6	7.2	2.2	0.8	
17	36.0	5.0	16.7	7.2	1.8	0.7	
18	38.0	5.0	15.8	7.2	2.0	0.8	
19	43.0	6.0	16.7	7.2	2.0	0.8	
20	38.0	5.0	15.8		1.8		
21	29.0	5.0	20.7		2.0		
22	30.0	5.0	20.0	7.2	2.0	0.8	
23	32.0	4.0	15.0	7.2	1.8	0.6	
24	44.0	5.0	13.6	7.2	1.9	0.6	
25	21.0	4.0	22.9		1.8		
26	38.0	4.0	12.6		1.8		
27	35.0	5.0	17.1		2.0		
28	54.0	6.0	13.3		1.8		
29	24.0	5.0	25.0	7.2	1.8	0.7	
30	35.0	4.0	13.7	7.2	1.8	0.7	
31	47.0	6.0	15.3	7.2	1.7	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 12-11-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULIE, FL ; MASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth L. Laughlin, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1817.0	232.0	474.0	131.2	52.0	12.2	
AVERAGE	60.6	7.7	15.8	7.3	1.7	0.7	
MAXIMUM	104.0	12.0	26.1	7.3	1.9	0.8	
MINIMUM	27.0	3.0	8.5	7.2	1.3	0.5	
01	53.0	8.0	18.1		1.7		
02	46.0	10.0	26.1		1.8		
03	39.0	6.0	18.5	7.3	1.9	0.7	
04	46.0	8.0	20.9	7.3	1.9	0.7	
05	85.0	6.0	8.5	7.3	1.9	0.6	
06	58.0	6.0	12.4	7.3	1.8	0.7	
07	49.0	6.0	14.7	7.3	1.8	0.7	
08	56.0	8.0	17.1		1.8		
09	65.0	7.0	12.9		1.9		
10	69.0	8.0	13.9	7.3	1.7	0.6	
11	96.0	11.0	13.8	7.3	1.5	0.5	
12	50.0	6.0	14.4	7.3	1.8	0.5	
13	54.0	6.0	13.3	7.3	1.8	0.6	
14	101.0	11.0	13.1	7.3	1.8	0.6	
15	91.0	10.0	13.2		1.3		
16	104.0	12.0	13.8		1.5		
17	68.0	9.0	15.9	7.3	1.6	0.7	
18	51.0	9.0	21.2	7.3	1.8	0.8	
19	73.0	12.0	19.7	7.3	1.7	0.8	
20	60.0	9.0	18.0	7.3	1.8	0.8	
21	51.0	7.0	16.5	7.3	1.8	0.7	
22	68.0	8.0	14.1		1.6		
23	68.0	8.0	14.1		1.6		
24	63.0	8.0	15.2	7.3	1.7	0.7	
25	68.0	8.0	14.1	7.2	1.8	0.8	
26	35.0	5.0	17.1	7.2	1.7	0.7	
27	38.0	6.0	18.9		1.7		
28	46.0	6.0	15.7		1.8		
29	27.0	3.0	13.3		1.8		
30	39.0	5.0	15.4		1.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOPFON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Sturlock, C.O., CERT. NO. C-4016 C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1868.0	255.0	526.1	165.6	56.3	15.2	
AVERAGE	60.3	8.2	17.0	7.2	1.8	0.7	
MAXIMUM	98.0	19.0	42.0	7.2	2.0	0.8	
MINIMUM	20.0	4.0	11.8	7.2	1.6	0.5	
01	51.0	5.0	11.8	7.2	2.0	0.8	
02	81.0	19.0	28.1	7.2	1.8	0.7	
03	64.0	9.0	16.9	7.2	1.8	0.7	
04	38.0	10.0	13.6		1.8		
05	68.0	9.0	15.9		1.9		
06	94.0	11.0	14.0	7.2	1.9	0.7	
07	68.0	12.0	21.2	7.2	1.7	0.7	
08	73.0	10.0	16.4	7.2	2.0	0.8	
09	70.0	8.0	13.7	7.2	1.8	0.7	
10	80.0	9.0	13.5	7.2	1.8	0.7	
11	68.0	10.0	17.6		2.0		
12	44.0	5.0	13.6		1.8		
13	51.0	8.0	18.8	7.2	1.6	0.5	
14	57.0	8.0	16.8	7.2	1.8	0.5	
15	53.0	10.0	22.6	7.2	1.8	0.6	
16	30.0	6.0	18.9	7.2	1.7	0.6	
17	62.0	7.0	13.5	7.2	1.9	0.6	
18	64.0	8.0	15.0		1.8		
19	70.0	9.0	15.4		1.9		
20	48.0	5.0	12.5	7.2	1.9	0.7	
21	49.0	6.0	14.7	7.2	1.8	0.7	
22	53.0	7.0	15.8	7.2	1.8	0.6	
23	45.0	8.0	21.3	7.2	2.0	0.6	
24	36.0	4.0	13.3	7.2	2.0	0.6	
25	45.0	5.0	13.3		1.6		
26	68.0	7.0	12.4		1.6		
27	20.0	7.0	42.0	7.2	1.8	0.8	
28	64.0	8.0	15.0	7.2	1.8	0.7	
29	34.0	5.0	17.6	7.2	1.7	0.7	
30	64.0	9.0	16.9	7.2	1.7	0.6	
31	98.0	11.0	13.5	7.2	1.8	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 10-06-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2499.0	321.0	477.0	151.2	56.7	12.9	
AVERAGE	86.2	10.7	16.4	7.2	1.9	0.6	
MAXIMUM	178.0	21.0	51.4	7.2	2.1	0.8	
MINIMUM	34.0	5.0	8.1	7.2	1.6	0.4	
01	77.0	6.0	9.4		2.0		
02	61.0	5.0	9.8	7.2	2.0	0.6	
03	178.0	18.0	12.1	7.2	1.8	0.6	
04	52.0	6.0	13.8	7.2	2.1	0.7	
05	49.0	21.0	51.4	7.2	1.9	0.6	
06	100.0	12.0	14.4		1.8		
07	93.0	13.0	16.8		2.0		
08	81.0	12.0	17.8	7.2	2.1	0.7	
09	66.0	10.0	18.2	7.2	2.1	0.7	
10	107.0	10.0	11.2	7.2	1.8	0.5	
11	34.0	12.0	42.4	7.2	2.0	0.6	
12	76.0	11.0	17.4	7.2	1.9	0.6	
13	100.0	12.0	14.4		2.0		
14	89.0	10.0	13.5		1.9		
15	138.0	12.0	10.4	7.2	1.6	0.4	
16	117.0	10.0	10.3	7.2	1.8	0.4	
17	76.0	8.0	12.6	7.2	1.7	0.5	
18	118.0	8.0	8.1	7.2	1.7	0.5	
19	118.0	21.0	21.4	7.2	1.9	0.6	
20	106.0	15.0	17.0		1.8		
21	86.0	15.0	20.9		1.8		
22	71.0	10.0	16.9	7.2	2.1	0.8	
23	110.0	15.0	16.4	7.2	1.9	0.8	
24	63.0	8.0	15.2	7.2	1.9	0.7	
25	59.0	5.0	10.2	7.2	1.8	0.7	
26	78.0	8.0	12.3	7.2	1.8	0.6	
27	61.0	5.0	9.8		1.8		
28	52.0	8.0	18.5		1.8		
29	83.0	10.0	14.5	7.2	1.9	0.6	
30		5.0		7.2	2.0	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Stillland

, C.O., CERT. NO. ~~C-4016~~ C-7258

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1914.0	249.0	495.2	151.2	63.5	14.2	
AVERAGE	61.7	8.0	16.0	7.2	2.0	0.7	
MAXIMUM	117.0	17.0	20.0	7.2	2.2	0.8	
MINIMUM	26.0	4.0	9.9	7.2	1.8	0.5	
01	39.0	6.0	18.5	7.2	2.0	0.7	
02	36.0	4.0	13.3		2.0		
03	117.0	17.0	17.4		1.8		
04	26.0	4.0	18.5	7.2	1.8	0.6	
05	61.0	7.0	13.8	7.2	2.0	0.6	
06	61.0	9.0	17.7	7.2	2.2	0.8	
07	79.0	11.0	16.7	7.2	2.2	0.8	
08	58.0	9.0	18.6	7.2	2.1	0.7	
09	50.0	8.0	19.2		2.1		
10	59.0	8.0	16.3		2.0		
11	65.0	9.0	16.6	7.2	2.0	0.5	
12	34.0	5.0	17.6	7.2	2.0	0.7	
13	49.0	7.0	17.1	7.2	2.0	0.7	
14	40.0	6.0	18.0	7.2	2.1	0.6	
15	56.0	7.0	15.0	7.2	2.0	0.7	
16	45.0	6.0	16.0		2.2		
17	38.0	6.0	18.9		2.0		
18	63.0	7.0	13.3	7.2	2.2	0.8	
19	36.0	6.0	20.0	7.2	2.1	0.7	
20	69.0	7.0	12.2	7.2	2.1	0.6	
21	60.0	8.0	16.0	7.2	2.0	0.7	
22	54.0	7.0	15.6	7.2	2.2	0.7	
23	69.0	10.0	17.4		2.1		
24	61.0	8.0	15.7		2.1		
25	81.0	11.0	16.3	7.2	2.1	0.6	
26	66.0	9.0	16.4	7.2	2.0	0.7	
27	78.0	8.0	12.3	7.2	1.9	0.6	
28	97.0	12.0	14.8	7.2	2.0	0.6	
29	112.0	12.0	12.9	7.2	2.2	0.8	
30	73.0	6.0	9.9		2.0		
31	82.0	9.0	13.2		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 08-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULBE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Jenneth C. Snyder, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1951.0	241.0	483.6	158.4	55.5	15.7	
AVERAGE	62.9	7.8	15.6	7.2	1.8	0.7	
MAXIMUM	108.0	13.0	36.0	7.2	2.1	0.9	
MINIMUM	20.0	5.0	10.2	7.2	1.2	0.3	
01	37.0	5.0	16.2	7.2	2.1	0.9	
02	58.0	7.0	14.5	7.2	2.0	0.7	
03	65.0	7.0	12.9	7.2	1.8	0.8	
04	67.0	8.0	14.3		1.6		
05	61.0	6.0	11.8		1.6		
06	20.0	6.0	36.0		1.4		
07	32.0	5.0	18.8	7.2	1.8	0.7	
08	45.0	6.0	16.0	7.2	1.8	0.8	
09	56.0	5.0	10.7	7.2	1.8	0.8	
10	58.0	5.0	10.3	7.2	1.7	0.8	
11	56.0	5.0	10.7	7.2	1.8	0.8	
12	70.0	6.0	10.3		1.8		
13	88.0	8.0	10.9		1.8		
14	105.0	12.0	13.7	7.2	1.2	0.3	
15	92.0	13.0	17.0	7.2	1.5	0.4	
16	63.0	9.0	17.1	7.2	1.5	0.5	
17	108.0	13.0	14.4	7.2	1.8	0.7	
18	76.0	9.0	14.2	7.2	1.8	0.7	
19	61.0	13.0	25.6		1.6		
20	60.0	9.0	18.0		1.8		
21	78.0	10.0	15.4	7.2	1.8	0.7	
22	92.0	12.0	15.7	7.2	1.8	0.7	
23	77.0	10.0	15.6	7.2	1.7	0.7	
24	94.0	10.0	12.8	7.2	2.0	0.8	
25	59.0	5.0	10.2	7.2	2.0	0.8	
26	46.0	5.0	13.0		1.9		
27	65.0	7.0	12.9		1.9		
28	50.0	7.0	16.8	7.2	2.1	0.8	
29	43.0	7.0	19.5	7.2	2.0	0.8	
30	34.0	5.0	17.6	7.2	2.1	0.8	
31	35.0	6.0	20.6	7.2	2.0	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOU OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth C. Lynch*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1354.0	154.0	435.5	151.2	52.4	14.2	
AVERAGE	45.1	5.1	14.5	7.2	1.7	0.7	
MAXIMUM	93.0	10.0	29.1	7.2	2.5	0.8	
MINIMUM	24.0	3.0	8.2	7.2	0.6	0.2	
01	47.0	5.0	12.8		1.8		
02	32.0	3.0	11.3	7.2	1.6	0.7	
03	45.0	5.0	13.3	7.2	2.5	0.6	
04	31.0	3.0	11.6	7.2	2.0	0.2	
05	29.0	4.0	16.6	7.2	1.9	0.8	
06	28.0	4.0	17.1	7.2	1.9	0.7	
07	30.0	3.0	12.0		1.6		
08	33.0	4.0	14.5		1.6		
09	33.0	5.0	18.2	7.2	1.6	0.7	
10	47.0	6.0	15.3	7.2	1.7	0.7	
11	65.0	7.0	12.9	7.2	1.8	0.7	
12	35.0	5.0	17.1	7.2	1.7	0.8	
13	65.0	5.0	9.2	7.2	1.8	0.7	
14	35.0	5.0	17.1		1.7		
15	56.0	5.0	10.7		1.7		
16	74.0	10.0	16.2	7.2	1.8	0.7	
17	33.0	8.0	29.1	7.2	1.8	0.7	
18	27.0	4.0	17.8	7.2	1.2	0.5	
19	24.0	4.0	20.0	7.2	1.7	0.6	
20	67.0	7.0	12.5	7.2	1.8	0.7	
21	44.0	3.0	8.2		1.8		
22	52.0	5.0	11.5		1.6		
23	55.0	5.0	10.9	7.2	0.6	0.7	
24	93.0	8.0	10.3	7.2	1.8	0.7	
25	66.0	5.0	9.1	7.2	1.5	0.7	
26	60.0	7.0	14.0	7.2	1.8	0.7	
27	47.0	4.0	10.2	7.2	2.0	0.8	
28	45.0	5.0	13.3		2.0		
29	31.0	6.0	23.2		2.1		
30	25.0	4.0	19.2	7.2	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 06-12-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

AS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: DUF. OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Smyth, C.O., CERT. NO. C-4816

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1833.0	235.0	500.2	172.8	58.6	15.7	
AVERAGE	59.1	7.6	16.1	7.2	1.9	0.7	
MAXIMUM	89.0	14.0	28.2	7.2	2.5	1.0	
MINIMUM	17.0	4.0	10.6	7.2	1.5	0.6	
01	54.0	6.0	13.3	7.2	2.2	0.8	
02	57.0	6.0	12.6	7.2	2.2	0.8	
03	31.0	5.0	19.4	7.2	2.1		
04	68.0	6.0	10.6	7.2	2.0		
05	65.0	9.0	16.6	7.2	2.4	0.9	
06	65.0	8.0	14.8	7.2	2.5	1.0	
07	77.0	10.0	15.6	7.2	2.4	0.8	
08	77.0	8.0	12.5	7.2	2.4	0.9	
09	83.0	10.0	14.5	7.2	2.4	0.9	
10	89.0	12.0	16.2		1.8		
11	84.0	10.0	14.3		1.8		
12	29.0	5.0	20.7	7.2	1.9	0.8	
13	47.0	7.0	17.9	7.2	1.8	0.7	
14	61.0	8.0	15.7	7.2	1.5	0.6	
15	78.0	10.0	15.4	7.2	1.6	0.6	
16	86.0	14.0	19.5	7.2	1.6	0.7	
17	76.0	8.0	12.6		1.7		
18	76.0	8.0	12.6		1.7		
19	49.0	7.0	17.1	7.2	1.6	0.6	
20	61.0	6.0	11.8	7.2	1.8	0.7	
21	68.0	8.0	14.1	7.2	1.8	0.7	
22	83.0	11.0	15.9	7.2	1.8	0.7	
23	67.0	9.0	16.1	7.2	1.8	0.8	
24	61.0	8.0	15.7		1.6		
25	17.0	4.0	28.2		1.6		
26	50.0	6.0	14.4	7.2	1.8		
27	31.0	6.0	23.2	7.2	1.8	0.7	
28	26.0	4.0	18.5	7.2	1.8	0.7	
29	35.0	5.0	17.1	7.2	1.6	0.6	
30	50.0	6.0	14.4	7.2	1.8	0.7	
31	32.0	5.0	18.8		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 05-14-97

COMMENTS:

PWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: JAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth L. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1361.0	211.0	593.7	172.8	62.5	18.1	
AVERAGE	45.4	7.0	19.8	7.2	2.1	0.8	
MAXIMUM	103.0	14.0	30.0	7.2	2.3	1.0	
MINIMUM	24.0	3.0	9.1	7.2	1.8	0.7	
01	38.0	9.0	28.4	7.2	2.0	0.8	
02	25.0	6.0	28.8	7.2	2.1	0.8	
03	36.0	9.0	30.0	7.2	2.0	0.7	
04	32.0	8.0	30.0	7.2	1.8	0.7	
05	36.0	9.0	30.0	7.2	2.1		
06	40.0	8.0	24.0	7.2	2.0		
07	27.0	6.0	26.7	7.2	2.0	0.9	
08	33.0	8.0	29.1	7.2	2.0	0.8	
09	52.0	8.0	18.5	7.2	2.2	0.9	
10	42.0	8.0	22.9	7.2	2.0	0.9	
11	63.0	5.0	9.5	7.2	2.2	0.9	
12	53.0	4.0	9.1		2.0		
13	51.0	7.0	16.5		2.0		
14	47.0	7.0	17.9	7.2	2.1	0.8	
15	31.0	7.0	27.1	7.2	2.1	0.9	
16	50.0	6.0	14.4	7.2	2.0	0.7	
17	51.0	7.0	16.5	7.2	2.0	0.8	
18	73.0	9.0	14.8	7.2	2.2	0.8	
19	67.0	7.0	12.5		2.2		
20	103.0	14.0	16.3		2.2		
21	61.0	6.0	11.8	7.2	2.0	0.8	
22	51.0	6.0	14.1	7.2	2.1	0.8	
23	31.0	5.0	19.4	7.2	2.0	0.8	
24	44.0	6.0	16.4	7.2	2.0	0.7	
25	56.0	10.0	21.4	7.2	2.2	0.8	
26	27.0	3.0	13.3		2.2		
27	25.0	4.0	19.2		2.2		
28	24.0	4.0	20.0	7.2	2.3	1.0	
29	59.0	12.0	24.4	7.2	2.1	1.0	
30	33.0	3.0	10.9	7.2	2.2	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-09-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

A

PLANT ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Boyd, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1642.0	189.0	431.3	138.2	56.0	17.1	
AVERAGE	53.0	6.1	13.9	7.3	1.9	0.9	
MAXIMUM	95.0	10.0	25.5	7.3	2.0	1.2	
MINIMUM	26.0	3.0	9.2	7.2	1.6	0.6	
01	52.0	4.0	9.2		2.0		
02	52.0	5.0	11.5		1.9		
03	49.0	5.0	12.2	7.3	1.9	1.2	
04	57.0	7.0	14.7	7.3	1.8	1.0	
05	57.0	8.0	16.8	7.3	1.8	1.0	
06	43.0	5.0	14.0	7.3	1.8	0.9	
07	26.0	4.0	18.5	7.3	1.8	0.8	
08	74.0	9.0	14.6		1.8		
09	47.0	10.0	25.5		1.8		
10	65.0	7.0	12.9	7.3	2.0	1.0	
11	74.0	10.0	16.2	7.3	2.0	0.9	
12	49.0	8.0	19.6	7.3	1.8	0.8	
13	42.0	6.0	17.1	7.3	1.8	0.8	
14	45.0	5.0	13.3	7.3	2.0	0.8	
15	43.0	4.0	11.2		1.8		
16	53.0	5.0	11.3		1.6		
17	54.0	6.0	13.3	7.3	1.8	0.8	
18	57.0	6.0	12.6	7.3	2.0	0.9	
19	58.0	7.0	14.5	7.3	1.9	0.8	
20	35.0	3.0	10.3	7.3	1.8	0.8	
21	51.0	4.0	9.4	7.2	2.0	0.8	
22	49.0	4.0	9.8		2.0		
23	52.0	5.0	11.5		1.8		
24	60.0	5.0	10.0	7.2	1.9	0.8	
25	46.0	5.0	13.0		1.6	0.6	
26	49.0	6.0	14.7	7.2	1.8	0.7	
27	95.0	10.0	12.6	7.2	2.0	0.9	
28	52.0	7.0	16.2		2.0		
29	54.0	7.0	15.6		1.8		
30	43.0	6.0	16.7				
31	59.0	6.0	12.2	7.2	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-06-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOPI AKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULBE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth Boyd*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	500.1	127.0	860.7	165.6	59.8	16.2	
AVERAGE	17.9	4.5	30.7	7.2	2.1	0.9	
MAXIMUM	30.1	7.0	43.5	7.2	2.5	1.1	
MINIMUM	11.6	2.0	16.7	7.2	2.0	0.7	
01	19.7	6.0	36.5	7.2	2.0		
02	16.4	5.0	36.6	7.2	2.0		
03	22.4	6.0	32.1	7.2	2.0	0.9	
04	19.6	5.0	30.6	7.2	2.1	0.9	
05	19.0	5.0	31.6	7.2	2.4	1.1	
06	19.5	5.0	30.8	7.2	2.4	1.0	
07	11.7	4.0	41.0	7.2	2.0	0.8	
08	18.6	5.0	32.3	7.2	2.0	0.7	
09	17.6	6.0	40.9		2.1		
10	19.2	5.0	31.3	7.2	2.0	0.7	
11	13.8	5.0	43.5	7.2	2.0	0.8	
12	17.0	3.0	21.2	7.2	2.0	0.9	
13	11.6	3.0	31.0	7.2	2.0	0.9	
14	14.4	4.0	33.3	7.2	2.2	1.0	
15	14.1	4.0	34.0		2.2		
16	15.0	4.0	32.0		2.0		
17	14.0	4.0	34.3	7.2	2.5		
18	22.0	4.0	21.8	7.2	2.5		
19	21.5	4.0	22.3	7.2	2.1	0.8	
20	14.4	2.0	16.7	7.2	2.1	0.8	
21	12.6	2.0	19.0	7.2	2.3	0.9	
22	18.9	6.0	38.1		2.4		
23	21.2	5.0	28.3		2.2		
24	15.9	4.0	30.2	7.2	2.0	0.7	
25	16.8	3.0	21.4	7.2	2.1	0.8	
26	23.0	5.0	26.1	7.2	2.1	0.8	
27	30.1	7.0	27.9	7.2	2.1	0.9	
28	20.1	6.0	35.8	7.2	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 02-05-97

COMMENTS:

WWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: YULEE OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth E. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	551.8	142.0	1011.6	221.7	61.9	17.8	
AVERAGE	17.8	4.6	32.6	7.2	2.0	0.8	
MAXIMUM	42.1	8.0	48.0	7.2	2.4	1.0	
MINIMUM	7.8	2.0	10.1	7.1	1.8	0.6	
01	42.1	8.0	22.8	7.2	1.8		
02	29.2	5.0	20.5	7.2	2.1	0.7	
03	15.5	5.0	38.7	7.2	1.8	0.6	
04	23.8	2.0	10.1	7.2	1.8		
05	15.4	6.0	46.8	7.2	1.9		
06	14.7	4.0	32.7	7.2	2.0	1.0	
07	11.6	4.0	41.4	7.2	1.8	0.7	
08	18.1	4.0	26.5	7.2	2.1	1.0	
09	14.0	4.0	34.3	7.1	2.0	0.8	
10	12.5	4.0	38.4	7.1	2.0	0.9	
11	16.6	5.0	36.1	7.1	1.9		
12	16.7	5.0	35.9	7.1	2.0		
13	12.4	4.0	38.7	7.1	2.2	1.0	
14	14.7	4.0	32.7	7.1	2.0	0.8	
15	17.3	5.0	34.7	7.1	1.8	0.6	
16	7.8	2.0	30.8	7.1	1.8	0.7	
17	25.2	6.0	28.6	7.1	1.8	0.7	
18	23.0	7.0	36.5	7.2	2.0		
19	21.9	5.0	27.4	7.2	1.8		
20	11.2	4.0	42.9	7.2	2.4	1.0	
21	15.5	4.0	31.0	7.1	2.0	0.8	
22	16.1	4.0	29.8	7.1	2.0	0.8	
23	22.4	4.0	21.4	7.1	2.1	0.8	
24	10.0	4.0	48.0	7.1	2.0	0.7	
25	18.7	6.0	38.5	7.1	1.8		
26	19.4	5.0	30.9	7.1	2.1		
27	19.8	5.0	30.3	7.2	2.0	0.8	
28	20.0	5.0	30.0	7.2	2.3	0.9	
29	13.4	4.0	35.8	7.2	2.1	0.8	
30	14.3	4.0	33.6	7.2	2.4	1.0	
31	18.5	4.0	25.9	7.2	2.1	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Stoddard, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4075.0	334.0	305.7	153.3	59.7	15.2	
AVERAGE	131.5	10.8	9.9	7.3	1.9	0.7	
MAXIMUM	170.0	20.0	17.1	7.3	2.1	0.9	
MINIMUM	93.0	4.0	3.4	7.3	1.8	0.6	
01	133.0	10.0	9.0	7.3	1.9	0.8	
02	138.0	10.0	8.7	7.3	1.9	0.7	
03	170.0	13.0	9.2	7.3	2.1	0.7	
04	118.0	12.0	12.2	7.3	2.0	0.7	
05	144.0	10.0	8.3	7.3	1.8	0.7	
06	140.0	20.0	17.1		2.0		
07	143.0	19.0	15.9		1.9		
08	122.0	12.0	11.8	7.3	2.0	0.7	
09	116.0	8.0	8.3	7.3	2.1	0.7	
10	140.0	19.0	16.3	7.3	2.1	0.7	
11	139.0	12.0	10.4	7.3	2.1	0.9	
12	103.0	8.0	9.3	7.3	1.9	0.9	
13	143.0	4.0	3.4		2.0		
14	114.0	5.0	5.3		1.8		
15	120.0	12.0	12.0	7.3	1.8	0.7	
16	138.0	11.0	9.6	7.3	1.9	0.7	
17	93.0	8.0	10.3	7.3	2.0	0.9	
18	154.0	10.0	7.8	7.3	1.8	0.7	
19	156.0	8.0	6.2	7.3	1.8	0.7	
20	136.0	13.0	11.5		1.9		
21	119.0	11.0	11.1		1.8		
22	116.0	10.0	10.3	7.3	1.8	0.7	
23	129.0	11.0	10.2	7.3	1.8	0.6	
24	151.0	13.0	10.3	7.3	1.8	0.6	
25	132.0	12.0	10.9		1.9		
26	159.0	13.0	9.8		1.8		
27	122.0	9.0	8.9		1.9		
28	168.0	8.0	5.7		1.9		
29	109.0	8.0	8.8	7.3	2.0	0.7	
30	105.0	8.0	9.1	7.3	2.1	0.7	
31	105.0	7.0	8.0	7.3	2.1	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 12-16-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Hillman, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4177.0	415.0	358.8	131.4	57.6	15.0	
AVERAGE	139.2	13.8	12.0	7.3	1.9	0.8	
MAXIMUM	174.0	21.0	18.4	7.3	2.3	1.1	
MINIMUM	90.0	8.0	6.2	7.3	1.4	0.6	
01	132.0	11.0	10.0		2.0		
02	90.0	8.0	10.7		2.0		
03	174.0	20.0	13.8	7.3	2.1	1.0	
04	116.0	14.0	14.5	7.3	2.3	1.1	
05	161.0	17.0	12.7	7.3	2.1	1.1	
06	120.0	11.0	11.0	7.3	2.1	1.0	
07	100.0	12.0	14.4	7.3	2.0	0.9	
08	123.0	15.0	14.6		2.0		
09	157.0	15.0	11.5		1.9		
10	151.0	15.0	11.9	7.3	2.1	0.9	
11	115.0	11.0	11.5	7.3	2.0	0.9	
12	137.0	10.0	8.8	7.3	1.9	0.7	
13	138.0	13.0	11.3	7.3	1.9	0.8	
14	131.0	10.0	9.2	7.3	1.8	0.8	
15	154.0	8.0	6.2		1.8		
16	150.0	9.0	7.2		1.6		
17	150.0	18.0	14.4	7.3	1.7	0.6	
18	141.0	10.0	8.5	7.3	1.7	0.6	
19	157.0	21.0	16.1	7.3	1.7	0.7	
20	135.0	12.0	10.7	7.3	1.9	0.8	
21	155.0	10.0	7.7	7.3	1.9	0.8	
22	135.0	14.0	12.4		1.4		
23	148.0	16.0	13.0		2.0		
24	147.0	17.0	13.9	7.3	1.8	0.7	
25	145.0	14.0	11.6	7.3	2.1	0.8	
26	124.0	19.0	18.4	7.3	2.0	0.8	
27	164.0	17.0	12.4		2.0		
28	154.0	18.0	14.0		1.8		
29	148.0	15.0	12.2		2.0		
30	125.0	15.0	14.4		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 11-06-97

CAUTION

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039W

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Shipman, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4353.0	398.0	344.8	167.9	58.2	17.7	
AVERAGE	140.4	12.8	11.1	7.3	1.9	0.8	
MAXIMUM	182.0	18.0	15.1	7.3	2.1	1.1	
MINIMUM	100.0	8.0	6.7	7.3	0.8	0.6	
01	138.0	13.0	11.3	7.3	2.0	0.9	
02	143.0	8.0	6.7	7.3	2.1	1.1	
03	167.0	12.0	8.6	7.3	1.7	0.6	
04	141.0	14.0	11.9		1.9		
05	122.0	13.0	12.8		1.8		
06	135.0	13.0	11.6	7.3	2.0	1.0	
07	174.0	12.0	8.3	7.3	1.9	0.9	
08	167.0	12.0	8.6	7.3	1.9	0.8	
09	155.0	10.0	7.7	7.3	0.8	0.8	
10	164.0	12.0	8.8	7.3	1.9	0.9	
11	136.0	12.0	10.6		1.9		
12	141.0	15.0	12.8		1.8		
13	150.0	16.0	12.8	7.3	1.8	0.7	
14	111.0	14.0	15.1	7.3	1.9	0.7	
15	143.0	15.0	12.6	7.3	2.1	0.8	
16	120.0	12.0	12.0	7.3	2.0	0.8	
17	142.0	13.0	11.0	7.3	2.0	0.8	
18	136.0	15.0	13.2		2.0		
19	127.0	12.0	11.3		1.9		
20	120.0	11.0	11.0	7.3	2.0	0.8	
21	182.0	16.0	10.5	7.3	2.0	0.7	
22	111.0	13.0	14.1	7.3	1.8	0.7	
23	136.0	10.0	8.8	7.3	1.8	0.6	
24	154.0	10.0	7.8	7.3	1.8	0.6	
25	145.0	10.0	8.3		1.8		
26	123.0	10.0	9.8		1.8		
27	100.0	10.0	12.0	7.3	1.9	0.7	
28	135.0	15.0	13.3	7.3	1.9	0.6	
29	131.0	15.0	13.7	7.3	1.9	0.6	
30	144.0	18.0	15.0	7.3	2.1	0.8	
31	160.0	17.0	12.8	7.3	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 10-14-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Hillard, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4589.0	391.0	309.4	153.3	54.6	15.3	
AVERAGE	153.0	13.0	10.3	7.3	1.8	0.7	
MAXIMUM	191.0	25.0	16.9	7.3	2.3	1.2	
MINIMUM	92.0	7.0	5.0	7.3	1.3	0.4	
01	178.0	25.0	16.9		1.6		
02	162.0	17.0	12.6	7.3	2.3	1.2	
03	107.0	10.0	11.2	7.3	2.1	1.0	
04	169.0	20.0	14.2	7.3	2.1	1.0	
05	136.0	8.0	7.1	7.3	1.9	0.8	
06	162.0	8.0	5.9		1.9		
07	167.0	7.0	5.0		1.8		
08	186.0	8.0	5.2	7.3	1.8	0.8	
09	158.0	12.0	9.1	7.3	1.6	0.4	
10	181.0	16.0	10.6	7.3	1.3	0.5	
11	165.0	10.0	7.3	7.3	2.0	0.8	
12	181.0	11.0	7.3	7.3	2.0	1.0	
13	163.0	12.0	8.8		1.8		
14	168.0	12.0	8.6		1.8		
15	115.0	10.0	10.4	7.3	1.9	1.0	
16	148.0	12.0	9.7	7.3	1.8	0.7	
17	140.0	15.0	12.9	7.3	1.8	0.7	
18	165.0	14.0	10.2	7.3	1.8	0.6	
19	176.0	14.0	9.5	7.3	2.0	0.7	
20	182.0	19.0	12.5		1.8		
21	170.0	16.0	11.3		1.8		
22	92.0	10.0	13.0	7.3	1.9	0.7	
23	135.0	14.0	12.4	7.3	1.5	0.5	
24	128.0	12.0	11.3	7.3	1.5	0.5	
25	191.0	19.0	11.9	7.3	1.7	0.6	
26	108.0	11.0	12.2	7.3	1.7	0.5	
27	134.0	12.0	10.7		1.8		
28	124.0	10.0	9.7		2.0		
29	139.0	13.0	11.2	7.3	1.8	0.6	
30	159.0	14.0	10.6	7.3	1.8	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039M

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Shilland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	936.0	71.0	86.1	36.5	10.2	3.8	
AVERAGE	133.7	10.1	12.3	7.3	1.5	0.8	
MAXIMUM	178.0	12.0	32.7	7.3	1.8	1.3	
MINIMUM	11.0	3.0	7.2	7.3	1.3	0.4	
01							
02							
03							
04							
05							
06							
07							
08							
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25	11.0	3.0	32.7	7.3	1.3	1.2	
26	131.0	12.0	11.0	7.3	1.4	1.3	
27	151.0	9.0	7.2	7.3	1.7	0.5	
28	178.0	12.0	8.1	7.3	1.3	0.4	
29	157.0	12.0	9.2	7.3	1.4	0.4	
30	143.0	11.0	9.2		1.3		
31	165.0	12.0	8.7		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

SAMPLE DATE: 08-12-97

COMMENTS: Plant off line for repair 8/1-8/25/97 Water provided by city intertia.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Stullman, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4807.0	444.0	329.3	160.6	56.6	18.4	
AVERAGE	165.8	15.3	11.4	7.3	2.0	0.8	
MAXIMUM	220.0	25.0	26.4	7.3	2.2	1.1	
MINIMUM	11.0	1.0	6.7	7.3	1.6	0.7	
01	180.0	18.0	12.0	7.3	2.0	0.8	
02	195.0	18.0	11.1	7.3	2.1	0.8	
03	144.0	11.0	9.2	7.3	2.2	0.8	
04	220.0	25.0	13.6		2.0		
05	147.0	12.0	9.8		1.8		
06	151.0	20.0	15.9		1.8		
07	159.0	15.0	11.3	7.3	2.0	0.8	
08	169.0	15.0	10.7	7.3	1.8	0.8	
09	187.0	16.0	10.3	7.3	1.6	0.7	
10	212.0	19.0	10.8	7.3	1.8	0.8	
11	153.0	15.0	11.8	7.3	1.6	0.7	
12	149.0	15.0	12.1		1.9		
13	176.0	17.0	11.6		2.1		
14	145.0	18.0	14.9	7.3	2.0	0.9	
15	91.0	20.0	26.4	7.3	1.9	0.9	
16	213.0	20.0	11.3	7.3	2.1	1.0	
17	139.0	16.0	13.8	7.3	2.0	1.0	
18	203.0	15.0	8.9	7.3	2.0	0.9	
19	163.0	10.0	7.4		2.0		
20	162.0	9.0	6.7		2.0		
21	166.0	10.0	7.2	7.3	1.9	0.8	
22	178.0	12.0	8.1	7.3	1.8	0.8	
23	193.0	16.0	9.9	7.3	1.8	0.7	
24	202.0	16.0	9.5	7.3	2.0	0.7	
25	161.0	12.0	8.9	7.3	2.0	0.8	
26	175.0	18.0	12.3		2.0		
27	184.0	18.0	11.7		2.1		
28	179.0	17.0	11.4	7.3	2.1	0.7	
29	11.0	1.0	10.9	7.3	2.2	0.9	
30				7.3		1.0	
31				7.3		1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 07-16-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: H... LIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Stuckland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4920.0	414.0	304.0	153.3	58.5	17.0	
AVERAGE	164.0	13.8	10.1	7.3	2.0	0.8	
MAXIMUM	216.0	21.0	13.8	7.3	2.2	1.0	
MINIMUM	116.0	8.0	6.2	7.3	1.6	0.6	
01	179.0	15.0	10.1		2.0		
02	179.0	16.0	10.7	7.3	2.0	1.0	
03	151.0	14.0	11.1	7.3	2.0	1.0	
04	116.0	9.0	9.3	7.3	2.1	1.0	
05	125.0	10.0	9.6	7.3	1.8	0.9	
06	169.0	15.0	10.7	7.3	1.9	0.8	
07	146.0	13.0	10.7		2.2		
08	156.0	15.0	11.5		1.6		
09	151.0	15.0	11.9	7.3	1.8	0.9	
10	172.0	18.0	12.6	7.3	2.0	0.8	
11	159.0	16.0	12.1	7.3	1.9	0.8	
12	148.0	16.0	13.0	7.3	1.9	1.0	
13	183.0	21.0	13.8	7.3	2.1	0.8	
14	174.0	17.0	11.7		2.0		
15	168.0	18.0	12.9		2.0		
16	195.0	15.0	9.2	7.3	2.0	0.8	
17	216.0	13.0	7.2	7.3	1.9	0.8	
18	162.0	17.0	12.6	7.3	1.8	0.8	
19	157.0	17.0	13.0	7.3	2.0	0.8	
20	189.0	10.0	6.3	7.3	2.0	0.7	
21	162.0	9.0	6.7		2.0		
22	127.0	8.0	7.6		1.8		
23	173.0	9.0	6.2	7.3	1.8	0.6	
24	150.0	11.0	8.8	7.3	1.8	0.6	
25	163.0	10.0	7.4	7.3	2.1	0.6	
26	191.0	11.0	6.9	7.3	2.0	0.7	
27	165.0	12.0	8.7	7.3	2.1	0.8	
28	154.0	13.0	10.1		2.0		
29	212.0	20.0	11.3		1.9		
30	128.0	11.0	10.3	7.3	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE:06-23-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039K

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Bonnie E. Smith C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5441.0	531.0	369.1	197.1	60.5	22.3	
AVERAGE	175.5	17.1	11.9	7.3	2.0	1.1	
MAXIMUM	235.0	24.0	21.5	7.3	2.3	1.3	
MINIMUM	67.0	6.0	8.6	7.3	1.6	0.8	
01	222.0	17.0	9.2	7.3	2.2	1.1	
02	170.0	13.0	9.2	7.3	2.0	1.0	
03	169.0	18.0	12.8	7.3	2.3		
04	182.0	18.0	11.9	7.3	2.2		
05	178.0	24.0	16.2	7.3	2.3	1.2	
06	184.0	17.0	11.1	7.3	2.3	1.3	
07	179.0	22.0	14.7	7.3	2.2	1.2	
08	106.0	19.0	21.5	7.3	2.1	1.1	
09	184.0	18.0	11.7	7.3	2.1	1.1	
10	180.0	18.0	12.0		1.6		
11	171.0	18.0	12.6		2.0		
12	223.0	16.0	8.6	7.3	2.0	1.2	
13	223.0	20.0	10.8	7.3	1.8	1.0	
14	200.0	19.0	11.4	7.3	2.0	1.1	
15	200.0	19.0	11.4	7.3	2.0	1.2	
16	172.0	16.0	11.2	7.3	1.8	1.0	
17	175.0	20.0	13.7		1.8		
18	143.0	13.0	10.9		2.0		
19	235.0	20.0	10.2	7.3	1.9	0.9	
20	166.0	14.0	10.1	7.3	1.9	1.0	
21	232.0	22.0	11.4	7.3	1.8	1.0	
22	159.0	17.0	12.8	7.3	1.8	0.9	
23	210.0	21.0	12.0	7.3	1.9	0.8	
24	180.0	18.0	12.0	7.3	1.8		
25	102.0	12.0	14.1	7.3	1.6		
26	186.0	18.0	11.6	7.3	1.8		
27	67.0	6.0	10.7	7.3	1.7	1.0	
28	155.0	15.0	11.6	7.3	1.8	1.0	
29	173.0	16.0	11.1	7.3	1.9	1.1	
30	151.0	12.0	9.5	7.3	1.9	1.1	
31	164.0	15.0	11.0	7.3	2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 05-15-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: M...A GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ramona E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5091.0	494.0	351.4	175.2	60.2	21.5	
AVERAGE	169.7	16.5	11.7	7.3	2.0	1.0	
MAXIMUM	238.0	24.0	14.6	7.3	2.2	1.3	
MINIMUM	123.0	12.0	9.4	7.3	1.7	0.7	
01	181.0	16.0	10.6	7.3	1.8	0.8	
02	170.0	17.0	12.0	7.3	1.8	0.8	
03	200.0	18.0	10.8	7.3	1.9	0.8	
04	164.0	15.0	11.0	7.3	1.9	0.8	
05	159.0	15.0	11.3	7.3	2.0		
06	156.0	15.0	11.5	7.3	2.0		
07	178.0	17.0	11.5	7.3	1.8	0.7	
08	172.0	16.0	11.2	7.3	1.7	0.7	
09	238.0	24.0	12.1	7.3	1.9	0.7	
10	150.0	15.0	12.0	7.3	2.0	0.9	
11	234.0	23.0	11.8	7.3	2.2	1.1	
12	123.0	12.0	11.7		2.0		
13	192.0	18.0	11.3		2.0		
14	150.0	15.0	12.0	7.3	2.1	1.0	
15	147.0	15.0	12.2	7.3	2.2	1.0	
16	138.0	13.0	11.3	7.3	2.0	1.0	
17	192.0	15.0	9.4	7.3	2.0	1.3	
18	181.0	17.0	11.3	7.3	2.0	1.2	
19	169.0	15.0	10.7		2.2		
20	213.0	18.0	10.1		1.9		
21	182.0	17.0	11.2	7.3	2.0	1.1	
22	148.0	18.0	14.6	7.3	2.0	1.0	
23	181.0	18.0	11.9	7.3	2.0	1.2	
24	170.0	18.0	12.7	7.3	2.2	1.1	
25	189.0	19.0	12.1	7.3	2.2	1.2	
26	130.0	12.0	11.1		2.0		
27	137.0	13.0	11.4		2.2		
28	186.0	19.0	12.3	7.3	2.2	1.1	
29	127.0	15.0	14.2	7.3	2.0	1.0	
30	134.0	16.0	14.3	7.3	2.0	1.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Burner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4679.0	424.0	339.1	146.0	61.1	17.5	
AVERAGE	150.9	13.7	10.9	7.3	2.0	0.9	
MAXIMUM	201.0	21.0	15.6	7.3	2.2	1.0	
MINIMUM	109.0	8.0	7.1	7.3	1.8	0.7	
01	148.0	14.0	11.4		2.0		
02	152.0	14.0	11.1		1.8		
03	109.0	8.0	8.8	7.3	2.0	0.9	
04	188.0	16.0	10.2	7.3	2.2	1.0	
05	148.0	14.0	11.4	7.3	2.2	1.0	
06	124.0	16.0	15.5	7.3	2.0	0.9	
07	168.0	15.0	10.7	7.3	2.0	0.8	
08	174.0	15.0	10.3		2.0		
09	142.0	13.0	11.0		2.2		
10	186.0	16.0	10.3	7.3	2.2	0.8	
11	201.0	21.0	12.5	7.3	2.2	0.8	
12	122.0	13.0	12.8	7.3	2.0	1.0	
13	125.0	12.0	11.5	7.3	2.1	1.0	
14	173.0	13.0	9.0	7.3	2.1	1.0	
15	169.0	10.0	7.1		2.0		
16	123.0	16.0	15.6		1.8		
17	143.0	12.0	10.1	7.3	1.8	0.9	
18	140.0	14.0	12.0	7.3	1.8	0.8	
19	151.0	13.0	10.3	7.3	1.9	0.8	
20	136.0	12.0	10.6	7.3	1.8	0.8	
21	145.0	14.0	11.6	7.3	1.8	0.8	
22	138.0	11.0	9.6		2.0		
23	156.0	15.0	11.5		1.9		
24	153.0	15.0	11.8	7.3	1.9	0.9	
25	148.0	14.0	11.4	7.3	2.1	0.9	
26	148.0	12.0	9.7	7.3	2.0	0.9	
27	184.0	18.0	11.7	7.3	1.8	0.7	
28	176.0	13.0	8.9		2.0		
29	146.0	14.0	11.5		1.9		
30	138.0	10.0	8.7		1.8		
31	125.0	11.0	10.6	7.3	1.8	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE:03-19-97

U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

NA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

TER FLORIDA INC.

REPORTING MONTH: February 1997

7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

MAIN OFFICE PHONE NO. (904) 725-2865

REPORT IS CORRECT

Banner I. Strickland, C.O., CERT. NO. C-7255

WATER TAKEN IN GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
958.0	331.0	280.6	167.9	52.5	14.0	
141.4	11.8	10.0	7.3	1.9	0.7	
166.0	16.0	13.2	7.3	2.1	0.9	
94.0	3.0	2.6	7.3	1.5	0.5	
137.0	3.0	2.6	7.3	1.8		
122.0	8.0	7.9	7.3	1.8		
162.0	10.0	7.4	7.3	1.5	0.6	
151.0	14.0	11.1	7.3	1.5	0.6	
163.0	12.0	8.8	7.3	1.6	0.6	
123.0	10.0	9.8	7.3	1.8	0.7	
159.0	10.0	7.5	7.3	1.8	0.6	
142.0	12.0	10.1	7.3	1.8		
142.0	13.0	11.0	7.3	1.9		
143.0	13.0	10.9	7.3	1.7	0.5	
133.0	11.0	9.9	7.3	1.7	0.6	
137.0	15.0	13.1	7.3	1.8	0.6	
152.0	14.0	11.1	7.3	1.9	0.8	
164.0	16.0	11.7	7.3	1.9	0.8	
146.0	14.0	11.5		1.8		
154.0	15.0	11.7		2.0		
146.0	16.0	13.2		2.0		
144.0	14.0	11.7	7.3	2.1	0.8	
148.0	14.0	11.4	7.3	2.0	0.9	
147.0	15.0	12.2	7.3	2.0	0.9	
112.0	7.0	7.5	7.3	2.0	0.9	
110.0	10.0	10.9		1.8	0.9	
101.0	10.0	11.9		2.0		
151.0	13.0	10.3	7.3	2.0		
146.0	10.0	8.2	7.3	2.1	0.8	
94.0	7.0	8.9	7.3	2.1	0.8	
166.0	13.0	9.4	7.3	2.1	0.8	
163.0	12.0	8.8	7.3	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 02-05-97

COMMENTS:

ID NO. 2160708 C.U.P. NO. 2-031-0039H

NAME OF DRINKING WATER SYSTEM: PALM GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4724.0	480.0	378.1	225.0	55.1	15.3	
AVERAGE	152.4	15.5	12.2	7.3	1.8	0.7	
MAXIMUM	210.0	25.0	18.4	7.3	2.1	0.9	
MINIMUM	102.0	8.0	7.0	7.2	1.6	0.6	
01	182.0	15.0	9.9	7.3	1.8		
02	139.0	14.0	12.1	7.3	2.0	0.6	
03	168.0	15.0	10.7	7.2	1.8	0.6	
04	151.0	16.0	12.7	7.3	1.8		
05	141.0	14.0	11.9	7.3	1.6		
06	130.0	12.0	11.1	7.2	1.8	0.7	
07	122.0	10.0	9.8	7.2	1.8	0.7	
08	154.0	14.0	10.9	7.3	1.8	0.7	
09	122.0	9.0	8.9	7.3	1.7	0.7	
10	195.0	13.0	8.0	7.3	1.8	0.8	
11	144.0	12.0	10.0	7.3	1.8		
12	138.0	8.0	7.0	7.3	1.7		
13	169.0	15.0	10.7	7.3	1.7	0.8	
14	126.0	9.0	8.6	7.3	1.6	0.7	
15	168.0	14.0	10.0	7.3	1.6	0.7	
16	139.0	12.0	10.4	7.3	1.6	0.6	
17	210.0	18.0	10.3	7.3	1.7	0.6	
18	192.0	23.0	14.4	7.3	1.6		
19	102.0	14.0	16.5	7.3	1.7		
20	173.0	20.0	13.9	7.3	1.6	0.7	
21	157.0	16.0	12.2	7.3	1.9	0.8	
22	140.0	21.0	18.0	7.2	1.9	0.8	
23	164.0	23.0	16.8	7.2	1.7	0.6	
24	160.0	22.0	16.5	7.2	1.7	0.6	
25	148.0	22.0	17.8	7.2	1.8		
26	163.0	25.0	18.4	7.2	2.0		
27	143.0	13.0	10.9	7.2	2.1	0.9	
28	162.0	16.0	11.9	7.2	2.0	0.8	
29	134.0	13.0	11.6	7.2	1.7	0.6	
30	133.0	12.0	10.8	7.2	1.8	0.6	
31	155.0	20.0	15.5	7.2	2.0	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : December, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : David DeLaney, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	12789.0	1155	338.5	28.5	91.2	4.1	55.6	N/A	N/A
AVERAGE	412.5	37	10.9	7.1	2.9	1.0	1.8	0.5	0.04
MAXIMUM	542.0	45	13.3	7.2	3.5	1.4	8.2	1.8	0.05
MINIMUM	284.0	28	7.6	7.1	1.0	0.7	0.0	0.0	0.02
01	433.0	41	11.4	7.2	3.5	0.7	5.8	1.6	
02	441.0	28	7.6		3.2		5.8	1.6	
03	370.0	29	9.4		3.5		3.5	1.1	
04	455.0	32	8.4		3.5		4.3	1.1	0.05
05	401.0	39	11.7		3.2		3.5	1.0	
06	542.0	43	9.5		3.0		8.2	1.8	
07	284.0	31	13.1		2.5		3.5	1.5	
08	386.0	32	9.9	7.1	3.3	0.9	3.1	1.0	
09	408.0	41	12.0		2.1		2.3	0.7	
10	405.0	41	12.1		3.0		2.3	0.7	
11	391.0	43	13.2		2.5		2.7	0.8	
12	445.0	39	10.5		3.5		0.4	0.1	
13	352.0	39	13.3		3.0		0.4	0.1	
14	466.0	43	11.1		1.0		1.2	0.3	
15	386.0	34	13.3	7.1	3.2	1.4	0.0	0.0	
16	436.0	43	11.8		3.0		1.2	0.3	
17	384.0	34	10.6		3.5		0.4	0.1	
18	416.0	41	11.8		3.3		0.8	0.2	0.02
19	418.0	40	11.5		3.5		0.8	0.2	
20	454.0	35	9.2		2.6		1.2	0.3	
21	436.0	35	9.6		2.4		1.6	0.4	
22	421.0	37	10.5	7.1	3.0	1.1	1.9	0.6	
23	397.0	39	11.8		2.1		0.4	0.1	
24	418.0	34	9.8		3.3		0.0	0.0	
25	394.0	35	10.7		3.5		0.0	0.0	
26	382.0	32	10.0		3.1		0.4	0.1	
27	383.0	35	11.0		2.4		0.0	0.0	
28	478.0	37	9.3		3.0		0.0	0.0	
29	425.0	34	9.6		2.5		0.0	0.0	
30	423.0	44	12.5		2.5		0.0	0.0	
31	439.0	45	12.3		3.5		0.0	0.0	

- NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 12-02-97
Isle of Palms-B System: 2 Date: 12-16-97
- WELL ARTESIAN PRESSURES: (1) WELL NO.1 6 psi (2) WELL NO.2 8 psi

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robert DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE MG/L	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	13679.0	1166	311.2	28.4	92.3	3.8	416.6	N/A	N/A
AVERAGE	456.0	39	10.4	7.1	3.1	1.0	13.9	3.6	0.27
MAXIMUM	618.0	48	14.6	7.2	3.5	1.2	24.9	5.0	0.34
MINIMUM	303.0	30	8.3	7.0	1.8	0.7	5.4	1.9	0.20
01	456.0	43	11.3		3.0		10.9	2.9	
02	406.0	30	8.9		3.2		12.5	3.7	
03	375.0	31	9.9	7.1	3.3	0.7	9.3	3.0	
04	618.0	44	8.5		1.8		24.9	4.8	
05	360.0	33	11.0		3.5		8.6	2.9	
06	453.0	34	9.0		3.5		14.0	3.7	0.20
07	424.0	43	12.2		3.3		10.5	3.0	
08	479.0	46	11.5		2.5		15.2	3.8	
09	454.0	35	9.2		2.5		14.8	3.9	
10	454.0	39	10.3	7.1	3.2	1.2	14.4	3.8	
11	495.0	41	9.9		2.0		16.7	4.1	
12	417.0	34	9.8		3.5		12.1	3.5	
13	409.0	33	9.7		3.5		10.9	3.2	
14	387.0	39	12.1		3.5		16.0	5.0	
15	431.0	31	8.6		3.0		10.9	3.0	
16	517.0	39	9.0		3.2		17.1	4.0	
17	426.0	34	9.6	7.0	3.5	0.9	11.7	3.3	
18	522.0	40	9.2		3.2		15.6	3.6	
19	593.0	41	8.3		3.5		22.9	4.6	0.34
20	444.0	47	12.7		3.0		13.2	3.6	
21	394.0	48	14.6		2.1		10.1	3.1	
22	551.0	42	9.1		3.5		20.2	4.4	
23	564.0	42	8.9		2.4		20.6	4.4	
24	498.0	48	11.6	7.2	3.3	1.0	18.3	4.4	
25	409.0	41	12.0		3.5		11.7	3.4	
26	561.0	39	8.3		3.5		19.1	4.1	
27	400.0	35	10.5		3.5		9.3	2.8	
28	472.0	42	10.7		3.0		13.2	3.4	
29	407.0	37	10.9		2.8		6.6	1.9	
30	303.0	35	13.9		3.0		5.4	2.2	

- NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 11-03-97
Isle of Palms-B System: 2 Date: 11-04-97
- WELL ARTESIAN PRESSURES: (1) WELL NO.1 9 psi (2) WELL NO.2 11 psi

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : October, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Donna D. May, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS. USED	MG/L	TOTAL PHOSPHATE SAMPLE MG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	14876.0	1409	356.1	35.5	91.3	3.8	683.9	N/A	N/A
AVERAGE	479.9	45	11.5	7.1	2.9	0.8	22.1	5.4	0.19
MAXIMUM	674.0	68	14.7	7.2	3.5	1.0	35.8	7.0	0.33
MINIMUM	328.0	33	8.3	7.0	1.5	0.5	10.9	3.1	0.05
01	500.0	51	12.2	7.1	2.0	0.9	26.4	6.3	
02	462.0	48	12.5		1.9		23.3	6.1	
03	550.0	53	11.6		3.5		29.5	6.4	0.05
04	523.0	46	10.5		2.8		20.0	6.4	
05	505.0	49	11.6		3.0		27.6	6.6	
06	593.0	49	9.9		3.1		33.1	6.7	
07	630.0	49	9.3	7.0	1.5	0.5	35.8	6.8	
08	467.0	45	11.6		3.5		26.8	6.9	
09	569.0	54	11.4		2.0		33.1	7.0	
10	674.0	68	12.1		3.1		35.8	6.4	
11	480.0	48	12.0		3.5		27.2	6.8	
12	407.0	37	10.9		2.5		23.3	6.9	
13	439.0	50	13.7		2.5		23.7	6.5	
14	452.0	41	10.9	7.1	3.5	1.0	24.9	6.6	
15	434.0	43	11.9		3.3		23.3	6.4	
16	375.0	40	12.8		3.0		14.0	4.5	0.33
17	400.0	33	9.7		3.5		17.9	5.3	
18	420.0	34	9.5		3.1		16.7	4.7	
19	551.0	38	8.3		2.5		22.6	4.9	
20	347.0	40	13.8		2.1		10.9	3.8	
21	521.0	38	8.7	7.2	2.3	0.7	19.4	4.5	
22	452.0	47	12.5		3.5		16.7	4.4	
23	462.0	46	11.9		3.5		19.1	4.9	
24	570.0	50	10.5		3.5		21.8	4.6	
25	486.0	53	13.1		3.2		17.9	4.4	
26	328.0	37	13.5		3.0		15.2	5.5	
27	417.0	51	14.7		3.5		14.8	4.2	
28	395.0	48	14.6	7.1	3.5	0.7	12.1	3.7	
29	461.0	40	10.4		2.8		13.6	3.5	
30	426.0	35	9.9		3.1		14.8	4.2	
31	564.0	48	10.2		3.5		14.8	3.1	

- NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 2 Date: 10-01-97
Isle of Palms-B System: 4 Date: 10-07-97
- WELL ARTESIAN PRESSURES: (1) WELL NO.1 8 psi (2) WELL NO.2 10 psi

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : September, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Richard Man, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE SAMPLE NG/L
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	18245.0	1663	332.2	28.3		3.0	881.5	N/A	N/A
AVERAGE	608.2	55	11.1	7.1		0.8	29.4	5.8	0.24
MAXIMUM	877.0	72	14.7	7.1		0.9	51.3	8.9	0.41
MINIMUM	385.0	41	9.2	7.0		0.6	13.6	3.3	0.06
01	518.0	48	11.1				15.9	3.7	
02	560.0	50	10.7				16.5	3.5	
03	636.0	57	10.7	7.1		0.9	19.3	3.6	
04	490.0	46	11.3				13.6	3.3	0.06
05	565.0	51	10.8				15.9	3.4	
06	677.0	52	9.2				20.5	3.6	
07	669.0	55	9.9				21.6	3.9	
08	667.0	55	9.9				21.0	3.8	
09	668.0	60	10.8				22.7	4.1	
10	494.0	48	11.7	7.1		0.6	21.3	5.2	
11	580.0	54	11.2				23.5	4.9	
12	627.0	51	9.8				32.3	6.2	
13	651.0	59	10.9				41.6	7.7	
14	877.0	69	9.4				51.3	7.0	
15	689.0	64	11.1				40.0	7.0	
16	653.0	55	10.1				38.9	7.1	
17	644.0	56	10.4				29.5	5.5	
18	632.0	65	12.3				36.9	7.0	0.41
19	857.0	72	10.1				48.7	6.8	
20	735.0	57	9.3				42.4	6.9	
21	457.0	56	14.7				33.8	8.9	
22	640.0	57	10.7	7.0		0.7	37.3	7.0	
23	633.0	62	11.7				37.3	7.1	
24	450.0	47	12.5				26.4	7.0	
25	502.0	51	12.2				29.2	7.0	
26	568.0	66	13.9				33.1	7.0	
27	698.0	67	11.5				39.7	6.8	
28	385.0	41	12.8				20.6	6.4	
29	514.0	45	10.5	7.1		0.8	25.3	5.9	
30	509.0	47	11.1				25.7	6.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Robert D. Man, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE LBS. USED	TOTAL PHOSPHATE SAMPLE	
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP		MG/L	MG/L
MONTHLY TOTAL	17474.0	1496	319.1	28.4	75.0	3.1	449.1	N/A	N/A
AVERAGE	563.7	48	10.3	7.1	2.4	0.8	14.5	3.0	0.07
MAXIMUM	899.0	79	13.2	7.2	3.5	0.9	28.9	4.2	0.08
MINIMUM	419.0	33	7.0	7.0	1.5	0.6	9.1	2.2	0.05
01	578.0	50	10.4		3.3		17.6	3.6	
02	506.0	41	9.7		2.0		14.2	3.4	
03	572.0	46	9.6		2.2		15.9	3.3	
04	565.0	47	10.0	7.2	2.0	0.6	14.2	3.0	
05	446.0	36	9.7		2.8		10.2	2.7	
06	467.0	41	10.5		2.7		11.3	2.9	
07	551.0	44	9.6		2.0		12.5	2.7	
08	452.0	41	10.9		2.1		9.6	2.6	0.08
09	545.0	44	9.7		3.5		12.5	2.7	
10	589.0	49	10.0		3.5		12.5	2.5	
11	542.0	42	9.3	7.0	3.1	0.9	12.5	2.8	
12	544.0	44	9.7		2.7		11.3	2.5	
13	490.0	40	9.8		2.7		9.1	2.2	
14	567.0	33	7.0		2.6		12.5	2.6	
15	600.0	50	10.0		3.0		13.6	2.7	
16	510.0	37	8.7		2.8		11.3	2.7	
17	430.0	34	9.5		2.6		10.2	2.8	
18	574.0	47	9.8	7.1	1.9	0.9	13.1	2.7	
19	597.0	50	10.0		2.0		14.2	2.8	
20	507.0	54	12.8		2.0		10.8	2.5	
21	555.0	61	13.2		2.9		12.5	2.7	
22	596.0	59	11.9		2.0		14.7	3.0	0.05
23	726.0	60	9.9		1.5		21.0	3.5	
24	471.0	49	12.5		1.7		13.1	3.3	
25	608.0	52	10.3	7.1	1.9	0.7	16.5	3.2	
26	636.0	59	11.1		1.9		18.7	3.5	
27	590.0	51	10.4		3.5		17.6	3.6	
28	606.0	52	10.3		1.7		19.3	3.8	
29	899.0	79	10.5		2.9		28.9	3.9	
30	419.0	45	12.9		1.8		11.9	3.4	
31	736.0	59	9.6		1.7		26.1	4.2	

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 08-04-97
 Isle of Palms-B System: 2 Date: 08-05-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July, 1997

PLANT EFFLUENT PH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Robin Delaney C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE		ZINC PHOSPHATE CORROSION CTRL LBS. USED	ORTHO-PHOS REMOTE SAMPLE MG/L
				MG/L	MG/L		
MONTHLY TOTAL	15539.0	1362	35.7	71.5	3.6	466.6	N/A
AVERAGE	501.3	44	7.1	2.3	0.7	15.1	3.6
MAXIMUM	664.0	63	7.2	3.5	1.1	22.1	5.3
MINIMUM	306.0	24	7.1	1.4	0.5	7.4	1.8
01	533.0	46	7.1	2.5	1.1	14.2	3.2
02	564.0	45	9.6	2.3		17.0	3.6
03	306.0	24	9.4	2.1		8.5	3.3
04	419.0	41	11.7	2.5		15.3	4.4
05	319.0	38	14.3	3.0		14.1	5.3
06	590.0	56	11.4	2.7		20.4	4.1
07	499.0	41	9.9	2.0		10.8	2.6
08	499.0	44	10.6	2.5	0.8	13.1	3.1
09	499.0	33	7.9	2.0		11.3	2.7
10	489.0	51	12.5	2.0		18.1	4.4
11	499.0	40	9.6	2.2		12.5	3.0
12	499.0	29	7.0	2.4		13.6	3.3
13	499.0	33	7.9	2.6		7.4	1.8
14	499.0	40	9.6	1.4		13.6	3.3
15	566.0	50	10.6	1.9	0.5	14.7	3.1
16	467.0	39	10.0	3.3		13.6	3.5
17	506.0	44	10.4	2.3		14.7	3.5
18	664.0	56	10.1	2.3		20.4	3.7
19	480.0	46	11.5	2.4		14.7	3.7
20	437.0	39	10.7	2.2		13.6	3.7
21	541.0	46	10.2	2.0		17.0	3.8
22	542.0	46	10.2	2.5	0.5	17.0	3.8
23	537.0	49	10.9	2.3		17.0	3.8
24	309.0	49	19.0	2.3		10.2	4.0
25	632.0	63	12.0	3.5		21.0	4.0
26	523.0	51	11.7	2.0		17.0	3.9
27	406.0	35	10.3	2.0		13.6	4.0
28	551.0	47	10.2	2.0		18.1	3.9
29	655.0	55	10.1	2.0	0.7	22.1	4.0
30	462.0	40	10.4	2.0		15.9	4.1
31	548.0	46	10.1	2.3		15.9	3.5

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

Isle of Palms-A System: 4

Date: 07-01-97

Isle of Palms-B System: 2

Date: 07-14-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: June, 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robert D. May, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC PHOSPHATE CORROSION CTRL		ORTHO-PHOS REMOTE SAMPLE
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS. USED	MG/L	
MONTHLY TOTAL	13752.0	1236	325.7	28.6	85.1	3.9	245.6	N/A	N/A
AVERAGE	458.4	41	10.9	7.2	2.8	1.0	11.2	2.9	
MAXIMUM	569.0	50	14.7	7.2	3.5	1.2	16.5	4.3	
MINIMUM	347.0	27	8.6	7.1	2.0	0.8	7.4	1.9	
01	473.0	41	10.4		3.3				
02	539.0	47	10.5		3.5				
03	434.0	38	10.5	7.1	2.7	1.2			
04	458.0	48	12.6		3.0				
05	434.0	38	10.5		3.5				
06	557.0	50	10.8		3.5				
07	448.0	32	8.6		2.8				
08	347.0	27	9.3		2.6				
09	483.0	38	9.4		3.5		8.5	2.1	
10	466.0	35	9.0	7.2	3.3	0.9	7.4	1.9	
11	490.0	37	9.1		3.5		9.1	2.2	
12	487.0	37	9.1		3.5		7.9	2.0	<0.05
13	569.0	45	9.5		3.5		11.3	2.4	
14	449.0	45	12.0		2.5		9.6	2.6	
15	450.0	44	11.7		2.2		10.8	2.9	
16	438.0	46	12.6	7.2	2.5	0.8	11.3	3.1	
17	412.0	47	13.7		2.5		10.2	3.0	
18	359.0	44	14.7		3.0		7.4	2.5	
19	413.0	43	12.5		3.5		7.9	2.3	
20	451.0	46	12.2		2.5		11.3	3.0	
21	515.0	49	11.4		2.5		13.1	3.0	
22	370.0	40	13.0		2.3		9.1	2.9	
23	507.0	41	9.7		2.5		13.0	3.1	
24	452.0	37	9.8	7.1	2.5	1.0	12.5	3.3	
25	494.0	42	10.2		2.6		14.2	3.4	
26	534.0	45	10.1		2.5		15.9	3.6	<0.05
27	459.0	42	11.0		2.5		16.5	4.3	
28	423.0	37	10.5		2.5		13.6	3.9	
29	459.0	40	10.4		2.0		13.6	3.6	
30	382.0	35	11.0		2.3		11.3	3.6	

1. NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 06-03-97
 Isle of Palms-B System: 2 Date: 06-10-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : May, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Robert M. Smith, C.O., CERT. NO. C-3532

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14513	1346.0	350.3	28.3	88.9	3.6	
AVERAGE	468	43.4	11.3	7.1	2.9	0.9	
MAXIMUM	661	63.0	15.5	7.1	3.5	1.1	
MINIMUM	295	30.0	8.5	7.0	1.5	0.7	
01	445	41.0	11.0		2.0		
02	608	43.0	8.5		1.5		
03	508	37.0	8.7		1.8		
04	295	34.0	13.8		2.2		
05	534	44.0	9.9	7.0	2.6	1.1	
06	429	36.0	10.1		2.3		
07	544	40.0	8.8		3.1		Well #1 artesian pressure 0 psi
08	477	45.0	11.3		2.0		Well #2 artesian pressure 0 psi
09	661	63.0	11.4		2.5		
10	373	48.0	15.4		3.0		
11	446	34.0	9.1		3.5		
12	399	43.0	12.9	7.1	3.0	0.7	
13	460	43.0	11.2		3.0		
14	475	43.0	10.9		3.5		
15	422	43.0	12.2		3.5		
16	602	55.0	11.0		2.7		
17	516	51.0	11.9		2.5		
18	344	30.0	10.5		1.5		
19	463	45.0	11.7	7.1	2.2	0.8	
20	541	52.0	11.5		3.5		
21	412	42.0	12.2		2.8		
22	484	45.0	11.1		3.5		
23	524	48.0	11.0		3.5		
24	585	44.0	9.0		3.0		
25	333	43.0	15.5		3.5		
26	494	46.0	11.2	7.1	3.5	1.0	
27	410	44.0	12.9		3.5		
28	421	41.0	11.7		3.5		
29	414	41.0	11.9		3.2		
30	418	39.0	11.2		3.5		
31	476	43.0	10.8		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 05-13-97
 Isle of Palms-B System: 2 Date: 05-15-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Ron Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14030.0	1343	433.8	28.3	72.9	3.2	
AVERAGE	467.7	45	14.5	7.1	2.4	0.8	
MAXIMUM	608.0	60	108.1	7.1	3.3	0.9	
MINIMUM	51.0	34	8.4	7.0	1.5	0.6	
01	476.0	35	8.8		2.0		Estimated flow 4-12-97; flow meter out of order.
02	482.0	37	9.2		2.0		
03	528.0	37	8.4		1.9		
04	570.0	52	10.9		2.3		
05	431.0	45	12.5		2.8		
06	339.0	41	14.5		2.5		
07	443.0	38	10.3	7.1	2.3	0.9	Well #1 artesian pressure 7 psi
08	534.0	44	9.9		2.4		Well #2 artesian pressure 9 psi
09	400.0	36	10.8		2.4		
10	471.0	41	10.4		2.3		
11	608.0	57	11.2		2.6		
12	51.0	46	108.1		1.5		
13	398.0	44	13.3		1.5		
14	434.0	50	13.8	7.0	2.7	0.9	
15	423.0	49	13.9		2.5		
16	445.0	49	13.2		2.7		
17	456.0	37	9.7		2.8		
18	509.0	40	9.4		2.8		
19	520.0	38	8.8		2.5		
20	459.0	47	12.3		2.2		
21	497.0	50	12.1	7.1	2.8	0.6	
22	483.0	55	13.7		3.3		
23	582.0	53	10.9		2.6		
24	529.0	51	11.6		2.6		
25	537.0	60	13.4		2.3		
26	538.0	47	10.5		2.0		
27	541.0	50	11.1	7.1	2.9	0.8	
28	391.0	43	13.2		2.7		
29	433.0	34	9.4		2.9		
30	522.0	37	8.5		2.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 04-16-97
 Isle of Palms-B System: 2 Date: 04-17-97

DRINKING WATER TREATMENT PLANT UNIT OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robin Delaney, C.O., CERT. NO. C-4911

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14461.0	1343	337.1	28.3	72.9	3.2	
AVERAGE	482.0	45	11.2	7.1	2.4	0.8	
MAXIMUM	608.0	60	14.5	7.1	3.3	0.9	
MINIMUM	339.0	34	8.4	7.0	1.5	0.6	
01	476.0	35	8.8		2.0		Estimated flow 4-12-97; flow meter inoperative
02	482.0	37	9.2		2.0		
03	528.0	37	8.4		1.9		
04	570.0	52	10.9		2.3		
05	431.0	45	12.5		2.8		
06	339.0	41	14.5		2.5		
07	443.0	38	10.3	7.1	2.3	0.9	Well #1 artesian pressure 7 psi
08	534.0	44	9.9		2.4		Well #2 artesian pressure 9 psi
09	400.0	36	10.8		2.4		
10	471.0	41	10.4		2.3		
11	608.0	57	11.2		2.6		
12	482.0	46	11.4		1.5		
13	398.0	44	13.3		1.5		
14	434.0	50	13.8	7.0	2.7	0.9	
15	423.0	49	13.9		2.5		
16	445.0	49	13.2		2.7		
17	456.0	37	9.7		2.8		
18	509.0	40	9.4		2.8		
19	520.0	38	8.8		2.5		
20	459.0	47	12.3		2.2		
21	497.0	50	12.1	7.1	2.8	0.6	
22	483.0	55	13.7		3.3		
23	582.0	53	10.9		2.6		
24	529.0	51	11.6		2.6		
25	537.0	60	13.4		2.3		
26	538.0	47	10.5		2.0		
27	541.0	50	11.1	7.1	2.9	0.8	
28	391.0	43	13.2		2.7		
29	433.0	34	9.4		2.9		
30	522.0	37	8.5		2.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 04-16-97
 Isle of Palms-B System: 2 Date: 04-17-97

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUM

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : March, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Robert DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	15032	1228.0	303.2	28.3	72.2	2.5	
AVERAGE	485	39.6	9.8	7.1	2.3	0.6	
MAXIMUM	670	56.0	14.3	7.1	3.6	0.8	
MINIMUM	304	24.0	7.3	7.0	1.0	0.5	
01	565	44.0	9.3		1.0		
02	430	46.0	12.8		1.5		
03	561	50.0	10.7		3.5		
04	543	48.0	10.6		2.7		
05	550	56.0	12.2	7.1	2.7	0.8	
06	467	49.0	12.6		2.3		
07	580	56.0	11.6		2.5		Well #1 artesian pressure 7 psi
08	517	49.0	11.4		2.2		Well #2 artesian pressure 9 psi
09	606	49.0	9.7		1.7		
10	670	55.0	9.8		2.5		
11	503	33.0	7.9		2.1		
12	533	53.0	11.9	7.0	2.9	0.6	
13	436	52.0	14.3		2.5		
14	375	24.0	7.7		3.6		
15	490	33.0	8.1		1.8		
16	533	38.0	8.5		2.9		
17	386	29.0	9.0		3.5		
18	463	28.0	7.3		1.5		
19	466	36.0	9.3	7.1	2.0	0.6	
20	438	35.0	9.6		2.3		
21	396	31.0	9.4		2.3		
22	500	35.0	8.4		2.0		
23	544	35.0	7.7		2.9		
24	478	31.0	7.8		1.9		
25	432	38.0	10.5		2.2		
26	420	40.0	11.4	7.1	2.0	0.5	
27	510	35.0	8.2		2.0		
28	464	33.0	8.5		2.5		
29	444	31.0	8.4		2.2		
30	304	26.0	10.3		2.5		
31	428	30.0	8.4		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 03-10-97
 Isle of Palms-B System: 2 Date: 03-12-07

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February, 1997

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robin DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE NG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	12321	938.0	263.2	28.1	62.7	2.6	
AVERAGE	440	33.5	9.4	7.0	2.2	0.7	
MAXIMUM	636	60.0	19.3	7.1	3.5	0.9	
MINIMUM	230	25.0	6.5	7.0	1.0	0.5	
01	458	39.0	10.2		1.0		
02	399	26.0	7.8		1.3		
03	448	29.0	7.8		2.1		
04	498	31.0	7.5	7.1	1.9	0.6	
05	392	27.0	8.3		3.3		
06	371	25.0	8.1		2.2		
07	470	30.0	7.7		2.0		Well #1 artesian pressure 6 psi
08	457	30.0	7.9		1.6		Well #2 artesian pressure 8 psi
09	400	27.0	8.1		2.0		
10	436	33.0	9.1		2.0		
11	552	36.0	7.8	7.0	2.3	0.9	
12	370	29.0	9.4		3.5		
13	406	29.0	8.6		2.5		
14	372	31.0	10.0		2.1		
15	422	29.0	8.2		2.7		
16	636	38.0	7.2		3.5		
17	427	32.0	9.0		2.8		
18	413	31.0	9.0	7.0	2.0	0.5	
19	542	43.0	9.5		2.1		
20	500	40.0	9.6		1.5		
21	536	29.0	6.5		3.5		
22	441	26.0	7.1		2.8		
23	347	33.0	11.4		2.8		
24	319	36.0	13.5		1.9		
25	374	41.0	13.1	7.0	2.3	0.6	
26	230	37.0	19.3		2.4		
27	510	41.0	9.6		1.6		
28	595	60.0	12.1		1.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 02-03-97
 Isle of Palms-B System: 2 Date: 02-24-97

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYS MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : January, 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Robin DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	13889	1011.0	271.9	28.3	77.3	4.0	
AVERAGE	448	32.6	8.8	7.1	2.5	1.0	
MAXIMUM	650	45.0	11.7	7.1	3.5	1.4	
MINIMUM	353	22.0	7.0	7.0	1.8	0.7	
01	516	35.0	8.1		2.8		
02	411	24.0	7.0	7.1	3.5	0.9	
03	482	33.0	8.2		2.0		
04	464	32.0	8.3		2.4		
05	527	43.0	9.8		3.5		
06	430	41.0	11.4		2.5		
07	385	27.0	8.4		3.5		Well #1 artesian pressure 9 psi
08	428	26.0	7.3		2.0		Well #2 artesian pressure 10 psi
09	381	33.0	10.4	7.1	2.0	1.4	
10	374	29.0	9.3		2.5		
11	457	29.0	7.6		2.7		
12	481	31.0	7.7		3.0		
13	408	29.0	8.5		1.8		
14	468	31.0	7.9		2.5		
15	450	39.0	10.4		2.1		
16	444	39.0	10.5		2.0		
17	650	38.0	7.0		2.5		
18	414	38.0	11.0		2.8		
19	360	22.0	7.3		2.6		
20	457	31.0	8.1	7.0	2.0	0.7	
21	387	28.0	8.7		2.7		
22	431	38.0	10.6		2.9		
23	488	31.0	7.6		2.1		
24	537	45.0	10.0		1.9		
25	378	37.0	11.7		2.2		
26	353	25.0	8.5		2.0		
27	453	29.0	7.7	7.1	2.4	1.0	
28	418	27.0	7.7		2.9		
29	425	30.0	8.5		3.0		
30	443	30.0	8.1		1.9		
31	589	41.0	8.3		2.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 01-14-97
 Isle of Palms-B System: 2 Date: 01-13-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: COUNTY DETENTION FACILITY
 WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULBE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	342.1	62.0	708.3	149.1	84.3	32.9	
AVERAGE	11.0	2.0	22.8	7.1	2.7	1.6	
MAXIMUM	17.9	2.0	38.7	7.1	5.5	1.8	
MINIMUM	6.2	2.0	13.4	7.1	2.2	1.3	
01	10.9	2.0	22.0	7.1	2.8	1.5	
02	14.4	2.0	16.7	7.1	2.9	1.8	
03	9.6	2.0	25.0	7.1	2.8	1.7	
04	8.6	2.0	27.9	7.1	3.0	1.8	
05	12.0	2.0	20.0	7.1	2.9	1.8	
06	12.0	2.0	20.0		2.7		
07	12.4	2.0	19.4		2.8		
08	13.4	2.0	17.9	7.1	3.0	1.8	
09	7.6	2.0	31.6	7.1	2.6	1.5	
10	13.5	2.0	17.8	7.1	2.6	1.7	
11	13.2	2.0	18.2	7.1	2.7	1.7	
12	9.7	2.0	24.7	7.1	2.3	1.5	
13	11.6	2.0	20.7		2.5		
14	6.2	2.0	38.7		2.2		
15	17.9	2.0	13.4	7.1	2.5	1.3	
16	11.9	2.0	20.2	7.1	2.7	1.6	
17	9.1	2.0	26.4	7.1	2.7	1.5	
18	9.9	2.0	24.2	7.1	2.7	1.4	
19	12.6	2.0	19.0	7.1	2.6	1.4	
20	10.1	2.0	23.8		2.6		
21	7.6	2.0	31.6		2.5		
22	11.0	2.0	21.8	7.1	2.4	1.3	
23	11.1	2.0	21.6	7.1	2.7	1.5	
24	13.2	2.0	18.2	7.1	2.6	1.5	
25	9.2	2.0	26.1		5.5		
26	10.5	2.0	22.9		2.6		
27	11.0	2.0	21.8		2.4		
28	12.2	2.0	19.7		2.5		
29	6.9	2.0	34.8	7.1	2.5	1.4	
30	10.6	2.0	22.6	7.1	2.4	1.5	
31	12.2	2.0	19.7	7.1	2.6	1.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 12-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM. NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULBE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Snydal, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	284.1	60.0	791.7	129.4	77.3	22.9	
AVERAGE	9.5	2.0	26.4	7.2	2.6	1.3	
MAXIMUM	13.1	2.0	45.3	7.2	3.0	1.8	
MINIMUM	5.3	2.0	18.3	7.1	2.2	1.0	
01	7.1	2.0	33.8		2.2		
02	10.5	2.0	22.9		2.4		
03	8.0	2.0	30.0	7.2	2.6	1.1	
04	10.0	2.0	24.0	7.2	2.5	1.1	
05	12.3	2.0	19.5	7.2	2.5	1.0	
06	8.8	2.0	27.3	7.2	2.4	1.2	
07	8.8	2.0	27.3	7.2	2.5	1.0	
08	9.8	2.0	24.5		2.5		
09	8.9	2.0	27.0		2.5		
10	8.7	2.0	27.6	7.2	2.6	1.2	
11	11.9	2.0	20.2	7.2	2.4	1.0	
12	7.0	2.0	34.3	7.2	2.4	1.0	
13	13.1	2.0	18.3	7.2	2.5	1.1	
14	12.3	2.0	19.5	7.2	2.6	1.1	
15	9.4	2.0	25.5		2.7		
16	11.7	2.0	20.5		2.4		
17	8.5	2.0	28.2	7.2	2.5	1.2	
18	11.1	2.0	21.6	7.2	2.6	1.4	
19	5.3	2.0	45.3	7.2	2.6	1.5	
20	11.5	2.0	20.9	7.2	2.5	1.5	
21	8.5	2.0	28.2	7.2	2.4	1.4	
22	8.3	2.0	28.9		2.8		
23	9.1	2.0	26.4		2.8		
24	9.4	2.0	25.5	7.2	3.0	1.7	
25	10.5	2.0	22.9	7.1	3.0	1.8	
26	7.2	2.0	33.3	7.1	2.8	1.6	
27	8.0	2.0	30.0		2.6		
28	11.6	2.0	20.7		2.8		
29	7.6	2.0	31.6		2.7		
30	9.2	2.0	26.1		2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Stuchlik, C.O., CERT. NO. ~~C-4016~~ C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	360.6	62.0	669.6	167.9	70.6	28.3	
AVERAGE	11.6	2.0	21.6	7.3	2.3	1.2	
MAXIMUM	19.7	2.0	30.4	7.3	2.8	1.5	
MINIMUM	7.9	2.0	12.2	7.3	2.0	1.0	
01	12.6	2.0	19.0	7.3	2.0	1.2	
02	12.7	2.0	18.9	7.3	2.1	1.0	
03	12.3	2.0	19.5	7.3	2.2	1.1	
04	14.7	2.0	16.3		2.2		
05	9.9	2.0	24.2		2.1		
06	15.0	2.0	16.0	7.3	2.2	1.3	
07	11.2	2.0	21.4	7.3	2.2	1.2	
08	13.2	2.0	18.2	7.3	2.4	1.2	
09	11.8	2.0	20.3	7.3	2.2	1.4	
10	19.7	2.0	12.2	7.3	2.1	1.2	
11	12.5	2.0	19.2		2.2		
12	9.2	2.0	26.1		2.2		
13	17.4	2.0	13.8	7.3	2.4	1.5	
14	9.3	2.0	25.8	7.3	2.2	1.4	
15	12.0	2.0	20.0	7.3	2.3	1.3	
16	12.9	2.0	18.6	7.3	2.1	1.3	
17	12.1	2.0	19.8	7.3	2.0	1.2	
18	11.6	2.0	20.7		2.2		
19	9.9	2.0	24.2		2.1		
20	12.1	2.0	19.8	7.3	2.3	1.0	
21	9.2	2.0	26.1	7.3	2.2	1.0	
22	11.4	2.0	21.1	7.3	2.4	1.2	
23	8.9	2.0	27.0	7.3	2.2	1.1	
24	8.6	2.0	27.9	7.3	2.0	1.0	
25	9.8	2.0	24.5		2.8		
26	9.8	2.0	24.5		2.8		
27	7.9	2.0	30.4	7.3	2.5	1.4	
28	7.9	2.0	30.4	7.3	2.6	1.4	
29	11.1	2.0	21.6	7.3	2.6	1.3	
30	9.5	2.0	25.3	7.3	2.4	1.3	
31	14.4	2.0	16.7	7.3	2.4	1.3	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 10-07-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Stillland, C.O., CERT. NO. C-4016 7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	352.9	60.0	639.4	153.3	63.2	23.2	
AVERAGE	11.8	2.0	21.3	7.3	2.1	1.1	
MAXIMUM	18.2	2.0	31.6	7.3	2.8	1.6	
MINIMUM	7.6	2.0	13.2	7.3	1.4	0.9	
01	11.7	2.0	20.5		2.4		
02	10.9	2.0	22.0	7.3	2.3	1.1	
03	8.9	2.0	27.0	7.3	2.3	1.0	
04	12.3	2.0	19.5	7.3	2.0	0.9	
05	8.6	2.0	27.9	7.3	2.0	0.9	
06	15.6	2.0	15.4		2.0		
07	11.1	2.0	21.6		2.1		
08	9.2	2.0	26.1	7.3	2.3	1.0	
09	13.2	2.0	18.2	7.3	2.1	1.0	
10	10.9	2.0	22.0	7.3	2.1	1.0	
11	13.1	2.0	18.3	7.3	2.0	1.0	
12	13.0	2.0	18.5	7.3	2.0	1.1	
13	13.5	2.0	17.8		2.2		
14	12.7	2.0	18.9		2.0		
15	12.5	2.0	19.2	7.3	2.1	1.2	
16	10.2	2.0	23.5	7.3	2.1	1.0	
17	9.5	2.0	25.3	7.3	2.1	1.0	
18	9.4	2.0	25.5	7.3	2.4	1.3	
19	13.9	2.0	17.3	7.3	2.3	1.1	
20	12.3	2.0	19.5		2.0		
21	7.6	2.0	31.6		2.1		
22	18.2	2.0	13.2	7.3	2.5	1.6	
23	13.5	2.0	17.8	7.3	2.2	1.3	
24	13.2	2.0	18.2	7.3	2.0	1.3	
25	7.6	2.0	31.6	7.3	2.0	1.2	
26	13.5	2.0	17.8	7.3	1.8	1.2	
27	11.9	2.0	20.2		2.8		
28	10.4	2.0	23.1		1.4		
29	15.5	2.0	15.5	7.3	1.8	1.1	
30	9.0	2.0	26.7	7.3	1.8	0.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. St. Hillman, C.O., CERT. NO. ~~6-1916~~ C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	361.3	62.0	652.5	151.2	72.3	31.3	
AVERAGE	11.7	2.0	21.0	7.2	2.3	1.5	
MAXIMUM	15.4	2.0	28.6	7.2	2.8	1.6	
MINIMUM	8.4	2.0	15.6	7.2	2.0	1.3	
01	12.1	2.0	19.8	7.2	2.3	1.5	
02	10.3	2.0	23.3		2.8		
03	13.1	2.0	18.3		2.4		
04	9.9	2.0	24.2	7.2	2.7	1.6	
05	10.1	2.0	23.8	7.2	2.6	1.6	
06	13.2	2.0	18.2	7.2	2.5	1.5	
07	9.3	2.0	25.8	7.2	2.5	1.4	
08	9.9	2.0	24.2	7.2	2.3	1.3	
09	10.8	2.0	22.2		2.3		
10	11.2	2.0	21.4		2.7		
11	14.7	2.0	16.3	7.2	2.5	1.6	
12	11.2	2.0	21.4	7.2	2.5	1.5	
13	12.6	2.0	19.0	7.2	2.4	1.5	
14	12.3	2.0	19.5	7.2	2.2	1.6	
15	13.5	2.0	17.8	7.2	2.3	1.4	
16	12.3	2.0	19.5		2.2		
17	10.5	2.0	22.9		2.4		
18	15.4	2.0	15.6	7.2	2.3	1.6	
19	11.9	2.0	20.2	7.2	2.1	1.5	
20	9.4	2.0	25.5	7.2	2.1	1.4	
21	11.5	2.0	20.9	7.2	2.2	1.5	
22	11.6	2.0	20.7	7.2	2.0	1.3	
23	11.8	2.0	20.3		2.1		
24	9.7	2.0	24.7		2.2		
25	14.3	2.0	16.8	7.2	2.3	1.4	
26	8.4	2.0	28.6	7.2	2.2	1.6	
27	10.4	2.0	23.1	7.2	2.2	1.6	
28	14.5	2.0	16.6	7.2	2.2	1.6	
29	13.7	2.0	17.5	7.2	2.0	1.3	
30	10.9	2.0	22.0		2.4		
31	10.8	2.0	22.2		2.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Lugh, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	357.9	62.0	653.5	158.4	70.9	30.9	
AVERAGE	11.5	2.0	21.1	7.2	2.3	1.4	
MAXIMUM	14.3	2.0	28.9	7.2	3.0	1.7	
MINIMUM	8.3	2.0	16.8	7.2	1.2	0.8	
01	10.8	2.0	22.2	7.2	2.2	1.3	
02	10.8	2.0	22.2	7.2	2.0	1.3	
03	11.0	2.0	21.8	7.2	2.0	1.5	
04	12.0	2.0	20.0		1.6		
05	9.2	2.0	26.1		1.4		
06	10.4	2.0	23.1		1.2		
07	14.3	2.0	16.8	7.2	1.6	1.2	
08	8.3	2.0	28.9	7.2	1.4	1.0	
09	10.6	2.0	22.6	7.2	1.5	0.9	
10	13.8	2.0	17.4	7.2	1.6	0.8	
11	12.9	2.0	18.6	7.2	1.6	0.8	
12	11.4	2.0	21.1		1.7		
13	11.4	2.0	21.1		1.7		
14	11.1	2.0	21.6	7.2	2.8	1.6	
15	12.9	2.0	18.6	7.2	2.8	1.6	
16	12.7	2.0	18.9	7.2	2.6	1.6	
17	13.2	2.0	18.2	7.2	2.8	1.7	
18	12.3	2.0	19.5	7.2	2.6	1.6	
19	11.5	2.0	20.9		2.5		
20	11.4	2.0	21.1		2.6		
21	10.8	2.0	22.2	7.2	2.5	1.6	
22	11.2	2.0	21.4	7.2	2.5	1.6	
23	12.3	2.0	19.5	7.2	2.8	1.6	
24	12.5	2.0	19.2	7.2	2.8	1.6	
25	11.2	2.0	21.4	7.2	2.9	1.6	
26	12.8	2.0	18.8		3.0		
27	13.3	2.0	18.0		3.0		
28	11.0	2.0	21.8	7.2	2.8	1.5	
29	9.4	2.0	25.5	7.2	2.7	1.5	
30	11.1	2.0	21.6	7.2	2.8	1.5	
31	10.3	2.0	23.3	7.2	2.9	1.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 07-01-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997


PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	344.4	60.0	665.2	151.2	83.0	35.9	
AVERAGE	11.5	2.0	22.2	7.2	2.8	1.7	
MAXIMUM	15.8	2.0	50.0	7.2	3.0	2.0	
MINIMUM	4.8	2.0	15.2	7.2	2.3	1.4	
01	15.8	2.0	15.2		2.8		
02	14.1	2.0	17.0	7.2	2.5	1.6	
03	13.0	2.0	18.5	7.2	2.9	1.8	
04	4.8	2.0	50.0	7.2	2.8	1.6	
05	12.6	2.0	19.0	7.2	2.6	1.6	
06	12.2	2.0	19.7	7.2	2.5	1.6	
07	9.7	2.0	24.7		2.5		
08	12.6	2.0	19.0		2.8		
09	13.5	2.0	17.8	7.2	2.8	1.6	
10	7.0	2.0	34.3	7.2	2.8	1.6	
11	10.5	2.0	22.9	7.2	3.0	1.8	
12	10.5	2.0	22.9	7.2	3.0	2.0	
13	12.9	2.0	18.6	7.2	2.8	2.0	
14	12.7	2.0	18.9		3.0		
15	11.1	2.0	21.6		2.9		
16	12.3	2.0	19.5	7.2	3.0	1.9	
17	9.8	2.0	24.5	7.2	3.0	1.8	
18	13.1	2.0	18.3	7.2	3.0	1.8	
19	13.0	2.0	18.5	7.2	2.7	1.6	
20	14.3	2.0	16.8	7.2	3.0	1.7	
21	9.4	2.0	25.5		2.8		
22	10.0	2.0	24.0		3.0		
23	9.6	2.0	25.0	7.2	3.0	1.8	
24	13.2	2.0	18.2	7.2	2.9	1.8	
25	9.5	2.0	25.3	7.2	2.4	1.4	
26	15.2	2.0	15.8	7.2	2.6	1.7	
27	8.2	2.0	29.3	7.2	2.8	1.7	
28	10.8	2.0	22.2		2.3		
29	12.8	2.0	18.8		2.5		
30	10.2	2.0	23.5	7.2	2.3	1.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 06-12-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NAS. COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

ON: 50 BOBBY MOORE CIRCLE

YULBEE, FL ; NASSAU COUNTY

BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

INFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Lynch, C.O., CERT. NO. C-4016

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	345.4	62.0	701.8	187.2	77.2	29.2	
AVERAGE	11.1	2.0	22.6	7.2	2.6	1.5	
MAXIMUM	14.6	2.0	39.3	7.2	3.0	1.8	
MINIMUM	6.1	2.0	16.4	7.2	2.0	1.2	
01	14.4	2.0	16.7	7.2	2.3	1.2	
02	6.1	2.0	39.3	7.2	2.2	1.2	
03	11.4	2.0	21.1	7.2	2.2		
04	13.2	2.0	18.2	7.2	2.0		
05	8.8	2.0	27.3	7.2	2.3	1.2	
06	12.3	2.0	19.5	7.2	2.3	1.2	
07	9.9	2.0	24.2	7.2	2.4	1.2	
08	7.8	2.0	30.8	7.2	2.2	1.2	
09	12.9	2.0	18.6				
10	9.0	2.0	26.7		2.6		
11	10.7	2.0	22.4		2.6		
12	12.7	2.0	18.9	7.2	2.3	1.3	
13	11.5	2.0	20.9	7.2	2.6	1.4	
14	13.8	2.0	17.4	7.2	3.0	1.8	
15	9.3	2.0	25.8	7.2	2.8	1.8	
16	13.1	2.0	18.3	7.2	2.8	1.6	
17	9.5	2.0	25.3		2.5		
18	13.1	2.0	18.3		2.5		
19	13.0	2.0	18.5	7.2	2.8	1.7	
20	14.0	2.0	17.1	7.2	2.6	1.4	
21	11.2	2.0	21.4	7.2	2.8	1.6	
22	9.4	2.0	25.5	7.2	2.8	1.6	
23	13.2	2.0	18.2	7.2	2.6	1.5	
24	11.6	2.0	20.7	7.2	2.8		
25	8.1	2.0	29.6	7.2	2.6		
26	14.6	2.0	16.4	7.2	2.8		
27	10.1	2.0	23.8	7.2	2.6	1.5	
28	14.1	2.0	17.0	7.2	2.8	1.6	
29	11.2	2.0	21.4	7.2	2.8	1.6	
30	7.3	2.0	32.9	7.2	2.8	1.6	
31	8.1	2.0	29.6	7.2	2.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	348.8	60.0	668.8	172.5	68.4	30.2	
AVERAGE	11.6	2.0	22.3	7.2	2.3	1.3	
MAXIMUM	17.4	2.0	52.2	7.2	2.9	1.6	
MINIMUM	4.6	2.0	13.8	7.1	1.2	0.4	
01	12.9	2.0	18.6	7.1	2.4	1.4	
02	12.0	2.0	20.0	7.1	2.5	1.5	
03	8.0	2.0	30.0	7.1	2.5	1.6	
04	10.5	2.0	22.9	7.2	1.2	0.4	
05	11.9	2.0	20.2	7.2	2.2	1.6	
06	15.0	2.0	16.0	7.2	2.4		
07	10.5	2.0	22.9	7.2	2.4	1.5	
08	15.7	2.0	15.3	7.2	2.5	1.5	
09	6.7	2.0	35.8	7.2	2.3	1.2	
10	10.8	2.0	22.2	7.2	2.3	1.5	
11	17.4	2.0	13.8	7.2	2.3	1.4	
12	11.1	2.0	21.6		2.4		
13	9.6	2.0	25.0		2.4		
14	15.9	2.0	15.1	7.2	2.9	1.4	
15	8.7	2.0	27.6	7.2	2.2	1.3	
16	8.4	2.0	28.6	7.2	2.4	1.4	
17	12.2	2.0	19.7	7.2	2.1	1.0	
18	10.2	2.0	23.5	7.2	2.2	1.2	
19	9.9	2.0	24.2		2.2		
20	15.6	2.0	15.4		2.0		
21	8.7	2.0	27.6	7.2	2.3	1.4	
22	12.5	2.0	19.2	7.2	2.3	1.3	
23	12.1	2.0	19.8	7.2	2.5	1.5	
24	13.5	2.0	17.8	7.2	2.4	1.3	
25	12.5	2.0	19.2	7.2	2.2	1.2	
26	12.0	2.0	20.0		2.2		
27	14.9	2.0	16.1		2.2		
28	11.5	2.0	20.9	7.2	2.2	1.2	
29	13.5	2.0	17.8	7.2	2.0	1.2	
30	4.6	2.0	52.2	7.2	2.3	1.2	

DRINKING-WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY.

WS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Kenneth J. Boyd, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	355.8	62.0	700.4	141.9	70.8	30.3	
AVERAGE	11.5	2.0	22.6	7.1	2.3	1.5	
MAXIMUM	29.8	2.0	32.4	7.1	3.0	2.0	
MINIMUM	7.4	2.0	8.1	7.0	2.0	1.2	
01	11.8	2.0	20.3		2.2		
02	10.2	2.0	23.5		2.0		
03	11.5	2.0	20.9	7.1	2.0	1.2	
04	15.0	2.0	16.0	7.1	2.0	1.3	
05	8.4	2.0	28.6	7.1	2.2	1.3	
06	9.4	2.0	25.5	7.1	2.5	1.7	
07	9.1	2.0	26.4	7.1	2.3	1.4	
08	10.3	2.0	23.3		2.6		
09	11.3	2.0	21.2		2.2		
10	10.0	2.0	24.0	7.1	2.0	1.3	
11	11.7	2.0	20.5	7.1	2.1	1.5	
12	7.4	2.0	32.4	7.1	2.0	1.4	
13	9.3	2.0	25.8	7.1	2.4	1.5	
14	16.2	2.0	14.8	7.1	2.5	1.6	
15	29.8	2.0	8.1		2.5		
16	19.7	2.0	12.2		2.5		
17	7.8	2.0	30.8	7.1	2.5	1.7	
18	11.7	2.0	20.5	7.1	2.3	1.6	
19	10.5	2.0	22.9	7.1	2.3	1.6	
20	9.2	2.0	26.1	7.1	2.3	1.5	
21	10.8	2.0	22.2	7.1	2.3	1.5	
22	10.8	2.0	22.2		2.1		
23	11.0	2.0	21.8		2.0		
24	13.4	2.0	17.9	7.0	2.0	1.4	
25	9.0	2.0	26.7	7.1	2.1	1.4	
26	8.9	2.0	27.0	7.1	3.0	2.0	
27	10.5	2.0	22.9	7.1	2.6	1.8	
28	8.8	2.0	27.3		2.2		
29	9.5	2.0	25.3		2.4		
30	13.4	2.0	17.9		2.2		
31	9.4	2.0	25.5	7.1	2.5	1.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 03-06-97

NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

CIRCLE

YULSB, FL ; NASSAU COUNTY

ORIDA INC.

REPORTING MONTH: February 1997

7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

MAIN OFFICE PHONE NO. (904) 725-2865

IS CORRECT

Kenneth A. Boyd

, C.O., CERT. NO. C-4016

NO. OF	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
6	56.0	621.4	7.2	61.9	26.6	
7	2.0	22.2	7.2	2.2	1.3	
8	2.0	35.8	7.2	2.5	1.5	
9	2.0	12.2	7.1	1.8	1.0	
10	2.0	22.9	7.2	2.0		
11	2.0	22.2	7.2	1.8		
12	2.0	22.2	7.2	2.2	1.3	
13	2.0	15.3	7.2	2.0	1.2	
14	2.0	26.4	7.2	2.3	1.4	
15	2.0	20.9	7.2	2.2	1.2	
16	2.0	35.8	7.2	2.0	1.0	
17	2.0	12.5	7.2	2.0	1.1	
18	2.0	12.2	7.2	1.9		
19	2.0	16.2	7.2	2.3	1.2	
20	2.0	13.8	7.2	2.2	1.2	
21	2.0	32.4	7.2	2.3	1.2	
22	2.0	22.6	7.2	2.0	1.2	
23	2.0	18.6	7.2	2.1	1.2	
24	2.0	23.3		2.4		
25	2.0	23.5		2.2		
26	2.0	17.6	7.1	2.5	1.4	
27	2.0	29.6	7.2	2.1	1.3	
28	2.0	18.2	7.2	2.1	1.2	
29	2.0	31.2	7.2	2.5	1.4	
30	2.0	27.0	7.2	2.2	1.3	
31	2.0	19.4		2.4		
32	2.0	20.0		2.3		
33	2.0	23.3	7.2	2.3	1.5	
34	2.0	21.8	7.2	2.3	1.4	
35	2.0	30.4	7.2	2.5	1.4	
36	2.0	22.4	7.2	2.5	1.3	
37	2.0	19.7	7.2	2.3	1.2	

WS ID NO.: 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULBEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kurt E. Boyd*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	336.0	62.0	723.4	222.3	69.0	33.2	
AVERAGE	10.8	2.0	23.3	7.2	2.2	1.5	
MAXIMUM	17.7	2.0	35.3	7.2	2.6	1.8	
MINIMUM	6.8	2.0	13.6	7.1	1.8	1.2	
01	6.8	2.0	35.3	7.1	2.0		
02	11.4	2.0	21.1	7.1	2.1	1.5	
03	11.4	2.0	21.1	7.1	2.0	1.4	
04	8.4	2.0	28.6	7.1	2.0		
05	10.3	2.0	23.3	7.1	1.8		
06	10.5	2.0	22.9	7.1	2.0	1.5	
07	8.5	2.0	28.2	7.1	2.2	1.5	
08	8.1	2.0	29.6	7.1	2.0	1.3	
09	17.7	2.0	13.6	7.1	2.4	1.5	
10	7.3	2.0	32.9	7.2	2.2	1.2	
11	9.6	2.0	25.0	7.2	2.5		
12	10.8	2.0	22.2	7.2	2.5		
13	11.7	2.0	20.5	7.2	2.3	1.3	
14	7.0	2.0	34.3	7.2	2.5	1.4	
15	13.5	2.0	17.8	7.2	2.5	1.5	
16	8.6	2.0	27.9	7.2	2.5	1.6	
17	15.6	2.0	15.4	7.2	2.1	1.4	
18	12.9	2.0	18.6	7.2	2.2		
19	12.3	2.0	19.5	7.2	2.0		
20	10.0	2.0	24.0	7.2	2.3	1.6	
21	9.9	2.0	24.2	7.2	2.4	1.6	
22	12.6	2.0	19.0	7.2	2.2	1.5	
23	15.6	2.0	15.4	7.2	2.2	1.5	
24	8.1	2.0	29.6	7.2	2.0	1.6	
25	10.7	2.0	22.4	7.2	2.1		
26	13.0	2.0	18.5	7.2	1.9		
27	11.6	2.0	20.7	7.2	2.2	1.6	
28	11.0	2.0	21.8	7.2	2.5	1.7	
29	9.1	2.0	26.4	7.2	2.6	1.6	
30	11.4	2.0	21.1	7.2	2.5	1.8	
31	10.6	2.0	22.6	7.2	2.3	1.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 01-16-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ellen T. White, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3572.0	129	135.2	155.3	66.9	16.6	
AVERAGE	115.2	4	4.4	7.4	2.2	0.8	
MAXIMUM	153.0	7	6.7	7.5	2.4	0.9	
MINIMUM	84.0	3	3.1	7.3	1.8	0.7	
01	99.0	4	4.8	7.4	2.2	0.8	
02	84.0	3	4.3	7.3	2.2	0.8	
03	111.0	4	4.3	7.3	2.2	0.7	
04	98.0	4	4.9	7.4	2.1	0.8	
05	147.0	5	4.1	7.4	2.0	0.8	
06	123.0	4	3.9		2.2		
07	129.0	4	3.7		2.1		
08	141.0	5	4.3	7.4	2.1	0.8	
09	92.0	4	5.2	7.4	2.2	0.8	
10	106.0	4	4.5	7.5	2.2	0.8	
11	104.0	4	4.6	7.5	1.9	0.7	
12	145.0	6	5.0	7.4	2.4	0.8	
13	127.0	5	4.7		2.2		
14	107.0	4	4.5		2.1		
15	107.0	4	4.5	7.4	2.2	0.8	
16	113.0	4	4.2	7.4	2.4	0.8	
17	99.0	4	4.8	7.4	2.2	0.7	
18	112.0	4	4.3	7.4	2.2	0.8	
19	115.0	4	4.2	7.3	2.0	0.8	
20	127.0	5	4.7		2.0		
21	85.0	3	4.2		2.2		
22	120.0	4	4.0	7.4	2.2	0.8	
23	112.0	4	4.3	7.4	2.2	0.8	
24	113.0	3	3.2	7.4	2.0	0.7	
25	111.0	3	3.2		1.8		
26	146.0	4	3.3		2.2		
27	126.0	7	6.7		2.0		
28	101.0	4	4.8		2.2		
29	112.0	4	4.3	7.4	2.4	0.9	
30	107.0	4	4.5	7.4	2.2	0.9	
31	153.0	4	3.1	7.4	2.4	0.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160852 C.U.P. NO. 2-031-00250

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Ellen T. White*, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3172.0	135	154.8	132.5	61.6	14.0	
AVERAGE	105.7	5	5.2	7.4	2.1	0.8	
MAXIMUM	156.0	7	6.9	7.4	2.2	0.9	
MINIMUM	71.0	3	3.7	7.3	1.8	0.7	
01	137.0	5	4.4		2.0		
02	104.0	4	4.6		2.0		
03	87.0	4	5.5	7.3	1.8	0.8	
04	112.0	5	5.4	7.3	2.0	0.9	
05	90.0	4	5.3	7.3	2.0	0.7	
06	96.0	4	5.0	7.4	2.1	0.7	
07	93.0	4	5.2	7.4	2.0	0.8	
08	87.0	5	6.9		1.8		
09	151.0	6	4.8		2.0		
10	92.0	4	5.2	7.3	2.0	0.9	
11	113.0	4	4.2	7.4	2.2	0.8	
12	86.0	4	5.6	7.4	2.2	0.8	
13	98.0	3	3.7	7.4	2.2	0.8	
14	73.0	4	6.6	7.3	2.0	0.7	
15	115.0	5	5.2		1.9		
16	130.0	4	3.7		2.2		
17	93.0	4	5.2	7.4	1.8	0.7	
18	106.0	4	4.5	7.4	1.8	0.8	
19	99.0	4	4.8	7.4	2.2	0.8	
20	100.0	4	4.8	7.3	2.2	0.7	
21	71.0	3	5.1	7.4	2.2	0.7	
22	116.0	4	4.1		2.2		
23	141.0	7	6.0		2.0		
24	156.0	6	4.6	7.4	2.0	0.8	
25	73.0	4	6.6	7.4	2.2	0.8	
26	133.0	7	6.3	7.3	2.2	0.8	
27	116.0	5	5.2		2.0		
28	80.0	3	4.5		2.2		
29	126.0	6	5.7		2.2		
30	98.0	5	6.1		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

SAMPLE DATE: 11-05-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ellen T. Valentin, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3375.0	--134	148.1	169.7	61.8	17.4	
AVERAGE	108.9	4	4.8	7.4	2.0	0.8	
MAXIMUM	169.0	6	5.7	7.4	2.2	0.9	
MINIMUM	68.0	3	3.6	7.3	1.8	0.7	
01	116.0	5	5.2	7.4	1.8	0.7	
02	108.0	5	5.6	7.4	2.0	0.7	
03	107.0	5	5.6	7.4	2.0	0.7	
04	123.0	5	4.9		1.8		
05	105.0	5	5.7		1.8		
06	87.0	4	5.5	7.4	2.0	0.8	
07	108.0	4	4.4	7.3	2.2	0.7	
08	101.0	4	4.8	7.4	2.2	0.8	
09	96.0	4	5.0	7.3	2.0	0.8	
10	133.0	4	3.6	7.3	1.8	0.7	
11	87.0	3	4.1		2.0		
12	115.0	4	4.2		2.0		
13	82.0	3	4.4	7.4	2.2	0.7	
14	155.0	6	4.6	7.4	1.9	0.8	
15	94.0	4	5.1	7.4	1.8	0.7	
16	122.0	5	4.9	7.4	1.8	0.7	
17	121.0	5	5.0	7.4	2.0	0.7	
18	105.0	5	5.7		1.9		
19	109.0	4	4.4		2.0		
20	101.0	4	4.8	7.3	1.8	0.8	
21	128.0	6	5.6	7.4	2.0	0.8	
22	68.0	3	5.3	7.4	2.0	0.7	
23	128.0	5	4.7	7.4	2.0	0.7	
24	87.0	3	4.1	7.4	2.2	0.7	
25	122.0	4	3.9		2.0		
26	169.0	6	4.3		2.2		
27	92.0	3	3.9	7.3	2.0	0.8	
28	81.0	3	4.4	7.4	2.0	0.8	
29	119.0	5	5.0	7.4	2.0	0.9	
30	100.0	4	4.8	7.4	2.2	0.9	
31	106.0	4	4.5	7.4	2.2	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 10-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160852 C.U.P. NO. 2-031-00250r

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Elhasan T. Valentin, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3706.0	139	135.6	155.1	57.7	14.7	
AVERAGE	123.5	5	4.5	7.4	1.9	0.7	
MAXIMUM	173.0	9	7.4	7.4	2.2	0.8	
MINIMUM	77.0	3	3.3	7.3	1.8	0.6	
01	162.0	6	4.4		2.0		
02	108.0	3	3.3	7.3	2.0	0.7	
03	118.0	4	4.1	7.4	1.9	0.7	
04	116.0	4	4.1	7.4	1.9	0.8	
05	112.0	4	4.3	7.4	1.9	0.7	
06	148.0	5	4.1		2.0		
07	121.0	4	4.0		2.0		
08	131.0	4	3.7	7.4	1.8	0.8	
09	118.0	5	5.1	7.4	1.9	0.7	
10	110.0	4	4.4	7.4	2.0	0.7	
11	111.0	5	5.4	7.4	2.0	0.7	
12	157.0	8	6.1	7.3	2.0	0.6	
13	146.0	9	7.4		2.1		
14	117.0	4	4.1		2.0		
15	126.0	4	3.8	7.4	2.0	0.7	
16	124.0	4	3.9	7.4	1.8	0.7	
17	118.0	4	4.1	7.4	1.8	0.6	
18	120.0	4	4.0	7.4	1.8	0.7	
19	173.0	6	4.2	7.4	2.0	0.7	
20	147.0	5	4.1		1.8		
21	128.0	4	3.8		1.8		
22	143.0	4	3.4	7.3	1.8	0.7	
23	108.0	4	4.4	7.4	1.8	0.7	
24	117.0	4	4.1	7.4	1.8	0.6	
25	96.0	4	5.0	7.4	1.8	0.6	
26	77.0	4	6.2	7.4	1.8	0.7	
27	118.0	4	4.1		2.0		
28	142.0	6	5.1		2.0		
29	106.0	5	5.7	7.4	2.2	0.8	
30	88.0	4	5.5	7.4	2.0	0.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: OMEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ellasari T. Ushin, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3549.0	133	139.9	155.2	61.6	14.5	
AVERAGE	114.5	4	4.5	7.1	2.0	0.7	
MAXIMUM	152.0	6	5.7	7.4	2.2	0.9	
MINIMUM	77.0	3	3.2	0.0	1.8	0.6	
01	91.0	4	5.3	7.4	2.2	0.8	
02	131.0	4	3.7		2.2		
03	123.0	5	4.9		1.9		
04	109.0	4	4.4	7.4	2.0	0.6	
05	117.0	5	5.1	7.4	2.2	0.9	
06	97.0	4	4.9	7.4	2.0	0.7	
07	124.0	5	4.8	7.4	2.0	0.8	
08	77.0	3	4.7	7.4	2.2	0.6	
09	118.0	5	5.1	0.0	2.1		
10	151.0	6	4.8		2.1		
11	99.0	3	3.6	7.4	2.0	0.7	
12	91.0	3	4.0	7.3	1.8	0.6	
13	103.0	3	3.5	7.4	2.0	0.6	
14	130.0	5	4.6	7.4	1.8	0.7	
15	131.0	4	3.7	7.4	1.9	0.7	
16	114.0	3	3.2		1.8		
17	152.0	5	3.9		2.0		
18	101.0	4	4.8	7.4	2.0	0.8	
19	108.0	4	4.4	7.4	1.8	0.7	
20	100.0	4	4.8	7.3	1.8	0.7	
21	117.0	4	4.1	7.4	2.0	0.7	
22	106.0	4	4.5	7.4	1.8	0.7	
23	134.0	5	4.5		1.8		
24	147.0	5	4.1		2.0		
25	115.0	5	5.2	7.4	2.0	0.6	
26	121.0	5	5.0	7.4	2.0	0.7	
27	109.0	5	5.5	7.4	2.0	0.6	
28	106.0	5	5.7	7.4	2.0	0.6	
29	85.0	3	4.2	7.4	2.2	0.7	
30	124.0	4	3.9		2.0		
31	118.0	5	5.1		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 08-13-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellarson T. Valentine, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3574.0	136	140.9	162.4	62.6	15.3	
AVERAGE	115.3	4	4.5	7.4	2.0	0.7	
MAXIMUM	148.0	6	5.9	7.4	2.2	0.8	
MINIMUM	82.0	3	3.5	7.3	1.8	0.6	
01	95.0	3	3.8	7.3	2.0	0.7	
02	130.0	5	4.6	7.4	2.1	0.7	
03	121.0	5	5.0	7.4	2.0	0.6	
04	118.0	5	5.1		2.1		
05	103.0	4	4.7		2.0		
06	131.0	5	4.6		2.2		
07	108.0	4	4.4	7.4	2.1	0.8	
08	100.0	4	4.8	7.4	2.0	0.7	
09	107.0	4	4.5	7.4	1.9	0.7	
10	118.0	4	4.1	7.4	1.9	0.7	
11	128.0	5	4.7	7.4	2.0	0.6	
12	82.0	3	4.4		2.0		
13	130.0	5	4.6		1.8		
14	107.0	4	4.5	7.4	2.1	0.7	
15	101.0	4	4.8	7.4	2.2	0.7	
16	116.0	5	5.2	7.4	2.2	0.6	
17	117.0	5	5.1	7.4	1.8	0.7	
18	117.0	5	5.1	7.4	2.0	0.7	
19	112.0	4	4.3		2.0		
20	148.0	6	4.9		2.2		
21	116.0	5	5.2	7.4	2.0	0.6	
22	101.0	3	3.6	7.4	2.2	0.8	
23	146.0	5	4.1	7.4	2.2	0.7	
24	145.0	5	4.1	7.3	1.9	0.7	
25	123.0	6	5.9	7.3	1.9	0.6	
26	122.0	5	4.9		2.0		
27	131.0	5	4.6		1.9		
28	104.0	3	3.5	7.4	2.2	0.8	
29	102.0	3	3.5	7.4	2.0	0.7	
30	94.0	3	3.8	7.4	1.8	0.7	
31	101.0	4	4.8	7.3	1.9	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 07-10-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: ORANGE HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellison T. Uchida, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3341.0	127	137.3	155.1	61.1	16.0	
AVERAGE	111.4	4	4.6	7.4	2.0	0.8	
MAXIMUM	142.0	6	5.7	7.4	2.2	0.9	
MINIMUM	81.0	3	3.3	7.3	1.8	0.7	
01	88.0	4	5.5		2.0		
02	121.0	5	5.0	7.4	2.2	0.7	
03	108.0	4	4.4	7.3	2.2	0.8	
04	101.0	4	4.8	7.4	2.0	0.7	
05	102.0	4	4.7	7.4	1.8	0.7	
06	86.0	3	4.2	7.4	2.2	0.9	
07	108.0	3	3.3		2.2		
08	123.0	4	3.9		2.0		
09	106.0	4	4.5	7.4	2.0	0.7	
10	126.0	5	4.8	7.4	2.0	0.7	
11	106.0	5	5.7	7.4	2.0	0.9	
12	99.0	3	3.6	7.4	2.2	0.8	
13	84.0	4	5.7	7.4	2.2	0.9	
14	119.0	5	5.0		2.0		
15	135.0	5	4.4		1.8		
16	121.0	5	5.0	7.4	2.0	0.7	
17	108.0	4	4.4	7.4	2.2	0.8	
18	104.0	4	4.6	7.4	2.0	0.7	
19	116.0	4	4.1	7.4	2.0	0.8	
20	129.0	6	5.6	7.4	2.0	0.7	
21	142.0	5	4.2		2.2		
22	81.0	3	4.4		2.2		
23	116.0	4	4.1	7.3	1.9	0.8	
24	123.0	4	3.9	7.3	1.9	0.7	
25	111.0	4	4.3	7.4	2.0	0.7	
26	118.0	4	4.1	7.4	2.0	0.7	
27	138.0	5	4.3	7.4	1.9	0.8	
28	110.0	4	4.4		2.0		
29	95.0	4	5.1		2.0		
30	117.0	5	5.1	7.4	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 06-19-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: ORT. HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellen T. Valentin, C.O., CERT. NO. C-3211

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3599.0	142	148.7	162.7	64.6	16.4	
AVERAGE	116.1	5	4.8	7.4	2.1	0.8	
MAXIMUM	166.0	6	6.7	7.5	2.2	0.9	
MINIMUM	60.0	3	3.8	7.3	1.7	0.7	
01	112.0	4	4.3	7.4	1.8	0.8	
02	128.0	4	3.8	7.4	2.2	0.8	
03	115.0	4	4.2		2.2		
04	109.0	5	5.5		2.1		
05	116.0	4	4.1	7.3	2.2	0.9	
06	116.0	4	4.1	7.4	2.2	0.7	
07	116.0	4	4.1	7.4	2.2	0.8	
08	119.0	4	4.0	7.4	2.2	0.8	
09	121.0	5	5.0	7.4	2.2	0.9	
10	117.0	5	5.1		2.2		
11	138.0	5	4.3		2.0		
12	100.0	4	4.8	7.4	2.0	0.8	
13	126.0	5	4.8	7.5	2.0	0.8	
14	129.0	6	5.6	7.4	2.0	0.7	
15	151.0	5	4.0	7.4	2.2	0.9	
16	60.0	3	6.0	7.4	2.0	0.8	
17	166.0	6	4.3		2.2		
18	110.0	4	4.4		2.0		
19	116.0	4	4.1	7.4	1.7	0.8	
20	123.0	4	3.9	7.4	2.0	0.7	
21	113.0	4	4.2	7.4	2.0	0.7	
22	88.0	4	5.5	7.3	2.0	0.8	
23	133.0	5	4.5	7.4	2.2	0.8	
24	117.0	5	5.1		2.2		
25	94.0	4	5.1		2.0		
26	138.0	6	5.2		2.2		
27	107.0	6	6.7	7.4	2.0	0.8	
28	81.0	4	5.9	7.4	2.2	0.7	
29	111.0	5	5.4	7.4	2.2	0.7	
30	114.0	5	5.3	7.4	2.0	0.7	
31	115.0	5	5.2	7.4	2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 05-05-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

.60852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: O. HILLS WATER TREATMENT PLANT

5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

IF THIS REPORT IS CORRECT Ellen T. Valentin, C.O., CERT. NO. C-3211

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3507.0	142	147.1	162.6	63.4	17.9	
AVERAGE	116.9	5	4.9	7.4	2.1	0.8	
MAXIMUM	174.0	7	6.7	7.4	2.2	1.0	
MINIMUM	67.0	3	3.5	7.3	1.6	0.7	
01	121.0	4	4.0	7.4	2.2	0.8	
02	145.0	6	5.0	7.4	2.0	0.9	
03	122.0	5	4.9	7.4	1.6	0.8	
04	157.0	6	4.6	7.4	2.2	0.8	
05	110.0	4	4.4		2.0		
06	118.0	5	5.1		2.2		
07	123.0	6	5.9	7.4	2.2	0.9	
08	115.0	5	5.2	7.3	2.2	0.8	
09	121.0	5	5.0	7.4	2.2	0.8	
10	117.0	5	5.1	7.4	2.0	0.7	
11	103.0	3	3.5	7.4	2.2	0.7	
12	123.0	4	3.9		2.2		
13	174.0	7	4.8		2.2		
14	80.0	4	6.0	7.4	2.2	0.9	
15	92.0	4	5.2	7.4	2.2	0.8	
16	125.0	4	3.8	7.4	2.2	0.9	
17	121.0	5	5.0	7.4	2.2	1.0	
18	72.0	4	6.7	7.4	2.0	0.8	
19	169.0	7	5.0		2.0		
20	153.0	5	3.9		2.0		
21	91.0	3	4.0	7.4	2.2	0.9	
22	118.0	5	5.1	7.4	2.2	0.8	
23	100.0	4	4.8	7.4	2.0	0.9	
24	109.0	5	5.5	7.3	2.0	0.7	
25	120.0	6	6.0	7.4	2.2	0.8	
26	139.0	6	5.2		2.0		
27	67.0	3	5.4		2.0		
28	105.0	4	4.6	7.4	2.2	0.8	
29	98.0	4	4.9	7.4	2.2	0.7	
30	99.0	4	4.8	7.4	2.2	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

C.U.P. NO. 2-031-0025UE

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNER: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ellen T. Upton, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3725.0	135	135.9	147.8	59.8	17.0	
AVERAGE	120.2	4	4.4	7.4	1.9	0.9	
MAXIMUM	194.0	7	5.5	7.4	2.2	1.0	
MINIMUM	66.0	3	3.5	7.3	1.6	0.7	
01	194.0	7	4.3		1.8		
02	76.0	3	4.7		1.8		
03	126.0	4	3.8	7.4	1.8	0.9	
04	135.0	5	4.4	7.4	1.6	0.9	
05	118.0	4	4.1	7.4	1.6	0.8	
06	114.0	4	4.2	7.4	1.9	0.9	
07	137.0	6	5.3	7.4	2.1	0.8	
08	112.0	4	4.3		2.0		
09	118.0	4	4.1		2.0		
10	137.0	4	3.5	7.3	1.7	0.9	
11	132.0	4	3.6	7.4	2.0	0.8	
12	103.0	4	4.7	7.4	1.6	0.7	
13	109.0	4	4.4	7.4	2.0	0.9	
14	103.0	4	4.7	7.4	2.0	0.9	
15	122.0	4	3.9		2.2		
16	146.0	5	4.1		2.2		
17	107.0	4	4.5	7.4	2.2	0.8	
18	113.0	5	5.3	7.4	1.9	0.9	
19	117.0	5	5.1	7.4	1.7	0.8	
20	120.0	5	5.0	7.4	1.8	0.8	
21	66.0	3	5.5	7.4	1.8	0.7	
22	164.0	6	4.4		2.0		
23	122.0	4	3.9		2.0		
24	109.0	4	4.4	7.4	2.2	1.0	
25	95.0	4	5.1	7.4	2.2	0.9	
26	120.0	4	4.0	7.3	1.7	0.9	
27	139.0	5	4.3	7.4	2.0	0.8	
28	124.0	4	3.9		2.0		
29	116.0	4	4.1		1.8		
30	116.0	4	4.1		2.2		
31	115.0	4	4.2	7.4	2.0	0.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-17-97

PWS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: OR HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ellarsont Valera

, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3270.0	116	119.5	140.7	57.6	18.2	
AVERAGE	116.8	4	4.3	7.4	2.1	1.0	
MAXIMUM	152.0	6	5.6	7.5	2.2	1.1	
MINIMUM	81.0	3	3.1	7.4	1.6	0.8	
01	103.0	3	3.5		2.0		
02	151.0	4	3.2		2.2		
03	110.0	4	4.4	7.4	2.0	0.9	
04	117.0	4	4.1	7.5	2.2	0.8	
05	119.0	4	4.0	7.4	1.9	0.9	
06	105.0	4	4.6	7.4	2.1	1.0	
07	141.0	5	4.3	7.4	2.2	0.8	
08	118.0	4	4.1		2.0		
09	102.0	4	4.7		2.1		
10	120.0	4	4.0	7.4	2.2	1.0	
11	108.0	5	5.6	7.4	2.0	0.9	
12	102.0	4	4.7	7.4	2.2	1.1	
13	121.0	5	5.0	7.4	2.2	0.9	
14	93.0	4	5.2	7.4	2.0	0.9	
15	144.0	6	5.0		2.0		
16	88.0	3	4.1		2.1		
17	145.0	6	5.0		2.1		
18	88.0	3	4.1	7.4	2.0	1.0	
19	152.0	4	3.2	7.4	2.1	1.1	
20	116.0	3	3.1	7.4	2.1	1.0	
21	81.0	3	4.4	7.4	2.2	1.0	
22	137.0	5	4.4		2.0		
23	123.0	4	3.9		2.0		
24	99.0	3	3.6	7.4	1.9	1.0	
25	131.0	5	4.6	7.4	2.0	0.9	
26	131.0	5	4.6	7.4	2.2	1.1	
27	95.0	3	3.8	7.4	2.0	1.0	
28	130.0	5	4.6	7.4	1.6	0.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 02-11-97

MS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: WEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellen Sant. Vol. Lin, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3750.0	135	136.1	162.6	63.7	20.3	
AVERAGE	121.0	4	4.4	7.4	2.1	0.9	
MAXIMUM	165.0	6	5.8	7.5	2.2	1.1	
MINIMUM	68.0	3	3.5	7.3	1.8	0.8	
01	129.0	4	3.7		2.0		
02	127.0	4	3.8	7.4	1.8	1.1	
03	68.0	3	5.3	7.4	2.0	1.0	
04	129.0	4	3.7		2.0		
05	128.0	4	3.8		1.9		
06	102.0	4	4.7	7.4	2.1	1.0	
07	120.0	5	5.0	7.4	1.9	0.9	
08	113.0	4	4.2	7.4	2.2	0.9	
09	108.0	4	4.4	7.3	2.1	1.1	
10	150.0	5	4.0	7.4	2.0	1.0	
11	124.0	6	5.8		2.0		
12	110.0	4	4.4		2.2		
13	117.0	5	5.1	7.3	2.2	1.1	
14	121.0	5	5.0	7.4	2.2	1.1	
15	107.0	4	4.5	7.4	2.0	1.0	
16	115.0	4	4.2	7.4	2.1	0.9	
17	165.0	5	3.6	7.4	2.0	0.8	
18	159.0	5	3.8		2.2		
19	164.0	5	3.7		2.0		
20	103.0	3	3.5	7.4	1.8	0.8	
21	113.0	4	4.2	7.5	2.2	0.9	
22	145.0	5	4.1	7.4	2.0	0.9	
23	114.0	4	4.2	7.4	2.2	0.8	
24	72.0	3	5.0	7.4	2.0	0.8	
25	152.0	5	3.9		2.2		
26	143.0	5	4.2		2.2		
27	85.0	4	5.6	7.4	2.2	0.8	
28	126.0	5	4.8	7.3	1.8	0.8	
29	98.0	4	4.9	7.4	2.0	0.9	
30	116.0	4	4.1	7.4	2.0	0.8	
31	127.0	5	4.7	7.4	2.2	0.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2434286 C.U.P. NO. 2-089-0017- A

NAME OF DRINKING WATER SYSTEM: J.F. RUM WAYER TREATMENT PLANT

CANION: 0000 LITTLEBERRY LANE

FERRANDINA BEACH, MASSAU COUNTY

(MED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT PH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Kenneth P. Snyder, C.O., CERT. NO. C-4016

AYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
TOTAL	2145.0	160	153.3	62.2	16.6
VERAGE	69.2	5	7.3	2.0	0.8
AYIKUN	129.0	8	7.3	2.3	1.1
INIKUN	43.0	3	7.3	1.8	0.6
01	80.0	4	7.3	2.1	0.8
02	81.0	6	7.3	2.0	0.8
03	92.0	5	7.3	2.3	0.8
04	87.0	5	7.3	2.2	0.8
05	81.0	6	7.3	2.3	0.8
06	72.0	6	7.3	2.1	0.8
07	129.0	8	7.3	2.0	0.8
08	58.0	4	7.3	2.0	0.8
09	73.0	6	7.3	2.1	0.8
10	66.0	5	7.3	2.3	1.0
11	59.0	3	7.3	2.2	1.0
12	54.0	5	7.3	2.2	1.1
13	80.0	5	7.3	2.0	0.7
14	47.0	5	7.3	1.9	0.9
15	56.0	6	7.3	1.9	0.9
16	65.0	6	7.3	2.1	0.9
17	87.0	8	7.3	2.0	0.9
18	59.0	5	7.3	1.9	0.6
19	70.0	5	7.3	1.9	0.7
20	63.0	4	7.3	1.8	0.7
21	86.0	5	7.3	1.8	0.7
22	54.0	5	7.3	2.0	0.6
23	58.0	5	7.3	1.9	0.6
24	62.0	6	7.3	1.9	0.6
25	55.0	5	7.3	2.0	0.6
26	53.0	5	7.3	1.8	0.6
27	53.0	5	7.3	1.9	0.6
28	82.0	5	7.3	1.9	0.6
29	43.0	3	7.3	1.8	0.6
30	60.0	5	7.3	1.8	0.8
31	80.0	4	7.3	2.1	0.8

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 12-11-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454286 C.U.P. NO. 2-089-0017- NMZR

NAME OF DRINKING WATER SYSTEM: OTTER RUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LAKE

FERNANDINA BEACH; MASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Robert E. Long*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2898.0	229	306.5	131.4	60.4	14.1	
AVERAGE	96.6	8	10.2	7.3	2.0	0.8	
MAXIMUM	372.0	14	18.8	7.3	3.5	1.3	
MINIMUM	50.0	3	4.5	7.3	1.2	0.5	
01	56.0	5	10.7		1.8		
02	123.0	11	10.7		1.8		
03	89.0	8	10.8	7.3	1.8	0.7	
04	91.0	10	13.2	7.3	1.8	0.7	
05	372.0	14	4.5	7.3	1.9	0.7	
06	75.0	10	16.0	7.3	1.2	0.5	
07	51.0	8	18.8	7.3	1.6	0.6	
08	87.0	9	12.4		1.8		
09	109.0	13	14.3		1.8		
10	90.0	10	13.3	7.3	2.1	0.8	
11	100.0	8	9.6	7.3	2.8	1.3	
12	50.0	5	12.0	7.3	2.0	0.7	
13	67.0	6	10.7	7.3	2.0	0.7	
14	67.0	5	9.0	7.3	2.1	0.7	
15	76.0	5	7.9		2.3		
16	91.0	8	10.5		2.3		
17	86.0	8	11.2	7.3	2.2	0.8	
18	90.0	7	9.3	7.3	2.0	0.7	
19	99.0	7	8.5	7.3	3.5	1.2	
20	114.0	8	8.4	7.3	2.6	1.0	
21	90.0	6	8.0	7.3	2.5	0.8	
22	87.0	5	6.9		2.0		
23	116.0	6	6.2		2.0		
24	82.0	6	8.8	7.3	1.6	0.6	
25	101.0	10	11.9	7.3	2.1	0.8	
26	124.0	9	8.7	7.3	2.1	0.8	
27	103.0	5	5.8		1.8		
28	86.0	6	8.4		1.6		
29	50.0	3	7.2		1.6		
30	76.0	8	12.6		1.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 11-06-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WWS ID NO. 2454286 C.U.P. NO. 2-089-0017- NHZR

NAME OF DRINKING WATER SYSTEM: BER RUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Schilder, C.O., CERT. NO. ~~C-4016~~ C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3562.0	220	230.4	167.9	57.3	15.5	
AVERAGE	114.9	7	7.4	7.3	1.8	0.7	
MAXIMUM	258.0	15	12.0	7.3	2.2	0.8	
MINIMUM	72.0	4	5.2	7.3	1.5	0.3	
01	170.0	9	6.4	7.3	1.9	0.7	
02	154.0	8	6.2	7.3	1.9	0.7	
03	98.0	5	6.1	7.3	1.7	0.6	
04	130.0	7	6.5		1.7		
05	135.0	7	6.2		1.8		
06	258.0	15	7.0	7.3	1.7	0.3	
07	133.0	10	9.0	7.3	2.1	0.8	
08	122.0	9	8.9	7.3	2.0	0.8	
09	134.0	10	9.0	7.3	1.9	0.7	
10	120.0	8	8.0	7.3	1.7	0.7	
11	132.0	8	7.3		1.8		
12	124.0	8	7.7		1.7		
13	131.0	8	7.3	7.3	1.5	0.6	
14	92.0	4	5.2	7.3	1.5	0.7	
15	109.0	5	5.5	7.3	1.7	0.6	
16	83.0	5	7.2	7.3	1.8	0.6	
17	77.0	4	6.2	7.3	1.8	0.6	
18	80.0	5	7.5		1.8		
19	110.0	11	12.0		1.7		
20	96.0	6	7.5	7.3	1.7	0.7	
21	124.0	7	6.8	7.3	2.0	0.7	
22	126.0	8	7.6	7.3	1.9	0.7	
23	119.0	9	9.1	7.3	1.9	0.6	
24	72.0	4	6.7	7.3	1.9	0.8	
25	89.0	5	6.7		2.0		
26	89.0	6	8.1		2.2		
27	72.0	5	8.3	7.3	2.1	0.7	
28	73.0	5	8.2	7.3	2.1	0.8	
29	148.0	9	7.3	7.3	1.9	0.7	
30	83.0	5	7.2	7.3	2.0	0.7	
31	79.0	5	7.6	7.3	1.9	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454286 C.U.P. NO. 2-089-0017- NMZR

NAME OF DRINKING WATER SYSTEM: OTTER RUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Stillman

, C.O., CERT. NO. C-4016 7253

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3067.0	204	250.0	153.3	56.6	14.1	
AVERAGE	102.2	7	8.3	7.3	1.9	0.7	
MAXIMUM	197.0	14	15.5	7.3	2.2	0.8	
MINIMUM	52.0	3	4.6	7.3	1.6	0.6	
01	68.0	5	8.8		2.0		
02	55.0	4	8.7	7.3	2.1	0.7	
03	92.0	6	7.8	7.3	2.1	0.7	
04	110.0	7	7.6	7.3	1.9	0.6	
05	77.0	6	9.4	7.3	1.8	0.6	
06	103.0	10	11.7		2.2		
07	133.0	8	7.2		2.2		
08	79.0	5	7.6	7.3	1.9	0.6	
09	128.0	9	8.4	7.3	1.8	0.6	
10	53.0	3	6.8	7.3	1.8	0.6	
11	100.0	8	9.6	7.3	1.9	0.7	
12	108.0	7	7.8	7.3	1.9	0.7	
13	149.0	8	6.4		1.8		
14	108.0	7	7.8		1.8		
15	100.0	7	8.4	7.3	1.8	0.6	
16	131.0	10	9.2	7.3	1.8	0.7	
17	123.0	6	5.9	7.3	1.9	0.7	
18	108.0	6	6.7	7.3	1.9	0.7	
19	150.0	8	6.4	7.3	1.9	0.7	
20	139.0	6	5.2		1.8		
21	197.0	14	8.5		1.9		
22	87.0	4	5.5	7.3	2.0	0.8	
23	115.0	6	6.3	7.3	1.8	0.8	
24	105.0	4	4.6	7.3	1.7	0.7	
25	85.0	11	15.5	7.3	1.6	0.7	
26	60.0	6	12.0	7.3	1.9	0.7	
27	52.0	6	13.8		2.0		
28	64.0	8	15.0		1.8		
29	100.0	5	6.0	7.3	1.8	0.6	
30	88.0	4	5.5	7.3	1.8	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454286 C.U.P. NO. 2-089-0017- WWR

NAME OF DRINKING WATER SYSTEM: OTHER RUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERRANDINA BEACH; HASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT PH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. S. Strickland, C.O., CERT. NO. 6-1016 C-7253

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	2396.0	152	151.2	63.2	20.6
AVERAGE	77.3	5	7.2	2.0	1.0
MAXIMUM	118.0	8	7.2	2.4	1.3
MINIMUM	41.0	3	7.2	1.8	0.7
01	61.0	4	7.2	2.3	1.3
02	57.0	3	6.3	2.2	
03	83.0	5	7.2	2.2	
04	62.0	4	7.7	2.0	1.1
05	88.0	5	6.8	2.0	1.0
06	41.0	4	11.7	2.2	1.0
07	52.0	4	9.2	2.2	1.3
08	72.0	5	8.3	2.0	1.2
09	59.0	4	8.1	2.3	
10	73.0	5	8.2	2.3	
11	62.0	3	5.8	2.3	1.0
12	82.0	5	7.3	2.2	1.0
13	115.0	6	6.3	2.2	1.1
14	83.0	8	11.6	1.8	0.9
15	81.0	6	8.9	2.0	0.8
16	53.0	4	9.1	2.0	
17	69.0	7	12.2	1.8	
18	91.0	6	7.9	2.1	0.9
19	49.0	4	9.8	2.1	0.8
20	93.0	6	7.7	2.1	0.8
21	94.0	6	7.7	1.8	0.9
22	101.0	5	5.9	2.0	0.7
23	71.0	5	8.5	1.8	
24	77.0	5	7.8	1.8	
25	89.0	5	6.7	1.9	1.0
26	99.0	5	6.1	1.8	0.8
27	85.0	5	7.1	1.8	0.9
28	118.0	5	5.1	1.8	0.9
29	94.0	5	6.4	2.4	1.2
30	44.0	3	8.2	1.8	
31	98.0	5	6.1	2.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 08-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454286 C.U.P. NO. 2-089-0017- MNZR

NAME OF DRINKING WATER SYSTEM: OTTER RUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2995.0	174	221.7	158.4	65.9	26.6	
AVERAGE	96.6	6	7.2	7.2	2.1	1.2	
MAXIMUM	160.0	10	10.9	7.2	3.0	1.9	
MINIMUM	51.0	3	4.0	7.2	1.2	0.5	
01	72.0	4	6.7	7.2	1.8	0.8	
02	119.0	4	4.0	7.2	1.9	0.8	
03	118.0	4	4.1	7.2	1.6	0.6	
04	108.0	4	4.4		1.6		
05	71.0	3	5.1		1.6		
06	89.0	4	5.4		1.6		
07	51.0	4	9.4	7.2	1.7	0.6	
08	82.0	6	8.8	7.2	1.7	0.7	
09	75.0	5	8.0	7.2	1.2	0.5	
10	62.0	5	9.7	7.2	1.4	0.6	
11	97.0	7	8.7	7.2	1.6	0.7	
12	103.0	5	5.8		1.5		
13	110.0	10	10.9		1.7		
14	121.0	7	6.9	7.2	3.0	1.9	
15	126.0	7	6.7	7.2	2.8	1.8	
16	137.0	8	7.0	7.2	2.8	1.8	
17	96.0	7	8.8	7.2	2.8	1.7	
18	105.0	9	10.3	7.2	2.7	1.7	
19	97.0	7	8.7		2.4		
20	127.0	8	7.6		2.5		
21	99.0	5	6.1	7.2	2.5	1.6	
22	124.0	7	6.8	7.2	2.4	1.6	
23	160.0	8	6.0	7.2	2.5	1.4	
24	101.0	5	5.9	7.2	2.5	1.4	
25	96.0	4	5.0	7.2	2.3	1.3	
26	65.0	5	9.2		2.3		
27	82.0	6	8.8		2.3		
28	87.0	4	5.5	7.2	2.2	1.2	
29	99.0	4	4.8	7.2	2.4	1.3	
30	64.0	4	7.5	7.2	2.3	1.3	
31	52.0	4	9.2	7.2	2.3	1.3	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 07-14-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454286 C.U.P. NO. 2-089-0017- NMZR

NAME OF DRINKING WATER SYSTEM: OTEARUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH, NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth L. Lynch*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2310.0	164	262.5		57.8	23.2	
AVERAGE	77.0	5	8.8		1.9	1.1	
MAXIMUM	123.0	9	16.0		2.2	8.0	
MINIMUM	30.0	3	4.7		1.1	0.4	
01	62.0	5	9.7		1.8		
02	62.0	5	9.7		1.8	0.7	
03	62.0	6	11.6		2.0	0.8	
04	73.0	4	6.6		1.8	0.6	
05	62.0	4	7.7		1.8	0.6	
06	55.0	4	8.7		1.9	0.6	
07	66.0	4	7.3		2.2		
08	93.0	6	7.7		2.2		
09	78.0	5	7.7		2.1	0.8	
10	81.0	6	8.9		2.0	0.7	
11	112.0	6	6.4		2.0	0.7	
12	94.0	8	10.2		2.2	0.8	
13	96.0	7	8.8		2.1	0.8	
14	69.0	5	8.7		2.0		
15	81.0	6	8.9		2.0		
16	123.0	9	8.8		2.2	0.8	
17	51.0	4	9.4		2.1	0.8	
18	67.0	5	9.0		2.2	0.8	
19	57.0	5	10.5		2.2	0.8	
20	72.0	3	5.0		2.1	0.8	
21	77.0	3	4.7		2.0		
22	77.0	7	10.9		1.8		
23	87.0	7	9.7		2.0	0.8	
24	122.0	7	6.9		1.8	0.7	
25	100.0	6	7.2		1.1	0.4	
26	75.0	5	8.0		1.5	0.6	
27	73.0	5	8.2		1.7	0.7	
28	55.0	4	8.6		1.8		
29	97.0	9	11.1		1.8	0.9	
30	30.0	4	16.0		1.6	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 06-12-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454286 C.U.P. NO. 2-089-0017- NM

NAME OF DRINKING WATER SYSTEM: UN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Syph, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2936.0	157	211.9	194.4	58.3	15.2	
AVERAGE	94.7	5	6.8	7.2	1.9	0.7	
MAXIMUM	197.0	10	13.0	7.2	2.3	0.8	
MINIMUM	37.0	3	3.6	7.2	1.4	0.5	
01	81.0	5	7.4	7.2	2.0	0.8	
02	88.0	3	4.1	7.2	2.1	0.8	
03	88.0	4	5.5	7.2	2.0		
04	106.0	5	5.7	7.2	1.9		
05	125.0	5	4.8	7.2	2.1	0.7	
06	197.0	7	4.3	7.2	2.0	0.7	
07	97.0	5	6.2	7.2	2.0	0.8	
08	91.0	6	7.9	7.2	2.3	0.8	
09	90.0	6	8.0	7.2	2.1	0.7	
10	128.0	6	5.6		1.8		
11	90.0	6	8.0		1.8		
12	65.0	4	7.4	7.2	2.0	0.8	
13	62.0	4	7.7	7.2	2.1	0.8	
14	87.0	5	6.9	7.2	2.0	0.8	
15	93.0	5	6.5	7.2	1.6	0.6	
16	120.0	6	6.0	7.2	1.8	0.7	
17	99.0	4	4.8		1.8		
18	69.0	5	8.7		2.0		
19	92.0	5	6.5	7.2	2.0	0.8	
20	152.0	10	7.9	7.2	1.8	0.7	
21	106.0	6	6.8	7.2	1.9	0.7	
22	133.0	4	3.6	7.2	2.0	0.8	
23	113.0	5	5.3	7.2	1.6	0.5	
24	79.0	5	7.6	7.2	1.8		
25	37.0	4	13.0	7.2	1.4		
26	102.0	6	7.1	7.2	1.8		
27	63.0	4	7.6	7.2	1.8	0.8	
28	82.0	5	7.3	7.2	1.6	0.6	
29	59.0	4	8.1	7.2	1.6	0.6	
30	97.0	4	4.9	7.2	1.8	0.7	
31	45.0	4	10.7	7.2	1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 05-14-97

WS ID NO. 2454286 C.U.P. NO. 2-089-0017-

NAME OF DRINKING WATER SYSTEM: SUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth L. Lynch, C.O., CERT. NO. C-4016

MAY MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2870.0	135	174.0	172.6	57.5	18.6	
AVERAGE	95.7	5	5.8	7.2	1.9	0.8	
MAXIMUM	174.0	8	8.6	7.2	2.5	1.1	
MINIMUM	46.0	2	2.8	7.1	1.6	0.7	
01	101.0	5	5.9	7.2	1.8	0.8	
02	104.0	5	5.8	7.2	1.9	0.8	
03	64.0	3	5.6	7.2	1.9	0.8	
04	105.0	6	6.9	7.2	1.8	0.8	
05	118.0	7	7.1	7.2	1.8	0.7	
06	86.0	5	7.0	7.2	1.9		
07	117.0	6	6.2	7.1	2.5	1.1	
08	88.0	4	5.5	7.1	2.3	1.0	
09	138.0	8	7.0	7.2	2.2	1.0	
10	90.0	5	6.7	7.2	2.2	1.0	
11	102.0	4	4.7	7.2	1.9	0.8	
12	107.0	4	4.5		1.6		
13	93.0	6	7.7		1.6		
14	69.0	4	7.0	7.2	1.7	0.8	
15	46.0	3	7.8	7.2	1.7	0.7	
16	102.0	4	4.7	7.2	1.6	0.7	
17	84.0	6	8.6	7.2	1.8	0.8	
18	128.0	6	5.6	7.2	2.0	0.8	
19	124.0	6	5.8		2.0		
20	174.0	4	2.8		2.1		
21	100.0	4	4.8	7.2	2.0	0.8	
22	140.0	4	3.4	7.2	2.0	0.7	
23	60.0	3	6.0	7.2	1.8	0.7	
24	90.0	4	5.3	7.2	2.0	0.8	
25	96.0	4	5.0	7.2	1.8	0.7	
26	62.0	3	5.8		1.8		
27	52.0	3	6.9		1.8		
28	57.0	2	4.2	7.2	2.1	0.8	
29	101.0	4	4.8	7.2	1.9	0.7	
30	72.0	3	5.0	7.2	2.0	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-09-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2454286 C.U.P. NO. 2-089-0017- WZR

NAME OF DRINKING WATER SYSTEM: OTTER RUN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2479.0	134	212.9	144.0	62.6	22.8	
AVERAGE	80.0	4	6.9	7.2	2.0	1.1	
MAXIMUM	132.0	6	10.7	7.2	3.0	1.8	
MINIMUM	56.0	2	2.3	7.2	1.5	0.7	
01	64.0	5	9.4		1.8		
02	63.0	5	9.5		1.9		
03	85.0	5	7.1	7.2	3.0	1.8	
04	72.0	5	8.3	7.2	2.6	1.5	
05	96.0	4	5.0	7.2	2.5	1.5	
06	60.0	4	8.0	7.2	2.5	1.5	
07	57.0	5	10.5	7.2	2.6	1.5	
08	86.0	4	5.6		2.4		
09	93.0	4	5.2		2.5		
10	77.0	4	6.2	7.2	2.2	1.4	
11	70.0	5	8.6	7.2	2.2	1.2	
12	63.0	5	9.5	7.2	2.1	1.0	
13	87.0	5	6.9	7.2	2.3	1.1	
14	88.0	5	6.8	7.2	2.2	1.0	
15	69.0	5	8.7		1.8		
16	85.0	5	7.1		1.8		
17	76.0	5	7.9	7.2	1.9	1.1	
18	56.0	5	10.7	7.2	1.8	1.0	
19	75.0	5	8.0	7.2	1.8	1.1	
20	76.0	4	6.3	7.2	2.0	1.1	
21	108.0	3	3.3	7.2	1.8	1.0	
22	68.0	4	7.1		1.9		
23	132.0	4	3.6		1.9		
24	96.0	3	3.8	7.2	2.0	1.0	
25	57.0	3	6.3	7.2	1.8	0.9	
26	107.0	4	4.5	7.2	1.5	0.7	
27	70.0	4	6.9	7.2	1.5	0.7	
28	103.0	2	2.3		1.6		
29	89.0	3	4.0		1.5		
30	73.0	4	6.6		1.6		
31	78.0	6	9.2	7.2	1.6	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 03-06-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454286 C.U.P. NO. 2-089-0017-

NAME OF DRINKING WATER SYSTEM ST. JOHN WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Kenneth E. Lloyd

, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2066.0	115	207.6	173.3	50.1	14.4	
AVERAGE	73.8	4	7.4	7.2	1.8	0.7	
MAXIMUM	223.0	7	14.0	7.3	2.0	0.9	
MINIMUM	40.0	2	3.6	7.2	0.8	0.4	
01	95.0	5	6.3	7.2	1.8		
02	76.0	5	7.9	7.2	1.9		
03	102.0	5	5.9	7.2	1.8	0.7	
04	167.0	5	3.6	7.2	1.8	0.8	
05	84.0	6	8.6	7.2	1.8	0.9	
06	40.0	2	6.0	7.2	2.0	0.9	
07	56.0	2	4.3	7.2	1.9	0.8	
08	54.0	2	4.4	7.2	1.8	0.8	
09	59.0	2	4.1	7.2	1.7		
10	223.0	7	3.8	7.3	0.8	0.6	
11	146.0	7	5.8	7.3	1.6	0.6	
12	59.0	2	4.1	7.3	2.0	0.8	
13	43.0	4	11.2	7.3	1.9	0.8	
14	58.0	3	6.2	7.3	1.9	0.8	
15	40.0	2	6.0		1.4		
16	43.0	5	14.0		1.6		
17	56.0	5	10.7	7.2	1.8		
18	71.0	6	10.1	7.2	1.3	0.4	
19	41.0	3	8.8	7.2	2.0	0.6	
20	68.0	3	5.3	7.2	2.0	0.7	
21	45.0	4	10.7	7.2	1.8	0.6	
22	50.0	3	7.2		1.9		
23	66.0	6	10.9		1.9		
24	68.0	5	8.8	7.2	2.0	0.8	
25	40.0	4	12.0	7.2	2.0	0.8	
26	52.0	4	9.2	7.2	2.0	0.6	
27	72.0	4	6.7	7.2	1.8	0.7	
28	92.0	4	5.2	7.2	1.9	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 02-19-97

WS ID NO. 2454286 C.U.P. NO. 2-089-0017- N

NAME OF DRINKING WATER SYSTEM: FERNANDINA BEACH WATER TREATMENT PLANT

LOCATION: 0000 LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Robert C. Boyd*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3085.0	141	176.2	223.1	61.2	23.5	
AVERAGE	99.5	5	5.7	7.2	2.0	1.0	
MAXIMUM	142.0	8	11.1	7.2	2.5	1.3	
MINIMUM	54.0	1	1.3	7.1	1.2	0.6	
01	54.0	5	11.1	7.2	1.8		
02	110.0	4	4.4	7.2	2.1	1.1	
03	119.0	3	3.0	7.2	2.0	1.1	
04	99.0	4	4.8	7.2	2.0		
05	83.0	4	5.8	7.2	1.6		
06	87.0	4	5.5	7.2	1.7	0.6	
07	77.0	4	6.2	7.2	1.8	0.8	
08	113.0	6	6.4	7.2	2.0	1.1	
09	111.0	5	5.4	7.2	2.1	1.1	
10	72.0	4	6.7	7.2	2.0	1.0	
11	111.0	5	5.4	7.2	2.5	1.2	
12	131.0	8	7.3	7.2	2.5		
13	108.0	7	7.8	7.2	2.2	1.3	
14	119.0	6	6.1	7.2	2.0	1.0	
15	93.0	6	7.7	7.2	2.2	1.1	
16	71.0	2	3.4	7.2	2.0	1.0	
17	120.0	2	2.0	7.2	2.1	1.1	
18	114.0	2	2.1	7.2	1.5		
19	92.0	1	1.3	7.2	1.2		
20	114.0	5	5.3	7.2	1.5	0.6	
21	120.0	6	6.0	7.2	2.3	1.2	
22	118.0	4	4.1	7.2	2.1	1.2	
23	118.0	4	4.1	7.2	2.2	1.2	
24	93.0	4	5.2	7.2	2.0	1.1	
25	70.0	5	8.6	7.2	1.8		
26	92.0	6	7.8	7.2	2.1		
27	95.0	5	6.3	7.1	2.0	1.0	
28	142.0	6	5.1	7.2	1.9	0.8	
29	60.0	4	8.0	7.2	2.0	1.0	
30	86.0	5	7.0	7.2	2.0	0.9	
31	93.0	5	6.5	7.2	2.0	1.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2554334 C.U.P. NO. 2-109-02090

NAME OF DRINKING WATER SYSTEM NCC LEON SYSTEM GRID PLANT No. 1

CATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

AVERAGE FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	4135.0	155.8	140.3	7.3	69.3	16.3	1	
AVERAGE	133.4	5.0	4.5	7.3	2.2	0.8		
MAXIMUM	199.0	7.4	5.5	7.6	3.0	1.1		
MINIMUM	88.0	3.3	3.4	6.9	1.0	0.5		
01	133.0	5.6	5.1	7.3	2.1	0.6		
02	101.0	3.6	4.3	7.3	2.3	0.7		
03	143.0	5.4	4.5	7.4	1.9	0.8		
04	129.0	4.9	4.6	7.4	2.0	0.8		
05	175.0	6.5	4.5	7.4	2.4	0.9		
06	88.0	3.3	4.5	7.0	1.0			
07	175.0	6.6	4.5	6.9	3.0			
08	199.0	7.4	4.5	6.9	2.8	0.7	1	
09	117.0	4.4	4.5	6.9	2.0	0.5		
10	127.0	4.7	4.4	7.1	2.8	0.8		
11	117.0	4.4	4.5	7.2	2.5	0.9		
12	125.0	4.3	4.1	7.2	2.3	0.8		
13	114.0	4.2	4.4	7.2	2.1			
14	139.0	5.2	4.5	7.2	2.0			
15	118.0	4.4	4.5	7.2	2.1	0.7		
16	111.0	4.2	4.5	7.2	2.0	0.8		
17	148.0	5.6	4.5	7.3	2.2	0.9		
18	97.0	3.8	4.7	7.3	2.3	1.1		
19	140.0	5.3	4.5	7.3	2.0	0.9		
20	136.0	5.1	4.5	7.6	2.5			
21	140.0	5.3	4.5	7.5	3.0			
22	153.0	5.8	4.5	7.5	2.8	0.7		
23	113.0	4.3	4.6	7.5	2.9	0.8		
24	141.0	5.3	4.5	7.5	2.8	0.8		
25	133.0	5.0	4.5	7.4	2.0			
26	135.0	5.6	5.0	7.4	2.7			
27	135.0	6.2	5.5	7.5	1.3			
28	159.0	4.5	3.4	7.5	1.8			
29	128.0	4.8	4.5	7.5	1.7	0.6		
30	116.0	4.4	4.6	7.5	1.9	0.7		
31	150.0	5.7	4.6	7.5	2.1	0.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NS ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1997


PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	RESIDUAL CHLORINE REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	5022.0	187.5	134.6	220.5	74.8	16.2	1	
AVERAGE	167.4	6.3	4.5	7.4	2.5	0.9		
MAXIMUM	270.0	9.8	5.3	7.5	3.1	1.3		
MINIMUM	121.0	4.1	3.6	6.9	1.0	0.5		
01	203.0	7.5	4.4	7.3	2.9			
02	270.0	9.8	4.4	7.4	2.4			
03	166.0	6.0	4.3	7.4	3.0	1.0		
04	160.0	5.8	4.4	7.4	3.1	1.1	1	
05	170.0	6.2	4.4	7.4	2.9	1.1		
06	178.0	6.5	4.4	7.4	2.6	1.1		
07	169.0	6.2	4.4	7.4	2.5	1.0		
08	203.0	7.4	4.4	7.4	3.0			
09	219.0	8.0	4.4	7.3	2.9			
10	178.0	7.2	4.9	7.3	2.9	1.0		
11	171.0	6.5	4.6	7.3	2.5	1.0		
12	150.0	6.6	5.3	7.3	2.4	0.8		
13	138.0	4.1	3.6	7.3	2.3	0.8		
14	134.0	5.1	4.6	7.3	2.1	0.7		
15	139.0	5.2	4.5	7.5	2.0			
16	186.0	6.9	4.5	7.5	2.2			
17	130.0	5.2	4.8	7.5	2.2	0.8		
18	139.0	4.9	4.2	7.5	2.2	0.8		
19	121.0	4.8	4.8	7.5	2.3	0.9		
20	164.0	6.2	4.5	7.4	2.4	1.3		
21	133.0	5.0	4.5	7.4	2.8	1.1		
22	135.0	5.0	4.4	7.3	2.6			
23	208.0	7.9	4.6	6.9	3.0			
24	142.0	5.4	4.6	7.2	3.0	0.5		
25	161.0	6.0	4.5	7.3	2.8	0.5		
26	166.0	6.2	4.5	7.3	2.7	0.7		
27	189.0	7.2	4.6	7.3	2.3			
28	164.0	6.2	4.5	7.4	2.0			
29	163.0	6.2	4.6	7.3	1.0			
30	173.0	6.3	4.4	7.3	1.8			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2554334 C.U.P. NO. 2-109-0209USH

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1997


PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5685.0	206.7	135.3	229.8	72.6	17.9	1	
AVERAGE	183.4	6.7	4.4	7.4	2.3	0.8		
MAXIMUM	292.0	10.5	4.4	7.6	3.0	1.1		
MINIMUM	124.0	4.5	4.2	7.3	1.6	0.6		
01	161.0	5.7	4.2	7.4	2.4	0.7	1	
02	159.0	5.8	4.4	7.4	2.0	0.7		
03	162.0	5.9	4.4	7.4	1.8	0.7		
04	167.0	6.1	4.4	7.4	2.0			
05	219.0	8.0	4.4	7.4	1.6			
06	198.0	7.2	4.4	7.4	1.8	0.6		
07	194.0	7.1	4.4	7.4	1.7	0.6		
08	189.0	6.9	4.4	7.4	1.9	0.7		
09	190.0	6.9	4.4	7.4	2.0	0.8		
10	186.0	6.8	4.4	7.4	2.1	0.8		
11	213.0	7.5	4.2	7.4	2.0			
12	292.0	10.5	4.3	7.4	1.7			
13	167.0	5.9	4.2	7.4	3.0	0.6		
14	230.0	8.4	4.4	7.4	2.8	0.7		
15	179.0	6.5	4.4	7.4	2.7	0.7		
16	156.0	5.7	4.4	7.4	2.4	0.6		
17	200.0	7.3	4.4	7.4	2.3	0.8		
18	177.0	6.5	4.4	7.4	3.0			
19	138.0	5.0	4.3	7.4	3.0			
20	230.0	8.4	4.4	7.4	2.9	1.0		
21	196.0	7.1	4.3	7.4	2.9	1.1		
22	172.0	6.3	4.4	7.4	2.7	1.0		
23	172.0	6.3	4.4	7.4	2.5	1.0		
24	186.0	6.8	4.4	7.4	2.2	1.0		
25	196.0	7.2	4.4	7.6	2.2			
26	179.0	6.6	4.4	7.6	2.5			
27	152.0	5.5	4.3	7.5	2.0	0.6		
28	144.0	5.2	4.3	7.5	2.1	0.6		
29	193.0	7.1	4.4	7.3	2.8	0.9		
30	124.0	4.5	4.4	7.4	2.6	0.7		
31	164.0	6.0	4.4	7.3	3.0	1.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554334 C.U.P. NO. 2-109-0209USM

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5319.0	193.5	131.0	222.2	66.1	13.9	1	
AVERAGE	177.3	6.4	4.4	7.4	2.2	0.7		
MAXIMUM	233.0	8.5	4.7	7.5	2.8	0.8		
MINIMUM	141.0	5.0	4.0	7.3	1.8	0.4		
01	199.0	7.3	4.4	7.3	1.8			
02	142.0	5.2	4.4	7.3	1.9	0.5		
03	179.0	6.5	4.4	7.3	2.0	0.5		
04	141.0	5.0	4.3	7.3	2.1	0.5		
05	168.0	6.2	4.4	7.3	2.3	0.6		
06	182.0	6.8	4.5	7.5	2.3			
07	209.0	7.0	4.0	7.5	2.2			
08	174.0	6.4	4.4	7.5	2.4	0.6		
09	164.0	6.2	4.5	7.5	2.5	0.8		
10	204.0	7.5	4.4	7.4	1.8	0.5	1	
11	168.0	6.1	4.4	7.4	2.0	0.7		
12	141.0	5.2	4.4	7.4	2.1	0.8		
13	218.0	8.1	4.5	7.4	2.3			
14	233.0	8.5	4.4	7.4	1.9			
15	228.0	8.2	4.3	7.4	2.1	0.6		
16	191.0	6.9	4.3	7.4	2.0	0.7		
17	204.0	7.8	4.6	7.4	2.2	0.8		
18	186.0	6.8	4.4	7.4	2.1	0.8		
19	213.0	7.7	4.3	7.4	2.1	0.7		
20	228.0	8.3	4.4	7.5	2.0			
21	167.0	5.9	4.2	7.4	2.5			
22	147.0	5.4	4.4	7.4	2.6	0.4		
23	188.0	6.2	4.0	7.4	2.3	0.6		
24	143.0	5.2	4.4	7.4	2.4	0.8		
25	141.0	5.1	4.3	7.4	2.2	0.7		
26	158.0	6.2	4.7	7.4	2.8	0.7		
27	146.0	5.1	4.2	7.5	2.4			
28	164.0	6.1	4.5	7.5	2.3			
29	141.0	5.1	4.3	7.4	2.2	0.8		
30	152.0	5.5	4.3	7.4	2.3	0.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

FWS ID NO. 254334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: FORCE DE LEON SYSTEM GRID PLANT NO. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997


PLANT EFFLUENT PH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



C.O., CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	EFFLUENT RESIDUAL CHLORINE MS/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	5474.0	-197.7	288.1	64.7	12.7	1
AVERAGE	176.6	6.4	7.4	2.1	0.6	
MAXIMUM	235.0	8.1	7.5	2.6	0.9	
MINIMUM	106.0	3.9	7.3	1.7	0.4	
01	207.0	7.0	7.4	2.6	0.9	
02	170.0	7.0	7.5	2.0		
03	192.0	7.0	7.5	2.1		
04	165.0	6.0	7.4	1.8	0.6	1
05	168.0	6.1	7.4	1.9	0.7	
06	221.0	8.1	7.4	1.9	0.4	
07	175.0	6.4	7.4	2.2	0.5	
08	157.0	5.7	7.4	1.7		
09	191.0	6.9	7.4	1.8		
10	178.0	6.4	7.4	2.0	0.7	
11	167.0	6.1	7.4	2.0	0.7	
12	154.0	6.3	7.4	2.1	0.7	
13	183.0	6.7	7.4	2.2	0.5	
14	199.0	7.3	7.4	2.3	0.6	
15	186.0	3.9	7.4	2.5		
16	194.0	7.0	7.3	2.3		
17	189.0	6.9	7.4	1.7	0.5	
18	176.0	6.4	7.3	2.0	0.6	
19	154.0	6.0	7.3	2.2	0.6	
20	162.0	5.8	7.3	2.1	0.6	
21	187.0	6.8	7.3	2.0	0.7	
22	206.0	7.5	7.3	2.1		
23	235.0	6.4	7.3	1.9		
24	147.0	5.3	7.3	2.2	0.6	
25	166.0	6.0	7.3	2.3	0.8	
26	165.0	6.0	7.3	2.4	0.7	
27	167.0	6.1	7.3	2.4	0.6	
28	147.0	4.3	7.3	2.0	0.7	
29	161.0	6.0	7.3	2.3		
30	183.0	6.8	7.3	1.9		
31	202.0	7.5	7.3	1.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Tom C. Atwood*, C.O., CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5683.0	207.1	136.6	7.4	74.0	17.6	1	
AVERAGE	183.3	6.7	4.4	7.4	2.4	0.8		
MAXIMUM	261.0	8.4	6.6	7.5	3.0	1.5		
MINIMUM	129.0	4.5	3.3	7.4	1.0	0.4		
01	129.0	4.7	4.4	7.5	2.0	0.8		
02	179.0	6.5	4.4	7.5	2.2	0.5	1	
03	202.0	7.3	4.3	7.4	1.8	0.5		
04	222.0	8.0	4.3	7.4	1.0			
05	164.0	6.0	4.4	7.4	1.8			
06	261.0	7.1	3.3	7.4	1.7			
07	136.0	7.5	6.6	7.4	1.9	0.5		
08	197.0	7.1	4.3	7.4	2.3	0.6		
09	170.0	6.0	4.2	7.5	3.0	1.5		
10	169.0	6.5	4.6	7.5	3.0	1.5		
11	158.0	5.7	4.3	7.5	3.0	1.5		
12	186.0	6.8	4.4	7.5	3.0			
13	231.0	8.4	4.4	7.5	3.0			
14	181.0	6.5	4.3	7.4	2.9	0.6		
15	193.0	7.0	4.4	7.4	2.7	0.8		
16	193.0	6.9	4.3	7.4	2.7	0.9		
17	190.0	7.0	4.4	7.4	2.5	0.8		
18	164.0	6.0	4.4	7.4	2.6	0.8		
19	187.0	6.9	4.4	7.4	2.3			
20	219.0	7.9	4.3	7.4	2.1			
21	191.0	6.9	4.3	7.4	2.2	0.7		
22	201.0	7.3	4.4	7.4	2.5	0.7		
23	202.0	7.4	4.4	7.4	2.9	0.7		
24	214.0	7.9	4.4	7.4	2.3	0.6		
25	212.0	7.7	4.4	7.4	2.4	0.7		
26	141.0	5.2	4.4	7.5	2.2			
27	178.0	6.5	4.4	7.4	2.0			
28	131.0	4.5	4.1	7.5	2.3	0.4		
29	174.0	6.5	4.5	7.5	2.2	0.6		
30	165.0	6.0	4.4	7.5	2.8	1.0		
31	143.0	5.4	4.5	7.5	2.7	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: June 1997


AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

AVERAGE FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. DR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	4487.0	163.5	131.1	221.3	60.5	17.1	1	
AVERAGE	149.6	5.5	4.4	7.4	2.0	0.8		
MAXIMUM	184.0	7.0	4.6	7.6	2.4	1.1		
MINIMUM	85.0	2.9	4.1	7.3	1.5	0.5		
01	113.0	4.1	4.4	7.4	2.2			
02	163.0	5.9	4.3	7.4	2.1	0.7		
03	134.0	4.9	4.4	7.4	2.2	0.9		
04	139.0	5.0	4.3	7.4	1.9	1.0		
05	140.0	5.1	4.4	7.4	2.0	1.0		
06	134.0	5.0	4.5	7.4	2.2	1.1		
07	154.0	5.6	4.4	7.6	2.2			
08	158.0	5.7	4.3	7.6	1.8			
09	121.0	4.5	4.5	7.5	1.9	0.9		
10	144.0	5.3	4.4	7.5	1.8	0.9		
11	152.0	5.2	4.1	7.5	1.9	0.9		
12	140.0	5.1	4.4	7.5	1.8	0.9	1	
13	152.0	5.5	4.3	7.3	2.0	0.9		
14	85.0	2.9	4.1	7.3	1.7			
15	183.0	7.0	4.6	7.3	1.9			
16	148.0	5.5	4.5	7.3	1.8	0.8		
17	124.0	4.6	4.5	7.3	2.0	0.5		
18	149.0	5.5	4.4	7.3	1.9	0.5		
19	121.0	4.4	4.4	7.3	2.3	0.5		
20	173.0	6.5	4.5	7.6	2.0	0.8		
21	184.0	6.7	4.4	7.3	1.5			
22	154.0	5.7	4.4	7.3	2.4			
23	158.0	5.4	4.1	7.3	2.2	0.7		
24	162.0	5.9	4.4	7.3	2.3	0.8		
25	179.0	6.5	4.4	7.3	2.3	0.9		
26	164.0	5.9	4.3	7.3	2.4	0.9		
27	155.0	5.7	4.4	7.3	2.2	0.8		
28	166.0	6.1	4.4	7.3	1.9			
29	183.0	6.6	4.3	7.3	1.8			
30	155.0	5.7	4.4	7.3	1.9	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

MS ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONC. LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April 1997

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-6202

MAY MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE µg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	µg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	4378.0	162.5	133.5	223.7	64.0	19.6	1	
AVERAGE	145.9	5.4	4.5	7.5	2.1	0.9		
MAXIMUM	227.0	8.5	4.8	7.5	2.8	1.2		
MINIMUM	98.0	3.5	4.2	7.3	0.5	0.2		
01	135.0	5.0	4.4	7.4	2.5	1.0	1	
02	151.0	5.6	4.5	7.5	2.2	1.0		
03	163.0	6.0	4.4	7.5	2.2	1.1		
04	178.0	6.6	4.4	7.5	0.5	0.2		
05	143.0	5.3	4.4	7.5	2.8			
06	132.0	5.2	4.7	7.4	2.5			
07	148.0	5.4	4.4	7.4	2.4	1.0		
08	152.0	5.5	4.3	7.4	2.4	1.1		
09	155.0	5.7	4.4	7.4	2.4	1.0		
10	137.0	5.1	4.5	7.3	2.5	1.2		
11	123.0	4.6	4.5	7.3	2.3	1.0		
12	164.0	6.6	4.8	7.5	2.5			
13	176.0	6.5	4.4	7.5	2.3			
14	119.0	4.2	4.2	7.5	2.2	0.9		
15	131.0	4.9	4.5	7.5	2.1	0.9		
16	138.0	5.1	4.4	7.5	2.2	1.0		
17	185.0	6.8	4.4	7.5	2.1	0.9		
18	98.0	3.5	4.3	7.4	2.3	0.7		
19	227.0	8.5	4.5	7.4	2.0			
20	138.0	5.0	4.3	7.5	2.3			
21	168.0	6.2	4.4	7.5	2.1	0.6		
22	135.0	5.0	4.4	7.4	1.9	0.7		
23	132.0	4.9	4.5	7.4	2.0	0.9		
24	138.0	5.1	4.4	7.5	1.8	0.7		
25	143.0	5.3	4.4	7.5	1.9	0.6		
26	149.0	5.6	4.5	7.5	1.8			
27	137.0	5.0	4.4	7.5	1.9			
28	124.0	4.7	4.5	7.5	1.8	1.0		
29	120.0	4.4	4.4	7.5	2.0	1.0		
30	139.0	5.2	4.5	7.5	2.1	1.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: RONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: March 1997

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	4576.0	171.1	136.3	229.1	75.4	19.5	1	
AVERAGE	147.6	5.5	4.4	7.4	2.4	1.0		
MAXIMUM	214.0	7.9	4.9	7.5	3.0	1.4		
MINIMUM	97.0	3.7	1.7	7.3	1.8	0.7		
01	141.0	5.2	4.4	7.5	2.0			
02	175.0	6.1	4.2	7.4	1.8			
03	151.0	5.6	4.4	7.4	2.0	1.0		
04	123.0	5.0	4.9	7.4	3.0	1.2		
05	142.0	5.3	1.7	7.4	2.9	1.4		
06	123.0	4.6	4.5	7.4	2.5	0.9		
07	165.0	6.3	4.5	7.5	1.8	0.8		
08	152.0	5.6	4.4	7.4	2.5			
09	155.0	5.9	4.6	7.4	2.8			
10	166.0	6.1	4.4	7.4	2.6	0.8	1	
11	136.0	5.1	4.5	7.4	2.6	1.0		
12	174.0	6.5	4.5	7.4	2.5	1.0		
13	145.0	5.4	4.5	7.4	2.4	1.0		
14	123.0	4.6	4.5	7.4	3.0	1.1		
15	145.0	5.4	4.5	7.5	3.0			
16	170.0	6.3	4.5	7.5	2.5			
17	141.0	5.3	4.5	7.5	2.3	0.8		
18	152.0	5.6	4.4	7.5	2.1	0.7		
19	161.0	6.0	4.5	7.5	2.2	0.9		
20	154.0	5.8	4.5	7.4	2.0	0.8		
21	97.0	3.7	4.5	7.4	2.5	0.9		
22	157.0	5.9	4.5	7.3	2.1			
23	214.0	7.9	4.4	7.3	2.7			
24	136.0	4.9	4.4	7.3	2.5	1.0		
25	145.0	5.4	4.4	7.3	2.4	1.1		
26	122.0	4.8	4.7	7.3	2.3	1.0		
27	135.0	4.8	4.2	7.3	2.6	1.1		
28	137.0	5.1	4.5	7.3	2.5			
29	143.0	5.4	4.5	7.3	2.8			
30	158.0	6.4	4.9	7.3	2.3			
31	138.0	5.1	4.4	7.3	2.2	1.0		

WWS ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	3952.0	155.2	131.3	207.0	60.7	18.5	1	
AVERAGE	141.1	5.5	4.7	7.4	2.2	0.9		
MAXIMUM	183.0	12.3	8.1	7.5	3.0	2.0		
MINIMUM	95.0	4.0	4.3	7.3	1.0	0.2		
01	153.0	5.6	4.4	7.3	2.4			
02	166.0	6.1	4.4	7.3	2.4			
03	121.0	4.3	4.3	7.3	2.3	1.0	1	
04	131.0	4.8	4.4	7.4	2.7	1.2		
05	142.0	5.1	4.3	7.4	2.5	1.1		
06	109.0	4.0	4.4	7.4	2.4	1.3		
07	129.0	4.6	4.3	7.4	2.2	1.1		
08	163.0	5.9	4.3	7.5	2.5			
09	154.0	5.6	4.4	7.4	1.5			
10	141.0	5.1	4.3	7.5	1.6	0.3		
11	183.0	12.3	8.1	7.5	1.0	0.2		
12	122.0	5.7	5.6	7.3	2.8	2.0		
13	166.0	7.6	5.5	7.3	2.5	1.7		
14	95.0	4.3	5.4	7.4	2.7	0.3		
15	125.0	5.9	5.7	7.3	2.9			
16	163.0	6.0	4.4	7.3	3.0			
17	155.0	5.7	4.4	7.3	2.6	1.0		
18	151.0	5.5	4.4	7.3	2.3	1.0		
19	132.0	4.9	4.5	7.3	2.5	1.2		
20	138.0	5.1	4.4	7.3	2.3	1.2		
21	145.0	5.4	4.5	7.3	2.3	1.1		
22	135.0	5.0	4.4	7.5	2.3			
23	127.0	4.7	4.4	7.5	1.0			
24	143.0	5.2	4.4	7.5	1.5	0.5		
25	137.0	5.1	4.5	7.5	1.6	0.5		
26	138.0	5.0	4.3	7.5	1.6	0.6		
27	139.0	5.2	4.5	7.5	1.7	0.7		
28	149.0	5.5	4.4	7.5	1.6	0.5		

3 ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: POI E LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1997

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	4151.0	154.4	138.9	229.9	62.4	20.2	1	
AVERAGE	133.9	5.0	4.5	7.4	2.0	0.9		
MAXIMUM	216.0	9.7	5.8	7.5	2.6	1.4		
MINIMUM	29.0	1.4	4.1	7.3	1.0	0.3		
01	173.0	6.4	4.4	7.5	1.7			
02	161.0	5.9	4.4	7.5	1.9	0.8		
03	118.0	4.2	4.3	7.5	1.8	0.8		
04	155.0	5.7	4.4	7.5	1.9			
05	173.0	7.1	4.9	7.5	2.2			
06	133.0	4.8	4.3	7.5	2.3	1.3		
07	157.0	5.8	4.4	7.5	2.5	1.4		
08	129.0	4.8	4.5	7.5	2.6	0.9		
09	101.0	3.7	4.4	7.4	2.0	0.7		
10	162.0	6.1	4.5	7.4	2.2	1.2		
11	29.0	1.4	5.8	7.5	2.5			
12	91.0	3.5	4.6	7.4	1.8			
13	144.0	5.3	4.4	7.4	1.0	0.3	1	
14	121.0	4.4	4.4	7.4	2.0	0.8		
15	119.0	4.3	4.3	7.4	2.2	0.9		
16	134.0	4.9	4.4	7.4	2.1	1.0		
17	146.0	5.4	4.4	7.4	2.3	1.0		
18	93.0	3.8	4.9	7.4	2.0			
19	216.0	9.7	5.4	7.4	1.8			
20	124.0	4.4	4.3	7.3	2.2	0.9		
21	150.0	5.1	4.1	7.3	2.3	0.9		
22	137.0	4.9	4.3	7.3	2.2	1.0		
23	136.0	4.6	4.1	7.3	2.3	1.0		
24	113.0	4.1	4.4	7.3	2.1	1.0		
25	127.0	4.6	4.3	7.5	2.5			
26	157.0	5.7	4.4	7.5	1.5			
27	125.0	4.5	4.3	7.4	1.6	0.8		
28	127.0	4.7	4.4	7.4	1.7	0.8		
29	104.0	3.8	4.4	7.4	1.9	1.0		
30	139.0	5.1	4.4	7.3	1.5	0.8		
31	157.0	5.7	4.4	7.4	1.8	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2551325 C.U.P. NO. 2-109-011-0

NAME OF DRINKING WATER SYSTEM: DONALD DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:



C.O. CERT.NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS	
MONTHLY TOTAL	11.0	1.1	43.7	230.3	38.8	10.2	1
AVERAGE	0.4	0.0	10.9	7.4	1.3	0.5	
MAXIMUM	7.0	0.8	13.7	7.6	2.0	1.1	
MINIMUM	0.0	0.0	6.0	7.3	0.5	0.3	
01	1.0	0.1	12.0	7.3	2.0	0.8	
02	0.0	0.0		7.4	1.8	0.6	
03	7.0	0.8	13.7	7.4	1.8	0.7	
04	0.0	0.0		7.4	1.5	0.5	
05	0.0	0.0		7.4	1.2	0.4	
06	0.0	0.0		7.4	1.3		
07	0.0	0.0		7.4	0.6		
08	0.0	0.0		7.4	1.6	0.4	1
09	2.0	0.1	6.0	7.4	1.5	0.4	
10	0.0	0.0		7.4	1.5	0.5	
11	0.0	0.0		7.4	1.4	0.5	
12	0.0	0.0		7.4	1.4	0.4	
13	0.0	0.0		7.4	1.3		
14	0.0	0.0		7.4	1.4		
15	0.0	0.0		7.4	1.3	0.4	
16	0.0	0.0		7.4	1.2	0.4	
17	0.0	0.0		7.4	1.4	0.4	
18	1.0	0.1	12.0	7.4	1.5	1.1	
19	0.0	0.0		7.4	1.6	0.9	
20	0.0	0.0		7.4	0.5		
21	0.0	0.0		7.6	0.5		
22	0.0	0.0		7.6	0.8	0.3	
23	0.0	0.0		7.5	1.0	0.3	
24	0.0	0.0		7.5	0.8	0.3	
25	0.0	0.0		7.5	1.0		
26	0.0	0.0		7.5	1.0		
27	0.0	0.0		7.5	1.1		
28	0.0	0.0		7.5	1.1		
29	0.0	0.0		7.4	1.2	0.3	
30	0.0	0.0		7.4	1.3	0.3	
31	0.0	0.0		7.4	1.2	0.3	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT: *Ray C. Adams*, C.O. CERT.NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	45.0	4.7	206.9	7.4	56.4	10.3	1	
AVERAGE	1.5	0.2	34.5	7.4	1.9	0.6		
MAXIMUM	35.0	2.0	120.0	7.5	3.0	0.9		
MINIMUM	0.0	0.0	6.9	7.3	0.7	0.4		
01	0.0	0.0		7.5	1.2			
02	0.0	0.0		7.5	1.8			
03	0.0	0.0		7.5	3.0	0.5		
04	0.0	0.0		7.5	3.0	0.9	1	
05	0.0	0.0		7.5	2.9	0.9		
06	0.0	0.0		7.4	1.9	0.7		
07	35.0	2.0	6.9	7.4	1.9	0.6		
08	0.0	0.0		7.4	3.0			
09	0.0	0.0		7.3	2.0			
10	0.0	0.0		7.3	2.1	0.5		
11	1.0	1.0	120.0	7.3	1.7	0.5		
12	0.0	0.0		7.3	1.5	0.4		
13	0.0	0.0		7.3	1.6	0.5		
14	0.0	0.0		7.3	1.5	0.5		
15	0.0	0.0		7.5	1.8			
16	0.0	0.0		7.5	1.8			
17	0.0	0.0		7.5	1.6	0.5		
18	2.0	0.2	12.0	7.5	1.5	0.4		
19	0.0	0.0		7.5	1.9	0.4		
20	0.0	0.0		7.4	0.7	0.7		
21	0.0	0.0		7.4	1.1	0.6		
22	0.0	0.0		7.3	2.0			
23	0.0	0.0		7.4	3.0			
24	1.0	0.1	12.0	7.4	1.7	0.5		
25	3.0	0.8	32.0	7.4	1.8	0.5		
26	3.0	0.6	24.0	7.4	1.9	0.7		
27	0.0	0.0		7.4	2.0			
28	0.0	0.0		7.4	1.3			
29	0.0	0.0		7.4	1.8			
30	0.0	0.0		7.4	1.4			

WATER ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:



C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	57.0	9.6	75.1	230.2	44.5	9.3	1	
AVERAGE	1.8	1.6	12.5	7.4	1.4	0.4		
MAXIMUM	43.0	8.5	23.7	7.6	3.0	0.7		
MINIMUM	0.0	0.1	6.0	7.3	0.8	0.3		
01	9.0	0.7	9.3	7.5	1.3	0.3	1	
02	2.0	0.1	6.0	7.5	1.9	0.5		
03	0.0			7.5	1.6	0.5		
04	0.0			7.5	1.4			
05	0.0			7.5	0.8			
06	0.0			7.5	1.0	0.3		
07	0.0			7.5	1.1	0.3		
08	0.0			7.5	1.3	0.4		
09	1.0	0.1	12.0	7.4	1.2	0.4		
10	0.0			7.4	1.2	0.3		
11	0.0			7.4	1.0			
12	1.0	0.1	12.0	7.4	1.1			
13	0.0			7.4	1.3	0.4		
14	1.0	0.1	12.0	7.4	1.2	0.4		
15	0.0			7.4	1.1	0.4		
16	0.0			7.4	1.3	0.4		
17	0.0			7.4	1.0	0.3		
18	0.0			7.3	1.0			
19	0.0			7.3	1.5			
20	0.0			7.3	1.2	0.3		
21	0.0			7.3	1.3	0.3		
22	0.0			7.3	1.2	0.3		
23	0.0			7.3	1.3	0.3		
24	0.0			7.3	1.2	0.3		
25	0.0			7.3	3.0			
26	0.0			7.6	3.0			
27	0.0			7.6	2.5	0.7		
28	0.0			7.5	2.0	0.6		
29	0.0			7.5	1.5	0.5		
30	43.0	8.5	23.7	7.5	1.2	0.5		
31	0.0			7.5	1.8	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT: *[Signature]*, C.O. CERT.NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	15.0	2.0	97.5	223.7	31.3	6.4	1	
AVERAGE	0.5	0.1	16.3	7.5	1.0	0.3		
MAXIMUM	8.0	0.9	30.0	7.5	1.3	0.8		
MINIMUM	0.0	0.0	12.0	7.4	0.5	0.2		
01	0.0	0.0		7.5	1.2			
02	0.0	0.0		7.5	1.3	0.3		
03	0.0	0.0		7.5	1.1	0.2		
04	0.0	0.0		7.5	1.2	0.2		
05	0.0	0.0		7.5	1.2	0.3		
06	0.0	0.0		7.5	0.5			
07	0.0	0.0		7.5	0.5			
08	0.0	0.0		7.5	0.6	0.2		
09	0.0	0.0		7.5	0.9	0.3		
10	0.0	0.0		7.5	1.0	0.3	1	
11	0.0	0.0		7.5	1.1	0.3		
12	0.0	0.0		7.5	0.9	0.2		
13	2.0	0.3	18.0	7.5	0.6			
14	2.0	0.5	30.0	7.4	1.2			
15	1.0	0.1	12.0	7.4	1.1	0.2		
16	8.0	0.9	13.5	7.4	1.0	0.2		
17	1.0	0.1	12.0	7.4	1.3	0.2		
18	0.0	0.0		7.4	1.0	0.2		
19	0.0	0.0		7.4	1.0	0.2		
20	0.0	0.0		7.4	1.1			
21	0.0	0.0		7.4	1.1			
22	0.0	0.0		7.4	1.2	0.4		
23	1.0	0.1	12.0	7.4	1.0	0.8		
24	0.0	0.0		7.4	1.3	0.6		
25	0.0	0.0		7.4	1.1	0.4		
26	0.0	0.0		7.4	1.0	0.2		
27	0.0	0.0		7.5	1.3			
28	0.0	0.0		7.5	1.1			
29	0.0	0.0		7.5	1.2	0.4		
30	0.0	0.0		7.5	1.2	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WTS ID NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT NO. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997


OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/L	PLANT EFFLUENT TAP	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS	COMMENTS
MONTHLY TOTAL	23.0	4.2	229.3	38.7	9.4	9.4	1		
AVERAGE	0.7	0.1	7.4	1.2	0.4	0.4			
MAXIMUM	18.0	3.7	7.5	1.9	0.7	0.7			
MINIMUM	0.0	0.0	7.3	0.5	0.3	0.3			
01	0.0	0.0	7.5	1.0	0.3	0.3			
02	1.0	0.1	7.5	0.5					
03	0.0	0.0	7.5	0.5					
04	1.0	0.1	7.4	1.0	0.6	0.6	1		
05	0.0	0.0	7.4	1.1	0.5	0.5			
06	0.0	0.0	7.4	1.3	0.5	0.5			
07	0.0	0.0	7.4	1.0	0.4	0.4			
08	0.0	0.0	7.4	1.1	0.7	0.7			
09	0.0	0.0	7.4	1.2					
10	0.0	0.0	7.4	1.1					
11	0.0	0.0	7.4	1.1	0.3	0.3			
12	0.0	0.0	7.4	0.9	0.3	0.3			
13	0.0	0.0	7.5	0.9	0.3	0.3			
14	0.0	0.0	7.4	1.0	0.5	0.5			
15	1.0	0.1	7.4	1.2	0.5	0.5			
16	1.0	0.1	7.3	1.3					
17	18.0	3.7	7.3	1.8					
18	1.0	0.1	7.3	1.9	0.5	0.5			
19	0.0	0.0	7.3	1.8	0.5	0.5			
20	0.0	0.0	7.3	1.5	0.6	0.6			
21	0.0	0.0	7.3	1.6	0.6	0.6			
22	0.0	0.0	7.3	1.3	0.5	0.5			
23	0.0	0.0	7.3	1.3					
24	0.0	0.0	7.4	1.5					
25	0.0	0.0	7.4	1.4	0.4	0.4			
26	0.0	0.0	7.4	1.5	0.4	0.4			
27	0.0	0.0	7.4	1.4	0.4	0.4			
28	0.0	0.0	7.5	1.3	0.3	0.3			
29	0.0	0.0	7.5	1.4	0.3	0.3			
30	0.0	0.0	7.4	1.6					
31	0.0	0.0	7.5	1.2					

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT: *[Signature]* C.O. CERT.NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	51.0	3.4	260.0	230.9	37.5	9.6	1	
AVERAGE	1.6	0.1	9.3	7.4	1.2	0.4		
MAXIMUM	7.0	0.4	24.0	7.6	1.8	0.7		
MINIMUM	0.0	0.0	0.0	7.3	0.5	0.2		
01	0.0	0.0		7.4	1.3	0.4		
02	2.0	0.1	6.0	7.6	1.8	0.5	1	
03	2.0	0.1	6.0	7.5	1.5	0.7		
04	7.0	0.3	5.1	7.4	1.2			
05	2.0	0.1	6.0	7.4	1.5			
06	1.0	0.1	12.0	7.4	1.6			
07	1.0	0.1	12.0	7.4	1.5	0.5		
08	0.0	0.1		7.4	1.3	0.6		
09	2.0	0.0	0.0	7.5	0.5	0.2		
10	0.0	0.1		7.5	0.5	0.2		
11	1.0	0.0	0.0	7.5	0.5	0.2		
12	3.0	0.1	4.0	7.5	0.5			
13	1.0	0.2	24.0	7.6	1.7			
14	1.0	0.1	12.0	7.5	1.5	0.6		
15	1.0	0.1	12.0	7.5	1.6	0.6		
16	1.0	0.1	12.0	7.5	1.4	0.5		
17	1.0	0.1	12.0	7.5	1.5	0.6		
18	1.0	0.1	12.0	7.5	1.5	0.5		
19	1.0	0.1	12.0	7.4	1.1			
20	1.0	0.1	12.0	7.4	0.9			
21	1.0	0.1	12.0	7.4	1.0	0.4		
22	1.0	0.1	12.0	7.4	1.1	0.4		
23	1.0	0.1	12.0	7.4	1.4	0.5		
24	2.0	0.1	6.0	7.4	1.2	0.5		
25	2.0	0.1	6.0	7.4	1.3	0.5		
26	2.0	0.1	6.0	7.3	1.1			
27	1.0	0.1	12.0	7.4	0.9			
28	1.0	0.1	12.0	7.4	1.3	0.4		
29	1.0	0.1	12.0	7.4	1.3	0.3		
30	7.0	0.4	6.9	7.5	0.9	0.2		
31	3.0	0.1	4.0	7.5	1.1	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: June 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.O. CERT.NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	14.0	-1.3	61.0	222.9	32.9	8.1	1	
AVERAGE	0.5	0.0	10.2	7.4	1.1	0.4		
MAXIMUM	4.0	0.5	16.0	7.6	1.5	0.5		
MINIMUM	0.0	0.0	6.0	7.3	0.5	0.2		
01	0.0	0.0		7.3	1.1			
02	0.0	0.0		7.3	1.2	0.3		
03	0.0	0.0		7.3	1.3	0.3		
04	0.0	0.0		7.3	1.2	0.4		
05	0.0	0.0		7.3	1.4	0.4		
06	0.0	0.0		7.3	1.5	0.4		
07	0.0	0.0		7.3	0.5			
08	0.0	0.0		7.6	0.5			
09	0.0	0.0		7.6	0.7	0.4		
10	0.0	0.0		7.6	0.6	0.4		
11	0.0	0.0		7.6	0.7	0.3		
12	0.0	0.0		7.6	0.9	0.3	1	
13	0.0	0.0		7.6	1.0	0.3		
14	0.0	0.0		7.5	1.0			
15	0.0	0.0		7.5	1.2			
16	0.0	0.0		7.4	1.1	0.3		
17	3.0	0.4	16.0	7.4	1.0	0.5		
18	4.0	0.5	15.0	7.4	1.4	0.5		
19	0.0	0.0		7.4	1.2	0.5		
20	0.0	0.0		7.3	0.8	0.2		
21	2.0	0.1	6.0	7.6	0.8			
22	0.0	0.0		7.5	1.3			
23	0.0	0.0		7.4	1.2	0.4		
24	0.0	0.0		7.4	1.2	0.4		
25	2.0	0.1	6.0	7.4	1.4	0.5		
26	2.0	0.1	6.0	7.4	1.3	0.4		
27	0.0	0.0		7.4	1.4	0.4		
28	0.0	0.0		7.4	1.3			
29	1.0	0.1	12.0	7.4	1.3			
30	0.0	0.0		7.4	1.4	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WWS ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: May 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:



C.D. CERT.NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	104.0	-- 8.6	318.0	231.1	31.9	10.2	1	
AVERAGE	3.4	0.3	10.3	7.5	1.0	0.5		
MAXIMUM	5.0	0.5	18.0	7.6	1.8	0.8		
MINIMUM	1.0	0.1	6.0	7.3	0.5	0.3		
01	1.0	0.1	12.0	7.5	1.7	0.8		
02	2.0	0.2	12.0	7.5	1.3	0.4		
03	4.0	0.3	9.0	7.3	0.6			
04	4.0	0.3	9.0	7.5	0.5	0.4		
05	1.0	0.1	12.0	7.4	0.9	0.6		
06	4.0	0.3	9.0	7.6	0.8	0.4		
07	3.0	0.3	12.0	7.5	1.0	0.5	1	
08	4.0	0.3	9.0	7.5	1.2	0.4		
09	5.0	0.4	9.6	7.5	1.1			
10	4.0	0.3	9.0	7.5	0.5			
11	1.0	0.1	12.0	7.5	0.5	0.5		
12	3.0	0.3	12.0	7.5	1.0	0.6		
13	4.0	0.3	9.0	7.5	1.1	0.5		
14	4.0	0.3	9.0	7.5	1.1	0.5		
15	5.0	0.4	9.6	7.5	1.2	0.4		
16	3.0	0.3	12.0	7.5	0.9			
17	4.0	0.3	9.0	7.4	1.0			
18	3.0	0.3	12.0	7.5	0.6	0.4		
19	4.0	0.4	12.0	7.5	1.0	0.4		
20	5.0	0.3	7.2	7.5	1.1	0.4		
21	5.0	0.4	9.6	7.5	1.0	0.5		
22	2.0	0.1	6.0	7.5	1.2	0.3		
23	1.0	0.1	12.0	7.4	1.0			
24	4.0	0.3	9.0	7.4	1.0			
25	2.0	0.1	6.0	7.4	0.6			
26	4.0	0.3	9.0	7.3	1.1	0.6		
27	2.0	0.3	18.0	7.4	0.9	0.7		
28	5.0	0.5	12.0	7.4	1.8	0.5		
29	3.0	0.3	12.0	7.4	1.6	0.4		
30	4.0	0.3	9.0	7.4	1.2			
31	4.0	0.3	9.0	7.3	1.4			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: POND LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

INFLUENT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.O. CERT. NO. C-6202

MYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	1.0	0.1	12.0	224.1	32.7	8.3	1	
AVERAGE	0.0	0.0	12.0	7.5	1.1	0.4		
MAXIMUM	1.0	0.1	12.0	7.6	1.4	0.6		
MINIMUM	0.0	0.0	12.0	7.4	0.5	0.2		
01	1.0	0.1	12.0	7.4	1.4	0.6	1	
02	0.0	0.0		7.4	1.4	0.5		
03	0.0	0.0		7.5	0.5	0.2		
04	0.0	0.0		7.5	0.8	0.3		
05	0.0	0.0		7.4	0.9			
06	0.0	0.0		7.4	0.6			
07	0.0	0.0		7.4	0.9	0.3		
08	0.0	0.0		7.4	1.0	0.3		
09	0.0	0.0		7.4	1.1	0.3		
10	0.0	0.0		7.4	1.2	0.4		
11	0.0	0.0		7.5	1.0	0.5		
12	0.0	0.0		7.5	1.4			
13	0.0	0.0		7.5	0.8			
14	0.0	0.0		7.5	1.0	0.2		
15	0.0	0.0		7.5	1.1	0.2		
16	0.0	0.0		7.4	1.3	0.3		
17	0.0	0.0		7.4	1.2	0.4		
18	0.0	0.0		7.4	1.1	0.5		
19	0.0	0.0		7.5	1.2			
20	0.0	0.0		7.5	1.0			
21	0.0	0.0		7.5	1.0	0.5		
22	0.0	0.0		7.5	1.2	0.5		
23	0.0	0.0		7.6	1.2	0.5		
24	0.0	0.0		7.6	1.0	0.4		
25	0.0	0.0		7.5	1.1	0.5		
26	0.0	0.0		7.5	1.3			
27	0.0	0.0		7.5	1.1			
28	0.0	0.0		7.5	1.4	0.3		
29	0.0	0.0		7.5	1.2	0.3		
30	0.0	0.0		7.5	1.3	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2551325 C.U.P. NO. 2-109-011-DU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: March 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DIRECTION OF FLOW: _____

CERTIFY THIS REPORT IS CORRECT:

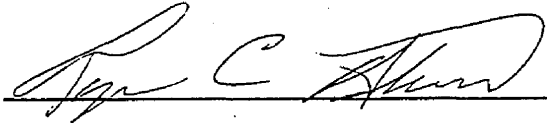

C.D. CERT. NO. C-6202

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	6.0	0.4	40.0	229.2	39.4	10.2	1	
AVERAGE	0.2	0.0	10.0	7.4	1.3	0.5		
MAXIMUM	3.0	0.1	12.0	7.5	1.7	0.9		
MINIMUM	0.0	0.0	4.0	7.3	0.8	0.4		
01	0.0	0.0		7.4	1.3			
02	0.0	0.0		7.4	1.2			
03	0.0	0.0		7.4	1.7	0.6		
04	3.0	0.1	4.0	7.4	1.4	0.5		
05	0.0	0.0		7.4	1.3	0.5		
06	0.0	0.0		7.4	1.1	0.8		
07	0.0	0.0		7.4	1.3	0.9		
08	0.0	0.0		7.4	1.0			
09	0.0	0.0		7.4	1.2			
10	0.0	0.0		7.4	1.1	0.4	1	
11	0.0	0.0		7.4	1.3	0.5		
12	0.0	0.0		7.4	1.2	0.5		
13	0.0	0.0		7.4	1.4	0.5		
14	0.0	0.0		7.4	1.1	0.4		
15	0.0	0.0		7.5	1.0			
16	0.0	0.0		7.5	1.2			
17	0.0	0.0		7.4	1.3	0.4		
18	0.0	0.0		7.4	1.4	0.4		
19	0.0	0.0		7.4	1.3	0.5		
20	1.0	0.1	12.0	7.4	1.5	0.6		
21	1.0	0.1	12.0	7.4	1.2	0.7		
22	0.0	0.0		7.4	1.0			
23	1.0	0.1	12.0	7.4	1.5			
24	0.0	0.0		7.4	1.5	0.4		
25	0.0	0.0		7.4	1.4	0.4		
26	0.0	0.0		7.4	1.3	0.4		
27	0.0	0.0		7.4	1.4	0.4		
28	0.0	0.0		7.3	1.5			
29	0.0	0.0		7.3	1.5			
30	0.0	0.0		7.3	0.8			
31	0.0	0.0		7.3	1.0	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

By: United Water Florida Inc.

REPORTING MONTH: February 1997

ISSUED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT: 

C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/L	PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
---------------	---	-----------------------------	-------------	------------------------	----------------	------------	-------------------------	---

MONTHLY TOTAL	11.0	0.6	51.0	206.8	34.5	8.2	1	
---------------	------	-----	------	-------	------	-----	---	--

AVERAGE	0.4	0.0	8.5	7.4	1.2	0.4		
---------	-----	-----	-----	-----	-----	-----	--	--

MAXIMUM	4.0	0.1	12.0	7.4	1.7	0.7		
---------	-----	-----	------	-----	-----	-----	--	--

MINIMUM	0.0	0.0	3.0	7.3	1.0	0.2		
---------	-----	-----	-----	-----	-----	-----	--	--

01	0.0	0.0		7.3	1.7			
02	0.0	0.0		7.4	1.6			
03	2.0	0.1	6.0	7.4	1.5	0.6	1	
04	1.0	0.1	12.0	7.4	1.6	0.7		
05	0.0	0.0		7.4	1.5	0.7		
06	0.0	0.0		7.4	1.5	0.5		
07	0.0	0.0		7.4	1.2	0.5		
08	0.0	0.0		7.4	1.1			
09	1.0	0.1	12.0	7.4	1.3			
10	0.0	0.0		7.4	1.5	0.6		
11	0.0	0.0		7.3	1.0	0.3		
12	0.0	0.0		7.3	1.1	0.4		
13	0.0	0.0		7.3	1.2	0.3		
14	0.0	0.0		7.4	1.0	0.3		
15	0.0	0.0		7.4	1.0			
16	0.0	0.0		7.4	1.1			
17	0.0	0.0		7.4	1.2			
18	0.0	0.0		7.4	1.0	0.3		
19	0.0	0.0		7.4	1.2	0.3		
20	0.0	0.0		7.4	1.1	0.2		
21	0.0	0.0		7.4	1.0	0.3		
22	4.0	0.1	3.0	7.4	1.1			
23	0.0	0.0		7.4	1.0			
24	0.0	0.0		7.4	1.1	0.5		
25	0.0	0.0		7.4	1.0	0.5		
26	1.0	0.1	12.0	7.4	1.2	0.4		
27	2.0	0.1	6.0	7.4	1.3	0.4		
28	0.0	0.0		7.4	1.4	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PLYMOUTH LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DIRECTION OF FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:



C.D. CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY	96.0	5.9	164.0	229.5	44.3	14.6	1	
AVERAGE	7.4	0.5	12.6	7.4	1.4	0.7		
MAXIMUM	51.0	2.4	42.0	7.5	3.0	1.2		
MINIMUM	1.0	0.1	5.6	7.3	0.5	0.3		
01				7.5	1.2			
02				7.5	1.3	0.6		
03				7.5	1.2	0.5		
04				7.5	1.0			
05				7.5	1.4			
06				7.5	1.3	0.8		
07	2.0	0.2	12.0	7.5	1.1	0.6		
08	1.0	0.1	12.0	7.4	2.2	0.8		
09	2.0	0.3	18.0	7.3	2.0	0.6		
10	2.0	0.7	42.0	7.3	1.4	0.8		
11	51.0	2.4	5.6	7.5	2.3			
12	23.0	1.1	5.7	7.4	1.6			
13	2.0	0.1	6.0	7.4	1.7	0.4	1	
14				7.4	1.6	0.4		
15				7.4	1.4	0.3		
16				7.4	1.5	0.4		
17				7.4	1.4	0.4		
18	7.0	0.5	8.6	7.4	1.0			
19	1.0	0.1	12.0	7.3	1.8			
20	1.0	0.1	12.0	7.3	1.6	0.9		
21				7.3	3.0	1.2		
22	1.0	0.1	12.0	7.3	2.4	1.0		
23				7.3	1.8	1.0		
24				7.3	1.5	0.8		
25				7.5	0.5			
26				7.5	0.5			
27				7.4	0.8	0.4		
28				7.4	0.9	0.5		
29				7.4	1.0	0.5		
30	2.0	0.1	6.0	7.4	0.9	0.6		
31	1.0	0.1	12.0	7.3	1.0	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT NO. 2551325 C.U.P. NO. 2-109-011-

NAME OF DRINKING WATER SYSTEM PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.3 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
<hr/>								
MONTHLY TOTAL	274.0	11.2	149.7	227.2	55.0	13.9	1	
AVERAGE	8.8	0.4	5.3	7.3	1.8	0.7		
MAXIMUM	34.0	1.3	12.0	7.5	3.2	1.1		
MINIMUM	0.0	0.0	3.0	7.2	1.0	0.3		
<hr/>								
01	20.0	0.8	4.8	7.3	2.2	0.8		
02	15.0	0.6	4.8	7.3	2.3	0.7		
03	25.0	0.9	4.3	7.3	1.8	0.9		
04	12.0	0.5	5.0	7.3	1.9	0.8		
05	34.0	1.3	4.6	7.3	1.6	0.6		
06	13.0	0.7	6.5	7.3	1.6			
07	14.0	0.5	4.3	7.2	3.2			
08	20.0	0.9	5.4	7.2	2.8	0.9	1	
09	17.0	0.5	3.5	7.2	2.5	0.7		
10	7.0	0.4	6.9	7.2	2.2	0.6		
11	7.0	0.2	3.4	7.2	2.2	0.7		
12	4.0	0.3	9.0	7.2	1.4	0.5		
13	7.0	0.2	3.4	7.2	1.6			
14	3.0	0.1	4.0	7.2	1.4			
15	13.0	0.5	4.6	7.2	1.2	0.4		
16	4.0	0.3	9.0	7.3	1.0	0.3		
17	8.0	0.3	4.5	7.3	1.3	0.4		
18	3.0	0.2	8.0	7.4	1.5	1.1		
19	11.0	0.5	5.5	7.4	1.7	0.9		
20	4.0	0.1	3.0	7.4	2.4			
21	5.0	0.2	4.8	7.5	1.9			
22	3.0	0.1	4.0	7.5	2.0	0.7		
23	4.0	0.2	6.0	7.5	1.8	0.7		
24	4.0	0.2	6.0	7.5	1.6	0.7		
25	0.0	0.0		7.4	1.5			
26	0.0	0.0		7.4	1.2			
27	0.0	0.0		7.4	1.2			
28	2.0	0.2	12.0	7.4	1.3			
29	4.0	0.2	6.0	7.4	1.6	0.5		
30	7.0	0.2	3.4	7.4	1.5	0.5		
31	4.0	0.1	3.0	7.4	1.6	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PNS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.3 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT: *[Signature]*, C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	605.0	25.8	155.0	219.9	60.0	9.7	1	
AVERAGE	20.2	0.9	5.2	7.3	2.0	0.5		
MAXIMUM	31.0	1.6	8.7	7.4	3.0	0.7		
MINIMUM	11.0	0.5	4.4	7.3	1.0	0.2		
01	22.0	1.6	8.7	7.4	2.0			
02	13.0	0.7	6.5	7.4	2.3			
03	22.0	0.8	4.4	7.3	1.2	0.6		
04	15.0	0.6	4.8	7.3	1.4	0.5	1	
05	25.0	1.0	4.8	7.3	1.3	0.5		
06	12.0	0.5	5.0	7.3	2.0	0.5		
07	23.0	0.9	4.7	7.3	1.7	0.6		
08	15.0	0.7	5.6	7.3	2.6			
09	22.0	0.8	4.4	7.3	3.0			
10	29.0	1.1	4.6	7.3	2.4	0.6		
11	22.0	1.0	5.5	7.3	2.2	0.6		
12	16.0	0.7	5.2	7.3	2.3	0.6		
13	19.0	0.7	4.4	7.3	2.1	0.5		
14	13.0	0.6	5.5	7.3	2.0	0.5		
15	21.0	0.8	4.6	7.4	3.0			
16	13.0	0.6	5.5	7.4	1.7			
17	17.0	0.8	5.6	7.4	1.0	0.2		
18	31.0	1.2	4.6	7.4	2.4	0.3		
19	23.0	1.0	5.2	7.4	2.2	0.5		
20	13.0	0.5	4.6	7.4	1.8	0.7		
21	26.0	1.0	4.6	7.4	1.9	0.6		
22	11.0	0.5	5.5	7.3	2.0			
23	22.0	1.0	5.5	7.3	3.0			
24	22.0	0.9	4.9	7.3	1.1	0.5		
25	19.0	0.8	5.1	7.3	1.8	0.7		
26	20.0	0.9	5.4	7.3	2.3	0.7		
27	28.0	1.2	5.1	7.3	1.7			
28	25.0	1.0	4.8	7.3	1.8			
29	25.0	1.0	4.8	7.3	2.1			
30	21.0	0.9	5.1	7.3	1.7			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: JOSE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
<hr/>								
MONTHLY TOTAL	712.0	32.8	177.4	229.2	58.4	13.4	1	
AVERAGE	23.0	1.1	5.7	7.4	1.9	0.6		
MAXIMUM	58.0	2.6	9.0	7.6	3.0	0.8		
MINIMUM	8.0	0.4	2.6	7.3	0.7	0.4		
<hr/>								
01	24.0	1.2	6.0	7.5	1.4	0.5	1	
02	29.0	1.4	5.8	7.5	1.8	0.6		
03	29.0	1.7	7.0	7.5	1.7	0.5		
04	30.0	1.4	5.6	7.4	1.6			
05	52.0	2.6	6.0	7.4	1.3			
06	25.0	1.3	6.2	7.4	1.5	0.5		
07	23.0	1.2	6.3	7.4	1.7	0.6		
08	42.0	2.0	5.7	7.4	2.4	0.6		
09	11.0	0.7	7.6	7.4	2.2	0.8		
10	31.0	1.5	5.8	7.4	2.0	0.6		
11	22.0	1.1	6.0	7.4	1.6			
12	26.0	1.2	5.5	7.4	1.9			
13	9.0	0.6	8.0	7.4	2.3	0.6		
14	34.0	1.7	6.0	7.4	1.8	0.5		
15	12.0	0.6	6.0	7.4	1.9	0.5		
16	15.0	0.9	7.2	7.4	1.7	0.5		
17	11.0	0.5	5.5	7.3	1.8	0.8		
18	11.0	0.4	4.4	7.3	2.5			
19	8.0	0.6	9.0	7.3	2.9			
20	27.0	1.0	4.4	7.3	2.3	0.5		
21	13.0	0.6	5.5	7.3	1.8	0.5		
22	30.0	1.1	4.4	7.3	1.4	0.4		
23	8.0	0.4	6.0	7.3	1.3	0.4		
24	24.0	1.0	5.0	7.3	1.5	0.5		
25	13.0	0.5	4.6	7.6	0.7			
26	19.0	0.8	5.1	7.6	3.0			
27	18.0	0.7	4.7	7.4	2.3	0.8		
28	18.0	0.7	4.7	7.4	2.0	0.6		
29	8.0	0.4	6.0	7.4	2.0	0.7		
30	58.0	2.3	4.8	7.4	2.1	0.8		
31	32.0	0.7	2.6	7.3	2.0	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1997


OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	764.0	39.1	191.4	223.8	50.8	9.5	1	
AVERAGE	25.5	1.3	6.4	7.5	1.7	0.5		
MAXIMUM	50.0	2.3	13.5	7.5	3.0	0.7		
MINIMUM	10.0	0.5	3.7	7.4	1.0	0.2		
01	21.0	0.9	5.1	7.5	1.9			
02	10.0	0.6	7.2	7.4	1.7	0.3		
03	13.0	0.6	5.5	7.4	1.0	0.2		
04	16.0	1.8	13.5	7.4	1.1	0.2		
05	29.0	0.9	3.7	7.4	1.3	0.3		
06	27.0	1.5	6.7	7.4	1.5			
07	40.0	2.0	6.0	7.5	1.2			
08	21.0	1.1	6.3	7.5	1.2	0.4		
09	35.0	1.7	5.8	7.5	2.0	0.6		
10	27.0	1.4	6.2	7.5	1.7	0.6	1	
11	17.0	0.9	6.4	7.5	1.6	0.6		
12	15.0	0.9	7.2	7.5	1.8	0.6		
13	37.0	1.8	5.8	7.5	1.5			
14	50.0	1.8	4.3	7.4	2.1			
15	24.0	1.2	6.0	7.5	2.0	0.4		
16	32.0	1.7	6.4	7.5	2.1	0.4		
17	31.0	1.6	6.2	7.5	1.8	0.4		
18	33.0	1.7	6.2	7.5	1.9	0.5		
19	46.0	2.3	6.0	7.5	1.2	0.5		
20	41.0	2.0	5.9	7.4	1.5			
21	40.0	2.1	6.3	7.5	2.6			
22	22.0	1.1	6.0	7.4	1.7	0.4		
23	25.0	1.2	5.8	7.4	1.9	0.7		
24	15.0	0.8	6.4	7.4	1.8	0.5		
25	12.0	0.5	5.0	7.4	1.8	0.6		
26	22.0	1.3	7.1	7.4	1.3	0.3		
27	13.0	0.6	5.5	7.5	3.0			
28	25.0	1.4	6.7	7.5	1.7			
29	12.0	0.6	6.0	7.5	1.4	0.5		
	13.0	1.1	10.2	7.5	1.5	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	862.0	41.1	177.9	228.2	57.3	10.1	1	
AVERAGE	27.8	1.3	5.7	7.4	1.8	0.5		
MAXIMUM	52.0	2.5	6.7	7.5	3.0	0.8		
MINIMUM	9.0	0.5	4.3	7.3	1.2	0.3		
01	14.0	0.6	5.1	7.5	1.7	0.5		
02	28.0	1.4	6.0	7.4	3.0			
03	33.0	1.6	5.8	7.5	2.7			
04	18.0	0.9	6.0	7.4	2.0	0.6	1	
05	35.0	1.7	5.8	7.4	1.9	0.7		
06	29.0	1.4	5.8	7.4	1.5	0.5		
07	25.0	1.3	6.2	7.4	1.6	0.4		
08	27.0	1.3	5.8	7.4	2.1	0.8		
09	35.0	1.6	5.5	7.4	1.8			
10	33.0	1.7	6.2	7.4	1.9			
11	40.0	2.0	6.0	7.4	1.7	0.6		
12	46.0	2.2	5.7	7.4	1.8	0.3		
13	25.0	1.3	6.2	7.4	1.7	0.4		
14	33.0	1.5	5.5	7.4	1.6	0.5		
15	11.0	0.6	6.5	7.4	2.1	0.7		
16	36.0	1.3	4.3	7.3	1.3			
17	34.0	1.6	5.6	7.3	1.8			
18	18.0	0.8	5.3	7.3	1.5	0.4		
19	9.0	0.5	6.7	7.3	1.5	0.4		
20	9.0	0.5	6.7	7.3	1.4	0.3		
21	16.0	0.6	4.5	7.3	1.4	0.3		
22	23.0	1.0	5.2	7.4	3.0	0.7		
23	41.0	1.8	5.3	7.3	2.5			
24	12.0	0.5	5.0	7.3	2.2			
25	28.0	1.2	5.1	7.3	2.0	0.4		
26	22.0	1.0	5.5	7.3	2.1	0.5		
27	24.0	1.1	5.5	7.3	1.6	0.4		
28	52.0	2.5	5.8	7.3	1.2	0.3		
29	34.0	1.8	6.4	7.3	1.4	0.4		
30	29.0	1.6	6.6	7.4	1.5			
31	43.0	2.2	6.1	7.3	1.8			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:  , C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	1266.0	58.9	173.7	7.4	45.6	13.4	1	
AVERAGE	40.8	1.9	5.6	7.4	1.5	0.6		
MAXIMUM	92.0	4.7	7.8	7.5	2.0	1.0		
MINIMUM	14.0	0.6	4.6	7.3	0.6	0.3		
01	22.0	1.0	5.5	7.4	1.1	0.4		
02	35.0	1.7	5.8	7.4	1.8	0.7	1	
03	41.0	1.9	5.6	7.4	2.0	0.5		
04	17.0	1.1	7.8	7.4	1.5			
05	44.0	1.7	4.6	7.4	1.0			
06	60.0	2.7	5.4	7.4	1.5			
07	26.0	1.3	6.0	7.4	2.0	0.5		
08	36.0	1.6	5.3	7.4	1.2	0.6		
09	14.0	0.6	5.1	7.4	0.9	0.4		
10	24.0	1.1	5.5	7.5	2.0	0.7		
11	25.0	1.1	5.3	7.5	2.0	1.0		
12	42.0	1.9	5.4	7.5	1.2			
13	52.0	2.4	5.5	7.5	1.2			
14	46.0	2.2	5.7	7.4	1.7	0.8		
15	47.0	2.2	5.6	7.4	1.5	0.6		
16	49.0	2.1	5.1	7.4	1.6	0.6		
17	40.0	1.8	5.4	7.4	1.7	0.7		
18	30.0	1.3	5.2	7.4	1.6	0.7		
19	48.0	2.2	5.5	7.4	1.4			
20	47.0	2.1	5.4	7.3	0.6			
21	45.0	2.1	5.6	7.3	1.1	0.6		
22	50.0	2.3	5.5	7.3	1.3	0.7		
23	37.0	1.7	5.5	7.3	1.8	0.8		
24	55.0	2.5	5.5	7.3	1.7	0.8		
25	47.0	2.1	5.4	7.3	1.5	0.7		
26	46.0	2.2	5.7	7.3	0.9			
27	27.0	1.4	6.2	7.3	1.8			
28	69.0	3.4	5.9	7.4	1.5	0.4		
29	92.0	4.7	6.1	7.4	1.0	0.5		
30	33.0	1.5	5.5	7.4	1.9	0.3		
31	20.0	1.0	6.0	7.4	1.6	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2551325 C.U.P. NO. 2-109-011-DU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: June 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT: , C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		

MONTHLY TOTAL	736.0	30.7	158.4	220.6	47.6	10.0	1	
AVERAGE	24.5	1.0	5.3	7.4	1.6	0.5		
MAXIMUM	73.0	1.7	7.2	7.5	2.5	0.6		
MINIMUM	10.0	0.5	1.8	7.3	0.5	0.3		

01	21.0	0.9	5.1	7.4	2.2			
02	30.0	1.5	6.0	7.4	2.0	0.5		
03	20.0	0.9	5.4	7.4	1.9	0.6		
04	21.0	1.0	5.7	7.4	2.4	0.6		
05	20.0	0.8	4.8	7.4	2.0	0.5		
06	23.0	1.0	5.2	7.4	1.9	0.5		
07	18.0	0.8	5.3	7.4	0.5			
08	21.0	0.8	4.6	7.5	2.5			
09	16.0	0.7	5.2	7.5	2.2	0.5		
10	27.0	1.1	4.9	7.5	1.6	0.4		
11	17.0	0.8	5.6	7.5	1.5	0.4		
12	19.0	0.9	5.7	7.3	1.3	0.4	1	
13	22.0	0.9	4.9	7.3	1.4	0.4		
14	10.0	0.6	7.2	7.3	1.2			
15	30.0	1.3	5.2	7.3	1.3			
16	73.0	1.1	1.8	7.3	1.2	0.4		
17	15.0	0.7	5.6	7.3	1.3	0.5		
18	10.0	0.5	6.0	7.3	1.4	0.5		
19	18.0	0.7	4.7	7.3	1.5	0.5		
20	20.0	0.9	5.4	7.4	1.2	0.3		
21	39.0	1.7	5.2	7.3	1.0			
22	32.0	1.5	5.6	7.3	2.4			
23	31.0	1.3	5.0	7.3	1.5	0.5		
24	24.0	1.2	6.0	7.3	1.4	0.5		
25	37.0	1.6	5.2	7.3	1.5	0.5		
26	30.0	1.4	5.6	7.3	1.4	0.5		
27	21.0	0.8	4.6	7.3	1.6	0.5		
28	22.0	1.0	5.5	7.3	1.3			
29	27.0	1.3	5.8	7.3	1.4			
30	22.0	1.0	5.5	7.3	1.6	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: May 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.O. CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	792.0	35.8	173.5	223.0	53.2	11.8	1	
AVERAGE	25.5	1.2	5.6	7.4	1.7	0.6		
MAXIMUM	48.0	2.1	9.3	7.5	2.8	0.8		
MINIMUM	14.0	0.7	2.5	7.3	1.0	0.3		
01	17.0	0.7	4.9		2.0	0.8		
02	21.0	0.9	5.1	7.3	1.3	0.4		
03	18.0	0.9	6.0	7.4	1.5			
04	26.0	1.1	5.1	7.4	2.7			
05	20.0	0.9	5.4	7.3	2.0	0.7		
06	20.0	0.9	5.4	7.4	2.0	0.6		
07	24.0	1.1	5.5	7.4	1.8	0.5	1	
08	24.0	1.0	5.0	7.4	1.2	0.4		
09	29.0	1.4	5.8	7.4	1.3	0.4		
10	42.0	1.8	5.1	7.5	2.0			
11	31.0	1.3	5.0	7.5	2.3			
12	14.0	0.7	6.0	7.5	2.0	0.7		
13	20.0	1.0	6.0	7.5	1.5	0.5		
14	23.0	1.0	5.2	7.5	1.8	0.7		
15	23.0	1.6	8.3	7.5	1.7	0.7		
16	34.0	1.6	5.6	7.5	1.5	0.7		
17	34.0	2.1	7.4	7.5	1.7			
18	48.0	1.0	2.5	7.5	1.3			
19	22.0	1.3	7.1	7.4	1.0	0.6		
20	28.0	1.1	4.7	7.4	1.0	0.5		
21	26.0	1.2	5.5	7.4	1.2	0.5		
22	24.0	1.0	5.0	7.4	1.8	0.7		
23	22.0	1.7	9.3	7.4	1.5	0.3		
24	41.0	1.4	4.1	7.4	2.0			
25	29.0	1.1	4.6	7.4	1.8			
26	25.0	0.8	3.8	7.5	2.8			
27	19.0	0.7	4.4	7.5	1.7	0.5		
28	16.0	1.1	8.3	7.4	1.5	0.6		
29	22.0	1.1	6.0	7.4	1.6	0.6		
30	23.0	1.2	6.3	7.4	1.2	0.4		
31	27.0	1.1	4.9	7.5	2.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: PONC LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT: *[Signature]*, C.O. CERT. NO. C-6202

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		

MONTHLY TOTAL	687.0	30.2	158.9	222.9	47.9	10.3	1	
AVERAGE	22.9	1.0	5.3	7.4	1.6	0.5		
MAXIMUM	56.0	2.5	6.9	7.5	3.0	0.9		
MINIMUM	4.0	0.2	3.6	7.3	0.9	0.2		

01	41.0	1.9	5.6	7.4	1.3	0.5	1	
02	38.0	1.8	5.7	7.4	1.4	0.5		
03	31.0	1.3	5.0	7.5	1.8	0.8		
04	56.0	2.5	5.4	7.4	2.3	0.9		
05	43.0	2.0	5.6	7.5	2.0			
06	29.0	1.3	5.4	7.4	2.5			
07	25.0	1.1	5.3	7.4	2.2	0.8		
08	30.0	1.3	5.2	7.4	2.0	0.7		
09	20.0	0.9	5.4	7.4	1.4	0.5		
10	30.0	1.4	5.6	7.4	2.0	0.7		
11	18.0	0.8	5.3	7.5	1.5	0.5		
12	30.0	1.4	5.6	7.5	3.0			
13	29.0	1.2	5.0	7.5	1.0			
14	7.0	0.3	5.1	7.5	1.2	0.3		
15	8.0	0.4	6.0	7.5	1.1	0.3		
16	8.0	0.4	6.0	7.5	1.2	0.3		
17	27.0	1.3	5.8	7.5	1.0	0.3		
18	14.0	0.6	5.1	7.5	1.6	0.4		
19	42.0	2.0	5.7	7.5	0.9			
20	37.0	1.1	3.6	7.5	1.5			
21	14.0	0.7	6.0	7.4	2.5	0.4		
22	19.0	0.8	5.1	7.4	1.3	0.4		
23	7.0	0.3	5.1	7.4	1.5	0.4		
24	14.0	0.8	6.9	7.4	1.2	0.4		
25	22.0	0.7	3.8	7.4	1.3	0.4		
26	12.0	0.4	4.0	7.4	1.1			
27	7.0	0.3	5.1	7.4	1.3			
28	13.0	0.5	4.6	7.3	2.1	0.2		
29	4.0	0.2	6.0	7.3	1.4	0.3		
30	12.0	0.5	5.0	7.3	1.3	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: March 1997

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DIRECTION OF FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.O. CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY	454.0	19.7	161.6	230.8	48.4	11.7	1	
AVERAGE	14.6	0.6	5.2	7.4	1.6	0.6		
MAXIMUM	35.0	1.5	10.9	7.5	3.0	0.8		
MINIMUM	0.0	0.0	0.0	7.3	1.0	0.3		
01	21.0	1.0	5.5	7.5	2.0			
02	14.0	0.6	5.1	7.5	1.9			
03	18.0	0.7	4.9	7.5	3.0	0.4		
04	10.0	0.4	4.4	7.5	1.3	0.6		
05	11.0	0.3	5.4	7.5	1.5	0.7		
06	4.0	0.2	6.0	7.5	1.6	0.8		
07	27.0	1.1	4.8	7.4	1.3	0.8		
08	20.0	1.0	6.0	7.5	1.2			
09	24.0	1.1	5.7	7.5	2.5			
10	11.0	0.4	4.5	7.5	1.3	0.5	1	
11	7.0	0.3	5.5	7.5	1.7	0.7		
12	0.0	0.0	0.0	7.5	1.6	0.7		
13	11.0	0.4	4.5	7.5	1.4	0.7		
14	6.0	0.3	6.4	7.5	1.0	0.3		
15	25.0	1.1	5.5	7.5	1.8			
16	21.0	0.8	4.7	7.5	1.2			
17	22.0	1.0	5.7	7.5	1.3	0.5		
18	4.0	0.1	4.1	7.4	1.4	0.5		
19	11.0	0.6	6.0	7.4	1.2	0.5		
20	13.0	0.6	6.0	7.4	1.5	0.5		
21	10.0	0.4	5.0	7.4	1.8	0.6		
22	22.0	1.0	5.5	7.4	1.2			
23	35.0	1.5	5.2	7.4	1.7			
24	12.0	0.5	5.0	7.4	1.4	0.5		
25	1.0	0.1	10.9	7.4	1.4	0.5		
26	2.0	0.1	2.7	7.4	1.1	0.5		
27	11.0	0.5	5.0	7.4	1.5	0.7		
28	9.0	0.5	6.1	7.4	2.1			
29	27.0	1.1	5.1	7.4	2.2			
30	27.0	1.3	5.7	7.3	1.0			
31	18.0	0.7	4.7	7.3	1.3	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:



C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	388.0	17.3	154.8	209.0	43.7	9.6	1	
AVERAGE	13.9	0.6	5.5	7.5	1.6	0.5		
MAXIMUM	33.0	1.4	9.0	7.6	2.9	0.8		
MINIMUM	4.0	0.2	4.0	7.4	0.5	0.2		
01	20.0	0.9	5.4	7.4	1.9			
02	16.0	0.8	6.0	7.4	2.3			
03	12.0	0.5	5.0	7.4	2.2	0.6	1	
04	11.0	0.5	5.5	7.4	2.3	0.7		
05	13.0	0.5	4.6	7.4	2.0	0.7		
06	4.0	0.3	9.0	7.4	1.6	0.7		
07	19.0	0.8	5.1	7.4	1.7	0.6		
08	8.0	0.4	6.0	7.5	2.9			
09	13.0	0.6	5.5	7.4	1.1			
10	16.0	0.7	5.2	7.4	1.1	0.8		
11	15.0	0.6	4.8	7.6	1.0	0.2		
12	12.0	0.6	6.0	7.6	0.5	0.2		
13	19.0	0.9	5.7	7.5	1.0	0.5		
14	16.0	0.7	5.2	7.5	1.0	0.2		
15	19.0	0.7	4.4	7.5	0.9			
16	20.0	1.0	6.0	7.4	1.1			
17	33.0	1.4	5.1	7.5	1.5			
18	12.0	0.6	6.0	7.5	1.0	0.4		
19	26.0	1.0	4.6	7.4	1.2	0.5		
20	15.0	0.7	5.6	7.4	1.1	0.5		
21	16.0	0.8	6.0	7.5	1.3	0.5		
22	8.0	0.3	4.5	7.5	2.0			
23	9.0	0.4	5.3	7.5	2.0			
24	4.0	0.2	6.0	7.5	1.9	0.5		
25	9.0	0.4	5.3	7.5	1.5	0.4		
26	4.0	0.2	6.0	7.5	1.5	0.5		
27	12.0	0.4	4.0	7.5	1.6	0.6		
28	7.0	0.4	6.9	7.5	2.5	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PC DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1997


OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
<hr/>								
MONTHLY TOTAL	462.0	20.1	164.0	229.4	57.8	15.9	1	
AVERAGE	14.9	0.6	5.5	7.4	1.9	0.7		
MAXIMUM	63.0	2.6	9.0	7.5	3.0	1.1		
MINIMUM	0.0	0.0	2.8	7.3	1.2	0.3		
<hr/>								
01	16.0	0.7	5.2	7.4	1.4			
02	5.0	0.3	7.2	7.4	1.6	0.5		
03	7.0	0.3	5.1	7.4	1.6	0.5		
04	11.0	0.4	4.4	7.4	1.3			
05	8.0	0.4	6.0	7.4	2.0			
06	8.0	0.4	6.0	7.4	1.9	1.1		
07	4.0	0.2	6.0	7.4	1.6	0.8		
08	11.0	0.4	4.4	7.4	1.8	0.9		
09	0.0	0.0		7.4	1.7	0.6		
10	13.0	0.3	2.8	7.4	1.5	0.4		
11	63.0	2.6	5.0	7.4	1.3			
12	29.0	1.3	5.4	7.4	1.5			
13	16.0	0.6	4.5	7.4	1.6	0.3	1	
14	4.0	0.1	3.0	7.4	1.4	0.4		
15	5.0	0.3	7.2	7.4	1.2	0.4		
16	4.0	0.3	9.0	7.5	1.3	0.4		
17	30.0	1.2	4.8	7.4	1.6	0.5		
18	23.0	1.1	5.7	7.3	1.5			
19	34.0	1.5	5.3	7.4	1.3			
20	8.0	0.4	6.0	7.3	2.1	0.9		
21	8.0	0.5	7.5	7.3	2.5	1.0		
22	9.0	0.5	6.7	7.3	2.0	1.0		
23	13.0	0.5	4.6	7.3	1.7	0.9		
24	8.0	0.4	6.0	7.3	1.9	0.8		
25	28.0	1.2	5.1	7.5	3.0			
26	19.0	0.9	5.7	7.5	2.5			
27	20.0	0.9	5.4	7.5	3.0	0.8		
28	16.0	0.6	4.5	7.5	3.0	1.0		
29	14.0	0.6	5.1	7.5	2.5	0.9		
30	11.0	0.5	5.5	7.4	2.2	0.9		
31	17.0	0.7	4.9	7.4	2.3	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2550908 C.U.P. NO. 2-109-011

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

I CERTIFY THIS REPORT IS CORRECT: [Signature], C.O. CERT. NO. 5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5880.0	309.0	222.0	233.9	32.5	15.5	5	
AVERAGE	189.7	10.0	7.2	7.5	1.0	0.7		
MAXIMUM	294.0	12.0	29.3	7.7	2.4	1.6		
MINIMUM	41.0	8.0	4.1	7.4	0.5	0.2		
01	119.0	10.0	10.1	7.4	1.4	0.4		
02	154.0	10.0	7.8	7.4	1.5	0.4		
03	191.0	10.0	6.3	7.4	2.0	0.5		
04	171.0	10.0	7.0	7.4	2.0	0.5		
05	133.0	8.0	7.2	7.4	2.4	0.8		
06	140.0	11.0	9.4	7.5	2.0			
07	138.0	10.0	8.7	7.4	1.0			
08	138.0	9.0	7.8	7.6	1.2	1.2		
09	174.0	11.0	7.6	7.7	1.4	1.4		
10	165.0	10.0	7.3	7.6	0.9	0.9		
11	192.0	10.0	6.3	7.6	0.5	0.4		
12	155.0	10.0	7.7	7.6	1.5	1.5		
13	192.0	10.0	6.3	7.6	1.3			
14	218.0	11.0	6.1	7.6	1.6			
15	219.0	9.0	4.9	7.7	0.5	0.2		
16	231.0	10.0	5.2	7.7	0.5	0.2	5	
17	41.0	10.0	29.3	7.6	1.0	1.0		
18	214.0	10.0	5.6	7.6	0.5	0.5		
19	176.0	9.0	6.1	7.5	0.5	0.5		
20	275.0	12.0	5.2	7.6	0.5			
21	169.0	9.0	6.4	7.6	0.5			
22	210.0	10.0	5.7	7.7	0.5	0.5		
23	224.0	10.0	5.4	7.6	0.5	0.5		
24	215.0	10.0	5.6	7.6	0.5	0.5		
25	294.0	10.0	4.1	7.5	0.8			
26	242.0	10.0	5.0	7.5	0.7			
27	253.0	10.0	4.7	7.4	0.5			
28	231.0	10.0	5.2	7.5	0.7			
29	235.0	10.0	5.1	7.7	0.7	0.7		
30	192.0	10.0	6.3	7.5	1.6	1.6		
31	179.0	10.0	6.7	7.4	1.3	1.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WWS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Lake Vedra WTP No. 1

LOCATION: 71 State Road 11A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

CERTIFY THIS REPORT IS CORRECT: *[Signature]*, C.O. CERT. NO. 5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		

MONTHLY TOTAL	5611.0	311.0	257.1	231.1	49.9	15.2	5	
AVERAGE	181.0	10.0	8.3	7.5	1.6	0.7		
MAXIMUM	749.0	11.0	28.6	7.7	3.0	1.4		
MINIMUM	42.0	9.0	1.6	7.3	0.5	0.2		

01	171.0	10.0	7.0	7.5	1.1	0.7		
02	177.0	10.0	6.8	7.4	1.3	0.8		
03	215.0	10.0	5.6	7.4	1.7	0.6		
04	120.0	10.0	10.0	7.3	1.8			
05	200.0	11.0	6.6	7.4	2.3			
06	169.0	10.0	7.1	7.6	0.5	0.2		
07	210.0	10.0	5.7	7.6	1.0	0.7	5	
08	170.0	10.0	7.1	7.3	3.0	0.7		
09	189.0	10.0	6.3	7.5	2.0	0.2		
10	207.0	10.0	5.8	7.3	3.0	1.1		
11	155.0	10.0	7.7	7.3	2.8			
12	258.0	11.0	5.1	7.3	2.3			
13	146.0	9.0	7.4	7.6	2.5	0.9		
14	248.0	11.0	5.3	7.6	0.7	0.7		
15	242.0	10.0	5.0	7.6	0.5	0.3		
16	144.0	10.0	8.3	7.7	0.5	0.3		
17	85.0	10.0	14.1	7.4	1.7	0.9		
18	749.0	10.0	1.6	7.3	1.8			
19	92.0	9.0	11.7	7.4	0.6			
20	130.0	11.0	10.2	7.3	3.0	1.2		
21	162.0	9.0	6.7	7.3	3.0	1.0		
22	117.0	10.0	10.3	7.5	0.5	0.5		
23	177.0	10.0	6.8	7.5	0.5	0.5		
24	106.0	9.0	10.2	7.6	0.6	0.6		
25	188.0	10.0	6.4	7.5	3.0			
26	141.0	11.0	9.4	7.5	3.0			
27	92.0	10.0	13.0	7.4	2.0	1.4		
28	153.0	10.0	7.8	7.5	0.5	0.5		
29	188.0	10.0	6.4	7.5	0.6	0.6		
30	168.0	10.0	7.1	7.5	1.0	0.4		
31	42.0	10.0	28.6	7.5	1.1	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

LOCATION: 71 State Road 1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

I CERTIFY THIS REPORT IS CORRECT: A. J. C. [Signature], C.O. CERT. NO. 5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	6352.0	300.0	189.2	225.4	53.4	13.6	5	
AVERAGE	211.7	10.0	6.3	7.5	1.8	0.6		
MAXIMUM	379.0	11.0	11.4	7.7	3.0	1.0		
MINIMUM	105.0	9.0	3.2	7.3	0.5	0.2		
01	138.0	10.0	8.7	7.5	2.3			
02	149.0	9.0	7.2	7.5	2.2	0.7		
03	154.0	11.0	8.6	7.5	0.6	0.6		
04	193.0	10.0	6.2	7.5	0.6	0.6		
05	178.0	9.0	6.1	7.5	3.0	0.9		
06	232.0	10.0	5.2	7.6	0.5			
07	281.0	11.0	4.7	7.6	1.0			
08	190.0	10.0	6.3	7.4	3.0	0.9		
09	218.0	10.0	5.5	7.5	3.0	0.7		
10	175.0	10.0	6.9	7.5	3.0	0.5		
11	244.0	10.0	4.9	7.6	0.5	0.3	5	
12	187.0	10.0	6.4	7.7	1.2	0.2		
13	229.0	10.0	5.2	7.5	1.5			
14	353.0	11.0	3.7	7.4	1.9			
15	228.0	9.0	4.7	7.5	3.0	1.0		
16	310.0	10.0	3.9	7.3	3.0	0.2		
17	216.0	9.0	5.0	7.5	2.2	0.2		
18	379.0	10.0	3.2	7.5	1.1	0.3		
19	343.0	11.0	3.8	7.7	0.5	0.3		
20	239.0	10.0	5.0	7.6	0.8			
21	330.0	10.0	3.6	7.5	1.3			
22	228.0	10.0	5.3	7.4	3.0	0.8		
23	137.0	10.0	8.8	7.6	3.0	0.8		
24	145.0	10.0	8.3	7.6	2.5	0.7		
25	165.0	10.0	7.3	7.6	1.2	1.0		
26	151.0	9.0	7.2	7.5	1.0	1.0		
27	120.0	10.0	10.0	7.5	1.5			
28	129.0	11.0	10.2	7.5	0.5			
29	105.0	10.0	11.4	7.4	1.5	0.9		
30	206.0	10.0	5.8	7.4	3.0	1.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

DWS ID NO. 2550908 C.U.P. NO. 2-109-011-8X

NAME OF DRINKING WATER SYSTEM: Pon.e Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

I CERTIFY THIS REPORT IS CORRECT: John S. [Signature], C.O. CERT. NO. 5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/L	PLANT EFFLUENT TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL HCL VIOLATIONS	REMARKS AND COMMENTS
MONTHLY TOTAL	5483.0	312.0	232.6	47.8	14.4	5		
AVERAGE	176.9	10.1	7.5	1.5	0.7			
MAXIMUM	764.0	12.0	7.7	3.0	1.2			
MINIMUM	69.0	9.0	7.4	0.5	0.2			
01	100.0	9.0	7.4	3.0	1.2			
02	102.0	10.0	7.5	0.7				
03	146.0	11.0	7.4	1.6				
04	235.0	10.0	7.5	0.5	0.5			
05	190.0	9.0	7.6	1.3	0.8			
06	154.0	11.0	7.6	0.7	0.7			
07	153.0	10.0	7.5	2.0	0.7			
08	130.0	11.0	7.5	1.8	0.6			
09	69.0	11.0	7.5	2.2				
10	107.0	10.0	7.5	1.8				
11	138.0	10.0	7.5	1.0	0.8			
12	112.0	9.0	7.4	3.0	1.2			
13	127.0	11.0	7.4	0.6	0.6			
14	130.0	10.0	7.6	1.4	0.9			
15	151.0	10.0	7.5	3.0	1.2			
16	150.0	10.0	7.4	2.6				
17	183.0	10.0	7.4	2.9				
18	155.0	9.0	7.6	1.4	1.0			
19	88.0	11.0	7.6	0.5	0.5			
20	149.0	10.0	7.6	0.6	0.5			
21	147.0	10.0	7.7	0.6	0.2			
22	171.0	9.0	7.4	0.6	0.4			
23	217.0	12.0	7.6	0.5				
24	159.0	9.0	7.5	0.6				
25	138.0	10.0	7.6	1.1	1.1			
26	764.0	10.0	7.5	1.1	0.6			
27	111.0	9.0	7.6	0.5	0.2			
28	236.0	11.0	7.4	2.5	0.4			
29	226.0	10.0	7.5	3.0	0.3			
30	236.0	10.0	7.4	2.7				
31	309.0	10.0	7.4	2.0				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Po. Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

PLANT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

I CERTIFY THIS REPORT IS CORRECT: AS a, C.O. CERT. NO. 5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	7298.0	313.0	174.4	232.2	63.4	19.2	5	
AVERAGE	235.4	10.1	5.6	7.5	2.0	0.9		
MAXIMUM	383.0	12.0	10.1	7.7	3.0	1.4		
MINIMUM	120.0	9.0	3.0	7.3	0.5	0.4		
01	195.0	11.0	6.8	7.5	3.0	1.4		
02	243.0	10.0	4.9	7.4	3.0	1.2		
03	292.0	10.0	4.1	7.4	3.0	0.7		
04	234.0	10.0	5.1	7.3	3.0			
05	243.0	10.0	4.9	7.3	3.0			
06	283.0	10.0	4.2	7.4	2.6			
07	212.0	10.0	5.7	7.5	3.0	1.0	5	
08	219.0	11.0	6.0	7.5	3.0	0.9		
09	181.0	9.0	6.0	7.5	3.0	1.2		
10	124.0	10.0	9.7	7.6	1.2	1.2		
11	120.0	10.0	10.0	7.7	1.0	1.0		
12	203.0	10.0	5.9	7.7	0.8			
13	238.0	12.0	6.1	7.6	1.0			
14	219.0	10.0	5.5	7.3	3.0	0.7		
15	213.0	10.0	5.6	7.3	3.0	1.0		
16	303.0	10.0	4.0	7.6	1.2	1.2		
17	340.0	10.0	3.5	7.5	1.4	0.8		
18	247.0	11.0	5.3	7.5	1.3	0.5		
19	262.0	10.0	4.6	7.3	0.7			
20	383.0	10.0	3.1	7.3	0.5			
21	227.0	10.0	5.3	7.5	3.0	0.7		
22	304.0	10.0	3.9	7.5	3.0	0.7		
23	353.0	10.0	3.4	7.5	3.0	0.4		
24	355.0	9.0	3.0	7.6	2.5	0.5		
25	231.0	11.0	5.7	7.6	0.5	0.5		
26	131.0	11.0	10.1	7.5	1.1			
27	158.0	9.0	6.8	7.5	1.6			
28	241.0	10.0	5.0	7.5	3.0	1.2		
29	212.0	9.0	5.1	7.6	2.0	0.7		
30	206.0	11.0	6.4	7.6	1.1	0.8		
31	126.0	9.0	8.6	7.6	0.9	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: June 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DIRECTION OF FLOW _____

CERTIFY THIS REPORT IS CORRECT: 129 [Signature], C.O. CERT. NO. 5577

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5855.0	302.0	210.7	223.3	55.4	15.1	5	
AVERAGE	195.2	10.1	7.0	7.4	1.8	0.7		
MAXIMUM	728.0	11.0	11.7	7.6	3.0	1.2		
MINIMUM	92.0	9.0	1.6	7.3	0.5	0.2		
01	130.0	9.0	8.3	7.4	2.2			
02	201.0	10.0	6.0	7.6	0.7	0.7		
03	178.0	10.0	6.7	7.5	1.0	0.4		
04	184.0	9.0	5.9	7.6	0.6	0.6		
05	126.0	11.0	10.5	7.3	3.0	0.2		
06	92.0	9.0	11.7	7.3	3.0	0.7		
07	147.0	10.0	8.2	7.5	0.7			
08	141.0	11.0	9.4	7.4	1.4			
09	181.0	10.0	6.6	7.5	1.0	0.5		
10	166.0	11.0	8.0	7.6	2.2	0.7		
11	166.0	10.0	7.2	7.3	3.0	0.5		
12	165.0	10.0	7.3	7.3	3.0	0.6		
13	235.0	10.0	5.1	7.3	2.5	0.5		
14	143.0	10.0	8.4	7.3	1.9			
15	174.0	11.0	7.6	7.3	2.0			
16	168.0	10.0	7.1	7.6	0.7	0.7		
17	147.0	10.0	8.2	7.6	0.9	0.8	5	
18	127.0	10.0	9.4	7.6	1.8	1.1		
19	143.0	11.0	9.2	7.5	1.0	1.0		
20	199.0	10.0	6.0	7.6	0.6	0.6		
21	171.0	9.0	6.3	7.5	0.8			
22	199.0	10.0	6.0	7.3	1.9			
23	302.0	10.0	4.0	7.4	3.0	0.7		
24	246.0	10.0	4.9	7.5	3.0	1.0		
25	242.0	11.0	5.5	7.4	3.0	1.2		
26	208.0	10.0	5.8	7.4	3.0	0.8		
27	171.0	10.0	7.0	7.4	3.0	1.2		
28	728.0	10.0	1.6	7.4	2.8			
29	185.0	11.0	7.1	7.4	0.5			
30	190.0	9.0	5.7	7.5	1.2	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: March 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DIRECTION OF FLOW _____

CERTIFY THIS REPORT IS CORRECT: J. J. [Signature], C.O. CERT. NO. 5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5868.0	310.0	204.3	231.4	48.5	11.0	5	
AVERAGE	189.3	10.0	6.6	7.5	1.6	0.6		
MINIMUM	312.0	12.0	9.8	7.5	3.0	1.1		
MAXIMUM	114.0	9.0	4.0	7.3	0.5	0.2		
01	166.0	10.0	7.2	7.5	1.5			
02	164.0	11.0	8.0	7.5	1.2			
03	204.0	10.0	5.7	7.5	3.0	1.1		
04	238.0	10.0	5.0	7.5	1.4	0.7		
05	195.0	10.0	6.2	7.5	0.9	0.9		
06	151.0	9.0	7.4	7.5	1.0	1.0		
07	312.0	12.0	4.0	7.5	1.1	1.1		
08	224.0	10.0	5.3	7.5	1.0			
09	190.0	9.0	5.9	7.5	1.5			
10	202.0	9.0	5.4	7.5	3.0	1.1		
11	180.0	10.0	6.7	7.5	1.0	0.9		
12	224.0	11.0	5.8	7.5	0.5	0.2	5	
13	167.0	10.0	7.3	7.5	0.5	0.2		
14	130.0	10.0	9.4	7.5	3.0	0.2		
15	174.0	10.0	6.9	7.3	3.0			
16	180.0	10.0	6.5	7.3	3.0			
17	205.0	10.0	5.8	7.5	1.7	0.7		
18	166.0	10.0	7.5	7.5	3.0	0.4		
19	174.0	10.0	6.9	7.5	0.5	0.3		
20	185.0	10.0	6.5	7.5	1.5	0.4		
21	114.0	9.0	9.8	7.5	1.4	0.4		
22	136.0	10.0	9.0	7.4	1.8			
23	184.0	11.0	7.0	7.4	1.9			
24	183.0	10.0	6.7	7.5	0.5	0.2		
25	135.0	9.0	8.0	7.5	0.5	0.3		
26	293.0	11.0	4.4	7.5	0.5	0.2		
27	185.0	11.0	7.0	7.5	1.1	0.2		
28	214.0	10.0	5.4	7.4	0.8			
29	217.0	10.0	5.7	7.4	0.7			
30	183.0	9.0	6.2	7.4	3.0			
31	193.0	9.0	5.7	7.3	3.0	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte ra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

SIGNATURE FLOW _____

CERTIFY THIS REPORT IS CORRECT: *[Signature]*, C.O. CERT. NO. 5577

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED		EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT REMOTE TAP		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
			mg/L					
MONTHLY TOTAL	3448.0	265.0	270.5	207.9	46.0	16.7	5	
AVERAGE	123.1	9.5	9.7	7.4	1.6	0.9		
MAXIMUM	182.0	12.0	15.5	7.5	3.0	2.0		
MINIMUM	58.0	5.0	6.1	7.0	0.5	0.2		
01	62.0	8.0	15.5	7.4	3.0			
02	145.0	11.0	9.1	7.4	1.1			
03	88.0	10.0	13.6	7.3	3.0	1.3		
04	116.0	10.0	10.3	7.4	3.0	2.0		
05	128.0	9.0	8.4	7.5	1.0	1.0		
06	125.0	11.0	10.6	7.5	0.5	0.2		
07	118.0	6.0	6.1	7.5	2.5	1.0		
08	58.0	5.0	10.3	7.4	2.8			
09	98.0	7.0	8.6	7.5	1.2			
10	97.0	10.0	12.4	7.5	1.0	0.5		
11	124.0	9.0	8.7	7.5	1.5	0.7		
12	120.0	9.0	9.0	7.5	1.2	1.1		
13	98.0	10.0	12.2	7.2	1.8	0.6		
14	124.0	12.0	11.6	7.0	2.9	0.9		
15	85.0	9.0	12.7	7.1	2.0			
16	117.0	9.0	9.2	7.3	1.4			
17	95.0	10.0	12.6	7.4	1.3			
18	131.0	10.0	9.2	7.5	1.6	1.2		
19	154.0	10.0	7.8	7.5	1.5	0.7	5	
20	146.0	10.0	8.2	7.5	1.0	1.0		
21	146.0	10.0	8.2	7.5	1.4	1.0		
22	109.0	10.0	11.0	7.5	1.5			
23	153.0	10.0	7.8	7.5	1.7			
24	153.0	10.0	7.8	7.5	1.2	0.8		
25	162.0	10.0	7.4	7.5	0.7	0.7		
26	146.0	10.0	8.2	7.5	1.3	0.7		
27	168.0	10.0	7.1	7.5	1.4	0.7		
28	182.0	10.0	6.6	7.5	1.5	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Piedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1997

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

INFLUENT EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

CERTIFY THIS REPORT IS CORRECT: [Signature], C.O. CERT. NO. 5577

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	3157.0	308.0	414.2	7.5	66.3	20.6	5	
AVERAGE	101.8	9.9	13.4	7.5	2.1	0.9		
MAXIMUM	150.0	12.0	35.3	7.5	3.0	1.5		
MINIMUM	17.0	5.0	8.0	7.4	0.5	0.2		
01	17.0	5.0	35.3	7.5	0.9			
02	90.0	10.0	13.3	7.5	0.5	0.2		
03	106.0	10.0	11.3	7.5	3.0	0.7		
04	70.0	10.0	17.1	7.5	3.0			
05	121.0	10.0	9.9	7.5	3.0			
06	91.0	10.0	13.2	7.5	1.0	0.8		
07	113.0	10.0	10.6	7.5	1.0	1.0		
08	129.0	10.0	9.3	7.5	1.3	1.0		
09	150.0	10.0	8.0	7.5	3.0	1.0		
10	107.0	10.0	11.2	7.5	2.2	0.3		
11	46.0	11.0	28.7	7.5	3.0			
12	100.0	9.0	10.8	7.5	2.5			
13	126.0	11.0	10.5	7.5	1.2	1.2		
14	141.0	10.0	8.5	7.5	1.7	1.4	5	
15	139.0	10.0	8.6	7.5	3.0	0.9		
16	109.0	9.0	9.9	7.4	2.5	0.7		
17	100.0	10.0	12.0	7.4	3.0	1.4		
18	85.0	10.0	14.0	7.4	2.2			
19	96.0	11.0	13.8	7.5	2.1			
20	72.0	10.0	16.7	7.5	2.1	1.0		
21	97.0	9.0	11.1	7.5	2.2	1.1		
22	92.0	10.0	13.0	7.5	0.5	0.2		
23	127.0	11.0	10.4	7.5	1.0	1.0		
24	47.0	10.0	25.5	7.5	2.5	1.1		
25	71.0	10.0	16.9	7.5	3.0			
26	124.0	10.0	9.7	7.5	0.5			
27	120.0	10.0	10.0	7.5	2.5	1.0		
28	132.0	10.0	9.1	7.5	3.0	1.5		
29	128.0	10.0	9.4	7.5	3.0	1.0		
30	123.0	10.0	9.8	7.5	2.9	1.0		
31	87.0	12.0	16.6	7.5	3.0	1.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2365

I CERTIFY THIS REPORT IS CORRECT [Signature], C.O., CERT. NO. C-5577

DAYS OF MONTH	TOTAL WATER TREATED IN		CHLORINE	CHLORINE	EFF	RESIDUAL CHLORINE		ZINC	TOTAL	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
	THOUSAND GALLONS	GAL. OR LBS USED	mg/L	pH	mg/L	PLANT EFFLUENT	REMOTE TAP	POLYPHOSPHATE LBS	PHOSPHATE mg/L		

MONTHLY TOTAL	24221.0	1205.0	185.5	232.6	70.5	20.7	671.7		0.07	4	
AVERAGE	781.3	33.9	6.0	7.5	2.3	1.0	21.7		0.04	4	
MAXIMUM	1027.0	49.0	6.4	7.6	3.0	1.6	31.1		0.05	4	
MINIMUM	578.0	31.0	5.4	7.3	1.7	0.6	16.8		0.02	4	

01	921.0	42.0	5.5	7.4	2.2	0.6	26.0				
02	931.0	49.0	6.3	7.4	2.4	0.7	24.0				
03	716.0	37.0	6.2	7.4	2.3	0.7	25.5				
04	761.0	36.0	6.0	7.4	2.5	0.7	21.4		0.05		
05	727.0	33.0	5.4	7.4	2.6	0.8	20.4				
06	1006.0	48.0	5.7	7.3	2.5		28.1				
07	939.0	46.0	5.9	7.4	3.0		31.1				
08	608.0	41.0	6.1	7.5	2.4	1.2	21.9			4	
09	819.0	38.0	5.6	7.6	2.7	1.1	21.9				
10	714.0	35.0	5.9	7.6	2.5	1.1	21.4				
11	740.0	37.0	6.0	7.5	2.0	1.0	19.4				
12	631.0	33.0	6.3	7.6	1.7	1.0	17.9				
13	758.0	39.0	6.2	7.6	1.9		19.4				
14	777.0	35.0	5.4	7.6	2.2		20.9				
15	578.0	31.0	6.4	7.6	1.7	0.8	16.8				
16	748.0	36.0	5.8	7.5	2.8	1.3	19.4				
17	796.0	40.0	6.0	7.5	2.8	1.2	21.9				
18	726.0	37.0	6.1	7.5	2.3	1.2	18.9		0.02		
19	674.0	34.0	6.1	7.5	1.7	1.6	17.9				
20	1027.0	49.0	5.7	7.6	2.3		28.1				
21	743.0	36.0	5.8	7.6	1.8		21.4				
22	798.0	39.0	5.9	7.6	2.2	1.1	21.4				
23	775.0	39.0	6.0	7.6	2.0	1.0	21.4				
24	631.0	33.0	6.3	7.6	2.0	1.0	17.3				
25	842.0	42.0	6.0	7.5	2.0		21.4				
26	882.0	46.0	6.3	7.5	2.3		24.5				
27	676.0	36.0	6.4	7.4	1.9		19.4				
28	691.0	35.0	6.1	7.4	2.8		18.4				
29	745.0	38.0	6.1	7.6	2.2	0.8	19.9				
30	859.0	43.0	6.0	7.5	2.5	1.0	23.0				
31	782.0	40.0	6.1	7.4	2.3	0.8	21.4				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Monte Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSAND GALLONS	CHLORINE GAL. OR LBS USED	CHLORINE mg/L	EFF pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	CHLORINE mg/L REMOTE TAP	ZINC POLYPHOSPHATE LBS	mg/L	TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	29787.0	1392.0	476.0	7.5	69.1	18.1	969.0	123.3	0.11	4	
AVERAGE	960.9	44.9	5.7	7.5	2.2	0.8	31.3	4.0	0.06	4	
MAXIMUM	1387.0	62.0	7.3	7.6	3.0	2.0	88.2	9.4	0.06	4	
MINIMUM	281.0	17.0	4.8	7.3	1.6	0.3	7.1	1.1	0.05	4	
01	1053.0	49.0	5.6	7.6	3.0	0.8	30.6	3.5		4	
02	1175.0	53.0	5.4	7.4	2.9	0.7	34.2	3.5			
03	1367.0	62.0	5.4	7.4	2.5	0.6	39.3	3.4	0.05		
04	497.0	26.0	6.3	7.4	2.2		14.3	3.4			
05	1291.0	59.0	5.5	7.3	2.8		38.3	3.6			
06	1084.0	50.0	5.5	7.6	1.7	0.6	31.6	3.5			
07	1200.0	55.0	5.5	7.5	1.8	0.6	88.2	8.8			
08	1085.0	51.0	5.6	7.6	1.7	0.5	82.6	9.1			
09	1148.0	52.0	5.4	7.6	1.7	0.3	34.7	3.6			
10	1112.0	45.0	4.9	7.6	2.0	0.3	35.2	3.8			
11	1022.0	48.0	5.6	7.5	1.9		30.6	3.6			
12	1387.0	61.0	5.3	7.4	2.3		40.8	3.5			
13	1017.0	47.0	5.5	7.6	1.8	0.4	29.6	3.5			
14	1301.0	58.0	5.3	7.6	1.6	0.5	37.7	3.5			
15	751.0	30.0	4.8	7.5	2.0	0.5	23.0	3.7			
16	833.0	40.0	5.8	7.6	2.0	0.5	44.9	6.5	0.06		
17	768.0	38.0	5.9	7.6	1.8	1.4	7.1	1.1			
18	281.0	17.0	7.3	7.3	2.5		21.9	9.4			
19	773.0	38.0	5.9	7.4	2.9		31.6	4.9			
20	981.0	52.0	6.4	7.6	2.3	0.8	14.3	1.7			
21	1011.0	47.0	5.6	7.3	2.8	0.8	14.3	1.7			
22	935.0	45.0	5.8	7.6	2.2	0.9	26.5	3.4			
23	1064.0	50.0	5.6	7.5	2.0	0.8	30.6	3.5			
24	785.0	38.0	5.8	7.5	2.5	0.7	21.9	3.4			
25	825.0	40.0	5.8	7.6	2.7		24.0	3.5			
26	970.0	46.0	5.7	7.6	3.0		26.0	3.2			
27	767.0	38.0	5.9	7.5	2.8	2.0	22.4	3.5			
28	844.0	41.0	5.8	7.5	2.0	1.0	24.5	3.5			
29	750.0	33.0	5.3	7.5	1.8	1.4	20.4	3.3			
30	888.0	43.0	5.8	7.5	1.9	1.0	24.0	3.2			
31	822.0	40.0	5.8	7.5	2.0	1.0	24.0	3.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Pol. Jedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSAND GALLONS	CHLORINE GAL. OR LBS USED	CHLORINE mg/L	EFF pH	RESIDUAL CHLORINE mg/L	ZINC POLYPHOSPHATE LBS	TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS	
					PLANT EFFLUENT	REMOTE TAP				
MONTHLY TOTAL	32230.0	1435.0	-166.3	234.0	69.3	18.6	929.2	107.2	0.68	4
AVERAGE	1039.7	46.3	5.4	7.5	2.2	0.8	30.0	3.5	0.34	4
MAXIMUM	1318.0	59.0	6.1	7.7	3.0	1.3	39.3	3.9	0.48	4
MINIMUM	700.0	35.0	4.2	7.4	1.5	0.4	19.9	2.5	0.20	4
01	1074.0	55.0	6.1	7.6	2.3	0.9	34.7	3.9		
02	1015.0	47.0	5.6	7.6	2.1	1.1	29.6	3.5		4
03	1006.0	45.0	5.4	7.6	1.8	0.7	28.1	3.3		
04	1050.0	48.0	5.5	7.5	2.0		32.1	3.7		
05	935.0	39.0	5.0	7.5	1.9		27.5	3.5		
06	1318.0	58.0	5.3	7.5	1.7		37.7	3.4		
07	1025.0	43.0	5.0	7.6	2.5	1.0	29.6	3.5		
08	1126.0	52.0	5.5	7.6	2.7	1.0	34.2	3.6		
09	766.0	36.0	5.6	7.6	2.5	1.3	22.4	3.5		
10	890.0	43.0	5.8	7.5	2.5	0.9	25.0	3.4		
11	837.0	41.0	5.9	7.7	1.8	1.0	24.5	3.5	0.48	
12	987.0	45.0	5.5	7.5	2.0		26.5	3.2		
13	1297.0	59.0	5.5	7.6	2.5		38.3	3.5		
14	992.0	46.0	5.6	7.4	3.0	1.3	27.5	3.3		
15	1072.0	50.0	5.6	7.5	3.0	1.0	32.1	3.6		
16	956.0	41.0	5.1	7.6	2.5	1.1	28.1	3.5		
17	1019.0	44.0	5.2	7.5	2.2	1.0	29.1	3.4		
18	1032.0	46.0	5.3	7.5	2.1	1.0	29.6	3.4		
19	969.0	44.0	5.4	7.4	2.7		28.6	3.5		
20	1130.0	48.0	5.1	7.4	2.2		32.6	3.5		
21	1081.0	49.0	5.4	7.6	1.5	0.7	31.1	3.5		
22	1261.0	56.0	5.3	7.5	2.5	0.4	36.2	3.4		
23	1074.0	45.0	5.0	7.6	1.5	0.6	33.7	3.8		
24	1089.0	38.0	4.2	7.6	2.0	0.5	24.5	2.7		
25	1284.0	53.0	5.0	7.6	2.0	0.6	39.3	3.7	0.20	
26	1156.0	47.0	4.9	7.5	2.2		33.2	3.4		
27	700.0	35.0	6.0	7.5	2.3		19.9	3.4		
28	1061.0	49.0	5.5	7.5	2.1	0.8	31.1	3.5		
29	978.0	45.0	5.5	7.6	2.3	0.5	28.6	3.5		
30	978.0	49.0	6.0	7.7	3.0	0.6	32.1	3.9		
31	1072.0	39.0	4.4	7.6	1.9	0.6	21.9	2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

A. D. G. King

, C.O., CERT. NO. C-5577

DAYS OF MONTH	TOTAL WATER TREATED IN		CHLORINE mg/L	EFF pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	THOUSAND GALLONS	GAL. OR LBS USED			PLANT EFFLUENT	REMOTE TAP	LBS	mg/L		
MONTHLY TOTAL	28602.0	1183.0	449.7	7.5	47.4	8.7	866.5	109.6	4	
AVERAGE	953.4	39.4	5.0	7.5	1.6	0.4	28.9	3.7	4	
MAXIMUM	1396.0	50.0	5.5	7.7	2.5	1.0	55.6	8.1	4	
MINIMUM	684.0	31.0	4.3	7.4	1.0	0.2	19.9	3.3	4	
01	1176.0	49.0	5.0	7.5	1.7	0.2	33.7	3.4	4	
02	1073.0	43.0	4.8	7.5	1.8	0.4	29.6	3.3		
03	855.0	36.0	5.1	7.5	1.5	0.4	25.5	3.6		
04	1396.0	50.0	4.3	7.5	1.2	0.3	40.3	3.5		
05	912.0	33.0	4.3	7.5	1.4		25.0	3.3		
06	965.0	40.0	5.0	7.4	2.0		30.1	3.7		
07	964.0	39.0	4.9	7.5	1.1	0.3	27.0	3.4		
08	1169.0	49.0	5.0	7.5	1.4	0.4	35.2	3.6		
09	1064.0	44.0	5.0	7.5	2.3	0.4	30.6	3.5		
10	1043.0	44.0	5.1	7.5	1.7	0.2	29.6	3.4		
11	975.0	40.0	4.9	7.7	1.8	0.5	30.1	3.7		
12	997.0	41.0	4.9	7.7	1.4		28.1	3.4		
13	921.0	38.0	5.0	7.7	1.8		26.5	3.5		
14	1022.0	42.0	4.9	7.5	1.8	0.9	35.7	4.2		
15	828.0	35.0	5.1	7.7	1.3	0.3	55.6	8.1		
16	901.0	32.0	4.3	7.5	1.0	0.2	29.6	3.9		
17	982.0	40.0	4.9	7.5	1.4	0.3	27.5	3.4		
18	956.0	41.0	5.1	7.5	1.5	0.4	28.1	3.5		
19	684.0	31.0	5.4	7.5	1.6		19.9	3.5		
20	1005.0	41.0	4.9	7.5	1.8		28.6	3.4		
21	1018.0	42.0	5.0	7.4	2.5	0.7	30.6	3.6		
22	1048.0	44.0	5.0	7.6	1.4	0.2	29.6	3.4		
23	737.0	32.0	5.2	7.7	1.0	0.2	23.0	3.7		
24	1024.0	43.0	5.0	7.6	1.5	0.3	28.6	3.3		
25	960.0	39.0	4.9	7.4	1.8	0.3	28.1	3.5		
26	888.0	39.0	5.3	7.4	1.6		25.5	3.4		
27	746.0	33.0	5.3	7.4	1.6		21.4	3.4		
28	742.0	34.0	5.5	7.7	2.0	1.0	20.9	3.4		
29	809.0	37.0	5.5	7.5	1.0	0.4	22.4	3.3		
30	742.0	32.0	5.2	7.4	1.5	0.4	20.4	3.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

HS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte a WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT L. S. My, C.O., CERT. NO. C-5577

MAY MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP		
TOTAL	23598.0	985.0	208.5	63.8	16.6	4	
AVERAGE	842.8	35.2	7.4	2.3	0.8		
MAXIMUM	1085.0	46.0	7.5	3.0	1.5		
MINIMUM	649.0	29.0	7.3	1.2	0.3		
01	749.0	33.0	7.4	2.5			
02	1000.0	42.0	7.3	2.5			
03	867.0	38.0	7.5	3.0	0.6	4	
04	668.0	30.0	7.5	1.2	1.2		
05	863.0	37.0	7.5	1.7	0.7		
06	923.0	39.0	7.5	3.0	0.9		
07	917.0	34.0	7.5	2.5	1.0		
08	824.0	31.0	7.4	2.2			
09	767.0	30.0	7.5	2.6			
10	882.0	38.0	7.5	2.8	0.6		
11	975.0	34.0	7.5	2.7	1.0		
12	800.0	36.0	7.4	2.6	1.1		
13	649.0	31.0	7.4	2.7	0.9		
14	1085.0	46.0	7.4	2.5	1.2		
15	681.0	29.0	7.3	2.6			
16	824.0	31.0	7.3	2.3			
17	897.0	38.0	7.5	2.3	0.4		
18	845.0	36.0	7.5	1.7	1.0		
19	860.0	36.0	7.5	2.2	0.8		
20	679.0	30.0	7.5	2.2	1.5		
21	1085.0	45.0	7.5	1.5	0.9		
22	729.0	32.0	7.5	3.0			
23	775.0	33.0	7.5	2.1			
24	818.0	36.0	7.5	1.7	0.4		
25	766.0	32.0	7.4	2.2	1.1		
26	790.0	34.0	7.4	1.8	0.7		
27	980.0	40.0	7.4	1.9	0.6		
28	900.0	34.0	7.4	1.8	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: December 1997


PLANT EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT

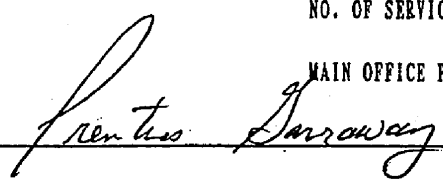

, C.O., CBET. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	NUMBER BACT OF MCI SAMPLES VIOL TAKEN TION
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	lbs	mg/l		
<hr/>										
MONTHLY TOTAL	85758.0	2760.0	120.0	225.0	53.1	13.0	3034.5	131.7	0.07	30
AVERAGE	2766.4	89.0	3.9	7.3	1.7	0.6	97.9	4.2	0.04	
MAXIMUM	3159.0	110.0	4.4	7.6	2.7	0.9	136.7	6.4	0.05	
MINIMUM	2181.0	80.0	3.5	7.1	0.9	0.4	47.9	2.0	0.02	
<hr/>										
01	3159.0	110.0	3.8	7.2	1.0	0.4	125.5	4.8		15
02	2939.0	100.0	3.8	7.3	1.0	0.5	113.2	4.6		
03	2988.0	100.0	3.5	7.4	0.9	0.5	127.0	5.1		15
04	3019.0	100.0	4.1	7.3	1.4	0.6	111.7	4.4	0.05	
05	2851.0	90.0	4.1	7.2	1.6	0.5	101.5	4.3		
06	2778.0	90.0	3.8	7.6	2.0		108.1	4.7		
07	2821.0	90.0	4.4	7.4	2.3		121.4	5.2		
08	3131.0	110.0	3.9	7.2	1.8	0.5	117.3	4.5		
09	2890.0	90.0	3.9	7.3	1.3	0.4	116.8	4.8		
10	2995.0	100.0	3.8	7.2	1.4	0.4	114.2	4.6		
11	2841.0	90.0	3.8	7.3	2.5	0.8	101.5	4.3		
12	2712.0	90.0	3.7	7.2	1.2	0.6	100.5	4.4		
13	2563.0	80.0	3.5	7.3	1.6		136.7	6.4		
14	2642.0	80.0	3.8	7.3	1.9		66.8	3.0		
15	2896.0	90.0	3.8	7.3	1.7	0.7	47.9	2.0		
16	2872.0	90.0	3.8	7.1	1.6	0.6	91.8	3.8		
17	2848.0	90.0	3.7	7.1	2.0	0.7	98.9	4.2		
18	3080.0	90.0	3.6	7.3	1.3	0.7	107.6	4.2	0.02	
19	2733.0	80.0	3.7	7.2	1.4	0.6	82.6	3.6		
20	2595.0	80.0	4.0	7.2	2.5		102.0	4.7		
21	2520.0	80.0	3.8	7.2	2.7		88.2	4.2		
22	2854.0	90.0	4.0	7.2	1.6	0.5	96.4	4.1		
23	2772.0	90.0	3.7	7.2	1.2	0.6	107.1	4.6		
24	2488.0	80.0	4.2	7.3	1.6	0.7	86.2	4.2		
25	2181.0	80.0	3.8	7.3	2.2		80.1	4.4		
26	2507.0	80.0	3.9	7.3	2.0	0.6	88.2	4.2		
27	2345.0	80.0	3.8	7.2	2.5		85.7	4.4		
28	2322.0	80.0	4.0	7.2	2.5		82.1	4.2		
29	2720.0	80.0	4.0	7.3	1.0	0.5	86.7	3.8		
30	2861.0	90.0	4.1	7.2	1.8	0.9	50.5	2.1		
31	2835.0	90.0	4.2	7.2	1.6	0.7	90.3	3.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PNS ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM JAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT Rebecca Larraway, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	NUMBER BACT OF MCL SAMPLES VIOL TAKEN TION
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	lbs	mg/l		
MONTHLY TOTAL	88454.0	2880.0	116.5	215.6	52.3	10.1	2451.1	99.5	0.40	30
AVERAGE	2948.5	96.0	3.9	7.2	1.7	0.6	81.7	3.3	0.20	
MAXIMUM	3231.0	120.0	4.5	7.4	2.4	0.7	128.5	4.8	0.35	
MINIMUM	2599.0	80.0	3.6	7.0	0.7	0.4	42.8	1.8	0.05	
01	2833.0	90.0	3.8	7.2	1.7		90.3	3.8		
02	2821.0	90.0	3.8	7.2	1.7		92.3	3.9		
03	3013.0	100.0	4.0	7.1	1.2	0.5	57.6	2.3		15
04	3049.0	100.0	3.9	7.1	1.9	0.6	74.5	2.9		
05	2999.0	100.0	4.0	7.0	1.7	0.7	70.4	2.8		15
06	3060.0	100.0	3.9	7.2	2.2	0.7	63.8	2.5		
07	2988.0	100.0	4.0	7.2	2.4	0.6	57.1	2.3	0.05	
08	2843.0	90.0	3.8	7.2	2.4		90.8	3.8		
09	2800.0	90.0	3.9	7.1	2.1		75.0	3.2		
10	2992.0	90.0	3.6	7.2	2.0	0.6	59.2	2.4		
11	3231.0	120.0	4.5	7.3	1.0	0.5	128.5	4.8		
12	2735.0	90.0	3.9	7.2	1.6	0.7	53.6	2.3		
13	3010.0	100.0	4.0	7.3	0.7	0.6	87.2	3.5		
14	2912.0	90.0	3.7	7.4	1.0	0.5	42.8	1.8		
15	2804.0	90.0	3.9	7.2	1.9		86.7	3.7		
16	2911.0	90.0	3.7	7.2	2.2		94.3	3.9		
17	3061.0	100.0	3.9	7.1	1.3	0.5	122.4	4.8		
18	3100.0	110.0	4.3	7.1	1.1	0.4	107.1	4.1		
19	3070.0	100.0	3.9	7.2	2.0	0.5	81.1	3.2	0.35	
20	3038.0	100.0	3.9	7.2	1.3	0.5	112.7	4.5		
21	3038.0	100.0	3.9	7.2	1.8	0.4	60.7	2.4		
22	2884.0	90.0	3.7	7.2	1.2		47.9	2.0		
23	2895.0	90.0	3.7	7.3	1.9		88.2	3.7		
24	3006.0	100.0	3.6	7.2	2.0	0.6	121.4	4.8		
25	3141.0	110.0	4.2	7.2	2.1	0.5	113.2	4.3		
26	2991.0	100.0	4.0	7.2	2.0	0.7	62.2	2.5		
27	2599.0	80.0	3.7	7.2	2.1		66.3	3.1		
28	2878.0	90.0	3.8	7.1	1.7		61.7	2.6		
29	2865.0	90.0	3.8	7.2	2.0		90.3	3.8		
30	2887.0	90.0	3.7	7.1	2.1		91.8	3.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: L LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT Prentiss Iversen, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	NUMBER BACTI OF MCL SAMPLES VIOL-TAKEN TIONS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	lbs	mg/l		
MONTHLY TOTAL	94494.0	3210.0	126.2	222.6	44.8	13.9	2714.2	106.7	0.28	30
AVERAGE	3048.2	103.5	4.1	7.2	1.4	0.6	87.6	3.4	0.14	
MAXIMUM	3327.0	120.0	4.5	7.4	2.3	0.8	122.4	4.9	0.23	
MINIMUM	2742.0	90.0	3.7	6.9	0.5	0.4	47.9	1.9	0.05	
01	3243.0	120.0	4.4	7.4	1.6	0.5	72.4	2.7		
02	3225.0	120.0	4.5	7.3	0.9	0.6	65.8	2.4		
03	3257.0	120.0	4.4	7.3	0.5	0.7	118.8	4.4	0.05	
04	3012.0	100.0	4.0	7.3	1.0		100.5	4.0		
05	3031.0	100.0	4.0	7.3	1.9		96.9	3.8		
06	3210.0	120.0	4.5	7.2	1.6	0.5	72.4	2.7		
07	3190.0	110.0	4.1	7.1	2.0	0.6	65.8	2.5		
08	3327.0	120.0	4.3	7.2	1.6	0.7	83.6	3.0		15
09	3217.0	120.0	4.5	7.2	1.6	0.6	68.3	2.5		
10	2742.0	90.0	3.9	7.2	1.5	0.4	56.1	2.5		
11	2857.0	90.0	3.8	7.2	1.6		55.1	2.3		
12	2867.0	90.0	3.8	7.2	1.8		54.1	2.3		
13	3160.0	110.0	4.2	7.0	1.8	0.5	110.7	4.2		
14	3095.0	100.0	3.9	7.2	1.4	0.4	121.4	4.7		15
15	3095.0	100.0	3.9	7.1	1.5	0.7	80.6	3.1		
16	2960.0	100.0	4.1	7.2	1.4	0.6	94.3	3.8	0.23	
17	2960.0	100.0	4.1	6.9	1.8	0.7	86.7	3.5		
18	2807.0	90.0	3.8	7.1	1.6		52.5	2.2		
19	2872.0	90.0	3.8	7.2	1.6		90.3	3.8		
20	3132.0	110.0	4.2	7.2	1.3	0.6	121.9	4.7		
21	3140.0	110.0	4.2	7.2	1.1	0.7	122.4	4.7		
22	3214.0	120.0	4.5	7.1	0.5	0.5	122.4	4.6		
23	3115.0	110.0	4.2	7.3	1.0	0.5	76.0	2.9		
24	3063.0	100.0	3.9	7.2	1.4	0.7	47.9	1.9		
25	2860.0	90.0	3.8	7.2	2.3	0.6	91.8	3.9		
26	2958.0	100.0	4.1	7.2	2.0		96.9	3.9		
27	2943.0	90.0	3.7	7.1	1.6	0.8	89.8	3.7		
28	3057.0	100.0	3.9	7.2	1.3	0.5	108.6	4.3		
29	2978.0	100.0	4.0	7.1	1.2	0.4	90.3	3.6		
30	3007.0	100.0	4.0	7.1	1.3	0.5	122.4	4.9		
31	2900.0	90.0	3.7	7.1	1.1	0.6	77.5	3.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: RURAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT *Robert S. Sweeney*, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	NUMBER BA OF M SAMPLES VI TAKEN TI
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	lbs	mg/l		
MONTHLY TOTAL	95580.0	3330.0	125.1	215.7	49.6	13.1	2030.3	76.6	0.32	30
AVERAGE	3186.0	111.0	4.2	7.2	1.7	0.6	67.7	2.6	0.16	
MAXIMUM	3478.0	120.0	4.5	7.4	2.2	0.7	109.7	4.1	0.22	
MINIMUM	2827.0	80.0	3.3	7.0	0.8	0.4	24.5	0.9	0.10	
01	2931.0	80.0	3.3	7.2	2.0	0.6	52.0	2.1		
02	3020.0	100.0	4.0	7.0	1.8	0.6	74.5	3.0		
03	3105.0	110.0	4.3	7.1	2.2	0.7	89.8	3.5		
04	3037.0	110.0	4.3	7.1	1.5	0.6	104.6	4.1	0.22	
05	3105.0	100.0	3.9	7.3	0.8	0.7	102.5	4.0		
06	2980.0	100.0	4.0	7.1	2.0		72.9	2.9		
07	2902.0	100.0	4.1	7.1	2.0		52.5	2.2		
08	3238.0	120.0	4.4	7.3	1.6	0.7	66.8	2.5		15
09	3197.0	100.0	3.8	7.0	1.5	0.6	70.4	2.6		
10	3358.0	120.0	4.3	7.3	1.2	0.5	109.7	3.9		
11	3220.0	120.0	4.5	7.2	1.0	0.7	59.7	2.2		
12	3319.0	120.0	4.3	7.2	1.5	0.4	59.7	2.2		
13	3059.0	100.0	3.9	7.3	2.0		77.0	3.0		
14	3072.0	100.0	3.9	7.2	2.0		95.4	3.7		
15	3330.0	120.0	4.3	7.2	1.6	0.5	24.5	0.9		15
16	3185.0	110.0	4.1	7.2	2.0	0.6	26.5	1.0		
17	3345.0	120.0	4.3	7.2	1.8	0.6	59.7	2.1		
18	3330.0	120.0	4.3	7.2	1.6	0.5	77.0	2.8	0.10	
19	3349.0	120.0	4.3	7.1	1.5	0.6	51.5	1.8		
20	3223.0	110.0	4.1	7.2	2.0		25.5	0.9		
21	3330.0	120.0	4.3	7.2	1.7		60.7	2.2		
22	3478.0	120.0	4.1	7.1	1.7	0.6	81.1	2.8		
23	3360.0	120.0	4.3	7.3	0.9	0.7	109.1	3.9		
24	3300.0	120.0	4.4	7.1	1.4	0.6	31.6	1.1		
25	3328.0	120.0	4.3	7.3	1.6	0.6	66.3	2.4		
26	3158.0	110.0	4.2	7.4	1.4	0.7	62.2	2.4		
27	2827.0	100.0	4.2	7.2	1.8		56.1	2.4		
28	2934.0	100.0	4.1	7.3	2.0		50.5	2.1		
29	3221.0	120.0	4.5	7.3	1.8	0.5	94.9	3.5		
30	3339.0	120.0	4.3	7.0	1.7	0.5	65.8	2.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT Prentiss Garaway, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE ng/L	NUMBER OF SAMPLES TAKEN	BACTERIAL MCL VIOLATIONS
		GALS. OR LBS. USED	ng/l		PLANT EFFLUENT	REMOTE TAP	lbs	ng/l			
MONTHLY TOTAL	96028.0	3640.0	141.1	223.2	50.9	12.2	1940.4	75.1	0.16	30	
AVERAGE	3097.7	117.4	4.6	7.2	1.6	0.6	62.6	2.4	0.08		
MAXIMUM	3981.0	150.0	5.8	7.4	2.3	0.7	100.6	3.9	0.10		
MINIMUM	2777.0	70.0	3.0	7.0	1.0	0.4	22.8	0.9	0.06		
01	3046.0	120.0	4.7	7.3	1.0	0.4	58.0	2.3			
02	3046.0	120.0	4.7	7.3	2.0		35.2	1.4			
03	3046.0	120.0	4.7	7.4	1.4		73.3	2.9			
04	3046.0	120.0	4.7	7.4	1.0	0.4	70.0	2.8			
05	3046.0	120.0	4.7	7.3	1.6	0.5	89.8	3.5			
06	3046.0	120.0	4.7	7.0	1.5	0.6	29.8	1.2	0.06		
07	3120.0	120.0	4.6	7.2	1.0	0.7	40.2	1.5		15	
08	3098.0	120.0	4.6	7.2	1.0	0.4	100.2	3.9			
09	2870.0	120.0	5.0	7.2	2.1		71.2	3.0			
10	2878.0	110.0	4.6	7.2	2.1		71.6	3.0			
11	3101.0	150.0	5.8	7.0	2.2	0.7	84.9	3.3		15	
12	2954.0	130.0	5.3	7.0	2.2	0.6	44.3	1.8			
13	3123.0	130.0	5.0	7.0	2.2	0.7	69.1	2.7			
14	3150.0	130.0	5.0	7.0	1.4	0.7	100.6	3.8			
15	3021.0	130.0	5.2	7.1	1.6	0.6	67.9	2.7			
16	2944.0	140.0	5.7	7.1	2.3		71.2	2.9			
17	2834.0	70.0	3.0	7.0	2.1		37.3	1.6			
18	3199.0	120.0	4.5	7.3	1.0	0.4	52.2	2.0			
19	3035.0	120.0	4.7	7.3	1.0	0.6	22.8	0.9			
20	3118.0	100.0	3.8	7.3	1.0	0.7	48.4	1.9			
21	3160.0	100.0	3.8	7.3	1.4	0.6	69.1	2.6			
22	3285.0	120.0	4.4	7.3	1.5	0.6	72.9	2.7	0.10		
23	2934.0	110.0	4.5	7.2	2.0		50.9	2.1			
24	2777.0	100.0	4.3	7.3	2.0		61.3	2.6			
25	3239.0	120.0	4.4	7.3	1.2	0.6	96.5	3.6			
26	3229.0	120.0	4.4	7.1	1.9	0.6	62.1	2.3			
27	3981.0	120.0	3.6	7.2	1.5	0.7	64.6	1.9			
28	3605.0	120.0	4.0	7.2	1.9	0.5	82.8	2.8			
29	3296.0	120.0	4.4	7.2	1.8	0.6	55.1	2.0			
30	3021.0	100.0	4.0	7.3	2.1		43.9	1.7			
31	2780.0	100.0	4.3	7.2	1.9		43.5	1.9			

Flow averaged from 7/1 to 7/6, flow meter back in service 7/7/97.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997


PLANT EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT

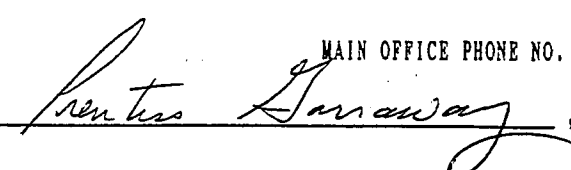

, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTI MCL VIOLA-TIONS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	lbs	mg/l			
<hr/>											
MONTHLY TOTAL	94563.0	3220.0	125.9	226.7	50.5	14.4	1663.0	65.4	0.14	30	
AVERAGE	3050.4	103.9	4.1	7.3	1.6	0.6	53.6	2.1	0.07		
MAXIMUM	3183.0	110.0	4.3	7.5	2.4	0.9	100.2	3.9	0.09		
MINIMUM	3046.0	90.0	3.5	7.0	0.9	0.4	23.6	0.9	0.05		
<hr/>											
01	3183.0	110.0	4.1	7.3	1.6	0.5	49.7	1.9			
02	3046.0	100.0	3.9	7.3	1.8	0.7	63.3	2.5			
03	3046.0	110.0	4.3	7.3	1.6	0.6	48.9	1.9			
04	3046.0	100.0	4.3	7.4	1.8	0.7	33.1	1.3			
05	3046.0	110.0	4.3	7.4	2.2		37.7	1.5			
06	3046.0	100.0	3.9	7.4	2.4		33.1	1.3			
07	3046.0	100.0	3.9	7.3	0.9	0.5	48.9	1.9			
08	3046.0	90.0	3.5	7.3	0.9	0.4	63.3	2.5		15	
09	3046.0	90.0	3.5	7.5	1.7	0.5	49.7	2.0		15	
10	3046.0	100.0	3.9	7.3	1.0	0.5	45.5	1.8			
11	3046.0	100.0	3.9	7.4	2.0	0.6	46.4	1.8	0.09		
12	3046.0	110.0	4.3	7.4	2.0		41.4	1.6			
13	3046.0	110.0	4.3	7.4	2.4		39.7	1.6			
14	3046.0	110.0	4.3	7.3	1.0	0.6	48.4	1.9			
15	3046.0	110.0	4.3	7.3	1.6	0.7	50.1	2.0			
16	3046.0	100.0	3.9	7.3	1.2	0.6	50.1	2.0			
17	3046.0	100.0	3.9	7.4	1.6	0.7	77.4	3.0			
18	3046.0	100.0	3.9	7.4	1.5	0.7	84.5	3.3			
19	3046.0	110.0	4.3	7.2	1.7		58.4	2.3			
20	3046.0	110.0	4.3	7.2	1.8		69.6	2.7			
21	3046.0	110.0	4.3	7.3	1.9	0.8	100.2	3.9			
22	3046.0	100.0	3.9	7.3	1.4	0.9	44.3	1.7			
23	3046.0	100.0	3.9	7.2	1.7	0.7	70.0	2.8			
24	3046.0	110.0	4.3	7.0	1.6	0.8	23.6	0.9			
25	3046.0	100.0	3.9	7.3	1.6	0.7	33.9	1.3	0.05		
26	3046.0	100.0	3.9	7.3	2.0		72.0	2.8			
27	3046.0	100.0	3.9	7.3	1.6		67.5	2.7			
28	3046.0	100.0	3.9	7.4	1.4	0.5	60.0	2.4			
29	3046.0	110.0	4.3	7.1	2.0	0.6	50.5	2.0			
30	3046.0	110.0	4.3	7.4	1.4	0.6	55.9	2.2			
31	3046.0	110.0	4.3	7.3	1.2	0.5	46.0	1.8			

Flow averaged from 7/2 due to flow meter O/S.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2150980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: June 1997

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DAILY AVERAGE FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4500

I CERTIFY THIS REPORT IS CORRECT

Pen to Sam away

, C.O., CERT. NO. C-5698

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/l	EFFLUENT pH	RESIDUAL CHLORINE mg/l	PLANT EFFLUENT	REMOTE TAP	ZINC POLYPHOSPHATE lbs	ZINC mg/l	ORTHO PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIAL MCL VIOLATIONS
DAILY TOTAL	91371.0	2876.0	112.3	7.3	47.5	13.5	1320.2	51.9	0.10		30	
PERAGE	3045.7	95.9	3.7	7.3	1.6	0.6	44.0	1.7	0.05			
MINIMUM	3352.0	150.0	6.0	7.4	2.2	0.8	57.5	2.2	0.05			
MAXIMUM	2717.0	40.0	1.5	7.0	1.0	0.4	29.4	1.3	0.05			
01	2930.0	140.0	5.7	7.2	2.1		40.6	1.7				
02	3352.0	100.0	3.6	7.2	1.0	0.6	50.9	1.8				
03	3282.0	100.0	3.6	7.1	1.0	0.6	52.6	1.9				
04	3235.0	110.0	4.1	7.4	1.0	0.7	46.0	1.7			15	
05	3050.0	80.0	3.1	7.2	1.2	0.8	40.2	1.6				
06	3071.0	75.0	2.9	7.3	1.2	0.4	46.4	1.8				
07	2800.0	75.0	3.2	7.2	1.7		36.4	1.6				
08	2772.0	75.0	3.2	7.2	1.8		29.4	1.3				
09	3122.0	75.0	2.9	7.1	1.6	0.6	44.7	1.7				
10	3165.0	90.0	3.4	7.0	1.6	0.5	47.2	1.8				
11	3292.0	80.0	2.9	7.4	1.5	0.7	47.2	1.7			15	
12	3083.0	90.0	3.5	7.3	1.8	0.6	46.4	1.8	< 0.05			
13	3071.0	90.0	3.5	7.3	1.5	0.7	53.8	2.1				
14	2866.0	70.0	2.9	7.3	2.0		39.7	1.7				
15	2805.0	100.0	4.3	7.3	2.2		34.4	1.5				
16	3203.0	40.0	1.5	7.4	1.7	0.8	46.8	1.8				
17	3071.0	100.0	3.9	7.3	1.4	0.7	57.5	2.2				
18	3114.0	120.0	4.6	7.3	1.4	0.6	43.9	1.7				
19	2990.0	150.0	6.0	7.2	1.8	0.8	41.0	1.6				
20	3060.0	70.0	2.7	7.2	1.7	0.7	45.1	1.8				
21	2879.0	116.0	3.7	7.2	2.0		40.6	1.7				
22	2819.0	108.0	4.6	7.3	2.0		36.8	1.6				
23	3082.0	108.0	4.2	7.3	1.8	0.7	33.9	1.3				
24	3082.0	108.0	4.2	7.3	1.1	0.6	45.1	1.8				
25	3233.0	116.0	4.3	7.3	1.0	0.7	50.5	1.9				
26	3140.0	100.0	3.8	7.3	1.5	0.6	53.4	2.0	< 0.05			
27	3095.0	70.0	2.7	7.3	1.4	0.5	46.4	1.8				
28	2939.0	110.0	4.5	7.3	1.9		41.8	1.7				
29	2717.0	120.0	5.3	7.3	1.6		35.2	1.6				
30	3051.0	90.0	3.5	7.2	2.0	0.6	46.4	1.8				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: May 1997

AVERAGE pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DATE: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I HEREBY CERTIFY THAT THIS REPORT IS CORRECT Robert J. Faraway, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/l	EFFLUENT pH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
					PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	100461.0	3000.0	109.7	225.6	55.5	14.0	30
AVERAGE	3240.7	96.8	3.5	7.3	1.8	0.6	
MAXIMUM	3562.0	115.0	4.4	7.4	2.9	0.8	
MINIMUM	2985.0	80.0	2.9	7.2	1.1	0.4	
01	3365.0	100.0	3.6	7.3	2.9	0.6	
02	3286.0	100.0	3.7	7.2	2.0	0.7	
03	3103.0	100.0	3.9	7.2	2.5		
04	3060.0	100.0	3.9	7.3	2.5		
05	3356.0	100.0	3.6	7.3	2.5	0.8	
06	3414.0	110.0	3.9	7.3	1.4	0.6	
07	3371.0	90.0	3.2	7.3	1.5	0.7	15
08	3285.0	80.0	2.9	7.3	1.8	0.7	
09	3324.0	100.0	3.6	7.3	2.2	0.6	
10	3136.0	90.0	3.4	7.3	2.0		
11	3036.0	90.0	3.6	7.3	2.4		
12	3107.0	90.0	3.3	7.3	1.1	0.7	
13	3358.0	100.0	3.6	7.3	1.4	0.6	
14	3329.0	100.0	3.6	7.3	1.4	0.8	15
15	3270.0	90.0	3.1	7.4	1.7	0.7	
16	3304.0	100.0	3.6	7.3	1.9	0.6	
17	3094.0	90.0	3.3	7.3	1.6		
18	3037.0	100.0	4.0	7.3	1.8		
19	3350.0	100.0	3.6	7.2	1.6	0.5	
20	3470.0	100.0	3.5	7.3	1.5	0.7	
21	3485.0	100.0	3.4	7.2	1.6	0.5	
22	3265.0	90.0	3.1	7.2	1.5	0.6	
23	3288.0	90.0	3.1	7.3	1.4	0.7	
24	3111.0	90.0	3.3	7.3	1.7		
25	3004.0	90.0	3.4	7.3	1.8		
26	3215.0	90.0	3.2	7.2	1.9	0.4	
27	3562.0	100.0	3.4	7.3	1.6	0.5	
28	3165.0	90.0	3.2	7.2	1.4	0.7	
29	3180.0	115.0	4.3	7.3	1.5	0.6	
30	3146.0	115.0	4.4	7.2	1.6	0.7	
31	2985.0	100.0	4.0	7.3	1.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: April 1997

AVERAGE pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

MAIN OFFICE PHONE NO. (904) 721-4600

THIS REPORT IS CORRECT Robert M. Saraway, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	mg/l	EFFLUENT pH	RESIDUAL CHLORINE mg/l PLANT EFFLUENT	REMOTE TAP	BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
MONTHLY TOTAL	96605.0	3080.0	114.6	7.4	60.3	12.8	30	
AVERAGE	3220.2	102.7	3.8	7.4	2.0	0.6		
MAXIMUM	3453.0	170.0	6.4	7.5	3.0	1.0		
MINIMUM	2736.0	60.0	2.1	7.0	1.4	0.2		
01	3306.0	70.0	2.5	7.4	1.4	0.4		
02	3361.0	90.0	3.2	7.4	1.6	0.3		
03	3342.0	100.0	3.6	7.4	2.2	0.3		
04	3384.0	90.0	3.2	7.4	1.4	0.2		
05	3059.0	80.0	3.1	7.4	1.5			
06	3065.0	70.0	2.7	7.4	2.0			
07	3341.0	150.0	5.4	7.3	1.8	0.4	15	
08	3294.0	80.0	2.9	7.4	2.2	0.6		
09	3338.0	120.0	4.3	7.3	2.2	0.7		
10	3277.0	90.0	3.3	7.3	1.5	0.5	15	
11	3290.0	100.0	3.6	7.3	1.8	0.5		
12	3005.0	100.0	4.0	7.4	2.1			
13	3120.0	110.0	4.2	7.4	2.2			
14	3112.0	130.0	5.0	7.3	2.0	0.7		
15	3111.0	80.0	3.1	7.4	1.6	0.6		
16	3255.0	150.0	5.5	7.4	1.8	0.7		
17	3165.0	170.0	6.4	7.3	2.0	0.8		
18	3343.0	80.0	2.9	7.5	2.1	0.6		
19	3079.0	100.0	3.9	7.4	2.2			
20	3135.0	100.0	3.8	7.4	2.4			
21	3453.0	100.0	3.5	7.4	2.0	1.0		
22	3358.0	120.0	4.3	7.0	1.5	0.8		
23	3412.0	110.0	3.9	7.4	2.1	0.7		
24	3405.0	60.0	2.1	7.4	2.4	0.7		
25	3295.0	60.0	2.2	7.3	1.8	0.5		
26	2902.0	80.0	3.3	7.3	1.9			
27	2736.0	80.0	3.5	7.3	2.1			
28	3160.0	145.0	5.5	7.4	2.7	0.5		
29	3334.0	145.0	5.2	7.5	3.0	0.6		
30	3168.0	120.0	4.5	7.4	2.8	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160980 C.U.P. NO. 2-031-0036H

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: March 1997

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT *Rebecca M. Harranney*, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/l	NUMBER BACTI OF NCL SAMPLES VIOL-TAKEN TIONS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	lbs	mg/l		
MONTHLY TOTAL	101839.0	3095.0	111.9	230.4	57.0	9.2				30
AVERAGE	3285.1	99.8	3.6	7.4	1.8	0.5				
MAXIMUM	3573.0	160.0	5.7	7.5	3.0	0.7				
MINIMUM	3043.0	50.0	2.0	7.3	1.2	0.3				
01	3043.0	50.0	2.0	7.5	2.2					
02	3057.0	60.0	2.4	7.5	2.8					
03	3275.0	70.0	2.6	7.4	1.4	0.4				
04	3573.0	120.0	4.0	7.4	1.4	0.4				
05	3421.0	120.0	4.2	7.4	1.4	0.3				15
06	3365.0	160.0	5.7	7.5	1.4	0.5				
07	3275.0	80.0	2.9	7.5	1.6	0.4				
08	3075.0	80.0	3.1	7.5	2.0					
09	3117.0	80.0	2.3	7.5	2.2					
10	3511.0	80.0	2.7	7.4	1.4	0.4				
11	3487.0	100.0	3.4	7.4	1.4	0.3				
12	3447.0	80.0	2.8	7.5	2.5	0.5				
13	3335.0	110.0	4.0	7.4	1.2	0.6				
14	3166.0	130.0	4.9	7.5	1.5	0.4				
15	3098.0	130.0	5.0	7.4	1.7					
16	3100.0	60.0	2.3	7.5	1.6					
17	3406.0	90.0	3.2	7.4	1.6	0.4				15
18	3302.0	120.0	4.4	7.4	1.7	0.5				
19	3361.0	80.0	2.9	7.4	1.6	0.5				
20	3295.0	110.0	4.0	7.4	2.2	0.6				
21	3222.0	110.0	4.0	7.5	3.0	0.7				
22	3151.0	100.0	3.8	7.4	2.1					
23	3109.0	120.0	4.6	7.4	2.7					
24	3382.0	60.0	2.0	7.4	2.5	0.6				
25	3336.0	100.0	3.6	7.4	1.5	0.5				
26	3420.0	110.0	3.9	7.4	1.4	0.4				
27	3420.0	115.0	4.0	7.4	1.4	0.5				
28	3425.0	100.0	3.5	7.4	1.4					
29	3136.0	90.0	3.4	7.3	2.2					
30	3090.0	120.0	4.7	7.4	2.4					
31	3439.0	160.0	5.6	7.5	1.6	0.3				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: February 1997

AVG pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

OWNER: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT

Robert S. Sawney

, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	87803.0	1815.0	69.6	208.9	43.7	9.8	30	
AVERAGE	3135.8	64.8	2.5	7.5	1.6	0.5		
MAXIMUM	3353.0	65.0	2.8	7.6	3.0	0.7		
MINIMUM	2836.0	60.0	2.3	7.2	1.0	0.4		
01	2970.0	65.0	2.6	7.5	1.0			
02	2947.0	65.0	2.6	7.4	1.1			
03	3285.0	65.0	2.4	7.4	1.2	0.5		
04	3206.0	65.0	2.4	7.5	2.5	0.4	15	
05	3314.0	65.0	2.4	7.4	2.0	0.4		
06	3200.0	65.0	2.4	7.5	1.7	0.5	15	
07	3150.0	65.0	2.5	7.4	1.6	0.4		
08	3034.0	65.0	2.6	7.4	2.0			
09	2964.0	65.0	2.6	7.4	3.0			
10	3219.0	65.0	2.4	7.4	2.0	0.5		
11	3177.0	65.0	2.5	7.5	1.0	0.5		
12	3226.0	65.0	2.4	7.5	1.7	0.6		
13	3200.0	65.0	2.4	7.5	1.4	0.6		
14	3131.0	65.0	2.5	7.5	1.0	0.6		
15	2857.0	65.0	2.7	7.5	2.0			
16	2836.0	65.0	2.8	7.4	2.4			
17	3168.0	65.0	2.5	7.5	1.3			
18	3190.0	65.0	2.4	7.6	1.4	0.5		
19	3353.0	65.0	2.3	7.5	1.2	0.6		
20	3352.0	65.0	2.3	7.4	1.0	0.5		
21	3180.0	65.0	2.5	7.5	1.5	0.4		
22	2989.0	65.0	2.6	7.5	1.1			
23	2889.0	65.0	2.7	7.4	1.9			
24	3188.0	65.0	2.4	7.6	1.6	0.4		
25	3129.0	65.0	2.5	7.5	1.6	0.6		
26	3198.0	65.0	2.4	7.5	1.5	0.5		
27	3155.0	65.0	2.3	7.2	1.0	0.7		
28	3296.0	60.0	2.5	7.5	1.0	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

3 ID NO. 2160980 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: ROY LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: January 1997

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DAILY SIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

Robert S. Sawaway

, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
DAILY	98488.0	2560.0	96.8	231.1	57.4	11.3	30	
AVERAGE	3177.0	82.6	3.1	7.5	1.9	0.5		
MAXIMUM	3676.0	160.0	5.9	7.5	3.5	0.7		
MINIMUM	2756.0	40.0	1.4	7.3	1.0	0.3		
01	3043.0	100.0	3.9	7.5	2.4			
02	3327.0	40.0	1.4	7.4	2.0	0.7		
03	3237.0	130.0	4.8	7.5	1.6	0.5		
04	2987.0	110.0	4.4	7.4	2.6			
05	3107.0	100.0	3.9	7.4	2.6			
06	3287.0	120.0	4.4	7.4	1.6	0.7		
07	3297.0	120.0	4.4	7.4	1.3	0.6		
08	3255.0	90.0	3.3	7.4	1.6	0.6		
09	3270.0	160.0	5.9	7.4	1.8	0.7		
10	3045.0	100.0	3.9	7.5	1.4	0.4		
11	2756.0	110.0	4.8	7.5	1.5			
12	2876.0	80.0	3.3	7.4	1.3			
13	3095.0	50.0	1.9	7.5	1.2	0.5		
14	3217.0	60.0	2.2	7.5	1.0	0.4		
15	3076.0	70.0	2.7	7.5	1.4	0.5		
16	3165.0	90.0	3.4	7.4	1.4	0.6		
17	3317.0	90.0	3.3	7.5	1.6	0.5		
18	3140.0	80.0	3.1	7.5	3.0			
19	2880.0	40.0	1.7	7.3	3.5			
20	3237.0	100.0	3.7	7.3	2.5	0.6	15	
21	3198.0	90.0	3.4	7.5	3.0	0.5		
22	3408.0	61.0	2.1	7.5	1.7	0.4	15	
23	3676.0	61.0	2.0	7.5	1.9	0.5		
24	3036.0	61.0	2.4	7.5	2.0	0.5		
25	3036.0	61.0	2.4	7.5	2.0			
26	3036.0	64.0	2.5	7.5	2.6			
27	3269.0	64.0	2.3	7.5	1.8	0.3		
28	3335.0	64.0	2.3	7.5	1.2	0.5		
29	3308.0	64.0	2.3	7.5	1.0	0.5		
30	3329.0	70.0	2.5	7.5	1.6	0.4		
31	3243.0	60.0	2.2	7.4	1.3	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 6.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas G. Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIAL VIOLATION AND COMMENT
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L			
MONTHLY TOTAL											
TOTAL	54565.0	4720.0	321.9	213.3	61.6	12.9	2971.8	202.8			
MONTHLY AVERAGE											
AVERAGE	1760.2	152.3	10.4	6.9	2.0	0.6	95.9	6.5			
MONTHLY MAXIMUM											
MAXIMUM	2039.0	220.0	15.6	7.1	3.2	1.1	122.4	8.1			
MONTHLY MINIMUM											
MINIMUM	1529.0	80.0	5.4	6.7	0.9	0.3	80.6	5.4			
01	2039.0	220.0	12.9	7.0	2.5	0.9	92.3	5.4			
02	1764.0	170.0	11.6	7.0	1.9	0.5	89.6	5.5			
03	1838.0	150.0	9.8	7.0	1.4	0.8	82.1	5.4			
04	1746.0	180.0	12.4	6.9	1.8	0.3	96.4	6.6			
05	1809.0	160.0	10.6	6.9	0.9	0.4	122.4	8.1			
06	1813.0	180.0	11.9	7.0	1.3		95.4	6.3			
07	1950.0	180.0	11.1	6.9	1.2		105.6	6.5			
08	1843.0	120.0	7.8	6.8	1.6	0.9	105.6	6.9			
09	1779.0	120.0	8.1	6.7	1.9	0.9	119.9	8.1			
10	1712.0	180.0	12.6	6.8	2.0	0.8	99.5	7.0			
11	1661.0	180.0	13.0	6.8	2.4	1.1	94.9	6.9			
12	1529.0	130.0	10.2	6.7	2.4	0.5	81.6	6.4			
13	1647.0	150.0	10.9	6.7	2.8		81.1	5.9			
14	1793.0	180.0	12.0	6.7	2.6		98.9	6.6			
15	1757.0	160.0	10.9	6.8	3.1	1.0	97.4	6.7			
16	1678.0	120.0	8.6	6.8	3.2	0.9	87.2	6.2			
17	1800.0	120.0	8.0	6.7	1.7	0.5	92.3	6.2			
18	1772.0	140.0	9.5	7.1	1.2	0.4	97.9	6.6			
19	1692.0	100.0	7.1	7.0	2.3	0.5	110.2	7.8			
20	1796.0	110.0	7.3	7.0	1.7		96.4	6.4			
21	1782.0	80.0	5.4	7.0	1.0		93.3	6.3			
22	1795.0	180.0	12.0	7.0	3.0	0.3	100.0	6.7			
23	1698.0	160.0	11.3	7.1	1.5	0.3	96.4	6.8			
24	1683.0	120.0	8.6	6.9	1.8	0.5	85.2	6.1			
25	1629.0	120.0	8.8	6.9	2.6		99.5	7.3			
26	1693.0	220.0	15.6	6.9	1.8		86.7	6.1			
27	1627.0	200.0	14.8	6.9	2.5		81.6	6.0			
28	1731.0	140.0	9.7	6.8	2.0		96.9	6.7			
29	1738.0	120.0	8.3	6.8	2.2	0.5	89.3	6.2			
30	1899.0	140.0	8.8	6.9	1.7	0.4	103.0	6.5			
31	1872.0	190.0	12.2	6.8	1.6	0.5	102.5	6.6			

3 WELL SAMPLES TAKEN: 12-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: November 1997

AVERAGE EFFLUENT pH: 6.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas R. Jones, C.O., CERT. NO. C-002710

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIAL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L			
MONTHLY TOTAL	57204.0	5180.0	326.5	208.1	54.5	6.5	2970.8	187.3	0.85	25	
AVERAGE	1906.8	172.7	10.9	6.9	1.8	0.4	99.0	6.2			
MAXIMUM	2399.0	230.0	12.9	7.0	3.0	0.8	145.4	7.8			
MINIMUM	1660.0	140.0	9.2	6.8	0.8	0.2	80.6	5.3			
01	1747.0	170.0	11.7	7.0	2.6		97.9	6.7			
02	1872.0	200.0	12.8	7.0	3.0		85.2	5.5			
03	2399.0	190.0	9.5	7.0	2.0	0.5	145.4	7.3			12
04	1745.0	180.0	12.4	7.0	1.0	0.2	99.5	6.8			13
05	1852.0	150.0	9.7	6.9	1.3	0.8	96.9	6.3			
06	1783.0	190.0	12.8	6.9	2.3	0.3	92.3	6.2			
07	1779.0	140.0	9.4	6.9	2.0	0.3	96.9	6.5	0.42		
08	1967.0	200.0	12.2	7.0	1.0		105.6	6.4			
09	2079.0	160.0	9.2	7.0	2.4		122.4	7.1			
10	1829.0	180.0	11.8	7.0	2.0	0.4	108.6	7.1			
11	2010.0	160.0	9.6	6.9	0.8	0.4	109.1	6.5			
12	1833.0	140.0	9.2	7.0	1.0	0.4	97.4	6.4			
13	1660.0	140.0	10.1	6.9	2.0	0.2	108.1	7.8			
14	1696.0	160.0	11.3	6.9	1.5	0.3	98.4	7.0			
15	1950.0	180.0	11.1	7.0	1.1		103.0	6.3			
16	2078.0	160.0	9.2	6.9	1.4		113.2	6.5			
17	1865.0	160.0	10.3	6.8	1.3	0.4	100.0	6.4			
18	1788.0	150.0	10.1	6.9	2.0	0.3	102.0	6.8			
19	1910.0	180.0	11.3	6.9	1.7	0.4	101.0	6.3	0.43		
20	1818.0	180.0	11.9	6.9	1.0	0.3	101.5	6.7			
21	1930.0	180.0	11.2	6.8	1.2	0.3	88.7	5.5			
22	2118.0	180.0	10.2	6.8	2.6		93.8	5.3			
23	2146.0	230.0	12.9	6.9	2.1		97.4	5.4			
24	1971.0	180.0	11.0	6.9	2.9	0.3	89.8	5.5			
25	1984.0	180.0	10.9	7.0	1.5	0.3	92.3	5.6			
26	1988.0	190.0	11.5	6.9	1.5	0.4	88.2	5.3			
27	1946.0	190.0	11.7	7.0	1.9		89.3	5.5			
28	1806.0	140.0	9.3	7.0	2.1		83.6	5.6			
29	1818.0	180.0	11.9	7.0	2.4		80.6	5.3			
30	1837.0	160.0	10.5	7.0	2.9		82.6	5.4			

3 WELL SAMPLES TAKEN: 11-03-97

MINIMUM WATER TREATMENT (GAL) WATER UTILIZATION (GAL)

PWS ID NO. 2160998 C.U.P. NO. 2-031-0033 NAME OF DRINKING WATER SYSTEM: Jose Water Treatment Plant
 LOCATION: 7128 Balboa Road Jacksonville, Fla., Duval County
 OWNED BY: United Water Florida Inc. REPORTING MONTH: October 1997
 PLANT EFFLUENT PH: 6.9 (AVG) NO. OF SERVICES AT END OF MONTH: 3838
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2365

I CERTIFY THIS REPORT IS CORRECT Thomas G. Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIAL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L			
MONTHLY TOTAL	63384.0	5830.0	342.4	7.0	48.3	15.3	3478.2	205.2	0.33	25	
AVERAGE	2044.8	188.1	11.0	6.9	1.6	0.7	112.2	6.6			
MAXIMUM	2534.0	240.0	15.4	7.0	3.0	2.3	122.4	7.8			
MINIMUM	1534.0	120.0	8.3	6.9	0.7	0.3	94.3	5.8			
01	2174.0	200.0	11.0	7.0	1.0	2.0	118.8	6.6			
02	2534.0	220.0	10.4	6.9	0.9	0.3	122.4	6.8		12	
03	2055.0	180.0	10.5	6.9	0.7	0.3	119.9	7.0	0.05		
04	2141.0	180.0	10.1	6.9	1.2		109.7	6.1			
05	2342.0	190.0	9.7	6.9	2.0		122.4	6.3			
06	2181.0	200.0	11.0	6.9	1.0	0.3	104.6	5.8			
07	2254.0	210.0	11.2	6.9	1.2	0.4	122.4	6.5			
08	2357.0	240.0	12.2	6.9	1.2	0.6	122.4	6.2			
09	2153.0	190.0	10.6	6.9	1.0	0.6	121.9	6.8		13	
10	2083.0	220.0	12.7	6.9	1.5	0.5	122.4	7.0			
11	2105.0	240.0	13.7	6.9	1.4		114.2	6.5			
12	2272.0	220.0	11.6	6.9	2.8		119.3	6.3			
13	2111.0	210.0	11.9	6.9	1.8	0.4	117.8	6.7			
14	2199.0	190.0	10.7	7.0	1.2	0.5	116.3	6.5			
15	2040.0	220.0	12.9	7.0	1.5	0.3	105.6	6.2			
16	1795.0	180.0	12.0	7.0	2.5	0.4	96.9	6.5	0.28		
17	1943.0	160.0	9.9	7.0	1.3	0.6	122.4	7.5			
18	1865.0	180.9	11.9	6.9	1.6		108.1	7.0			
19	2152.0	220.0	12.3	7.0	3.0		113.7	6.3			
20	2048.0	209.0	11.7	7.0	1.3	2.3	113.8	6.8			
21	2073.0	160.0	8.3	6.9	1.5	0.8	108.6	6.3			
22	1998.0	180.0	10.8	6.9	1.8	0.4	112.7	6.2			
23	2096.0	180.0	10.3	7.0	1.8	0.4	110.2	6.3			
24	1849.0	160.0	10.4	6.9	1.5	0.5	99.5	6.5			
25	2037.0	160.0	9.4	6.9	1.6		103.0	6.1			
26	2141.0	160.0	9.0	7.0	1.8		122.4	6.9			
27	1725.0	120.0	8.3	7.0	1.5	1.2	98.9	6.9			
28	1712.0	220.0	15.4	7.0	2.0	0.4	94.3	6.6			
29	1780.0	140.0	9.4	7.0	2.0	0.7	103.0	6.9			
30	1890.0	160.0	11.4	7.0	1.4	0.7	109.1	7.7			
31	1534.0	140.0	11.0	6.9	1.3	0.7	99.5	7.8			

3 WELL SAMPLES TAKEN: 10-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: Rose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas R Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIAL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L			
MONTHLY TOTAL											
	68453.0	6380.0	336.5	208.6	46.5	8.2	3544.5	187.7	0.47	25	
AVERAGE											
	2281.8	212.7	11.2	7.0	1.6	0.4	118.2	6.3			
MAXIMUM											
	2749.0	260.0	14.3	7.0	2.8	0.7	122.4	7.6			
MINIMUM											
	1874.0	160.0	9.6	6.8	0.7	0.2	102.0	5.3			
01	2205.0	180.0	9.8	6.8	2.6		113.2	6.2			
02	2131.0	180.0	10.1	7.0	1.0	0.3	110.2	6.2			
03	2128.0	200.0	11.3	7.0	1.6	0.3	114.8	6.5			
04	1984.0	220.0	13.3	7.0	1.5	0.4	102.0	6.2	0.17		
05	2093.0	250.0	14.3	7.0	2.1	0.3	111.2	6.4			
06	2282.0	230.0	12.1	7.0	2.4		122.4	6.4			
07	2418.0	220.0	10.9	7.0	2.8		122.4	6.1			
08	2749.0	240.0	10.5	7.0	2.1	0.5	122.4	5.3		12	
09	2157.0	230.0	12.8	7.0	1.0	0.5	122.4	6.8			
10	2189.0	210.0	11.5	7.0	1.0	0.3	119.3	6.5		13	
11	2241.0	180.0	9.6	6.9	0.7	0.4	119.3	6.4			
12	2231.0	200.0	10.7	7.0	1.6	0.3	122.4	6.6			
13	2464.0	200.0	9.7	6.9	1.5		122.4	6.0			
14	2488.0	200.0	9.6	7.0	1.8		122.4	5.9			
15	2450.0	220.0	10.8	7.0	1.0	0.3	122.4	6.0			
16	2458.0	200.0	9.8	6.9	0.9	0.4	122.4	6.0			
17	2508.0	260.0	12.4	6.9	1.0	0.7	121.9	5.8			
18	2469.0	200.0	9.7	6.9	1.3	0.5	122.4	5.9	0.30		
19	2457.0	240.0	11.7	6.9	1.0		121.4	5.9			
20	2610.0	260.0	12.0	7.0	1.4		122.4	5.6			
21	2736.0	240.0	10.5	6.9	2.0		122.4	5.4			
22	2507.0	240.0	11.5	6.9	1.0	0.3	122.4	5.9			
23	2271.0	200.0	10.6	6.9	1.5	0.6	122.4	6.5			
24	2306.0	220.0	11.4	7.0	1.0	0.2	122.4	6.4			
25	2088.0	200.0	11.5	7.0	1.0	0.2	110.7	6.4			
26	1944.0	180.0	11.1	6.9	1.0	0.7	111.7	6.9			
27	1874.0	160.0	10.2	7.0	2.2		118.8	7.6			
28	2056.0	200.0	11.7	7.0	2.1		105.6	6.2			
29	1929.0	200.0	12.4	6.9	2.3	0.5	115.8	7.2			
30	2030.0	220.0	13.0	6.9	2.1	0.5	112.7	6.7			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM n Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas E Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L			
MONTHLY TOTAL	62921.0	5680.0	335.0	216.8	53.1	8.1	3399.7	201.5	0.32	25	
AVERAGE	2029.7	183.2	10.8	7.0	1.7	0.4	109.7	6.5	0.16		
MAXIMUM	2480.0	230.0	13.0	7.2	2.8	0.7	122.4	7.3	0.27		
MINIMUM	1800.0	140.0	8.8	6.7	0.7	0.3	97.9	5.5	0.05		
01	1800.0	160.0	10.6	7.1	2.6	0.3	108.6	7.2			
02	1890.0	170.0	10.8	7.2	2.2		97.9	6.2			
03	1905.0	140.0	8.8	7.1	2.8		97.9	6.2			
04	1914.0	170.0	10.7	7.2	2.1	0.3	106.1	6.7		12	
05	1889.0	170.0	10.8	7.1	1.0	0.7	110.7	7.0			
06	1988.0	190.0	11.5	7.0	1.0	0.3	112.7	6.8			
07	1870.0	160.0	10.3	7.0	1.9	0.4	104.0	6.7		13	
08	1867.0	150.0	9.6	7.1	1.8	0.4	98.4	6.3	0.27		
09	1960.0	170.0	10.4	7.0	2.1		106.6	6.5			
10	1919.0	180.0	11.2	7.0	2.8		103.0	6.4			
11	1800.0	160.0	10.7	7.0	1.9	0.5	100.0	6.7			
12	1859.0	140.0	9.0	7.0	2.1	0.3	113.2	7.3			
13	1983.0	160.0	9.7	7.0	1.6	0.4	101.0	6.1			
14	2078.0	200.0	11.5	7.0	1.0	0.4	122.4	7.1			
15	1973.0	180.0	10.9	7.0	1.0	0.5	105.6	6.4			
16	2069.0	200.0	11.6	7.0	1.6		114.8	6.7			
17	2239.0	200.0	10.7	7.0	2.4		114.8	6.2			
18	2251.0	190.0	10.1	6.7	2.6	0.5	119.9	6.4			
19	2039.0	180.0	10.6	6.8	0.7	0.3	109.1	6.4			
20	2241.0	190.0	10.2	6.9	0.8	0.3	117.8	6.3			
21	2167.0	220.0	12.2	7.1	0.9	0.4	117.3	6.5			
22	2193.0	200.0	10.9	7.0	0.9	0.3	122.4	6.7	0.05		
23	2480.0	230.0	11.1	6.8	1.2		122.4	5.9			
24	2180.0	210.0	11.5	7.0	1.6		100.5	5.5			
25	1833.0	180.0	11.7	7.0	2.1	0.3	103.5	6.8			
26	2000.0	200.0	12.0	7.0	1.8	0.3	107.6	6.5			
27	2089.0	170.0	9.8	7.0	1.0	0.4	113.7	6.5			
28	2242.0	210.0	11.2	6.9	1.0	0.4	122.4	6.6			
29	2150.0	180.0	10.0	7.0	2.0	0.4	116.3	6.5			
30	2107.0	210.0	11.9	6.9	1.8		102.0	5.8			
31	1946.0	210.0	13.0	6.9	2.8		107.1	6.6			

3 WELL SAMPLES TAKEN: 08-04-97

DRINKING WATER ATM. PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas Jones, C.O., CERT. NO. C-002710

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		TOTAL PHOSPHATE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L			
MONTHLY TOTAL	66858.0	6100.0	340.3	216.4	48.8	8.7	3543.0	197.8	0.24	25	
AVERAGE	2156.7	196.8	11.0	7.0	1.6	0.4	114.3	6.4	0.12		
MAXIMUM	2667.0	240.0	13.0	7.1	3.2	0.9	122.4	7.2	0.14		
MINIMUM	1806.0	160.0	8.8	6.8	0.7	0.2	100.0	5.3	0.10		
01	1975.0	180.0	10.9	7.0	1.8	0.3	108.6	6.6			
02	2667.0	240.0	10.8	6.9	1.6	0.4	118.3	5.3			
03	2460.0	180.0	8.8	7.0	1.0	0.3	122.4	6.0			
04	2114.0	200.0	11.4	7.0	1.0		121.9	6.9			
05	1851.0	200.0	13.0	7.0	2.7		100.5	6.5			
06	1949.0	170.0	10.5	7.0	3.0		100.5	6.2			
07	2002.0	190.0	11.4	7.0	1.6	0.5	113.2	6.8			12
08	2048.0	180.0	10.5	7.0	2.6	0.3	112.2	6.6			
09	2032.0	200.0	11.8	6.9	1.0	0.3	107.1	6.3			13
10	1952.0	180.0	11.1	7.0	2.0	0.2	105.6	6.5			
11	1806.0	190.0	12.6	7.0	1.9	0.4	106.1	7.0	0.14		
12	1880.0	180.0	11.5	7.0	3.2		100.0	6.4			
13	2134.0	190.0	10.7	7.0	3.0		111.2	6.3			
14	2167.0	200.0	11.0	7.1	1.8	0.3	122.4	6.8			
15	2265.0	200.0	10.6	6.8	1.2	0.4	122.4	6.5			
16	2320.0	240.0	12.4	7.0	1.3	0.3	122.4	6.3			
17	2230.0	200.0	10.8	7.0	1.2	0.3	122.4	6.6			
18	2110.0	200.0	11.4	6.9	1.2	0.3	110.2	6.3			
19	2183.0	200.0	10.9	7.0	1.9		111.2	6.1			
20	2403.0	200.0	10.0	6.8	2.0		122.4	6.1			
21	2140.0	200.0	11.2	6.9	1.1	0.5	108.1	6.1			
22	2163.0	200.0	11.1	7.0	1.8	0.4	112.2	6.2			
23	2358.0	200.0	10.2	7.0	1.0	0.3	122.4	6.2			
24	2462.0	240.0	11.7	7.0	1.0	0.3	122.4	6.0			
25	2162.0	180.0	10.0	7.0	1.0	0.9	115.8	6.4	0.10		
26	2185.0	180.0	9.9	7.0	1.0		119.3	6.6			
27	2174.0	200.0	11.0	7.0	1.0		109.1	6.0			
28	2113.0	160.0	9.1	7.0	1.0	0.4	110.7	6.3			
29	2278.0	200.0	10.5	7.0	0.7	0.6	117.3	6.2			
30	2246.0	220.0	11.7	7.1	0.7	0.5	122.4	6.5			
31	2029.0	200.0	11.8	7.0	1.5	0.5	122.4	7.2			

WELL SAMPLES TAKEN: 07-07-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: June 1997

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DAILY AVERAGE FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas G. Jones, C.O., CERT. NO. C-002710

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		ORTHO PHOSPHATE	NUMBER OF SAMPLES TAKEN	BACTERIAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L			
DAILY											
TOTAL	59346.0	5360.0	325.2	209.8	55.6	8.4	3230.3	196.1	0.10	25	
AVERAGE	1978.2	178.7	10.8	7.0	1.9	0.4	107.7	6.5	0.05		
MAXIMUM	2380.0	200.0	12.7	7.2	3.1	0.7	122.9	7.8	0.05		
MINIMUM	1675.0	140.0	9.1	6.8	0.7	0.2	78.0	5.4	0.05		
01	1894.0	180.0	11.4	7.0	2.5		122.4	7.8			
02	1853.0	170.0	11.0	7.0	2.1	0.5	102.0	6.6			12
03	1908.0	190.0	11.9	7.0	1.9	0.3	122.4	7.7			
04	1907.0	180.0	11.3	7.0	2.0	0.4	122.4	7.7			13
05	1774.0	150.0	10.1	7.0	2.5	0.3	87.2	5.9			
06	1675.0	140.0	10.0	6.9	2.3	0.4	78.0	5.6			
07	1807.0	170.0	11.2	7.0	3.1		92.3	6.1			
08	1994.0	190.0	11.4	7.0	1.6		103.5	6.2			
09	1876.0	190.0	12.1	7.0	2.1	0.3	100.5	6.4			
10	1900.0	190.0	12.0	7.0	2.5	0.2	104.6	6.6			
11	1937.0	170.0	10.5	7.0	1.3	0.4	106.6	6.6			
12	1969.0	180.0	11.0	7.0	1.8	0.5	100.0	6.1	<0.05		
13	1907.0	170.0	10.7	7.0	2.0	0.5	103.0	6.5			
14	1855.0	170.0	11.0	7.0	2.3		98.4	6.4			
15	2016.0	190.0	11.3	7.0	2.8		100.5	6.0			
16	2015.0	190.0	11.3	7.1	1.0	0.3	122.4	7.3			
17	1909.0	170.0	10.7	7.0	1.6	0.4	100.5	6.3			
18	1819.0	160.0	10.5	6.9	1.9	0.4	103.5	6.8			
19	1793.0	160.0	10.6	6.9	2.0	0.5	98.9	6.6			
20	1802.0	160.0	10.6	6.8	2.0	0.5	105.1	7.0			
21	2072.0	170.0	9.8	7.0	2.2		115.3	6.7			
22	2380.0	180.0	9.1	7.1	1.5		107.1	5.4			
23	2147.0	180.0	10.0	7.1	1.0	0.5	114.2	6.4			
24	2114.0	180.0	10.2	7.2	0.7	0.4	111.2	6.3			
25	2296.0	200.0	10.5	7.0	1.8	0.3	122.4	6.4			
26	2170.0	190.0	10.5	7.0	1.2	0.3	121.4	6.7	<0.05		
27	2202.0	200.0	10.9	7.0	1.3	0.3	122.9	6.7			
28	2323.0	200.0	10.3	6.9	1.6		122.4	6.3			
29	2147.0	190.0	10.6	6.9	2.8		122.4	6.8			
30	1885.0	200.0	12.7	7.0	1.2	0.7	96.9	6.2			

WELL SAMPLES TAKEN: 06-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: May 1997

AVERAGE EFFLUENT pH: 6.8 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas E. Jones, C.O., CERT. NO. C-002710

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	LBS	mg/L		
DAILY TOTAL	71368.0	9070.0	296.4	211.8	55.3	7.8	3649.1	191.6	25	
AVERAGE	2302.2	260.3	9.6	6.8	1.8	0.4	117.7	6.2		
MAXIMUM	2691.0	1060.0	13.7	7.0	3.0	0.5	122.4	7.9		
MINIMUM	1753.0	140.0	6.2	6.5	1.0	0.3	90.8	5.5		
01	2217.0	160.0	8.7	6.9	1.8	0.3	122.4	6.6		
02	2249.0	150.0	8.0	6.9	1.0	0.3	114.8	6.1		
03	2270.0	160.0	8.5	6.9	1.3		122.4	6.5		
04	2595.0	190.0	8.8	6.8	1.8		122.4	5.7		
05	2418.0	180.0	8.9	6.5	1.5	0.3	119.9	5.9	12	
06	2465.0	180.0	8.8	6.9	1.0	0.5	122.4	6.0		
07	2546.0	160.0	7.5	6.9	1.2	0.5	122.4	5.8		
08	2672.0	200.0	9.0	7.0	2.0	0.3	122.4	5.5		
09	2504.0	230.0	11.0	7.0	3.0	0.3	122.4	5.9		
10	2691.0	140.0	6.2	7.0	1.8		122.4	5.5		
11	2660.0	190.0	8.6	7.0	3.0		122.4	5.5		
12	1920.0	220.0	13.7	7.0	3.0	0.5	107.1	6.7		
13	2123.0	200.0	11.3	6.9	2.5	0.4	120.4	6.8		
14	2320.0	170.0	8.8	7.0	2.5	0.3	122.4	6.3		
15	2379.0	180.0	9.1	7.0	2.9	0.3	122.4	6.2	13	
16	2509.0	170.0	8.1	6.9	2.3	0.4	122.4	5.9		
17	2498.0	180.0	8.6	6.8	1.0		122.4	5.9		
18	2639.0	180.0	8.2	6.5	1.8		122.4	5.6		
19	2282.0	200.0	10.5	6.8	1.0	0.3	122.4	6.4		
20	2512.0	170.0	8.1	6.7	1.0	0.4	122.4	5.8		
21	2504.0	180.0	8.6	6.7	1.0	0.3	122.4	5.9		
22	2255.0	150.0	8.0	6.8	1.0	0.3	122.4	6.5		
23	2327.0	180.0	9.3	6.7	1.0	0.4	122.4	6.3		
24	2328.0	210.0	10.8	6.6	1.7		122.4	6.3		
25	1965.0	190.0	11.6	7.0	2.1		106.1	6.5		
26	2295.0	200.0	10.4	6.9	2.1		122.4	6.4		
27	1787.0	180.0	12.1	7.0	1.0	0.5	90.8	6.1		
28	1753.0	1060.0	12.3	6.5	3.0	0.5	114.8	7.9		
29	1876.0	890.0	11.5	6.6	1.5	0.3	104.0	6.7		
30	1850.0	700.0	11.0	6.7	2.0	0.4	98.9	6.4		
31	1959.0	530.0	10.4	6.9	1.5		102.0	6.2		

WELL SAMPLES TAKEN: 05-05-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WIS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 6.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas E. Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	69001.0	5260.0	275.3	207.4	41.8	8.8	25	
AVERAGE	2300.0	175.3	9.2	6.9	1.4	0.4		
MAXIMUM	2841.0	200.0	11.4	7.0	2.6	0.5		
MINIMUM	1795.0	120.0	7.2	6.5	0.9	0.2		
01	2350.0	160.0	8.2	6.8	1.8	0.3		
02	2514.0	200.0	9.5	6.9	1.0	0.5		
03	2841.0	200.0	8.4	6.9	0.9	0.4	12	
04	2585.0	200.0	9.2	7.0	1.0	0.5		
05	2611.0	200.0	9.2	7.0	1.4			
06	2616.0	200.0	9.1	6.9	1.0			
07	2364.0	200.0	9.2	7.0	1.0	0.5		
08	2483.0	180.0	8.6	6.7	1.3	0.4		
09	2535.0	200.0	9.5	6.9	1.2	0.3	13	
10	2507.0	180.0	8.6	6.9	1.0	0.4		
11	2304.0	170.0	8.9	6.9	1.4	0.5		
12	2437.0	170.0	8.4	6.9	1.3			
13	2724.0	200.0	8.8	6.8	1.7			
14	1916.0	180.0	11.2	7.0	1.0			
15	1941.0	180.0	11.1	7.0	2.0	0.3		
16	2038.0	180.0	10.6	7.0	2.0	0.5		
17	2125.0	200.0	11.3	7.0	2.6	0.3		
18	2145.0	170.0	9.5	7.0	1.7	0.4		
19	2556.0	170.0	8.0	7.0	1.5	0.3		
20	2810.0	180.0	7.7	7.0	1.6			
21	2414.0	160.0	8.0	6.9	1.0			
22	2436.0	180.0	9.0	6.9	1.0	0.3		
23	1884.0	160.0	10.2	7.0	2.5	0.5		
24	2079.0	160.0	9.2	7.0	1.4	0.2		
25	2177.0	140.0	7.7	7.0	1.2	0.3		
26	1993.0	140.0	8.4	7.0	1.8	0.4		
27	2004.0	160.0	9.6	6.9	1.0			
28	1795.0	170.0	11.4	6.8	1.0	0.5		
29	1871.0	150.0	9.6	6.8	1.2	0.5		
30	1946.0	120.0	7.2	6.5	1.3	0.5		

WELL SAMPLES TAKEN: 04-03-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1997

AVERAGE EFFLUENT pH: 6.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

PERMIT NO. _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas S. Jones, C.O., CERT. NO. C-002710

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GAL. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
THLY	68128.0	5260.0	287.1	214.6	52.2	8.1	25	
RAGE	2197.7	169.7	9.3	6.9	1.7	0.4		
INUM	2732.0	240.0	12.0	7.0	3.0	0.7		
INUM	1761.0	120.0	6.3	6.8	1.0	0.3		
01	2236.0	180.0	9.7	6.9	1.3			
02	2468.0	180.0	8.7	7.0	2.1			
03	2147.0	180.0	10.0	6.9	3.0	0.4		
04	2332.0	180.0	9.3	7.0	1.3	0.3		
05	2396.0	240.0	12.0	6.9	1.8	0.3	12	
06	2314.0	160.0	8.4	6.8	1.7	0.4		
07	2217.0	120.0	6.5	6.8	1.3	0.3		
08	2612.0	220.0	10.1	7.0	1.4			
09	2732.0	200.0	8.9	7.0	1.6			
10	2360.0	200.0	10.0	7.0	1.0	0.4	13	
11	2318.0	160.0	8.4	7.0	1.5	0.5		
12	2374.0	160.0	8.0	7.0	1.0	0.6		
13	1955.0	140.0	8.4	6.9	3.0	0.6		
14	1761.0	140.0	9.3	7.0	1.2	0.4		
15	2099.0	160.0	9.6	7.0	2.5			
16	2250.0	120.0	6.3	6.9	2.0			
17	2059.0	140.0	8.4	7.0	1.0	0.3		
18	1866.0	120.0	7.7	7.0	1.3	0.4		
19	2066.0	140.0	8.1	7.0	1.0	0.4		
20	1959.0	160.0	9.8	6.8	1.4	0.3		
21	1896.0	140.0	8.9	6.8	2.4	0.4		
22	2053.0	180.0	10.5	6.8	1.2			
23	2318.0	170.0	8.8	6.8	1.6			
24	2021.0	170.0	10.0	6.8	1.3	0.3		
25	1886.0	160.0	10.2	6.8	1.8	0.3		
26	1976.0	180.0	10.9	6.8	2.0	0.4		
27	2135.0	180.0	10.1	7.0	2.5	0.4		
28	2326.0	180.0	9.3	7.0	1.7			
29	2287.0	220.0	11.5	7.0	1.0			
30	2470.0	200.0	9.7	7.0	3.0			
31	2239.0	180.0	9.6	6.9	1.3	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

W5 ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 6.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas G Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	56367.0	4560.0	273.3	194.4	46.7	7.9	25	
AVERAGE	2013.1	162.9	9.8	6.9	1.7	0.4		
MAXIMUM	2288.0	240.0	14.6	7.0	3.0	0.8		
MINIMUM	1761.0	140.0	8.0	6.6	0.6	0.2		
01	2083.0	180.0	10.8	7.0	2.0			
02	2282.0	240.0	12.6	7.0	3.0			
03	2064.0	160.0	9.6	6.9	1.2	0.3		
04	2003.0	170.0	10.2	6.9	1.6	0.4		
05	2185.0	160.0	8.8	6.9	1.6	0.3	12	
06	2029.0	160.0	9.5	6.6	0.9	0.5	13	
07	1904.0	150.0	9.5	6.9	2.0	0.8		
08	2104.0	160.0	9.1	7.0	0.8			
09	2288.0	180.0	9.4	6.9	1.0			
10	2094.0	160.0	9.2	7.0	1.5	0.7		
11	2036.0	160.0	9.4	6.9	1.1	0.4		
12	2264.0	160.0	8.5	7.0	0.9	0.6		
13	1904.0	160.0	10.1	7.0	1.3	0.5		
14	1828.0	160.0	10.5	7.0	1.0	0.4		
15	1801.0	180.0	12.0	7.0	2.1			
16	1967.0	180.0	11.0	7.0	3.0			
17	2007.0	140.0	8.4	7.0	1.7			
18	1902.0	160.0	10.1	7.0	0.6	0.4		
19	2042.0	140.0	8.4	7.0	0.7	0.5		
20	1941.0	140.0	8.6	6.9	0.9	0.4		
21	1978.0	140.0	8.4	7.0	1.0	0.3		
22	1809.0	220.0	14.6	7.0	0.9			
23	2087.0	140.0	8.0	7.0	3.0			
24	1927.0	150.0	9.5	7.0	2.9	0.2		
25	1761.0	140.0	9.3	7.0	3.0	0.3		
26	1989.0	150.0	9.0	6.9	2.0	0.3		
27	1978.0	150.0	9.1	6.8	2.0	0.3		
28	2110.0	170.0	9.7	6.8	3.0	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

AS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: Seaside Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1997

AVERAGE EFFLUENT pH: 6.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Thomas S. Jones

, C.O., CERT. NO. C-002710

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	61636.0	4710.0	281.8	215.3	61.1	12.4	25	
AVERAGE	1988.3	151.9	9.1	6.9	2.0	0.6		
MAXIMUM	2230.0	180.0	12.2	7.0	3.0	1.4		
MINIMUM	1770.0	120.0	4.7	6.5	0.7	0.2		
01	2149.0	170.0	9.5	7.0	2.0			
02	2049.0	120.0	7.0	6.9	1.5	0.4		
03	1941.0	120.0	7.6	7.0	1.9	0.5		
04	2065.0	140.0	8.4	7.0	2.5			
05	2217.0	160.0	8.7	7.0	3.0			
06	1866.0	140.0	9.0	6.9	0.9	0.4		
07	1882.0	180.0	11.5	6.9	1.9	0.5		
08	1871.0	140.0	9.0	7.0	2.7	0.5		
09	1808.0	180.0	11.9	7.0	3.0	1.4		
10	1770.0	180.0	12.2	7.0	3.0	0.6		
11	1912.0	160.0	10.0	7.0	2.1			
12	2006.0	180.0	10.8	6.9	1.6			
13	1876.0	140.0	9.0	7.0	2.2	0.4	12	
14	1893.0	140.0	8.9	7.0	2.0	0.8		
15	1902.0	140.0	8.8	7.0	1.7	0.9		
16	1817.0	140.0	9.3	7.0	1.6	0.8		
17	2092.0	140.0	8.4	7.0	1.4	0.5		
18	2155.0	160.0	9.6	7.0	1.5			
19	2197.0	140.0	7.7	7.0	3.0			
20	2230.0	120.0	6.5	6.9	2.7	0.5		
21	2100.0	160.0	9.1	6.5	2.4	0.5		
22	2061.0	180.0	4.7	6.9	1.5	0.7	13	
23	2113.0	140.0	8.0	6.7	1.9	0.4		
24	2001.0	180.0	10.8	6.8	0.7	0.5		
25	1878.0	180.0	11.4	6.9	1.8			
26	2127.0	160.0	9.1	7.0	3.0			
27	2000.0	140.0	8.4	7.0	1.0	0.5		
28	2031.0	140.0	8.4	7.0	1.0	0.5		
29	1906.0	160.0	10.1	7.0	3.0	0.4		
30	1788.0	140.0	9.4	7.0	1.0	0.2		
31	1933.0	140.0	8.6	7.0	1.6	0.5		

3 WELL SAMPLES TAKEN: 01-13-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS-ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Michael DeRosa*, C.O., CERT. NO. C-4789

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	2506.0	131.0	194.0	222.7	58.6	14.3	2	
AVERAGE	80.8	4.2	6.3	7.2	1.9	0.7		
MAXIMUM	158.0	8.0	7.3	7.3	3.0	2.5		
MINIMUM	55.0	2.0	4.2	7.0	0.5	0.2		
01	57.0	2.0	4.2	7.1	1.5	0.4	2	
02	66.0	3.0	5.5	7.1	2.0	0.6		
03	88.0	5.0	6.8	7.1	2.3	0.3		
04	102.0	5.0	5.9	7.1	3.0	0.8		
05	95.0	5.0	6.3	7.1	2.6	0.6		
06	158.0	8.0	6.1	7.2	2.5			
07	147.0	8.0	6.5	7.3	1.5			
08	96.0	5.0	6.3	7.3	3.0	1.5		
09	85.0	5.0	7.1	7.2	2.0	1.0		
10	104.0	5.0	5.8	7.0	2.9	2.5		
11	82.0	5.0	7.3	7.1	2.1	0.9		
12	55.0	3.0	6.5	7.1	2.3	0.9		
13	84.0	5.0	7.1	7.1	2.0			
14	97.0	5.0	6.2	7.1	1.4			
15	78.0	4.0	6.2	7.2	1.6	0.8		
16	77.0	4.0	6.2	7.2	1.0	0.5		
17	69.0	3.0	5.2	7.3	2.5	0.3		
18	76.0	4.0	6.3	7.2	1.9	0.6		
19	72.0	4.0	6.7	7.2	2.1	0.6		
20	61.0	3.0	5.9	7.3	3.0			
21	79.0	4.0	6.1	7.3	0.5			
22	85.0	4.0	5.6	7.3	1.0	0.3		
23	75.0	4.0	6.4	7.3	0.9	0.2		
24	69.0	4.0	7.0	7.3	1.0	0.4		
25	74.0	4.0	6.5	7.2	1.9			
26	60.0	3.0	6.0	7.1	2.2			
27	68.0	3.0	5.3	7.1	1.8			
28	56.0	3.0	6.4	7.1	2.0			
29	66.0	4.0	7.3	7.2	0.8	0.2		
30	66.0	4.0	7.3	7.3	1.3	0.5		
31	59.0	3.0	6.1	7.2	2.0	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Michael D. [Signature], C.O., CERT. NO. C-4789

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	2343.0	135.0	202.1	212.7	72.9	26.7	2	
AVERAGE	78.1	4.5	6.7	7.1	2.4	1.5		
MAXIMUM	278.0	18.0	8.4	7.3	3.5	2.6		
MINIMUM	50.0	3.0	5.1	6.9	1.0	0.2		
01	61.0	4.0	7.9	7.1	2.0			
02	58.0	3.0	6.2	7.1	2.2			
03	50.0	3.0	7.2	7.1	2.0	0.6	2	
04	170.0	11.0	7.8	7.1	3.0	1.0		
05	278.0	18.0	7.8	7.2	1.0	0.2		
06	129.0	9.0	8.4	7.2	3.0	1.3		
07	57.0	4.0	8.4	7.2	3.0	2.5		
08	80.0	5.0	7.5	7.1	3.3			
09	70.0	3.0	5.1	7.2	3.5			
10	73.0	4.0	6.6	7.2	3.1	2.5		
11	68.0	3.0	5.3	7.2	3.0	2.6		
12	62.0	3.0	5.8	7.1	2.8	2.5		
13	98.0	5.0	6.1	7.2	3.0	2.5		
14	52.0	3.0	6.9	7.1	2.8	2.3		
15	54.0	3.0	6.7	7.3	3.3			
16	63.0	3.0	5.7	7.3	1.8			
17	50.0	3.0	7.2	7.1	1.7	0.9		
18	58.0	3.0	6.2	7.0	1.9	0.8		
19	70.0	4.0	6.9	7.0	3.0	2.5		
20	81.0	5.0	7.4	7.0	2.2	1.0		
21	63.0	3.0	5.7	6.9	2.5	1.2		
22	64.0	3.0	5.6	7.0	1.3			
23	66.0	4.0	7.3	6.9	1.7			
24	53.0	3.0	6.8	7.0	2.0	1.0		
25	61.0	3.0	5.9	7.0	2.1	0.9		
26	75.0	4.0	6.4	7.0	2.3	0.4		
27	72.0	4.0	6.7	7.0	2.9			
28	71.0	4.0	6.8	7.1	1.8			
29	58.0	3.0	6.2	7.0	2.7			
30	78.0	5.0	7.7	7.0	2.0			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: JOHN'S FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Michael D. Jones

, C.O., CERT. NO. C-4789

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	2319.0	130.0	197.0	218.8	51.5	11.6	2	
AVERAGE	74.8	4.2	6.4	7.1	1.7	0.5		
MAXIMUM	180.0	17.0	11.3	7.4	3.0	1.0		
MINIMUM	34.0	2.0	4.1	6.7	0.5	0.2		
01	59.0	3.0	6.1	7.2	1.0	0.2	2	
02	59.0	2.0	4.1	7.1	1.0	0.9		
03	73.0	3.0	4.9	7.1	1.4	0.6		
04	61.0	3.0	5.9	7.1	1.3			
05	73.0	3.0	4.9	7.2	1.5			
06	47.0	2.0	5.1	6.8	0.8	0.4		
07	80.0	3.0	4.5	6.8	1.2	0.2		
08	100.0	6.0	7.2	7.0	1.3	0.2		
09	54.0	2.0	4.4	7.1	3.0	0.4		
10	56.0	2.0	4.3	6.7	1.8	0.2		
11	97.0	4.0	4.9	6.8	1.9			
12	180.0	17.0	11.3	6.9	2.0			
13	93.0	6.0	7.7	7.3	0.5	0.2		
14	91.0	5.0	6.6	7.0	2.5	0.2		
15	39.0	2.0	6.2	7.0	1.3	0.6		
16	180.0	13.0	8.7	7.0	1.5	0.2		
17	40.0	3.0	9.0	6.9	1.0	0.2		
18	68.0	4.0	7.1	7.1	3.0			
19	63.0	3.0	5.7	7.0	2.0			
20	95.0	5.0	6.3	7.1	1.3	0.2		
21	66.0	4.0	7.3	7.0	1.8	0.4		
22	60.0	3.0	6.0	7.1	2.2	1.0		
23	105.0	6.0	6.9	7.1	2.0	0.9		
24	51.0	3.0	7.1	7.0	2.3	1.0		
25	51.0	3.0	7.1	7.3	1.7			
26	114.0	7.0	7.4	7.4	1.0			
27	76.0	3.0	4.7	7.3	1.6	0.8		
28	44.0	2.0	5.5	7.2	2.1	0.8		
29	34.0	2.0	7.1	7.1	2.0	0.5		
30	55.0	3.0	6.5	7.1	1.7	0.6		
31	55.0	3.0	6.5	7.0	1.8	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Michael R. Pless*, C.O., CERT. NO. C-4789

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	2441.0	106.0	159.2	215.6	47.1	8.6	2	
AVERAGE	81.4	3.5	5.3	7.2	1.6	0.4		
MAXIMUM	163.0	8.0	13.3	7.4	3.5	0.7		
MINIMUM	35.0	1.0	3.4	7.1	0.9	0.2		
01	77.0	3.0	4.7	7.1	2.0			
02	77.0	3.0	4.7	7.2	1.0	0.3		
03	82.0	3.0	4.4	7.2	1.5	0.5		
04	79.0	3.0	4.6	7.2	1.0	0.4		
05	54.0	6.0	13.3	7.2	1.3	0.3		
06	62.0	3.0	5.8	7.3	1.3			
07	58.0	2.0	4.1	7.4	1.0			
08	163.0	5.0	3.7	7.3	1.2	0.4		
09	86.0	3.0	4.2	7.2	1.5	0.7	2	
10	119.0	4.0	4.0	7.2	1.3	0.5		
11	97.0	4.0	4.9	7.1	1.0	0.3		
12	65.0	3.0	5.5	7.1	1.8	0.7		
13	85.0	3.0	4.2	7.1	2.3			
14	158.0	7.0	5.3	7.1	2.0			
15	113.0	4.0	4.2	7.2	1.7	0.4		
16	113.0	4.0	4.2	7.1	1.0	0.2		
17	82.0	3.0	4.4	7.1	1.8	0.5		
18	113.0	5.0	5.3	7.1	0.9	0.4		
19	99.0	7.0	8.5	7.2	1.3	0.5		
20	104.0	8.0	9.2	7.3	1.1			
21	91.0	4.0	5.3	7.1	1.4			
22	88.0	3.0	4.1	7.1	1.7	0.4		
23	53.0	2.0	4.5	7.1	1.9	0.5		
24	49.0	2.0	4.9	7.2	1.8	0.5		
25	60.0	3.0	6.0	7.2	1.2	0.2		
26	35.0	1.0	3.4	7.2	1.3	0.4		
27	43.0	2.0	5.6	7.4	2.5			
28	42.0	2.0	5.7	7.3	3.5			
29	43.0	2.0	5.6	7.1	2.8	0.2		
30	51.0	2.0	4.7	7.2	1.0	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554368 C.U.P. NO.2-109-0227

NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: 100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Michael DeArden, C.O., CERT. NO. C-4789

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	2091.0	96.0	174.6	220.1	65.3	21.5	2	
AVERAGE	67.5	3.1	5.6	7.1	2.1	1.0		
MAXIMUM	108.0	7.0	7.8	7.4	3.0	2.0		
MINIMUM	35.0	2.0	4.1	6.9	0.8	0.4		
01	73.0	3.0	4.9	7.2	1.4	0.7		
02	62.0	3.0	5.8	7.4	3.0			
03	59.0	3.0	6.1	7.3	3.0			
04	83.0	3.0	4.3	7.2	2.5	0.8		
05	71.0	3.0	5.1	7.1	2.6	2.0		
06	43.0	2.0	5.6	7.1	2.4	1.8		
07	37.0	2.0	6.5	7.1	2.0	1.3	2	
08	35.0	2.0	6.9	7.1	2.2	0.9		
09	108.0	7.0	7.8	7.2	2.1			
10	69.0	3.0	5.2	7.1	2.0			
11	46.0	3.0	7.8	7.1	2.3	0.8		
12	53.0	3.0	6.8	7.1	2.8	1.2		
13	37.0	2.0	6.5	7.1	2.0	0.8		
14	52.0	3.0	6.9	7.1	1.9	0.6		
15	75.0	3.0	4.8	7.0	2.5	1.8		
16	74.0	3.0	4.9	7.0	2.9			
17	83.0	4.0	5.8	6.9	3.0			
18	67.0	4.0	7.2	7.0	3.0	1.7		
19	51.0	3.0	7.1	7.1	3.0	0.9		
20	88.0	3.0	4.1	7.1	1.3	0.7		
21	79.0	3.0	4.6	7.0	0.8	0.7		
22	76.0	3.0	4.7	7.0	1.3	0.9		
23	64.0	3.0	5.6	7.1	0.9			
24	62.0	3.0	5.8	7.0	0.8			
25	72.0	3.0	5.0	7.1	1.4	0.4		
26	72.0	3.0	5.0	7.1	1.7	0.8		
27	80.0	3.0	4.5	7.1	1.9	0.7		
28	86.0	4.0	5.6	7.1	2.1	1.0		
29	78.0	3.0	4.6	7.1	2.2	1.0		
30	78.0	3.0	4.6	7.1	2.3			
31	78.0	3.0	4.6	7.1	2.0			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2554368 C.U.P. NO.2-109-0227

NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT

CATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

AVERAGE EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

AVERAGE FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Michael D. Owen, C.O., CERT. NO. C-4789

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	2159.0	98.5	170.4	221.9	64.5	19.9	2	
AVERAGE	69.6	3.2	5.5	7.2	2.1	0.9		
MAXIMUM	102.0	4.8	9.1	7.4	3.0	1.7		
MINIMUM	43.0	1.7	4.7	7.1	1.1	0.4		
01	63.0	2.9	5.5	7.2	2.2	0.8		
02	91.0	3.7	4.9	7.2	2.0	0.9		
03	81.0	3.9	5.8	7.2	1.5	0.8		
04	80.0	3.9	5.9	7.1	2.0			
05	73.0	3.2	5.3	7.1	2.2			
06	83.0	3.6	5.2	7.1	2.1			
07	47.0	2.1	5.4	7.1	1.8	0.6		
08	102.0	4.6	5.4	7.2	2.2	0.7		
09	51.0	2.2	5.2	7.2	1.1	0.5	2	
10	68.0	3.9	6.9	7.2	2.5	0.5		
11	45.0	1.8	4.8	7.2	2.6	0.5		
12	71.0	3.1	5.2	7.3	3.0			
13	62.0	3.1	6.0	7.4	1.5			
14	69.0	2.8	4.9	7.2	2.0	1.7		
15	54.0	2.1	4.7	7.1	1.8	1.0		
16	79.0	3.7	5.6	7.1	1.5	0.9		
17	72.0	2.8	4.7	7.2	1.8	1.0		
18	46.0	2.1	5.5	7.1	2.3	1.3		
19	67.0	3.0	5.4	7.2	3.0			
20	83.0	3.3	4.8	7.3	3.0			
21	87.0	3.7	5.1	7.1	2.5	1.5		
22	81.0	3.9	5.8	7.1	2.3	1.2		
23	62.0	2.9	5.6	7.1	2.0	1.3		
24	82.0	3.3	4.8	7.1	2.3	1.7		
25	60.0	4.3	8.6	7.1	1.8	1.0		
26	63.0	4.8	9.1	7.2	2.0			
27	72.0	3.3	5.5	7.1	2.5			
28	56.0	2.2	4.7	7.1	1.7	0.4		
29	83.0	3.3	4.8	7.1	2.2	0.5		
30	83.0	3.3	4.8	7.1	1.5	0.7		
31	43.0	1.7	4.7	7.1	1.6	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554368 C.U.P. NO. NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT
 LOCATION: 2740-1 CR 210 W. COUNTY: ST. JOHNS
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: June 1997
 INFLUENT EFFLUENT pH: 7.2 (AVG) NO. OF SERVICES AT END OF MONTH: 24
 AVERAGE FLOW: .100 (MGD) MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Mike Owen, C.O., CERT. NO. C-4789

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	1947.0	86.9	160.6	214.8	56.7	19.5	2	
DAILY RANGE	64.9	2.9	5.4	7.2	1.9	0.9		
DAILY MINIMUM	112.0	4.8	6.3	7.4	2.5	2.3		
DAILY MINIMUM	39.0	1.8	4.7	6.9	1.0	0.2		
01	51.0	2.3	5.4	7.3	1.5			
02	72.0	3.0	5.0	7.2	1.0	0.2		
03	73.0	3.5	5.8	7.2	1.9	0.2		
04	74.0	3.0	4.9	7.3	1.7	0.4	2	
05	41.0	1.8	5.3	7.3	1.4	0.7		
06	41.0	2.0	5.9	7.3	1.5	1.2		
07	54.0	2.1	4.7	7.3	2.5			
08	56.0	2.5	5.4	7.4	2.3			
09	56.0	2.5	5.4	7.2	2.0	1.0		
10	73.0	3.4	5.6	7.1	2.3	1.2		
11	62.0	2.6	5.0	7.1	2.0	0.9		
12	56.0	2.4	5.1	7.1	1.8	1.0		
13	84.0	4.4	6.3	7.1	2.0	1.1		
14	79.0	3.5	5.3	7.1	1.7			
15	52.0	2.3	5.3	7.1	2.2			
16	51.0	2.2	5.2	7.1	2.3	1.7		
17	83.0	3.8	5.5	7.2	2.4	1.2		
18	69.0	2.9	5.0	7.1	2.0	2.3		
19	50.0	2.4	5.8	6.9	1.9	0.8		
20	52.0	2.1	4.8	7.0	1.6	1.0		
21	67.0	3.4	6.1	7.1	2.2			
22	39.0	1.8	5.5	7.1	2.1			
23	84.0	3.5	5.0	7.1	1.9	0.5		
24	61.0	2.7	5.3	7.1	2.5	1.8		
25	96.0	4.3	5.4	7.1	2.0	1.0		
26	112.0	4.8	5.1	7.2	1.4	0.3		
27	51.0	2.2	5.2	7.2	1.8	0.6		
28	65.0	3.2	5.9	7.2	1.6			
29	73.0	3.3	5.4	7.2	1.7			
30	70.0	3.0	5.1	7.1	1.5	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

SUPPLIED BY: United Water Florida Inc.

REPORTING MONTH: May 1997

AVERAGE EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Michael D. ..., C.O., CERT. NO. C-4789

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP		
TOTAL	2635.0	119.8	220.3	49.4	13.8	2	
AVERAGE	85.0	3.9	7.1	1.6	0.7		
MAXIMUM	121.0	5.7	7.4	2.6	1.5		
MINIMUM	54.0	2.2	7.0	0.8	0.2		
01	121.0	5.7	7.2	1.5	0.4		
02	67.0	3.1	7.3	1.0	0.2		
03	95.0	4.4	7.2	0.8			
04	74.0	3.1	7.3	1.6			
05	95.0	4.0	7.2	1.5	0.3	2	
06	89.0	4.0	7.0	1.7	0.5		
07	67.0	3.1	7.0	1.9	0.6		
08	96.0	4.0	7.0	1.9	0.6		
09	99.0	4.0	7.0	1.7	0.5		
10	105.0	4.0	7.3	2.5			
11	92.0	3.8	7.4	1.2			
12	69.0	2.9	7.0	1.8	0.9		
13	74.0	3.4	7.0	1.7	0.5		
14	83.0	3.5	7.1	1.8	0.4		
15	112.0	5.1	7.1	1.7	0.4		
16	107.0	4.5	7.0	1.9	0.5		
17	96.0	3.8	7.1	1.5			
18	92.0	4.5	7.0	1.8			
19	89.0	4.2	7.1	1.4	0.5		
20	101.0	4.5	7.1	1.7	0.6		
21	84.0	3.4	7.0	1.3	1.5		
22	82.0	3.9	7.1	1.2	0.9		
23	86.0	3.9	7.0	1.3	1.0		
24	79.0	3.4	7.1	1.0			
25	58.0	2.7	7.1	1.7			
26	100.0	4.6	7.1	0.8			
27	54.0	2.2	7.2	2.1	1.1		
28	56.0	2.5	7.1	1.9	1.0		
29	77.0	3.7	7.0	1.8	0.7		
30	71.0	4.9	7.1	2.6	0.7		
31	65.0	5.0	7.1	1.1			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ST. JOHN'S FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April 1997

AVERAGE EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-4789

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	2455.0	116.8	171.2	212.9	68.2	26.8	2	
AVERAGE	81.8	3.9	5.7	7.1	2.3	1.1		
MAXIMUM	136.0	7.3	10.1	7.4	3.0	2.7		
MINIMUM	42.0	1.3	2.4	6.9	0.8	0.2		
01	80.0	4.5	6.8	7.3	2.2	0.2	2	
02	76.0	6.4	10.1	7.3	2.5	0.3		
03	95.0	7.2	9.1	7.3	2.2	0.2		
04	87.0	2.9	4.0	7.3	2.3	0.3		
05	74.0	2.5	4.1	7.3	2.1			
06	91.0	7.3	9.6	7.4	3.0			
07	81.0	4.5	6.7	6.9	3.0	2.3		
08	74.0	5.1	8.3	7.0	0.8	2.0		
09	101.0	4.5	5.3	6.9	3.0	2.5		
10	93.0	3.6	4.6	7.1	1.0	0.4		
11	65.0	1.3	2.4	7.0	2.5	2.2		
12	84.0	2.8	4.0	7.4	3.0			
13	97.0	2.9	3.6	7.4	3.0			
14	59.0	1.8	3.7	7.0	2.8	2.3		
15	62.0	3.3	6.4	7.0	2.2	2.7		
16	45.0	2.0	5.3	7.1	2.0	0.4		
17	94.0	4.3	5.5	7.0	2.3	0.8		
18	129.0	6.3	5.9	7.0	1.4	0.5		
19	79.0	3.6	5.5	7.0	1.8	0.6		
20	108.0	4.7	5.2	7.0	2.3	1.4		
21	136.0	6.0	5.3	7.0	2.2	1.0		
22	76.0	3.7	5.8	7.1	1.7	0.4		
23	54.0	2.7	6.0	7.0	2.2	0.9		
24	84.0	3.8	5.4	7.0	2.4	0.7		
25	76.0	3.1	4.9	7.0	2.8	1.0		
26	66.0	2.8	5.1	7.0	2.6			
27	77.0	3.1	4.8	7.0	2.3			
28	42.0	2.5	7.1	7.0	2.5	2.2		
29	103.0	4.6	5.4	7.0	2.3	1.1		
30	67.0	3.0	5.4	7.1	1.8	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ST. JOHNS FOREST WATER TREATMENT PLANT

SECTION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1997

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: 1.100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Michael J. Adams, C.O., CERT. NO. C-4789

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	2166.0	75.1	128.1	7.3	51.0	10.8	2	
AVERAGE	69.9	2.4	4.1	7.3	1.6	0.5		
MAXIMUM	94.0	4.7	9.1	7.3	3.0	1.1		
MINIMUM	38.0	1.3	2.8	7.3	0.7	0.2		
01	88.0	2.2	3.1	7.3	1.7			
02	79.0	2.5	3.7	7.3	1.6			
03	70.0	2.3	3.9	7.3	1.8	0.4		
04	67.0	1.7	3.0	7.3	1.7	0.3		
05	62.0	2.0	3.8	7.3	1.5	0.3		
06	77.0	2.5	3.8	7.3	1.9	0.3		
07	64.0	1.5	2.8	7.3	1.6	0.3		
08	84.0	2.0	2.9	7.3	0.8			
09	94.0	2.3	2.9	7.3	1.3			
10	84.0	2.5	3.5	7.3	1.5	0.4		
11	53.0	1.9	4.3	7.3	1.7	0.5	2	
12	80.0	2.1	3.1	7.3	1.5	0.4		
13	48.0	1.5	3.6	7.3	2.0	0.7		
14	38.0	1.3	3.9	7.3	1.5	1.1		
15	60.0	1.5	3.1	7.3	3.0			
16	91.0	2.8	3.7	7.3	1.3			
17	68.0	2.3	4.0	7.3	1.5	0.9		
18	58.0	1.5	3.2	7.3	1.8	1.0		
19	59.0	1.8	3.6	7.3	1.4	0.5		
20	83.0	2.8	4.0	7.3	1.6	0.6		
21	53.0	1.4	3.1	7.3	1.8	0.7		
22	55.0	1.7	3.6	7.3	1.7			
23	77.0	2.6	4.0	7.3	1.8			
24	56.0	1.4	3.0	7.3	1.5	0.6		
25	80.0	2.5	3.7	7.3	1.4	0.5		
26	57.0	3.7	7.7	7.3	1.6	0.8		
27	71.0	3.4	5.7	7.3	3.0	0.3		
28	81.0	3.9	5.7	7.3	1.8			
29	82.0	4.6	6.7	7.3	0.8			
30	85.0	4.2	5.9	7.3	0.7			
31	62.0	4.7	9.1	7.3	2.2	0.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM.

FOREST WATER TREATMENT PLANT

LOCATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DESIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Michael Lee Oliver, C.O., CERT. NO. C-4789

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GAL. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	1542.0	45.4	99.4	205.1	48.5	13.9	2
AVERAGE	55.1	1.6	3.5	7.3	1.7	0.6	
MAXIMUM	77.0	2.3	4.5	7.4	2.3	1.0	
MINIMUM	35.0	1.0	2.9	7.3	1.1	0.3	
01	77.0	1.9	3.0	7.3	2.0		
02	59.0	1.8	3.7	7.4	1.2		
03	50.0	1.6	3.8	7.4	1.7	0.6	
04	59.0	1.8	3.1	7.4	1.5	0.3	2
05	42.0	1.0	2.9	7.3	1.7	0.5	
06	75.0	2.3	3.7	7.3	1.4	0.6	
07	56.0	1.8	3.9	7.3	1.8	0.5	
08	42.0	1.2	3.4	7.4	1.5		
09	51.0	1.8	4.2	7.3	1.8		
10	46.0	1.1	2.9	7.3	1.9	1.0	
11	46.0	1.5	3.9	7.4	1.7	1.0	
12	44.0	1.4	3.8	7.3	1.5	0.9	
13	41.0	1.0	2.9	7.3	2.0	0.9	
14	42.0	1.2	3.4	7.3	1.9	1.0	
15	35.0	1.3	4.5	7.3	2.1	0.8	
16	65.0	1.6	3.0	7.3	1.8	0.7	
17	48.0	1.5	3.8	7.3	2.3	0.9	
18	54.0	1.8	4.0	7.3	1.7	0.4	
19	54.0	1.3	2.9	7.3	1.9	0.5	
20	67.0	2.1	3.8	7.3	1.1	0.4	
21	44.0	1.4	3.8	7.3	1.8	0.5	
22	55.0	1.8	3.9	7.4	1.3		
23	54.0	1.7	3.8	7.4	1.6		
24	46.0	1.2	3.1	7.3	2.0	0.5	
25	64.0	2.0	3.8	7.3	1.8	0.3	
26	66.0	2.2	4.0	7.3	1.7	0.5	
27	74.0	1.8	2.9	7.3	1.8	0.6	
28	76.0	2.3	3.6	7.3	2.0	0.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2554368 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: VS FOREST WATER TREATMENT PLANT

CATION: 2740-1 CR 210 W.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1997

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 24

DAILY SIGN FLOW: .100 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Michael R. Oke, C.O., CERT. NO. C-4789

DAILY MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	1763.0	57.5	123.0	7.3	62.7	19.5	2	
AVERAGE	56.9	1.9	4.0	7.3	2.0	0.8		
MAXIMUM	109.0	2.9	5.4	7.4	2.8	1.5		
MINIMUM	25.0	0.9	2.9	7.2	1.0	0.2		
01	64.0	2.4	4.5	7.4	1.0			
02	52.0	2.0	4.6	7.4	2.4	0.3		
03	45.0	1.6	4.3	7.3	2.5	0.9		
04	54.0	2.0	4.4	7.3	1.9			
05	75.0	2.8	4.5	7.3	2.0			
06	36.0	1.4	4.7	7.3	2.5	0.7		
07	46.0	1.7	4.4	7.3	2.0	0.9		
08	50.0	1.9	4.6	7.3	2.3	0.9		
09	42.0	1.9	5.4	7.2	2.8	1.3		
10	27.0	1.0	4.4	7.2	2.5	1.3		
11	48.0	1.2	3.0	7.3	1.8			
12	52.0	1.3	3.0	7.3	1.3			
13	40.0	1.0	3.0	7.3	1.8	0.6	2	
14	84.0	2.7	3.9	7.3	1.7	0.6		
15	35.0	0.9	3.1	7.2	2.5	0.2		
16	66.0	2.1	3.8	7.2	2.0	0.5		
17	65.0	2.4	4.4	7.3	1.8	0.3		
18	66.0	2.4	4.4	7.2	2.1	0.9		
19	65.0	2.5	4.6	7.2	2.3	1.0		
20	82.0	2.6	3.8	7.2	2.5	1.3		
21	84.0	2.7	3.9	7.2	2.5	1.5		
22	61.0	2.0	3.9	7.2	2.6	1.5		
23	109.0	2.9	3.2	7.2	1.5	1.1		
24	25.0	1.1	5.3	7.3	1.8	1.3		
25	61.0	1.5	3.0	7.4	1.5			
26	87.0	2.1	2.9	7.4	2.0			
27	43.0	1.2	3.3	7.3	1.8	0.5		
28	63.0	2.2	4.2	7.3	1.9	0.5		
29	46.0	1.2	3.1	7.3	1.7	0.4		
30	49.0	1.6	3.9	7.3	1.8	0.5		
31	41.0	1.2	3.5	7.3	1.9	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554345 C.U.P. NO. 3-109-0243.

NAME OF DRINKING WATER SYSTEM ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Henry P. White*, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L	ZINC POLYPHOSPHATE GALS. OR LBS USED	Mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	9691.0	350.0	137.7	246.1	53.4	21.8		3	
AVERAGE	312.6	11.3	4.4	7.9	1.7	1.0			
MAXIMUM	468.0	16.0	9.3	8.1	2.4	2.0			
MINIMUM	194.0	8.0	3.6	7.8	1.0	0.7			
01	354.0	12.0	4.1	7.9	1.6	1.0		3	
02	391.0	12.0	3.7	8.0	2.1	1.6			
03	305.0	10.0	3.9	8.0	1.7	0.9			
04	342.0	14.0	4.9	7.9	1.1	0.8			
05	363.0	12.0	4.0	7.9	1.4	0.8			
06	468.0	15.0	3.8	7.8	1.9				
07	355.0	12.0	4.1	7.9	2.0				
08	349.0	12.0	4.1	7.9	1.4	0.9			
09	289.0	10.0	4.2	8.0	2.1	1.1			
10	291.0	10.0	4.1	8.0	2.0	0.8			
11	262.0	16.0	7.3	7.9	1.2	0.8			
12	218.0	8.0	4.4	8.0	2.3	0.9			
13	268.0	8.0	3.6	7.9	1.4				
14	347.0	11.0	3.8	8.0	2.4				
15	207.0	8.0	4.6	8.0	1.6	0.7			
16	284.0	9.0	3.8	7.8	1.3	1.0			
17	296.0	11.0	4.5	7.9	1.2	1.1			
18	320.0	12.0	4.5	8.1	1.4	1.2			
19	361.0	11.0	3.7	8.0	1.9	1.1			
20	252.0	9.0	4.3	7.9	2.2				
21	412.0	14.0	4.1	8.1	2.2				
22	345.0	12.0	4.2	7.9	1.9	0.9			
23	292.0	10.0	4.1	8.0	1.1	0.7			
24	326.0	11.0	4.0	7.9	1.9	1.3			
25	351.0	11.0	3.8	7.8	2.2				
26	194.0	15.0	9.3	8.0	1.9				
27	341.0	12.0	4.2	7.9	2.1				
28	194.0	8.0	4.9	7.8	1.8				
29	273.0	9.0	4.0	8.0	1.9	1.3			
30	312.0	15.0	5.8	7.9	1.2	0.9			
31	329.0	11.0	4.0	8.0	1.0	2.0			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Ronald P. Willy*, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
MONTHLY TOTAL	13492.0	--545.0	145.1	236.6	50.8	13.2			3	
AVERAGE	449.7	18.2	4.8	7.9	1.7	0.7				
MAXIMUM	653.0	26.0	7.1	8.0	2.4	1.2				
MINIMUM	247.0	8.0	3.6	7.8	1.2	0.3				
01	313.0	10.0	3.8	7.8	2.1					
02	504.0	19.0	4.5	7.9	1.7					
03	408.0	14.0	4.1	7.8	1.6	0.6			3	
04	494.0	19.0	4.6	8.0	1.9	0.7				
05	432.0	18.0	5.0	7.8	1.6	0.5				
06	453.0	18.0	4.8	8.0	1.6	0.6				
07	371.0	15.0	4.9	8.0	1.8	0.8				
08	477.0	20.0	5.0	7.9	2.1					
09	610.0	26.0	5.1	7.9	1.7					
10	406.0	19.0	5.6	7.9	1.6	0.9				
11	633.0	26.0	4.9	7.8	1.6	0.4				
12	338.0	20.0	7.1	7.8	1.3	0.5				
13	277.0	11.0	4.8	7.8	1.3	0.4				
14	417.0	18.0	5.2	8.0	1.9	0.3				
15	419.0	17.0	4.9	7.8	1.6					
16	374.0	15.0	4.8	7.9	1.7					
17	403.0	17.0	5.1	7.9	1.2	1.0				
18	522.0	23.0	5.3	7.9	2.0	0.9				
19	382.0	18.0	5.7	7.9	1.9	1.1				
20	603.0	25.0	5.0	7.9	1.3	0.8				
21	527.0	24.0	5.5	7.8	2.4	1.2				
22	540.0	22.0	4.9	7.8	1.8					
23	414.0	19.0	5.5	7.9	1.7					
24	519.0	22.0	5.1	7.9	1.6	1.0				
25	519.0	20.0	4.6	8.0	1.8	0.9				
26	653.0	23.0	4.2	8.0	1.3	0.6				
27	539.0	17.0	3.8	7.9	1.5					
28	330.0	10.0	3.6	7.8	1.8					
29	368.0	12.0	3.9	7.9	1.6					
30	247.0	8.0	3.9	7.9	1.8					

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Sam P. White, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	14945.0	740.0	179.2	244.1	54.3	16.9		2	
AVERAGE	482.1	22.9	5.8	7.9	1.8	0.7			
MAXIMUM	748.0	38.0	10.9	8.0	3.0	1.3			
MINIMUM	296.0	10.0	3.9	7.7	1.0	0.3			
01	474.0	20.0	5.1	7.9	2.0	1.1		2	
02	546.0	23.0	5.1	7.9	2.1	1.0			
03	650.0	23.0	4.2	7.8	1.6	0.8			
04	493.0	36.0	8.8	7.7	1.4				
05	460.0	23.0	6.0	7.9	2.3				
06	576.0	22.0	4.6	7.8	1.3	0.7			
07	691.0	27.0	4.7	7.9	2.0	0.7			
08	549.0	22.0	4.8	7.8	1.9	0.7			
09	519.0	20.0	4.6	7.8	1.5	0.7			
10	461.0	18.0	4.7	7.9	1.3	0.6			
11	748.0	30.0	4.8	7.8	1.0				
12	528.0	22.0	5.0	7.7	1.9				
13	484.0	20.0	5.0	7.8	1.1	0.6			
14	614.0	29.0	5.7	7.8	2.0	0.7			
15	450.0	18.0	4.8	7.8	1.7	0.6			
16	335.0	20.0	7.2	8.0	2.2	0.4			
17	349.0	15.0	5.2	7.9	1.4	1.0			
18	354.0	15.0	5.1	8.0	1.5				
19	507.0	21.0	5.0	7.9	1.3				
20	519.0	22.0	5.1	7.9	1.7	0.7			
21	460.0	21.0	5.5	7.9	1.3	0.7			
22	600.0	32.0	6.4	7.8	1.3	0.6			
23	568.0	37.0	7.8	7.8	2.0	1.0			
24	417.0	38.0	10.9	7.8	2.3	0.7			
25	513.0	38.0	8.9	8.0	2.2				
26	296.0	23.0	9.3	8.0	2.2				
27	311.0	12.0	4.6	7.9	1.5	1.3			
28	364.0	25.0	8.2	8.0	1.7	0.6			
29	389.0	14.0	4.3	8.0	3.0	0.6			
30	413.0	14.0	4.1	7.9	1.7	0.3			
31	307.0	10.0	3.9	8.0	1.9	0.8			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554345 C.U.P. NO. 3-109-002

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.8 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James P. Uddy, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		

MONTHLY TOTAL	18839.0	936.0	176.7	235.4	43.5	15.0			2	
AVERAGE	628.0	31.2	5.9	7.8	1.5	0.7				
MAXIMUM	1038.0	60.0	7.4	7.9	2.2	1.1				
MINIMUM	343.0	14.0	4.1	7.8	0.5	0.3				

01	400.0	20.0	6.0	7.8	1.4					
02	368.0	16.0	5.2	7.8	1.3	0.9				
03	547.0	23.0	5.0	7.8	1.7	0.7				
04	405.0	18.0	5.3	7.8	1.2	0.7				
05	610.0	28.0	5.5	7.9	1.4	0.8				
06	618.0	31.0	6.0	7.9	1.1					
07	665.0	32.0	5.8	7.9	2.0					
08	343.0	17.0	5.9	7.8	1.7	0.9				
09	914.0	47.0	6.2	7.8	1.4	1.0			2	
10	621.0	32.0	6.2	7.8	1.3	0.4				
11	613.0	38.0	7.4	7.8	1.4	0.8				
12	509.0	29.0	6.8	7.9	1.7	1.1				
13	1038.0	60.0	6.9	7.8	1.0					
14	708.0	43.0	7.3	7.9	2.1					
15	814.0	42.0	6.2	7.8	1.4	0.8				
16	796.0	42.0	6.3	7.9	1.5	0.8				
17	632.0	37.0	7.0	7.9	1.4	0.5				
18	783.0	39.0	6.0	7.8	1.5	0.4				
19	964.0	38.0	4.7	7.8	1.3	0.6				
20	859.0	44.0	6.1	7.9	0.9					
21	796.0	44.0	6.6	7.8	1.0					
22	794.0	36.0	5.4	7.8	1.5	0.3				
23	681.0	30.0	5.3	7.8	1.9	0.9				
24	573.0	24.0	5.0	7.9	2.2	0.9				
25	468.0	20.0	5.1	7.9	2.0	0.8				
26	411.0	14.0	4.1	7.9	1.8	0.9				
27	505.0	27.0	6.4	7.9	0.5					
28	505.0	25.0	5.9	7.9	0.5					
29	428.0	19.0	5.3	7.9	1.8	0.3				
30	471.0	21.0	5.4	7.8	1.6	0.5				

*USED LAST MONTHS
AVERAGE FLOW ON
9/27 & 9/28.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WHS ID NO. 2554345 C.U.P. NO. 3-109 JP

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.8 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.186 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Laura P. Kelly*, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE GALS. OR LBS USED Mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	15672.0	739.0	170.1	241.8	44.4	14.8		2	
AVERAGE	505.5	23.8	5.5	7.8	1.4	0.7			
MAXIMUM	854.0	43.0	8.6	7.9	2.1	1.0			
MINIMUM	234.0	7.0	2.9	7.7	1.1	0.4			
01	385.0	11.0	3.4	7.8	1.6	0.8			
02	327.0	8.0	2.9	7.8	1.9				
03	234.0	7.0	3.6	7.9	1.8				
04	392.0	12.0	3.7	7.9	1.3	0.7		2	
05	556.0	28.0	6.0	7.8	1.6	0.6			
06	322.0	14.0	5.2	7.8	1.4	0.9			
07	462.0	19.0	4.9	7.8	1.3	0.5			
08	338.0	14.0	5.0	7.8	1.1	0.5			
09	506.0	20.0	4.7	7.8	1.1				
10	538.0	23.0	5.1	7.7	1.2				
11	341.0	14.0	4.9	7.7	1.1	0.4			
12	345.0	15.0	5.2	7.8	1.4	0.8			
13	564.0	25.0	5.3	7.8	1.3	0.9			
14	438.0	22.0	6.0	7.8	1.6	1.0			
15	509.0	23.0	5.4	7.7	1.6	0.7			
16	550.0	30.0	6.5	7.7	1.2				
17	506.0	26.0	6.2	7.8	1.4				
18	610.0	31.0	6.1	7.7	1.1	0.7			
19	431.0	21.0	5.8	7.8	1.1	0.5			
20	540.0	27.0	6.0	7.8	1.2	0.6			
21	609.0	31.0	6.1	7.8	1.8	0.6			
22	600.0	43.0	8.6	7.8	1.3	0.5			
23	633.0	34.0	6.4	7.9	1.2				
24	489.0	23.0	5.6	7.8	1.3				
25	568.0	27.0	5.7	7.8	1.2	0.7			
26	502.0	25.0	6.0	7.8	1.6	0.7			
27	572.0	27.0	5.7	7.9	1.8	1.0			
28	678.0	34.0	6.0	7.9	2.1	0.9			
29	794.0	40.0	6.0	7.8	1.6	0.8			
30	854.0	42.0	5.9	7.8	1.7				
31	479.0	23.0	5.8	7.8	1.5				

DRI 3 WA TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.8 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Ron P. White*, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	RESIDUAL CHLORINE mg/L REMOTE TAP	ZINC POLYPHOSPHATE GALS. OR LBS USED	ZINC POLYPHOSPHATE Mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	16625.0	846.0	185.0	241.9	46.2	16.3			2	
AVERAGE	536.3	27.3	6.0	7.8	1.5	0.7				
MAXIMUM	1051.0	58.0	8.5	7.9	2.2	1.2				
MINIMUM	310.0	11.0	3.8	7.6	0.9	0.3				
01	476.0	21.0	5.3	7.8	1.5	0.5				
02	637.0	24.0	4.5	7.8	1.9	0.5				
03	1051.0	53.0	6.1	7.8	1.3	0.5				
04	574.0	24.0	5.0	7.7	1.6					
05	606.0	31.0	6.1	7.8	1.4					
06	442.0	25.0	6.8	7.6	1.7					
07	571.0	29.0	6.1	7.8	2.2	1.1			2	
08	590.0	32.0	6.5	7.8	2.2	1.2				
09	451.0	23.0	6.1	7.8	1.7	0.9				
10	398.0	18.0	5.4	7.8	1.5	0.5				
11	431.0	19.0	5.3	7.8	1.1	0.7				
12	515.0	20.0	4.7	7.8	1.0					
13	530.0	17.0	3.8	7.8	1.0					
14	509.0	22.0	5.2	7.8	1.3	0.5				
15	679.0	38.0	6.7	7.9	1.6	0.5				
16	650.0	39.0	7.2	7.8	2.1	0.7				
17	559.0	34.0	7.3	7.8	1.3	0.9				
18	391.0	22.0	6.8	7.9	1.3	0.8				
19	428.0	25.0	7.0	7.8	1.2					
20	579.0	32.0	6.6	7.8	1.3					
21	487.0	30.0	7.4	7.8	1.6	0.9				
22	642.0	40.0	7.5	7.8	1.7	0.9				
23	840.0	58.0	8.3	7.7	1.3	0.7				
24	687.0	45.0	7.9	7.8	1.0	0.3				
25	451.0	32.0	8.5	7.9	0.9	0.4				
26	465.0	19.0	4.9	7.8	1.2					
27	375.0	13.0	4.2	7.8	1.0					
28	364.0	14.0	4.6	7.8	1.3	1.2				
29	586.0	24.0	4.9	7.9	2.0	0.8				
30	351.0	12.0	4.1	7.9	2.2	0.9				
31	310.0	11.0	4.3	7.8	1.8	0.9				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.8 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Sam P. Willy

, C.O., CERT. NO. C-6345

MAY OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
MONTHLY TOTAL	13739.0	662.0	175.5	233.8	51.9	23.7			2	
AVERAGE	458.0	22.1	5.8	7.8	1.7	1.1				
MAXIMUM	611.0	27.0	6.8	7.9	2.2	1.8				
MINIMUM	264.0	13.0	4.9	7.5	0.5	0.7				
01	318.0	18.0	6.8	7.5	0.5					
02	468.0	24.0	6.2	7.8	1.8	0.8			2	
03	546.0	27.0	5.9	7.8	2.1	1.4				
04	505.0	23.0	5.5	7.8	1.9	1.5				
05	264.0	13.0	5.9	7.8	1.9	1.3				
06	451.0	21.0	5.6	7.8	1.9	1.1				
07	458.0	21.0	5.5	7.8	1.0					
08	458.0	24.0	6.3	7.8	1.9					
09	458.0	20.0	5.2	7.8	2.1	1.6				
10	439.0	23.0	6.3	7.9	2.2	1.8				
11	432.0	21.0	5.8	7.8	1.8	1.1				
12	317.0	17.0	6.4	7.8	1.9	1.0				
13	405.0	19.0	5.6	7.8	1.8	1.0				
14	464.0	23.0	5.9	7.7	2.0					
15	312.0	17.0	6.5	7.8	1.9					
16	464.0	23.0	5.9	7.8	1.8	1.1				
17	397.0	21.0	6.3	7.8	1.9	1.1				
18	330.0	18.0	6.5	7.8	1.3	1.0				
19	364.0	19.0	6.3	7.8	1.6	1.0				
20	493.0	26.0	6.3	7.8	1.7	0.9				
21	512.0	26.0	6.1	7.9	1.5					
22	518.0	24.0	5.6	7.8	1.6					
23	540.0	26.0	5.8	7.8	1.7	1.0				
24	454.0	23.0	6.1	7.8	2.2	1.0				
25	548.0	25.0	5.5	7.8	1.9	1.3				
26	507.0	22.0	5.2	7.8	1.7	1.1				
27	546.0	23.0	5.1	7.8	1.9	0.9				
28	577.0	25.0	5.2	7.8	1.2					
29	611.0	25.0	4.9	7.8	1.6					
30	583.0	25.0	5.1	7.8	1.6	0.7				

NOTE: 6-7, 8, 9 AVERAGE FLOW, RECORDER MALFUNCTION.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

AS ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: May 1997

AVERAGE EFFLUENT pH: 7.8 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Lawrence P. Willey, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE GALS. OR LBS USED Mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP			
MONTHLY TOTAL	19688.0	981.0	185.2	242.9	55.9	24.1		2	
AVERAGE	635.1	31.6	6.0	7.8	1.8	1.1			
MAXIMUM	865.0	44.0	6.8	8.0	2.5	2.0			
MINIMUM	313.0	15.0	4.4	7.8	0.2	0.3			
01	531.0	27.0	6.1	7.8	1.8	0.9			
02	698.0	37.0	6.4	7.8	2.3	0.8			
03	659.0	31.0	5.6	7.9	1.5				
04	683.0	31.0	5.4	7.8	1.3				
05	620.0	30.0	5.8	7.8	1.0	0.4		2	
06	711.0	35.0	5.9	7.8	1.5	0.5			
07	678.0	35.0	6.2	7.8	1.5	0.5			
08	773.0	40.0	6.2	7.8	1.7	0.5			
09	752.0	36.0	5.7	7.8	1.6	0.3			
10	839.0	42.0	6.0	7.8	1.0				
11	761.0	40.0	6.3	8.0	1.0				
12	394.0	21.0	6.4	7.8	1.9	0.6			
13	659.0	36.0	6.6	7.8	2.3	1.4			
14	456.0	26.0	6.8	7.8	2.1	1.3			
15	712.0	38.0	6.4	7.8	1.9	1.4			
16	865.0	44.0	6.1	7.8	1.6	0.9			
17	865.0	42.0	5.8	7.9	2.1				
18	494.0	26.0	6.3	8.0	2.3				
19	714.0	34.0	5.7	7.9	2.1	1.2			
20	818.0	40.0	5.9	7.8	0.2	1.5			
21	723.0	36.0	6.0	7.8	1.9	2.0			
22	745.0	35.0	5.6	7.8	2.3	1.7			
23	666.0	32.0	5.8	7.8	2.3	1.8			
24	668.0	34.0	6.1	7.8	2.3				
25	520.0	27.0	6.2	7.8	2.5				
26	604.0	31.0	6.2	7.9	2.5				
27	423.0	23.0	6.5	7.9	2.1	1.4			
28	391.0	18.0	5.5	7.8	2.1	1.9			
29	313.0	15.0	5.8	7.9	2.3	1.6			
30	518.0	23.0	5.3	7.9	2.1	1.5			
31	435.0	16.0	4.4	7.8	0.8				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONS SUMMARY

WS ID NO. 2554345 C.U.P. NO. 3-109-243P

NAME OF DRINKING WATER SYSTEM: ST. JOHN'S NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.8 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Gene Purtilly

, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/L	ZINC POLYPHOSPHATE GALS. OR LBS USED	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	18216.0	1180.0	236.7	234.6	67.4	25.9	2
AVERAGE	607.2	39.3	7.9	7.8	2.2	1.2	
MAXIMUM	972.0	61.0	14.2	7.9	3.6	2.0	
MINIMUM	284.0	18.0	6.1	7.7	1.3	0.5	
01	609.0	45.0	8.9	7.8	2.8	1.1	2
02	703.0	45.0	7.7	7.8	2.1	0.8	
03	675.0	40.0	7.1	7.8	2.3	0.5	
04	808.0	48.0	7.1	7.8	2.2	0.5	
05	610.0	37.0	7.3	7.7	1.8		
06	757.0	47.0	7.5	7.9	1.5		
07	808.0	61.0	9.1	7.9	2.3	1.1	
08	693.0	58.0	10.0	7.8	1.9	1.3	
09	767.0	59.0	9.2	7.8	1.7	1.3	
10	712.0	47.0	7.9	7.8	1.6	0.8	
11	578.0	37.0	7.7	7.8	1.3	0.7	
12	728.0	48.0	7.9	7.9	1.5		
13	935.0	61.0	7.8	7.9	1.9		
14	304.0	36.0	14.2	7.8	2.8	1.4	
15	374.0	19.0	6.1	7.8	3.3	1.6	
16	438.0	36.0	9.9	7.8	3.6	1.8	
17	659.0	40.0	7.3	7.8	2.3	2.0	
18	972.0	57.0	7.0	7.8	2.8	1.5	
19	648.0	37.0	6.9	7.9	2.7		
20	699.0	37.0	6.4	7.8	2.6		
21	778.0	43.0	6.6	7.8	2.3	1.1	
22	668.0	37.0	6.6	7.8	2.3	1.0	
23	415.0	28.0	8.1	7.9	2.5	1.2	
24	533.0	33.0	7.4	7.9	2.9	1.4	
25	525.0	30.0	6.9	7.8	2.2	0.9	
26	422.0	27.0	7.7	7.8	1.6		
27	284.0	18.0	7.6	7.8	1.8		
28	309.0	25.0	9.7	7.8	2.2	1.3	
29	374.0	22.0	7.1	7.8	2.3	1.5	
30	431.0	22.0	6.1	7.8	2.3	1.1	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT
 ADDRESS: 2369 Hawkcrest Woods Dr. COUNTY: ST. JOHNS
 PROVIDED BY: United Water Florida Inc. REPORTING MONTH: March 1997
 INFLUENT EFFLUENT pH: 7.9 (AVG) NO. OF SERVICES AT END OF MONTH: 297
 AVERAGE FLOW: 0.180 (MGD) MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT *Rosemary P. DeWitt*, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE GALS. OR LBS USED Mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP			
DAILY									
TOTAL	16696.0	872.0	190.0	244.0	69.9	11.7		2	
AVERAGE	538.6	28.1	6.1	7.9	2.3	0.6			
MINIMUM	705.0	70.0	13.0	8.1	3.3	1.1			
MAXIMUM	318.0	11.0	3.3	7.7	0.6	0.3			
01	609.0	28.0	5.5	7.9	2.9				
02	691.0	32.0	5.6	7.9	1.1				
03	590.0	34.0	6.9	7.9	1.8	0.3			
04	613.0	36.0	7.0	7.9	2.2	0.3			
05	632.0	41.0	7.8	8.0	3.2	1.1			
06	572.0	34.0	7.1	8.0	3.3	1.0			
07	675.0	37.0	6.6	7.9	3.0	1.1			
08	705.0	38.0	6.5	7.9	1.1				
09	678.0	33.0	5.8	8.1	1.3				
10	598.0	28.0	5.6	7.8	1.4	0.8			
11	538.0	26.0	5.8	7.7	2.5	0.4		2	
12	626.0	37.0	7.1	7.8	2.8	0.7			
13	400.0	18.0	5.4	7.7	3.2	0.8			
14	318.0	12.0	4.5	7.8	2.8	1.1			
15	466.0	14.0	3.6	7.9	1.0				
16	611.0	17.0	3.3	8.1	0.6				
17	578.0	24.0	5.0	7.9	2.3	0.4			
18	339.0	11.0	3.9	7.9	3.1	0.3			
19	483.0	24.0	6.0	7.8	2.8	0.3			
20	395.0	23.0	7.0	7.9	3.3	0.4			
21	434.0	23.0	6.4	7.9	2.8	0.4			
22	485.0	19.0	4.7	7.8	2.7				
23	493.0	18.0	4.4	7.9	2.3				
24	443.0	22.0	6.0	7.9	1.8	0.3			
25	424.0	16.0	4.5	7.9	2.8	0.4			
26	436.0	20.0	5.5	7.8	2.3	0.3			
27	510.0	25.0	5.9	7.8	3.3	0.3			
28	580.0	33.0	6.8	7.8	2.1				
29	561.0	42.0	9.0	7.8	1.1				
30	646.0	70.0	13.0	7.8	1.2				
31	567.0	37.0	7.8	7.8	1.8	1.0			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHN'S NORTH WATER TREATMENT PLANT

Acres Woods Dr.

COUNTY: ST. JOHNS

Water Florida Inc.

REPORTING MONTH: February 1997

pH: 7.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2855

THIS REPORT IS CORRECT Shawn P. Colby, C.O., CERT. NO. C-6345

	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE PLANT EFFLUENT mg/L	ZINC POLYPHOSPHATE REMOTE TAP GALS. OR LBS USED	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
1/PLY							
TOTAL	11057.0	727.0	220.4	63.9	11.9	2	
AVERAGE	394.9	26.0	7.9	2.3	0.6		
MAXIMUM	495.0	36.0	8.0	3.5	1.3		
MINIMUM	275.0	15.0	7.7	1.0	0.3		
01	415.0	29.0	7.9	1.4			
02	471.0	32.0	7.9	1.4	0.7		
03	415.0	36.0	7.9	1.8			
04	389.0	28.0	7.8	1.4	0.3		
05	495.0	35.0	7.8	1.6	0.4		
06	432.0	29.0	7.8	1.9	0.5		
07	403.0	30.0	7.8	2.0	0.7		
08	373.0	30.0	7.9	1.6			
09	317.0	23.0	8.0	3.5			
10	358.0	25.0	7.9	2.0	0.5		
11	358.0	22.0	7.9	2.3	0.5		
12	367.0	24.0	7.8	2.9	0.5		
13	294.0	20.0	7.9	3.1	0.7		
14	320.0	22.0	7.9	2.8	0.6		
15	275.0	19.0	7.8	2.5			
16	355.0	21.0	7.9	2.9			
17	343.0	16.0	7.9	2.6			
18	394.0	24.0	7.7	2.0	0.3		
19	422.0	23.0	7.8	2.3	0.3		
20	451.0	32.0	7.6	2.5	0.3		
21	472.0	32.0	7.8	1.8	0.4		
22	347.0	27.0	8.0	1.0			
23	459.0	33.0	8.0	3.0			
24	426.0	32.0	7.9	2.8	0.9		
25	389.0	18.0	7.8	2.5	1.0		
26	451.0	21.0	8.0	2.3	0.9		
27	424.0	20.0	7.9	2.9	1.1		
28	421.0	24.0	7.9	3.1	1.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1997

PLANT EFFLUENT pH: 7.9 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Sam P. ...*, C.O., CERT. NO. C-6345

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		

MONTHLY TOTAL	10926.0	858.0	296.3	245.7	63.9	14.0			2	
AVERAGE	352.5	27.7	9.6	7.9	2.1	0.6				
MAXIMUM	518.0	35.0	12.4	8.0	3.1	0.9				
MINIMUM	230.0	16.0	7.9	7.8	1.1	0.3				

01	393.0	30.0	9.2	7.9	1.8					
02	373.0	27.0	8.7	7.9	2.3	0.4				
03	333.0	26.0	9.4	8.0	1.4	0.3				
04	376.0	26.0	8.3	8.0	1.3					
05	432.0	29.0	8.1	7.9	1.1					
06	385.0	32.0	10.0	7.9	2.0	0.6				
07	264.0	25.0	11.4	8.0	2.3	0.8				
08	271.0	23.0	10.2	7.9	2.8	0.9				
09	261.0	27.0	12.4	8.0	2.6	0.8				
10	300.0	22.0	8.8	8.0	3.1	0.8				
11	284.0	26.0	11.0	8.0	1.1					
12	389.0	26.0	8.0	7.9	3.0					
13	428.0	33.0	9.3	7.9	1.3	0.6			2	
14	299.0	23.0	9.2	8.0	2.1	0.5				
15	331.0	26.0	9.4	7.8	1.4	0.5				
16	338.0	33.0	11.7	7.9	2.8	0.4				
17	410.0	30.0	8.8	7.9	1.8	0.7				
18	497.0	35.0	8.5	7.9	1.3					
19	230.0	16.0	8.3	7.8	1.9					
20	518.0	34.0	7.9	7.9	1.1	0.4				
21	345.0	24.0	8.3	7.9	2.1	0.3				
22	417.0	31.0	8.9	7.9	1.3	0.4				
23	437.0	32.0	8.8	7.9	1.2	0.6				
24	349.0	30.0	10.3	7.9	2.5	0.6				
25	266.0	26.0	11.7	8.0	2.2					
26	353.0	30.0	10.2	8.0	2.4					
27	327.0	28.0	10.3	7.9	2.8	0.9				
28	343.0	28.0	9.8	7.9	2.5	0.9				
29	325.0	29.0	10.7	8.0	3.0	0.9				
30	331.0	25.0	9.1	7.9	3.0	0.9				
31	321.0	26.0	9.7	7.9	2.4	0.8				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1855.0	63.0	127.2	155.1	45.9	10.6	
AVERAGE	59.8	2.0	4.1	7.4	1.5	0.5	
MAXIMUM	88.0	3.0	6.0	7.4	1.8	0.6	
MINIMUM	49.0	1.0	2.3	7.3	1.2	0.4	
01	63.0	2.0	3.8	7.3	1.5	0.5	
02	55.0	2.0	4.4	7.3	1.5	0.6	
03	51.0	2.0	4.7	7.3	1.6	0.4	
04	59.0	2.0	4.1	7.4	1.4	0.4	
05	71.0	3.0	5.1	7.4	1.5	0.5	
06	61.0	2.0	3.9		1.7		
07	70.0	3.0	5.1		1.5		
08	58.0	2.0	4.1	7.4	1.2	0.5	
09	60.0	2.0	4.0	7.4	1.4	0.5	
10	56.0	2.0	4.3	7.4	1.4	0.5	
11	63.0	2.0	3.8	7.4	1.6	0.5	
12	67.0	2.0	3.6	7.4	1.4	0.5	
13	65.0	2.0	3.7		1.5		
14	52.0	1.0	2.3		1.4		
15	63.0	2.0	3.8	7.4	1.4	0.4	
16	58.0	2.0	4.1	7.4	1.8	0.6	
17	54.0	2.0	4.4	7.4	1.6	0.5	
18	49.0	1.0	2.4	7.4	1.6	0.6	
19	77.0	2.0	3.1	7.4	1.7	0.6	
20	60.0	3.0	6.0		1.5		
21	54.0	2.0	4.4		1.6		
22	65.0	2.0	3.7	7.4	1.2	0.5	
23	50.0	2.0	4.8	7.4	1.2	0.5	
24	61.0	2.0	3.9	7.4	1.8	0.5	
25	57.0	2.0	4.2		1.6		
26	49.0	2.0	4.9		1.6		
27	60.0	2.0	4.0		1.5		
28	57.0	2.0	4.2		1.6		
29	49.0	2.0	4.9	7.4	1.2	0.5	
30	53.0	2.0	4.5	7.4	1.2	0.5	
31	88.0	2.0	2.7	7.4	1.2	0.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENERIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James E. L. Hill*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1590.0	43.0	99.1	131.2	40.9	9.2	
AVERAGE	53.0	1.4	3.3	7.3	1.4	0.5	
MAXIMUM	78.0	2.0	6.5	7.3	1.7	0.6	
MINIMUM	32.0	1.0	1.5	7.2	0.9	0.4	
01	66.0	2.0	3.6		1.6		
02	55.0	1.0	2.2		1.7		
03	49.0	1.0	2.4	7.3	1.7	0.6	
04	50.0	2.0	4.8	7.3	1.5	0.6	
05	37.0	2.0	6.5	7.3	1.6	0.5	
06	63.0	2.0	3.8	7.3	1.2	0.5	
07	42.0	1.0	2.9	7.3	1.2	0.5	
08	43.0	2.0	5.6		1.2		
09	78.0	1.0	1.5		1.4		
10	65.0	1.0	1.8	7.3	1.2	0.5	
11	52.0	1.0	2.3	7.3	1.2	0.5	
12	50.0	1.0	2.4	7.3	1.2	0.5	
13	51.0	1.0	2.4	7.3	1.2	0.5	
14	37.0	1.0	3.2	7.3	1.1	0.5	
15	56.0	2.0	4.3		1.5		
16	59.0	2.0	4.1		1.0		
17	46.0	1.0	2.6	7.3	0.9	0.4	
18	54.0	2.0	4.4	7.3	1.2	0.5	
19	56.0	2.0	4.3	7.3	1.2	0.4	
20	50.0	1.0	2.4	7.3	1.5	0.6	
21	32.0	1.0	3.8	7.3	1.4	0.5	
22	56.0	1.0	2.1		1.4		
23	76.0	2.0	3.2		1.2		
24	50.0	1.0	2.4	7.3	1.4	0.5	
25	52.0	2.0	4.6	7.2	1.5	0.6	
26	41.0	1.0	2.9	7.2	1.5	0.5	
27	65.0	2.0	3.7		1.6		
28	47.0	1.0	2.6		1.6		
29	61.0	2.0	3.9		1.5		
30	51.0	1.0	2.4		1.5		

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

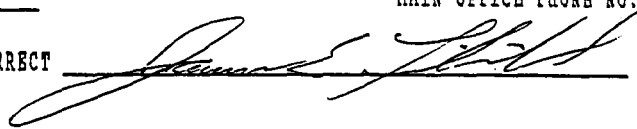 , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1793.0	46.0	94.8	169.7	48.5	12.6	
AVERAGE	57.8	1.5	3.1	7.4	1.6	0.5	
MAXIMUM	70.0	2.0	4.6	7.5	2.0	0.6	
MINIMUM	43.0	1.0	2.0	7.3	1.2	0.4	
01	57.0	1.0	2.1	7.4	1.4	0.5	
02	57.0	1.0	2.1	7.4	1.6	0.6	
03	59.0	1.0	2.0	7.4	1.6	0.6	
04	61.0	1.0	2.0		1.5		
05	61.0	1.0	2.0		1.6		
06	55.0	1.0	2.2	7.4	1.6	0.5	
07	48.0	1.0	2.5	7.4	1.6	0.6	
08	58.0	2.0	4.1	7.4	1.6	0.6	
09	66.0	2.0	3.6	7.3	1.6	0.5	
10	57.0	1.0	2.1	7.3	1.6	0.5	
11	63.0	2.0	3.8		1.5		
12	65.0	2.0	3.7		1.6		
13	59.0	1.0	2.0	7.4	1.4	0.5	
14	61.0	2.0	3.9	7.4	1.5	0.6	
15	43.0	1.0	2.8	7.4	1.5	0.5	
16	68.0	2.0	3.5	7.4	1.5	0.5	
17	61.0	1.0	2.0	7.3	2.0	0.6	
18	56.0	2.0	4.3		1.7		
19	62.0	2.0	3.9		1.7		
20	66.0	2.0	3.6	7.5	1.4	0.5	
21	47.0	1.0	2.6	7.3	1.2	0.4	
22	56.0	2.0	4.3	7.3	1.5	0.6	
23	61.0	1.0	2.0	7.3	1.6	0.6	
24	44.0	1.0	2.7	7.4	1.6	0.6	
25	60.0	2.0	4.0		1.8		
26	65.0	2.0	3.7		1.4		
27	70.0	2.0	3.4	7.4	1.6	0.5	
28	54.0	2.0	4.4	7.4	1.6	0.5	
29	52.0	2.0	4.6	7.4	1.5	0.6	
30	50.0	1.0	2.4	7.4	1.5	0.6	
31	51.0	1.0	2.4	7.4	1.7	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 10-02-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041A

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLAN

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

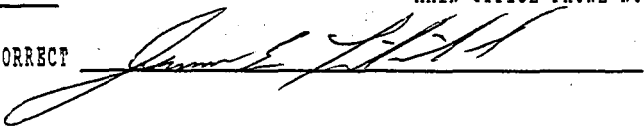

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1961.0	59.0	108.2	155.4	47.0	11.4	
AVERAGE	65.4	2.0	3.6	7.4	1.6	0.5	
MAXIMUM	87.0	3.0	5.2	7.4	2.0	0.6	
MINIMUM	41.0	1.0	1.6	7.4	1.4	0.5	
01	87.0	3.0	4.1		2.0		
02	58.0	2.0	4.1	7.4	1.4	0.5	
03	63.0	2.0	3.8	7.4	2.0	0.6	
04	49.0	1.0	2.4	7.4	1.4	0.6	
05	69.0	2.0	3.5	7.4	1.4	0.5	
06	76.0	2.0	3.2		1.5		
07	77.0	2.0	3.1		1.5		
08	53.0	1.0	2.3	7.4	1.4	0.5	
09	73.0	1.0	1.6	7.4	1.4	0.5	
10	61.0	2.0	3.9	7.4	1.5	0.5	
11	78.0	2.0	3.1	7.4	1.4	0.5	
12	69.0	3.0	5.2	7.4	1.4	0.5	
13	77.0	3.0	4.7		1.5		
14	61.0	2.0	3.9		1.4		
15	67.0	2.0	3.6	7.4	1.4	0.5	
16	58.0	2.0	4.1	7.4	1.6	0.6	
17	71.0	2.0	3.4	7.4	1.8	0.6	
18	65.0	2.0	3.7	7.4	1.4	0.5	
19	73.0	2.0	3.3	7.4	2.0	0.6	
20	81.0	2.0	3.0		1.8		
21	50.0	2.0	4.8		1.8		
22	77.0	3.0	4.7	7.4	1.4	0.6	
23	58.0	2.0	4.1	7.4	1.8	0.6	
24	52.0	2.0	4.6	7.4	1.6	0.6	
25	64.0	2.0	3.8	7.4	2.0	0.6	
26	41.0	1.0	2.9	7.4	1.4	0.5	
27	58.0	2.0	4.1		1.4		
28	65.0	2.0	3.7		1.6		
29	72.0	2.0	3.3	7.4	1.4	0.5	
30	58.0	1.0	2.1	7.4	1.4	0.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VANDUSTIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1912.0	62.0	119.6	155.4	55.6	12.8	
AVERAGE	61.7	2.0	3.9	7.4	1.8	0.6	
MAXIMUM	87.0	4.0	6.1	7.4	2.2	0.7	
MINIMUM	48.0	1.0	1.8	7.4	1.6	0.4	
01	48.0	1.0	2.5	7.4	2.0	0.7	
02	71.0	2.0	3.4		2.0		
03	73.0	2.0	3.3		1.8		
04	60.0	1.0	2.0	7.4	1.8	0.5	
05	49.0	1.0	2.4	7.4	1.6	0.5	
06	74.0	3.0	4.9	7.4	1.6	0.4	
07	55.0	2.0	4.4	7.4	1.8	0.6	
08	50.0	2.0	4.8	7.4	1.8	0.7	
09	58.0	2.0	4.1		2.0		
10	87.0	4.0	5.5		1.8		
11	57.0	2.0	4.2	7.4	1.7	0.5	
12	61.0	2.0	3.9	7.4	1.7	0.6	
13	51.0	2.0	4.7	7.4	1.6	0.6	
14	72.0	3.0	5.0	7.4	1.6	0.6	
15	49.0	2.0	4.9	7.4	2.0	0.7	
16	57.0	2.0	4.2		1.8		
17	83.0	4.0	5.8		1.8		
18	60.0	2.0	4.0	7.4	1.7	0.6	
19	59.0	3.0	6.1	7.4	1.7	0.6	
20	59.0	2.0	4.1	7.4	2.0	0.7	
21	62.0	2.0	3.9	7.4	1.8	0.6	
22	49.0	2.0	4.9	7.4	1.8	0.6	
23	68.0	1.0	1.8		1.8		
24	62.0	2.0	3.9		1.7		
25	74.0	2.0	3.2	7.4	1.8	0.6	
26	64.0	1.0	1.9	7.4	1.6	0.6	
27	57.0	2.0	4.2	7.4	1.7	0.7	
28	73.0	2.0	3.3	7.4	1.6	0.7	
29	53.0	1.0	2.3	7.4	2.2	0.7	
30	58.0	1.0	2.1		2.2		
31	59.0	2.0	4.1		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 08-12-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161210 C.U.P. NO. 2-031-00411 NAME OF DRINKING WATER SYSTEM: VIREOTA TERRACE WATER TREATMENT PLANT
 LOCATION: 5190 RESIGN AVENUE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: July 1997
 PLANT EFFLUENT PH: 7.4(AVG) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIL OFFICE PHONE NO. (904) 725-2845
 I CERTIFY THIS REPORT IS CORRECT _____, C.O., CERT. NO. C-7597

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		SALES OR LOSS, USPD	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1914.0	61.0	116.7	162.0	91.4	11.8	
AVERAGE	61.7	2.0	3.8	7.4	1.7	0.5	
MAXIMUM	80.0	4.0	7.0	7.4	2.9	0.7	
MINIMUM	33.0	1.0	1.7	7.3	1.4	0.4	
01	67.0	2.0	3.6	7.3	1.4	0.5	
02	78.0	3.0	4.6	7.3	2.0	0.6	
03	48.0	1.0	2.5	7.3	2.0	0.6	
04	74.0	3.0	4.9		1.8		
05	56.0	2.0	4.3		1.8		
06	63.0	4.0	7.0		1.8		
07	67.0	2.0	3.5	7.3	1.5	0.5	
08	61.0	1.0	2.0	7.3	1.6	0.5	
09	67.0	3.0	5.4	7.3	1.4	0.4	
10	54.0	2.0	4.4	7.3	1.5	0.4	
11	80.0	2.0	3.0	7.3	1.7	0.5	
12	48.0	1.0	2.5		1.6		
13	74.0	2.0	3.2		1.6		
14	67.0	3.0	5.4	7.4	1.5	0.5	
15	56.0	2.0	3.8	7.4	1.6	0.4	
16	52.0	1.0	2.3	7.4	1.6	0.6	
17	58.0	2.0	4.1	7.4	1.6	0.6	
18	51.0	1.0	2.0	7.4	1.6	0.6	
19	57.0	2.0	4.2		1.5		
20	68.0	3.0	5.3		1.5		
21	56.0	2.0	3.5	7.4	1.6	0.4	
22	69.0	1.0	1.7	7.4	1.5	0.4	
23	33.0	1.0	3.6	7.4	1.5	0.5	
24	56.0	2.0	3.6	7.4	1.6	0.6	
25	67.0	2.0	3.5	7.4	2.0	0.6	
26	56.0	2.0	4.4		1.8		
27	68.0	3.0	5.3		1.9		
28	56.0	2.0	4.3	7.4	1.7	0.7	
29	65.0	2.0	3.5	7.4	1.8	0.7	
30	53.0	1.0	2.3	7.4	1.8	0.5	
			6.7	7.4	1.6	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 07-16-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VIRGINIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1806.0	66.0	130.3	154.5	50.9	13.4	
AVERAGE	60.2	2.2	4.3	7.4	1.7	0.6	
MAXIMUM	82.0	4.0	7.4	7.4	2.5	1.5	
MINIMUM	36.0	1.0	2.1	7.2	0.6	0.4	
01	47.0	1.0	2.6		1.6		
02	67.0	2.0	3.6	7.4	1.8	0.5	
03	56.0	2.0	4.3	7.4	1.6	0.7	
04	50.0	2.0	4.8	7.4	1.6	0.6	
05	59.0	2.0	4.1	7.4	1.8	0.7	
06	37.0	1.0	3.2	7.4	1.6	0.7	
07	59.0	2.0	4.1		1.8		
08	78.0	3.0	4.6		2.0		
09	56.0	2.0	4.3	7.4	1.8	0.7	
10	57.0	1.0	2.1	7.4	1.8	0.5	
11	54.0	2.0	4.4	7.4	1.6	0.5	
12	60.0	2.0	4.0	7.4	1.6	0.6	
13	36.0	1.0	3.3	7.4	1.6	0.4	
14	71.0	2.0	3.4		1.8		
15	81.0	3.0	4.4		1.8		
16	61.0	3.0	5.9	7.2	1.6	0.5	
17	58.0	3.0	6.2	7.2	1.8	0.7	
18	58.0	2.0	4.1	7.2	1.6	0.6	
19	73.0	3.0	4.9	7.3	2.5	1.5	
20	56.0	3.0	6.4	7.3	2.0	1.0	
21	74.0	3.0	4.9		2.2		
22	39.0	2.0	6.2		2.0		
23	82.0	4.0	5.9	7.3	1.8	0.5	
24	49.0	1.0	2.4	7.4	2.0	0.6	
25	76.0	2.0	3.2	7.4	0.6	0.6	
26	62.0	2.0	3.9	7.4	1.0	0.4	
27	66.0	2.0	3.6	7.4	1.5	0.5	
28	63.0	2.0	3.8		1.4		
29	65.0	4.0	7.4		1.5		
30	56.0	2.0	4.3	7.4	1.6	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENEZIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997


LAST EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL	1669.0	47.0	91.8	169.9	41.6	11.8	
AVERAGE	61.8	1.7	3.4	7.4	1.5	0.7	
MAXIMUM	85.0	2.0	5.7	7.5	2.6	1.4	
MINIMUM	38.0	1.0	2.0	7.3	1.0	0.3	

01							
02							
03							
04							
05	66.0	2.0	3.6	7.3	1.0		
06	72.0	2.0	3.3	7.3	2.6	1.4	
07	57.0	2.0	4.2	7.3	1.8	1.0	
08	59.0	1.0	2.0	7.3	1.8	1.2	
09	59.0	1.0	2.0	7.5	1.2	0.3	
10	67.0	2.0	3.6		1.2		
11	83.0	2.0	2.9		1.5		
12	58.0	2.0	4.1	7.4	1.6	0.6	
13	56.0	1.0	2.1	7.4	1.5	0.6	
14	58.0	2.0	4.1	7.4	1.5	0.4	
15	63.0	2.0	3.8	7.4	1.6	0.6	
16	38.0	1.0	3.2	7.4	1.6	0.6	
17	85.0	2.0	2.8		1.6		
18	65.0	2.0	3.7		1.6		
19	66.0	2.0	3.6	7.4	1.5	0.7	
20	70.0	2.0	3.4	7.4	1.1	0.5	
21	47.0	1.0	2.6	7.4	1.6	0.7	
22	42.0	2.0	5.7	7.4	1.5	0.6	
23	68.0	2.0	3.5	7.4	1.3	0.5	
24	51.0	2.0	4.7	7.4	1.5		
25	71.0	2.0	3.4	7.4	1.4		
26	76.0	2.0	3.2	7.4	1.5		
27	65.0	2.0	3.7	7.4	1.7	0.5	
28	49.0	1.0	2.4	7.4	1.8	0.6	
29	42.0	1.0	2.9	7.4	1.5	0.5	
30	66.0	2.0	3.6	7.4	1.5	0.5	
31	70.0	2.0	3.4	7.4	1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 05-05-97

PLANT ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VERA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James E. Hill*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	300.0	8.0	15.9	29.2	10.5	2.4	
AVERAGE	60.0	1.6	3.2	7.3	1.8	0.6	
MAXIMUM	68.0	2.0	4.2	7.3	2.0	0.7	
MINIMUM	50.0	1.0	1.9	7.3	1.6	0.5	
01	64.0	1.0	1.9	7.3	1.8	0.7	
02	50.0	1.0	2.4	7.3	2.0	0.6	
03	68.0	2.0	3.5	7.3	1.6	0.6	
04	61.0	2.0	3.9	7.3	1.6	0.5	
05	57.0	2.0	4.2		1.8		
06					1.7		
07							
08							
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-10-97

COMMENTS: Plant off line 4/7 - 4/30 for painting. Water provided by city intertie.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

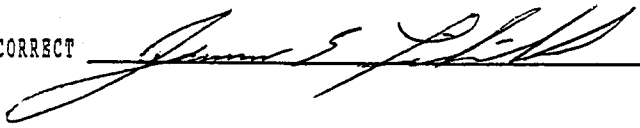

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1846.0	48.0	97.6	146.0	47.6	10.3	
AVERAGE	59.5	1.5	3.1	7.3	1.5	0.5	
MAXIMUM	86.0	3.0	6.1	7.3	1.8	0.6	
MINIMUM	31.0	1.0	1.7	7.3	1.4	0.4	
01	82.0	2.0	2.9		1.4		
02	53.0	1.0	2.3		1.5		
03	63.0	2.0	3.8	7.3	1.4	0.5	
04	57.0	2.0	4.2	7.3	1.4	0.4	
05	61.0	2.0	3.9	7.3	1.8	0.5	
06	56.0	1.0	2.1	7.3	1.6	0.5	
07	63.0	1.0	1.9	7.3	1.4	0.5	
08	55.0	2.0	4.4		1.4		
09	74.0	2.0	3.2		1.7		
10	52.0	2.0	4.6	7.3	1.4	0.5	
11	71.0	1.0	1.7	7.3	1.4	0.4	
12	48.0	1.0	2.5	7.3	1.4	0.5	
13	63.0	2.0	3.8	7.3	1.7	0.5	
14	41.0	1.0	2.9	7.3	1.6	0.6	
15	62.0	2.0	3.9		1.4		
16	68.0	1.0	1.8		1.8		
17	69.0	1.0	1.7	7.3	1.6	0.5	
18	54.0	2.0	4.4	7.3	1.5	0.6	
19	64.0	2.0	3.8	7.3	1.6	0.5	
20	59.0	2.0	4.1	7.3	1.6	0.5	
21	31.0	1.0	3.9	7.3	1.8	0.6	
22	86.0	2.0	2.8		1.7		
23	60.0	2.0	4.0		1.6		
24	48.0	1.0	2.5	7.3	1.6	0.5	
25	57.0	1.0	2.1	7.3	1.4	0.5	
26	58.0	1.0	2.1	7.3	1.4	0.6	
27	53.0	1.0	2.3	7.3	1.4	0.5	
28	58.0	1.0	2.1		1.5		
29	59.0	3.0	6.1		1.5		
30	67.0	2.0	3.6		1.6		
31	54.0	1.0	2.2	7.3	1.5	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-17-97

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James S. Hill, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1600.0	46.0	96.2	177.6	39.0	9.9	
AVERAGE	57.1	1.6	3.4	7.4	1.4	0.5	
MAXIMUM	72.0	3.0	6.5	7.4	1.6	0.6	
MINIMUM	37.0	1.0	1.7	7.4	1.2	0.4	
01	48.0	1.0	2.5	7.4	1.5		
02	69.0	2.0	3.5	7.4	1.4		
03	68.0	1.0	1.8	7.4	1.4	0.6	
04	58.0	1.0	2.1	7.4	1.6	0.5	
05	42.0	1.0	2.9	7.4	1.2	0.6	
06	56.0	1.0	2.1	7.4	1.2	0.5	
07	63.0	1.0	1.9	7.4	1.4	0.6	
08	63.0	1.0	1.9	7.4	1.5		
09	55.0	3.0	6.5	7.4	1.5		
10	64.0	2.0	3.8	7.4	1.4	0.4	
11	57.0	1.0	2.1	7.4	1.4	0.6	
12	40.0	1.0	3.0	7.4	1.2	0.5	
13	67.0	2.0	3.6	7.4	1.6	0.6	
14	37.0	1.0	3.2	7.4	1.4	0.5	
15	66.0	2.0	3.6		1.6		
16	71.0	1.0	1.7		1.6		
17	62.0	2.0	3.9	7.4	1.6		
18	52.0	2.0	4.6	7.4	1.4	0.5	
19	62.0	2.0	3.9	7.4	1.4	0.4	
20	54.0	1.0	2.2	7.4	1.2	0.4	
21	37.0	1.0	3.2	7.4	1.4	0.6	
22	63.0	3.0	5.7		1.3		
23	72.0	3.0	5.0		1.3		
24	51.0	2.0	4.7	7.4	1.2	0.4	
25	49.0	1.0	2.4	7.4	1.4	0.6	
26	50.0	2.0	4.8	7.4	1.2	0.5	
27	57.0	2.0	4.2	7.4	1.2	0.5	
28	67.0	3.0	5.4	7.4	1.5	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 02-20-97

COMMENTS:

WS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: TIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

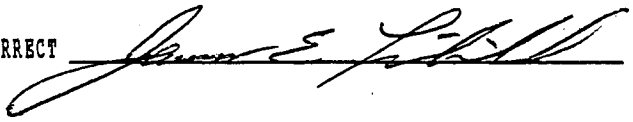

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1763.0	52.0	111.5	228.5	46.4	12.2	
AVERAGE	56.9	1.7	3.6	7.4	1.5	0.6	
MAXIMUM	75.0	4.0	7.7	7.4	1.8	0.7	
MINIMUM	38.0	1.0	1.8	7.3	1.2	0.5	
01	69.0	2.0	3.5	7.4	1.6		
02	58.0	2.0	4.1	7.4	1.5	0.7	
03	40.0	1.0	3.0	7.4	1.6	0.5	
04	56.0	1.0	2.1	7.3	1.6		
05	64.0	1.0	1.9	7.3	1.8		
06	50.0	1.0	2.4	7.3	1.6	0.6	
07	65.0	1.0	1.8	7.3	1.4	0.5	
08	38.0	1.0	3.2	7.3	1.8	0.5	
09	53.0	1.0	2.3	7.3	1.4	0.5	
10	61.0	1.0	2.0	7.3	1.6	0.6	
11	56.0	1.0	2.1	7.3	1.8		
12	63.0	2.0	3.8	7.3	1.7		
13	58.0	2.0	4.1	7.4	1.6	0.7	
14	48.0	2.0	5.0	7.4	1.6	0.5	
15	51.0	3.0	7.1	7.4	1.2	0.6	
16	52.0	2.0	4.6	7.4	1.2	0.7	
17	68.0	1.0	1.8	7.4	1.8	0.6	
18	71.0	2.0	3.4	7.4	1.6		
19	75.0	2.0	3.2	7.4	1.4		
20	55.0	3.0	6.5	7.4	1.4	0.5	
21	43.0	2.0	5.6	7.4	1.6	0.5	
22	62.0	4.0	7.7	7.4	1.4	0.6	
23	51.0	1.0	2.4	7.4	1.5	0.5	
24	45.0	2.0	5.3	7.4	1.4	0.5	
25	73.0	2.0	3.3	7.4	1.3		
26	59.0	1.0	2.0	7.4	1.3		
27	65.0	2.0	3.7	7.4	1.3	0.5	
28	60.0	2.0	4.0	7.4	1.4	0.5	
29	51.0	1.0	2.4	7.4	1.4	0.6	
30	55.0	1.0	2.2	7.4	1.2	0.5	
31	48.0	2.0	5.0	7.4	1.4	0.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth C. Sargent, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	25.3	7.75	2110.6	151.2	78.4	53.7	
AVERAGE	0.8	0.25	68.1	7.2	2.5	2.6	
MAXIMUM	3.9	0.25	300.0	7.2	3.0	3.0	
MINIMUM	0.1	0.25	7.7	7.2	1.4	1.4	
01	0.4	0.25	75.0	7.2	2.0	2.0	
02	0.4	0.25	75.0	7.2	2.4	2.4	
03	0.1	0.25	300.0	7.2	2.5	2.5	
04	0.3	0.25	100.0	7.2	2.8	2.8	
05	0.4	0.25	75.0	7.2	3.0	3.0	
06	1.1	0.25	27.3		2.7		
07	1.5	0.25	20.0		3.0		
08	0.6	0.25	50.0	7.2	3.0	3.0	
09	0.3	0.25	100.0	7.2	3.0	3.0	
10	0.4	0.25	75.0	7.2	3.0	3.0	
11	0.5	0.25	60.0	7.2	2.8	2.8	
12	0.7	0.25	42.9	7.2	2.7	2.7	
13	0.8	0.25	37.5		2.5		
14	0.2	0.25	150.0		2.7		
15	0.2	0.25	150.0	7.2	2.5	2.5	
16	0.5	0.25	60.0	7.2	2.8	2.8	
17	0.4	0.25	75.0	7.2	2.8	2.8	
18	0.3	0.25	100.0	7.2	2.6	2.6	
19	0.7	0.25	42.9	7.2	2.6	2.6	
20	0.8	0.25	37.5		2.4		
21	0.4	0.25	75.0		2.5		
22	0.5	0.25	60.0	7.2	2.7	2.7	
23	1.7	0.25	17.6	7.2	2.6	2.6	
24	3.9	0.25	7.7	7.2	2.4	2.4	
25	3.6	0.25	8.3		2.5		
26	1.0	0.25	30.0		2.2		
27	0.8	0.25	37.5		2.4		
28	0.4	0.25	75.0		1.8		
29	0.4	0.25	75.0	7.2	1.4	1.4	
30	0.6	0.25	50.0	7.2	2.1	2.1	
31	1.4	0.25	21.4	7.2	2.0	2.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Hennet & Lang*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	26.7	7.50	1576.0	158.4	73.9	59.0	
AVERAGE	0.9	0.25	52.5	7.2	2.5	2.5	
MAXIMUM	4.1	0.25	150.0	7.2	3.0	3.0	
MINIMUM	0.2	0.25	7.3	7.2	2.1	2.1	
01	0.4	0.25	75.0		2.4		
02	0.5	0.25	60.0		2.6		
03	0.3	0.25	100.0	7.2	2.5	2.5	
04	0.4	0.25	75.0	7.2	2.5	2.5	
05	0.9	0.25	33.3	7.2	2.5	2.5	
06	0.6	0.25	50.0	7.2	2.4	2.4	
07	1.1	0.25	27.3	7.2	2.5	2.5	
08	2.7	0.25	11.1	7.2	2.5	2.5	
09	0.6	0.25	50.0	7.2	2.5	2.5	
10	0.4	0.25	75.0	7.2	2.5	2.5	
11	0.3	0.25	100.0	7.2	2.3	2.3	
12	0.2	0.25	150.0	7.2	2.6	2.6	
13	0.6	0.25	50.0	7.2	2.4	2.4	
14	2.3	0.25	13.0	7.2	2.4	2.4	
15	0.3	0.25	100.0	7.2	2.3	2.2	
16	0.7	0.25	42.9	7.2	2.1	2.1	
17	0.7	0.25	42.9	7.2	2.3	2.3	
18	0.8	0.25	37.5	7.2	2.5	2.5	
19	0.3	0.25	100.0	7.2	2.3	2.3	
20	4.1	0.25	7.3	7.2	2.5	2.5	
21	1.0	0.25	30.0	7.2	2.8	2.8	
22	1.0	0.25	30.0		2.4	2.2	
23	0.6	0.25	50.0		2.6	2.6	
24	0.8	0.25	37.5	7.2	2.5	2.5	
25	1.1	0.25	27.3	7.2	3.0	3.0	
26	0.8	0.25	37.5	7.2	2.5	2.4	
27	0.5	0.25	60.0		2.1		
28	1.1	0.25	27.3		2.5		
29	0.9	0.25	33.3		2.4		
30	0.7	0.25	42.9		2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; HASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1997

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Hillman, C.O., CERT. NO. C-4016 C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14.2	7.75	2342.8	165.6	76.9	56.7	
AVERAGE	0.5	0.25	75.6	7.2	2.5	2.5	
MAXIMUM	0.8	0.25	230.8	7.2	2.8	2.6	
MINIMUM	0.1	0.25	36.6	7.2	2.2	2.2	
01	0.4	0.25	73.2	7.2	2.5	2.5	
02	0.6	0.25	54.5	7.2	2.2	2.2	
03	0.5	0.25	66.7	7.2	2.2	2.2	
04	0.6	0.25	49.2		2.4		
05	0.3	0.25	88.2		2.2		
06	0.6	0.25	53.6	7.2	2.5	2.5	
07	0.1	0.25	230.8	7.2	2.5	2.5	
08	0.8	0.25	36.6	7.2	2.5	2.5	
09	0.4	0.25	78.9	7.2	2.5	2.5	
10	0.7	0.25	44.8	7.2	2.4	2.4	
11	0.7	0.25	40.5		2.6		
12	0.3	0.25	88.2		2.5		
13	0.3	0.25	96.8	7.2	2.5	2.5	
14	0.2	0.25	142.9	7.2	2.6	2.6	
15	0.3	0.25	107.1	7.2	2.5	2.5	
16	0.5	0.25	58.8	7.2	2.4	2.4	
17	0.5	0.25	61.2	7.2	2.4	2.4	
18	0.5	0.25	57.7		2.5		
19	0.6	0.25	49.2		2.4		
20	0.4	0.25	81.1	7.2	2.5	2.5	
21	0.3	0.25	88.2	7.2	2.5	2.5	
22	0.5	0.25	65.2	7.2	2.5	2.5	
23	0.5	0.25	57.7	7.2	2.3	2.3	
24	0.4	0.25	81.1	7.2	2.4	2.4	
25	0.5	0.25	61.2		2.8		
26	0.6	0.25	52.6		2.8		
27	0.5	0.25	65.2	7.2	2.6	2.6	
28	0.3	0.25	88.2	7.2	2.6	2.6	
29	0.4	0.25	81.1	7.2	2.6	2.6	
30	0.3	0.25	96.8	7.2	2.5	2.5	
31	0.7	0.25	45.5	7.2	2.5	2.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 10-07-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1997

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Stibland, C.O., CERT. NO. C-4016 7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18.1	7.50	2458.2	152.4	59.7	41.5	
AVERAGE	0.6	0.25	81.9	7.3	2.0	2.0	
MAXIMUM	1.4	0.25	300.0	7.3	2.5	2.5	
MINIMUM	0.1	0.25	21.4	7.2	1.6	1.6	
01	0.6	0.25	50.0		2.4		
02	0.9	0.25	33.3	7.2	2.5	2.5	
03	0.9	0.25	33.3	7.2	2.2	2.2	
04	1.1	0.25	27.3	7.2	2.3	2.3	
05	0.6	0.25	50.0	7.2	2.0	2.0	
06	0.8	0.25	37.5		2.0		
07	0.9	0.25	33.3		1.8		
08	0.2	0.25	150.0	7.2	1.8	1.8	
09	1.1	0.25	27.3	7.2	1.9	1.9	
10	0.5	0.25	60.0	7.2	1.8	1.8	
11	1.2	0.25	25.0	7.2	1.8	1.8	
12	1.4	0.25	21.4	7.2	1.8	1.8	
13	0.9	0.25	33.3		1.6		
14	0.9	0.25	33.3		1.8		
15	1.3	0.25	23.1	7.3	1.6	1.6	
16	0.5	0.25	60.0	7.3	1.6	1.6	
17	0.3	0.25	100.0	7.3	1.8	1.8	
18	0.2	0.25	150.0	7.3	1.8	1.8	
19	0.5	0.25	60.0	7.3	2.0	2.0	
20	0.4	0.25	75.0		1.8		
21	0.1	0.25	300.0		1.8		
22	0.2	0.25	150.0	7.3	2.0	2.0	
23	0.4	0.25	75.0	7.3	2.0	2.0	
24	0.4	0.25	75.0	7.3	1.8	1.8	
25	0.2	0.25	150.0	7.3	1.8	1.8	
26	0.4	0.25	75.0	7.3	2.1	2.1	
27	0.4	0.25	75.0		2.5		
28	0.4	0.25	75.0		2.5		
29	0.3	0.25	100.0	7.3	2.4	2.4	
30	0.1	0.25	300.0	7.3	2.5	2.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; HASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-4016 C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	15.6	7.75	2350.8	149.1	64.9	44.1	
AVERAGE	0.5	0.25	75.8	7.1	2.1	2.1	
MAXIMUM	1.1	0.25	150.0	7.1	3.0	3.0	
MINIMUM	0.2	0.25	27.3	7.1	1.3	1.3	
01	0.7	0.25	42.9	7.1	3.0	3.0	
02	0.6	0.25	50.0		1.6		
03	0.8	0.25	37.5		1.4		
04	0.3	0.25	100.0	7.1	1.7	1.7	
05	0.3	0.25	100.0	7.1	2.0	2.0	
06	0.3	0.25	100.0	7.1	2.4	2.4	
07	0.2	0.25	150.0	7.1	2.4	2.4	
08	0.9	0.25	33.3	7.1	2.3	2.3	
09	0.3	0.25	100.0		2.3		
10	0.6	0.25	50.0		2.6		
11	0.4	0.25	75.0	7.1	1.3	1.3	
12	0.2	0.25	150.0	7.1	2.0	2.0	
13	0.5	0.25	60.0	7.1	2.2	2.2	
14	0.3	0.25	100.0	7.1	2.0	2.0	
15	0.8	0.25	37.5	7.1	1.8	1.8	
16	0.7	0.25	42.9		2.0		
17	0.2	0.25	150.0		2.2		
18	0.6	0.25	50.0	7.1	2.2	2.2	
19	0.4	0.25	75.0	7.1	2.2	2.2	
20	0.4	0.25	75.0	7.1	2.1	2.1	
21	0.4	0.25	75.0	7.1	2.2	2.2	
22	1.1	0.25	27.3	7.1	2.0	2.0	
23	0.5	0.25	60.0		2.2		
24	0.4	0.25	75.0		2.1		
25	0.3	0.25	100.0	7.1	2.0	2.0	
26	0.2	0.25	150.0	7.1	2.0	2.0	
27	0.4	0.25	75.0	7.1	2.0	2.0	
28	0.9	0.25	33.3	7.1	2.3	2.3	
29	0.7	0.25	42.9	7.1	2.0	2.0	
30	0.3	0.25	100.0		2.2		
31	0.9	0.25	33.3		2.2		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 08-11-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULBE AMOCO STATE ROAD A1A

YULBE, FL ; MASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Lloyd, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19.0	7.75	1733.9	156.6	83.7	61.6	
AVERAGE	0.6	0.25	55.9	7.1	2.7	2.8	
MAXIMUM	1.4	0.25	100.0	7.2	3.5	3.5	
MINIMUM	0.3	0.25	21.4	7.1	1.2	1.5	
01	0.6	0.25	50.0	7.1	2.8	2.8	
02	0.6	0.25	50.0	7.1	2.5	2.5	
03	0.6	0.25	50.0	7.2	2.5	2.5	
04	1.0	0.25	30.0		2.5		
05	0.7	0.25	42.9		1.6		
06	0.9	0.25	33.3		1.2		
07	0.6	0.25	50.0	7.2	1.5	1.5	
08	0.4	0.25	75.0	7.2	2.3	2.3	
09	0.6	0.25	50.0	7.2	3.0	3.0	
10	0.6	0.25	50.0	7.1	2.8	2.8	
11	1.4	0.25	21.4	7.1	2.8	2.8	
12	0.6	0.25	50.0		2.6		
13	1.3	0.25	23.1		2.4		
14	0.4	0.25	75.0	7.1	3.5	3.5	
15	0.5	0.25	60.0	7.1	3.2	3.2	
16	0.3	0.25	100.0	7.1	2.1	2.1	
17	0.5	0.25	60.0	7.1	2.8	2.8	
18	0.8	0.25	37.5	7.1	2.8	2.8	
19	0.7	0.25	42.9		3.0		
20	0.5	0.25	60.0		2.8		
21	0.4	0.25	75.0	7.1	3.0	3.0	
22	0.5	0.25	60.0	7.1	3.0	3.0	
23	0.5	0.25	60.0	7.1	2.9	2.9	
24	0.6	0.25	50.0	7.1	3.0	3.0	
25	0.6	0.25	50.0	7.1	3.0	3.0	
26	0.6	0.25	50.0		3.0		
27	0.7	0.25	42.9		3.0		
28	0.3	0.25	100.0	7.1	3.0	3.0	
29	0.3	0.25	100.0	7.1	3.0	3.0	
30	0.5	0.25	60.0	7.1	3.1	3.1	
31	0.4	0.25	75.0	7.1	3.0	3.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 07-14-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM:) STATION WATER TREATMENT PLANT

LOCATION: YULEE ANOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth L. Lavelle, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	15.3	7.50	2028.9	170.4	79.5	65.1	
AVERAGE	0.5	0.25	67.6	7.1	2.7	2.7	
MAXIMUM	1.0	0.25	150.0	7.1	3.0	3.0	
MINIMUM	0.2	0.25	30.0	7.1	1.8	2.0	
01	0.6	0.25	50.0	7.1	2.5	2.5	
02	0.5	0.25	60.0	7.1	3.0	3.0	
03	0.4	0.25	75.0	7.1	3.0	3.0	
04	0.2	0.25	150.0	7.1	3.0	3.0	
05	0.5	0.25	60.0	7.1	3.0	3.0	
06	0.5	0.25	60.0	7.1	2.5	2.5	
07	0.4	0.25	75.0		2.2		
08	0.6	0.25	50.0		1.8		
09	0.3	0.25	100.0	7.1	2.0	2.0	
10	0.4	0.25	75.0	7.1	2.4	2.4	
11	0.2	0.25	150.0	7.1	2.5	2.5	
12	0.6	0.25	50.0	7.1	2.0	2.0	
13	0.8	0.25	37.5	7.1	2.3	2.3	
14	0.6	0.25	50.0		2.3		
15	0.3	0.25	100.0		2.5		
16	0.4	0.25	75.0	7.1	2.8	2.8	
17	0.3	0.25	100.0	7.1	2.4	2.4	
18	0.4	0.25	75.0	7.1	2.8	2.8	
19	0.5	0.25	60.0	7.1	3.0	3.0	
20	0.7	0.25	42.9	7.1	3.0	3.0	
21	0.4	0.25	75.0		3.0		
22	0.4	0.25	75.0		2.6		
23	0.4	0.25	75.0	7.1	3.0	3.0	
24	0.6	0.25	50.0	7.1	3.0	3.0	
25	0.6	0.25	50.0	7.1	2.8	2.8	
26	0.7	0.25	42.9	7.1	3.0	3.0	
27	0.7	0.25	42.9	7.1	2.7	2.7	
28	0.7	0.25	42.9	7.1	2.9	2.9	
29	1.0	0.25	30.0	7.1	2.5	2.5	
30	0.6	0.25	50.0	7.1	3.0	3.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 06-12-97

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYS' AMC STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; MASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Smyth, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16.2	7.75	2080.8	191.7	82.2	65.7	
AVERAGE	0.5	0.25	67.1	7.1	2.7	2.6	
MAXIMUM	1.1	0.25	150.0	7.1	3.0	3.0	
MINIMUM	0.2	0.25	27.3	7.1	2.3	2.3	
01	0.7	0.25	42.9	7.1	2.5	2.5	
02	0.5	0.25	60.0	7.1	2.5	2.5	
03	0.7	0.25	42.9	7.1	2.3	2.3	
04	1.0	0.25	30.0	7.1	2.5	2.5	
05	0.4	0.25	75.0	7.1	2.5	2.5	
06	0.5	0.25	60.0	7.1	2.5	2.5	
07	0.4	0.25	75.0	7.1	2.8	2.8	
08	0.4	0.25	75.0	7.1	2.8	2.8	
09	0.7	0.25	42.9	7.1	2.5	2.5	
10	0.6	0.25	50.0		2.8		
11	0.5	0.25	60.0		2.8		
12	0.5	0.25	60.0	7.1	2.5	2.5	
13	0.4	0.25	75.0	7.1	2.3	2.3	
14	0.5	0.25	60.0	7.1	3.0	3.0	
15	1.1	0.25	27.3	7.1	3.0	3.0	
16	0.8	0.25	37.5	7.1	2.9	2.9	
17	0.4	0.25	75.0		2.8		
18	0.6	0.25	50.0		2.8		
19	0.5	0.25	60.0	7.1	2.5	2.5	
20	0.2	0.25	150.0	7.1	2.7	2.7	
21	0.6	0.25	50.0	7.1	2.4	2.4	
22	0.4	0.25	75.0	7.1	2.8	2.8	
23	0.8	0.25	37.5	7.1	2.6	2.6	
24	0.3	0.25	100.0	7.1	2.5		
25	0.2	0.25	150.0	7.1	2.8		
26	0.6	0.25	50.0	7.1	2.6	2.6	
27	0.4	0.25	75.0	7.1	2.8	2.8	
28	0.4	0.25	75.0	7.1	2.5	2.5	
29	0.3	0.25	100.0	7.1	2.8	2.8	
30	0.5	0.25	60.0	7.1	2.6	2.6	
31	0.3	0.25	100.0	7.1	2.8	2.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 05-14-97

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYST AM STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth Royal, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16.1	7.50	2398.6	170.4	76.4	60.9	
AVERAGE	0.5	0.25	80.0	7.1	2.5	2.5	
MAXIMUM	1.6	0.25	150.0	7.1	3.0	3.0	
MINIMUM	0.2	0.25	18.8	7.1	2.2	2.2	
01	0.8	0.25	37.5	7.1	2.5	2.5	
02	0.7	0.25	42.9	7.1	2.6	2.6	
03	0.6	0.25	50.0	7.1	2.8	2.6	
04	1.0	0.25	30.0	7.1	2.4	2.4	
05	0.9	0.25	33.3	7.1	2.5	2.5	
06	0.8	0.25	37.5	7.1	2.6	2.6	
07	0.5	0.25	60.0	7.1	2.5	2.5	
08	0.7	0.25	42.9	7.1	2.5	2.5	
09	0.5	0.25	60.0	7.1	2.3	2.3	
10	0.4	0.25	75.0	7.1	2.5	2.5	
11	0.9	0.25	33.3	7.1	2.5	2.5	
12	0.3	0.25	100.0		2.5		
13	0.5	0.25	60.0		2.5		
14	0.2	0.25	150.0	7.1	2.5	2.5	
15	0.2	0.25	150.0	7.1	2.5	2.5	
16	0.2	0.25	150.0	7.1	2.5	2.5	
17	0.4	0.25	75.0	7.1	3.0	3.0	
18	0.2	0.25	150.0	7.1	3.0	3.0	
19	0.2	0.25	150.0		3.0		
20	0.3	0.25	100.0		2.5		
21	0.2	0.25	150.0	7.1	2.8	2.8	
22	0.2	0.25	150.0	7.1	2.5	2.5	
23	0.4	0.25	75.0	7.1	2.5	2.5	
24	0.6	0.25	50.0	7.1	2.6	2.6	
25	1.0	0.25	30.0	7.1	2.4	2.4	
26	0.4	0.25	75.0		2.5		
27	0.4	0.25	75.0		2.4		
28	1.6	0.25	18.8	7.1	2.4	2.4	
29	0.8	0.25	37.5	7.1	2.2	2.2	
30	0.2	0.25	150.0	7.1	2.4	2.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-09-97

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1997

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth L. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	20.0	7.75	1920.6	155.6	58.1	45.7	
AVERAGE	0.6	0.25	62.0	7.1	1.9	2.1	
MAXIMUM	3.3	0.25	150.0	7.2	2.6	7.2	
MINIMUM	0.2	0.25	9.1	7.0	1.0	1.0	
01	0.5	0.25	60.0		2.2		
02	0.6	0.25	50.0	7.0	2.1	2.1	
03	0.5	0.25	60.0	7.0	2.4	2.4	
04	0.7	0.25	42.9	7.0	2.4	2.4	
05	0.3	0.25	100.0	7.0	2.2	2.2	
06	0.2	0.25	150.0	7.0	1.5	1.5	
07	0.8	0.25	37.5	7.0	1.5	1.5	
08	1.0	0.25	30.0		1.9		
09	3.3	0.25	9.1		2.1		
10	0.3	0.25	100.0		2.0		
11	0.5	0.25	60.0	7.0	2.2	2.2	
12	0.5	0.25	60.0	7.0	2.0	2.0	
13	0.4	0.25	75.0	7.2	2.0	2.0	
14	1.1	0.25	27.3	7.1	2.2	2.2	
15	0.5	0.25	60.0	7.1	1.5	1.5	
16	0.4	0.25	75.0	7.2	1.2	1.2	
17	0.3	0.25	100.0	7.1	1.4	1.4	
18	0.4	0.25	75.0	7.1	2.1	2.1	
19	0.5	0.25	60.0	7.1	2.0	2.0	
20	0.3	0.25	100.0	7.1	1.5	1.5	
21	0.7	0.25	42.9	7.1	1.4	1.4	
22	0.4	0.25	75.0		1.4		
23	0.8	0.25	37.5		1.6		
24	0.7	0.25	42.9	7.1	1.5	1.5	
25	0.3	0.25	100.0	7.1	1.0	1.0	
26	0.4	0.25	75.0	7.1	1.8	1.8	
27	1.0	0.25	30.0	7.1	2.6	2.6	
28	0.7	0.25	42.9		2.4		
29	0.6	0.25	50.0		1.8		
30	0.6	0.25	50.0		2.0		
31	0.7	0.25	42.9	7.1	2.2	7.2	

WS ID NO. 2454310 C.U.P. NO. NAME OF DRINKING WATER SYSTEM AMOCO STATION WATER TREATMENT PLANT
 LOCATION: YULEE AMOCO STATE ROAD A1A YULEE, FL ; NASSAU COUNTY
 OWNED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: February 1997
 INFLUENT EFFLUENT pH: 7.2(AVG) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 CERTIFY THIS REPORT IS CORRECT Kenneth A. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16.8	7.00	2069.5	164.7	63.7	50.7	
AVERAGE	0.6	0.25	73.9	7.2	2.3	2.3	
MAXIMUM	2.4	0.25	300.0	7.5	2.5	2.6	
MINIMUM	0.1	0.25	12.5	7.0	1.8	1.8	
01	0.3	0.25	100.0	7.4	2.0		
02	0.3	0.25	100.0		2.0		
03	0.3	0.25	100.0	7.4	2.2	2.2	
04	0.6	0.25	50.0	7.4	2.2	2.2	
05	0.4	0.25	75.0	7.5	2.1		
06	0.5	0.25	60.0	7.3	2.0	2.0	
07	0.1	0.25	300.0	7.3	1.8	1.8	
08	0.4	0.25	75.0	7.3	2.2	2.2	
09	0.5	0.25	60.0	7.2	2.2	2.2	
10	0.5	0.25	60.0	7.2	2.5	2.5	
11	0.4	0.25	75.0	7.1	2.5	2.5	
12	0.4	0.25	75.0	7.1	2.3	2.3	
13	0.4	0.25	75.0	7.1	2.5	2.5	
14	0.8	0.25	37.5	7.1	2.5	2.6	
15	0.9	0.25	33.3		2.5	2.5	
16	0.5	0.25	60.0		2.2		
17	0.5	0.25	60.0	7.1	2.3	2.3	
18	0.2	0.25	150.0	7.1	2.0	2.0	
19	0.4	0.25	75.0	7.0	2.5	2.5	
20	0.5	0.25	60.0	7.0	2.5	2.5	
21	0.3	0.25	100.0	7.0	2.5	2.5	
22	0.6	0.25	50.0		2.3		
23	0.6	0.25	50.0		2.5		
24	0.8	0.25	37.5	7.0	2.3	2.3	
25	2.2	0.25	13.6	7.0	2.2	2.2	
26	2.4	0.25	12.5	7.0	2.2	2.2	
27	0.6	0.25	50.0	7.0	2.2	2.2	
28	0.4	0.25	75.0	7.1	2.5	2.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 02-19-97

COMMENTS.

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: 70 STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1997

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth S. Snyder*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17.5	7.75	2012.8	228.2	61.8	53.5	
AVERAGE	0.6	0.25	64.9	7.4	2.0	2.0	
MAXIMUM	1.7	0.25	100.0	7.4	3.5	3.5	
MINIMUM	0.3	0.25	17.6	7.3	1.0	1.0	
01	0.4	0.25	75.0	7.4	1.8	1.8	
02	0.4	0.25	75.0	7.4	1.6	1.5	
03	1.7	0.25	17.6	7.4	1.4	1.4	
04	0.4	0.25	75.0	7.4	1.2	1.2	
05	0.3	0.25	100.0	7.4	1.2	1.2	
06	0.3	0.25	100.0	7.4	1.2	1.2	
07	0.7	0.25	42.9	7.4	1.0	1.0	
08	1.5	0.25	20.0	7.4	1.0	1.0	
09	0.7	0.25	42.9	7.3	2.5	2.5	
10	0.9	0.25	33.3	7.3	2.5	2.5	
11	0.4	0.25	75.0	7.3	2.5	2.5	
12	0.5	0.25	60.0	7.3	2.5	2.5	
13	0.6	0.25	50.0	7.3	2.2	2.2	
14	0.3	0.25	100.0	7.3	2.5	2.5	
15	0.7	0.25	42.9	7.3	3.5	3.5	
16	0.4	0.25	75.0	7.3	2.5	2.5	
17	0.7	0.25	42.9	7.3	2.4	2.4	
18	0.8	0.25	37.5	7.3	2.2		
19	0.5	0.25	60.0	7.3	2.0		
20	0.4	0.25	75.0	7.4	1.9	1.9	
21	0.3	0.25	100.0	7.4	2.0	2.0	
22	0.3	0.25	100.0	7.4	2.0	2.0	
23	0.3	0.25	100.0	7.4	1.8	1.8	
24	0.4	0.25	75.0	7.4	1.7	1.7	
25	0.4	0.25	75.0	7.4	2.0		
26	0.6	0.25	50.0	7.4	2.0		
27	0.3	0.25	100.0	7.4	2.2	2.2	
28	0.7	0.25	42.9	7.4	2.3	2.3	
29	0.5	0.25	60.0	7.4	2.0	2.0	
30	0.5	0.25	60.0	7.4	2.2	2.2	
31	0.6	0.25	50.0	7.3	2.0	2.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-97

COMMENTS: