

Writer's Direct Dial Number: (850) 521-1706
Writer's E-Mail Address: bkeating@gunster.com

December 1, 2022

BY E-PORTAL


Mr. Adam Teitzman, Clerk
Florida Public Service Commission
2540 Shumard Oak Boulevard
Tallahassee, FL 32399-0850

**Re: Docket No. 20220049-EI: Review of Storm Protection Plan pursuant to Rule 25-6.030,
F.A.C., Florida Public Utilities Company**

Dear Mr. Teitzman:

Attached for filing, please find Florida Public Utilities Company's corrected Modified Storm Protection Plan ("SPP") for the period 2022-2031. Consistent with Order No. PSC-2022-0387-FOF-EI, issued November 10, 2022, the Company has amended its SPP to remove the Future Transmission & Distribution Enhancement Program and the Transmission & Substation Resiliency Program contained in its initial Plan submitted on April 11, 2022. This modified SPP is being submitted consistent with the Commission's directive and within the time frame required by the referenced Order and to address scrivener's errors identified by Commission Staff after the Company's initial Modified Plan was submitted on November 15, 2022. As always, please don't hesitate to let me know if you have any questions whatsoever.

Sincerely,



Beth Keating
Gunster, Yoakley & Stewart, P.A.
215 South Monroe St., Suite 601
Tallahassee, FL 32301
(850) 521-1706

MEK

cc: Jacob Imig
Penelope Buys
Parties of Record



Florida Public Utilities Company

Storm Protection Plan 2022 - 2031

Rule 25-6.030, F.A.C.

Original plan filed April 11, 2022

Modified plan filed November 15, 2022 (corrected

December 1, 2022)



Table of Contents

EXECUTIVE SUMMARY	4
SPP PROGRAMS	5
INVESTMENT PLAN	6
1.0 INTRODUCTION	8
1.1 BACKGROUND	8
1.2 PROGRAM DEVELOPMENT	12
1.3 INVESTMENT PLAN	14
2.0 RESILIENCY RISK MODEL	17
2.1 STRUCTURE	17
2.2 INPUTS	18
Wind probability	18
Flood/Storm Surge Potential	19
Past Performance	21
Accessibility	21
Contingency	22
Vegetation Exposure	22
Critical Load	23
Customers Served	23
Interruption Cost Estimate	23
2.3 PRIORITIZATION	23
3.0 PROGRAM DESCRIPTIONS & BENEFITS	25
3.1 OVERHEAD FEEDER HARDENING	25
Description	25
Cost	26
Cost/Benefit Comparison	26
3.2 OVERHEAD LATERAL HARDENING	27
Description	27
Cost	27
Cost/Benefit Comparison	28
3.3 OVERHEAD LATERAL UNDERGROUNDING	28
Description	28

Cost 29

Cost/Benefit Comparison..... 29

3.4 DISTRIBUTION POLE INSPECTION AND REPLACEMENTS 30

Description..... 30

Cost 31

Cost/Benefit Comparison..... 31

3.5 TRANSMISSION SYSTEM INSPECTION AND HARDENING..... 32

Description..... 32

Cost 32

Cost/Benefit Comparison..... 33

3.6 TRANSMISSION & DISTRIBUTION (T&D) VEGETATION MANAGEMENT 33

Description..... 33

Cost 34

Cost/Benefit Comparison..... 35

4.0 ESTIMATE OF ANNUAL JURISDICTIONAL REVENUE REQUIREMENTS..... 36

5.0 ESTIMATE OF RATE IMPACTS FOR FIRST THREE YEARS OF SPP..... 37

6.0 PROJECT DETAILS 38

6.1 OVERHEAD FEEDER HARDENING 38

6.2 OVERHEAD LATERAL HARDENING 38

6.3 OVERHEAD LATERAL UNDERGROUNDING 39

7.0 CONCLUSION..... 40

Appendix A 41

Appendix B..... 43

Appendix C..... 47

List of Tables

Table 1 - Three-year estimated investment details for SPP Programs	16
Table 2 - Overhead Feeder Hardening estimated 3-year costs	26
Table 3 - Overhead Lateral Hardening estimated 3-year costs	27
Table 4 - Overhead Lateral Undergrounding estimated 3-year costs.....	29
Table 5 – Distribution Pole Inspection and Replacements estimated 3-year costs.....	31
Table 6 – Transmission SYSTEM INSPECTION AND HARDENING estimated 3-year costs	32
Table 7 - Transmission and Distribution Vegetation Management estimated 3-year costs	34
Table 8 – Estimated Annual Revenue Requirements.....	36
Table 9 – Estimated SPP Rate Impacts.....	37
Table 10 – Overhead Feeder Hardening 2022 Project Details.....	38
Table 11 – Overhead Lateral Hardening 2022 Project Details.....	39
Table 12 – Overhead Lateral Undergrounding 2022 Project Details	39

Table of Figures

Figure 1 - Ten-year estimated investment profile for SPP Programs	6
Figure 2 - Three-year estimated investment profile for SPP Programs	7
Figure 3 - Florida 20-year tropical event path	8
Figure 4 - Northeast Florida 20-year tropical event path	9
Figure 5 - Northwest Florida 20-year tropical event path	9
Figure 6 - FPUC separation of service areas.....	10
Figure 7 - FPUC NE Division service area	11
Figure 8 - FPUC NW Division service area	12
Figure 9 - Ten-year estimated investment profile for SPP Programs	15
Figure 10 - Three-year estimated investment profile for SPP Programs	15
Figure 11 - Florida NESC extreme wind zones	19
Figure 12- NOAA Coastal Flood Exposure Map - NW Division.....	20
Figure 13 – NOAA Coastal Flood Exposure Map – NE Division	20
Figure 14 - Accessible Areas - NW Division.....	21
Figure 15 - Inaccessible Area - NW Division.....	21
Figure 16 - Radial service to Liberty County customers.....	22
Figure 17 - Fernandina Beach Historic District - NE Division	23

EXECUTIVE SUMMARY

In 2019, the Florida Legislature passed Senate Bill 796 to enact Section 366.96, Florida Statutes (F.S.), entitled “Storm Protection Plan Cost Recovery.” Section 366.96, F.S. requires each investor-owned electric utility (IOU) to file a transmission and distribution Storm Protection Plan (SPP) that covers the immediate 10-year planning period. The plans are required to be filed with the Florida Public Service Commission (“Commission”) every three years and must explain the systematic approach the utility will follow to achieve the objectives of “reducing restoration costs and outage times associated with extreme weather events and enhancing reliability.” The Commission adopted Rule 25-6.030, Florida Administrative Code (F.A.C.), Storm Protection Plan, and 25-6.031, F.A.C., Storm Protection Plan Cost Recovery Clause, to implement the new statute¹. The Rules became effective February 18, 2020, with the first filing from the utilities required by April 10, 2020.

On April 10, 2020, Florida Public Utilities Company (FPUC) filed a Motion requesting to defer filing of its SPP and refrain from participating in the Storm Protection Plan Cost Recovery Clause (SPPCRC) proceeding due to circumstances affecting the utility as a result of Hurricane Michael. By Order No. PSC-2020-0097-PCO-EI, issued in Docket No. 20200068-EI, the prehearing officer granted that motion and FPUC was authorized to file its SPP in April 2021 with the next update then due in April 2023 in order to sync FPUC’s next filing with those of the other Florida investor-owned utilities (“IOUs”). Thereafter, the other Florida IOUs entered in settlement agreements for their respective initial SPPs. Within those settlement agreements, the parties agreed that the other IOUs would file their next SPP in April 2022. In light of the fact that the new date for filing by the other IOUs would now have FPUC out of sync again in terms of its filings, the Company asked the Commission to allow FPUC to defer its filing an additional year, which would align FPUC on the same schedule with the other Florida IOUs. That request was granted by Order PSC-2020-0502-PAA. Thus, consistent with that Order, FPUC has continued to operate under its current Storm Hardening Plan until now, the next scheduled SPP filing.²

FPUC, with the assistance of Pike Engineering, has developed a Storm Protection Plan that will strengthen the electric utility’s infrastructure to withstand extreme weather conditions. Key aspects of the SPP promote the overhead hardening of electrical facilities and the undergrounding of certain electrical distribution lines resulting in a systematic method of addressing and maintaining ongoing compliance with the requirements of the Rule, which will ensure FPUC’s implementation of its SPP achieves the statutory objectives of reducing restoration costs and outage times associated with extreme weather events, while also enhancing reliability.

FPUC’s SPP is a combination of previously Commission-approved storm hardening initiatives, some of which contain incremental investments, as well as newly proposed Programs which are grounded on a methodology of resiliency risk scores across FPUC’s Distribution system. To the extent, there are existing programs that will be continued from the Company’s existing Storm Hardening Plan, there may be some

¹ Docket No. 20190131-EU, In re: Proposed adoption of Rule 25-6.030, F.A.C., Storm Protection Plan and Rule 25-6.031, F.A.C., Storm Protection Plan Cost Recovery Clause.

² Docket No. 20200068-EI, In re: Review of 2020-2029 Storm Protection Plan pursuant to Rule 25-6.030, F.A.C., Florida Public Utilities Company.

costs associated with these programs already included in the base rates approved for the Company during its last rate proceeding. These costs will be identified at the time of SPP cost recovery filing such that only incremental investments are included for SPPCRC recovery as required by Rule 25.6.031, F.A.C.

SPP PROGRAMS

It is practically and prudently impossible to eliminate all outages associated with extreme weather conditions. However, programs can be implemented to significantly reduce outages and ancillary impact. This report outlines descriptions, prioritization, costs, and benefits for the following SPP programs:

- Overhead Feeder Hardening
- Overhead Lateral Hardening
- Overhead Lateral Undergrounding
- Distribution Pole Inspections and Replacements
- Transmission System Inspection and Hardening
- Transmission & Distribution Vegetation Management

The plan represents the initial 10-year investment in strengthening the utility infrastructure and is not intended to represent the total investment or implementation horizon to completely strengthen FPUC's distribution system. While some programs will be completed ahead of others due to criticality of impact and lower volume (e.g., Transmission System Inspection and Hardening), most will span beyond the initial ten-year planning period due to the complexities in the design and construction of the project, as well as the sheer volume of infrastructure to strengthen (e.g., Overhead Lateral Undergrounding).

FPUC recognizes that the holistic strengthening of an electric utility grid and a utility's preparation for extreme weather events spans beyond the programs mentioned above and subsequently included in this report. There are other aspects of a holistic plan which include efforts of which FPUC has undertaken for years and will carry forward in parallel to this plan up until which time they are transferred to the SPP. These initiatives include things such as coordination with local government officials, re-evaluation of construction standards against new standards that may emerge, partnering with Joint Use facility owners, and others.

Additionally, other efforts to strengthen the grid and thus reduce storm restoration costs, outage times to customers, and overall service reliability to customers may include investments in the visibility and control of grid devices such as those in place with grid automation and Automated Metering Infrastructure (AMI) systems. The specifics of these planned programs are still evolving and are therefore not detailed as part of this initial plan, but FPUC will continue to evaluate the current availability and emergence of new technologies along with other strategies, methods, and tactics for consideration in subsequent SPP updates.

Finally, FPUC has included SPP Program Management. This is a Full Time Equivalent (FTE) position that will be responsible for continued development, monitoring and administration of FPUC's SPP. This position will be responsible for the SPP projects, scheduling, and cost control/data collection necessary for the success of the overall SPP as well as documentation necessary for cost recovery.

INVESTMENT PLAN

FPUC recognizes the complexities of implementing new programs, the importance of identifying potential pitfalls early, and the validation of initial assumptions. With this in mind, the FPUC SPP ten-year investment plan in the three new Distribution SPP Programs (Overhead Feeder Hardening, Overhead Lateral Hardening, and Overhead Lateral Undergrounding) includes \$110.5M in Capital investments and O&M expenditures. The implementation plan includes a methodical ramp up of investments that allows for the acquisition of resources, initiation of design activities, the refinement of projects, and the Hurricane Michael cost recovery surcharge to expire³. Figure 1 below shows the full SPP 10-year investment plan which includes the \$110.5M in new Distribution SPP programs mentioned above and \$32.7M for T&D Vegetation Management, Distribution Pole Inspections and Replacements, and Transmission System Inspection and Hardening activities. Figure 2 below, details the breakdown by Program type for the \$20.2M in the first three years of the plan within the approximately \$143.2M SPP 10-year investment. As expected with these types of programs and as detailed within Figures 1 and 2, most of these investments are split between the new Overhead Lateral Undergrounding program and the Legacy Programs being carried forward.

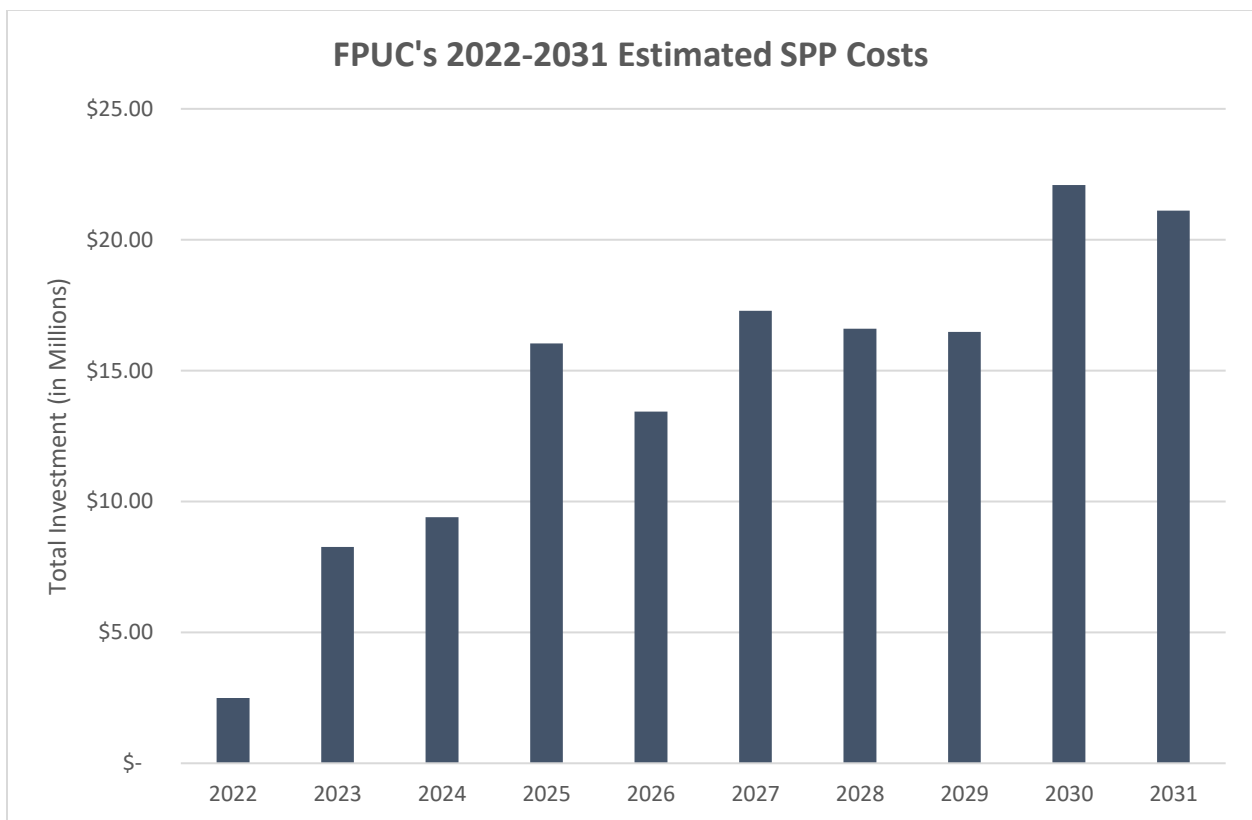


Figure 1 - Ten-year estimated investment profile for SPP Programs

³ <http://www.floridapsc.com/library/filings/2020/11003-2020/11003-2020.pdf>

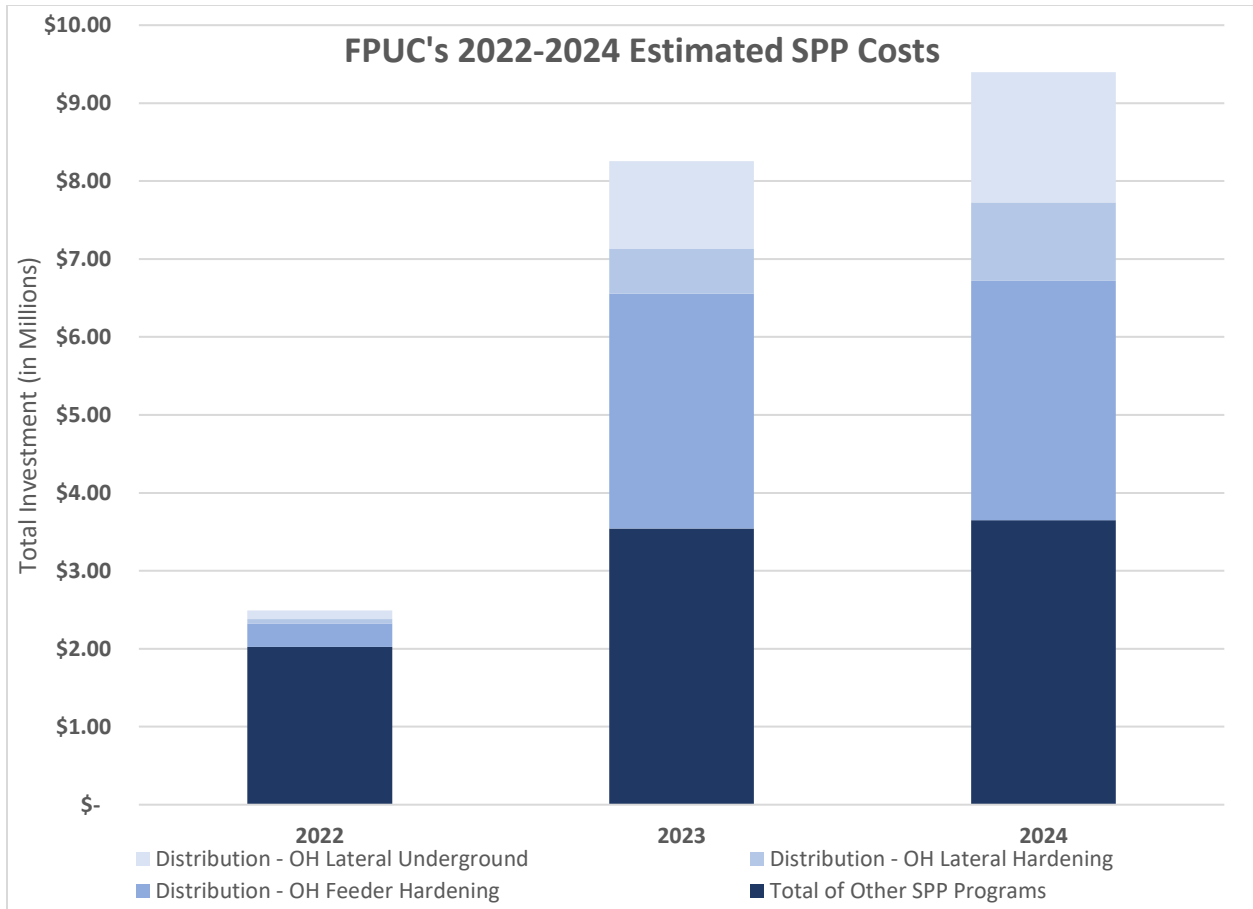


Figure 2 - Three-year estimated investment profile for SPP Programs

1.0 INTRODUCTION

Following the historical 2018 hurricane season, which brought Hurricane Michael and its devastating impact to the Florida Panhandle communities, the Florida Legislature passed Senate Bill 796 finding that “it is in the State’s interest to strengthen electric utility infrastructure to withstand extreme weather conditions by promoting the overhead hardening of electrical transmission and distribution facilities, the undergrounding of certain electrical distribution lines, and vegetation management.” Further the Florida Legislature found that “protecting and strengthening transmission and distribution electric utility infrastructure from extreme weather conditions can effectively reduce restoration costs and outage times to customers and improve overall service reliability to customers.”

Florida Public Utilities Company (FPUC), with the assistance of Pike Engineering, undertook the development of a Storm Protection Plan that would align with the Legislature’s findings in the new Section 366.96, Florida Statutes, as well as the Commission’s implementing Rule, and developed a SPP that promotes the overhead hardening of electrical facilities and the undergrounding of certain electrical distribution lines resulting in a systematic method of addressing and maintaining ongoing compliance with the requirements of the Rule, which will ensure FPUC’s implementation of its SPP achieves the statutory objectives of reducing restoration costs and outage times associated with extreme weather events, while also enhancing reliability.

1.1 BACKGROUND

The propensity of hurricanes to come near or impact the State of Florida is not uncommon. The National Oceanographic and Atmospheric Administration (NOAA) has recorded 406 Tropical events (from Extratropical Storms to Category 5 hurricanes) coming within 50 miles of the Florida coast in their historical archives; 57 of which within the last 20 years (Figure 3). While most of these storms had isolated and scattered impact to Florida communities or more specifically the electric utility infrastructure within those communities, others such as Hurricanes Charley, Wilma, Irma, Michael, and others have left a much deeper impact in the wake of their path.

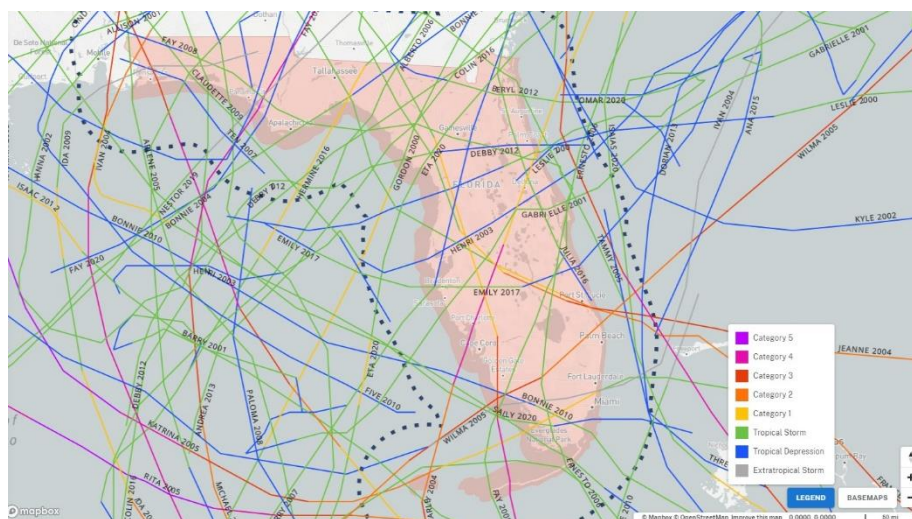


Figure 3 - Florida 20-year tropical event path

FPUC provides electric utility service to two distinct and non-contiguous areas of Florida; the geographical location of which, outside of Hurricane Michael in 2018, has isolated the FPUC territory from the direct path of a Category 1 or stronger weather event (Figure 4 and Figure 5). Nonetheless, the path of a hurricane is unpredictable and preparations ahead of hurricane season and when a potential threat looms in the Atlantic Ocean or the Gulf of Mexico, are essential in ensuring the continued electric service reliability when customers need it most. Although Hurricane Michael is the only notable direct impact to FPUC territory in recent history, both divisions have been impacted by tornadoes spawned by the outer bands of nearby hurricanes. For this reason, prudent and necessary investments must be made to strengthen the resiliency of the electric grid and reduce storm restoration costs associated with either the planning for potential impact or the recovery from it.

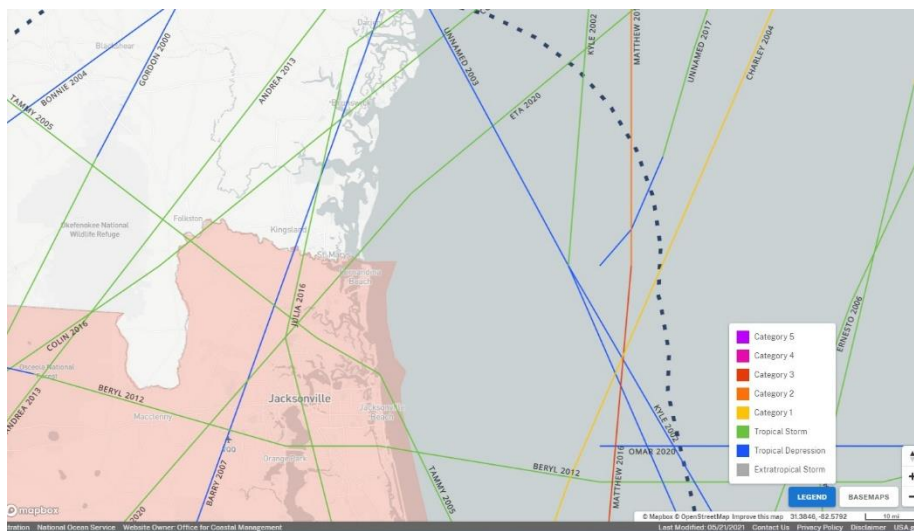


Figure 4 - Northeast Florida 20-year tropical event path

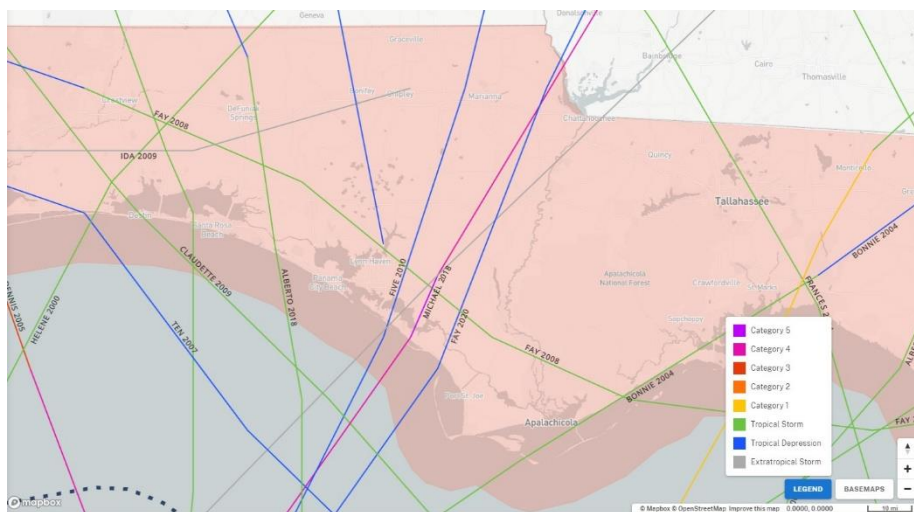


Figure 5 - Northwest Florida 20-year tropical event path

As mentioned above, FPUC has two distinct electric divisions that are not physically connected at the distribution level. The Northwest (NW) Division, also referred to as Marianna, and the Northeast (NE) Division, also referred to as Fernandina Beach are approximately 250 miles apart (Figure 6).

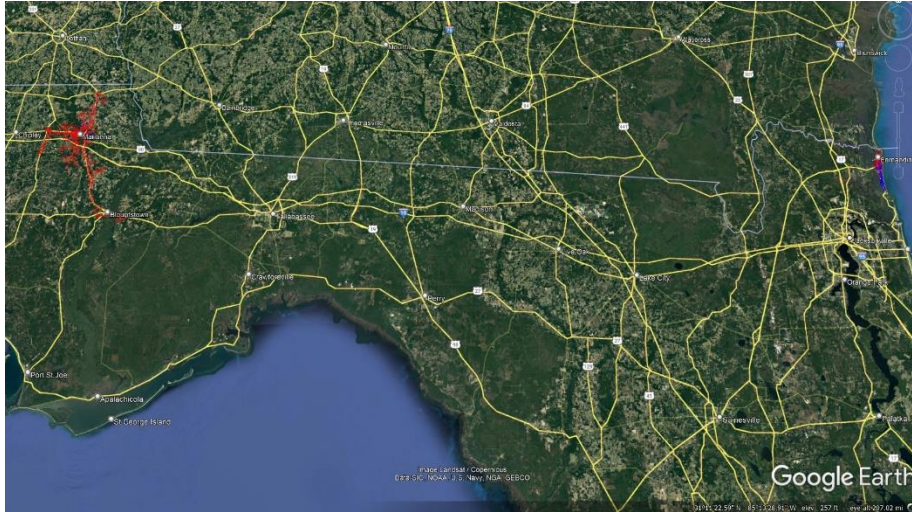


Figure 6 - FPUC separation of service areas

Due to their separation, the geographical location, and the architectural influences of their surrounding communities, the two divisions differ in their electrical characteristics. The NE division, located in Amelia Island in the North easternmost part of the State, serves approximately 17,000 customers. Approximately 60% of the distribution system in this division is of underground (UG) construction with the majority of the overhead facilities located along the northwestern part of the island (Figure 7).

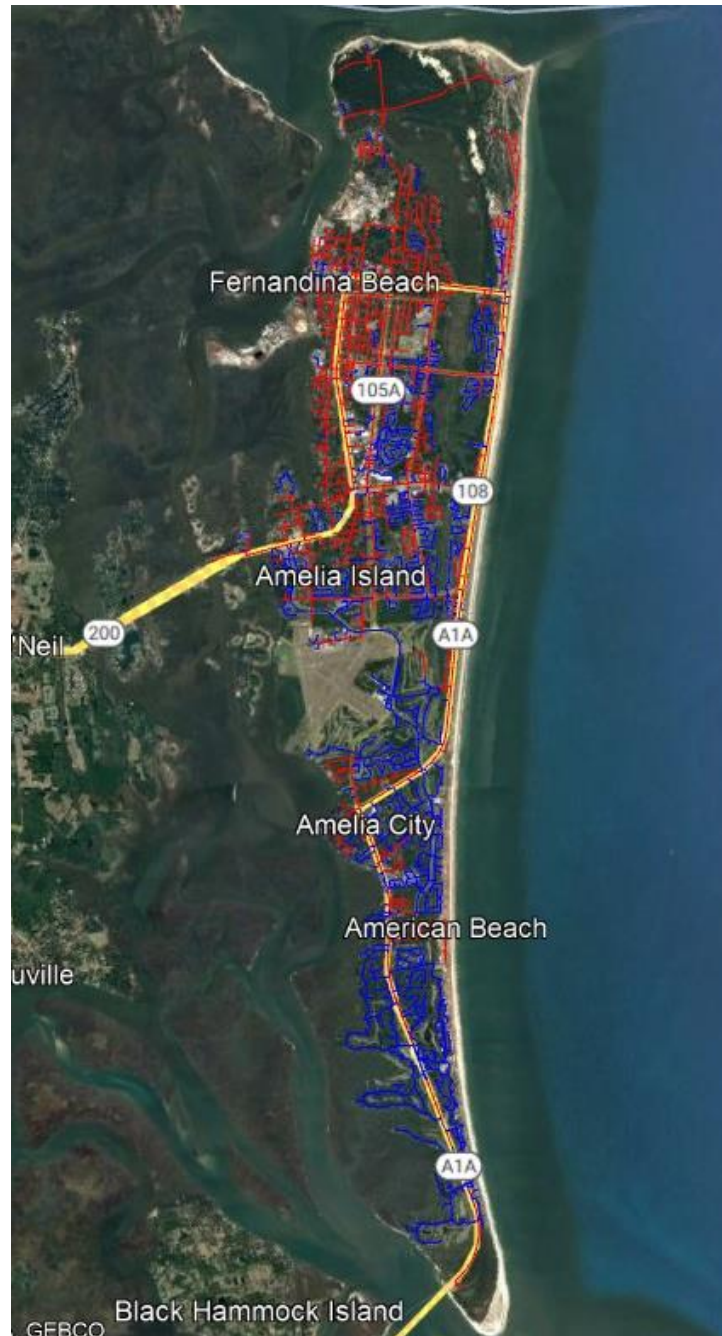


Figure 7 - FPUC NE Division service area

The NW division serves approximately 12,000 customers in parts of Jackson, Calhoun, and Liberty counties along the Florida panhandle. Approximately 94% of the distribution system in this division is of overhead (OH) construction with the majority of the UG facilities located along isolated neighborhoods or certain commercial establishments (Figure 8). FPUC does not own nor operate any Transmission facilities in this Division⁴.

⁴ FPUC receives service from FPL at a distribution voltage at six separate interconnection points.

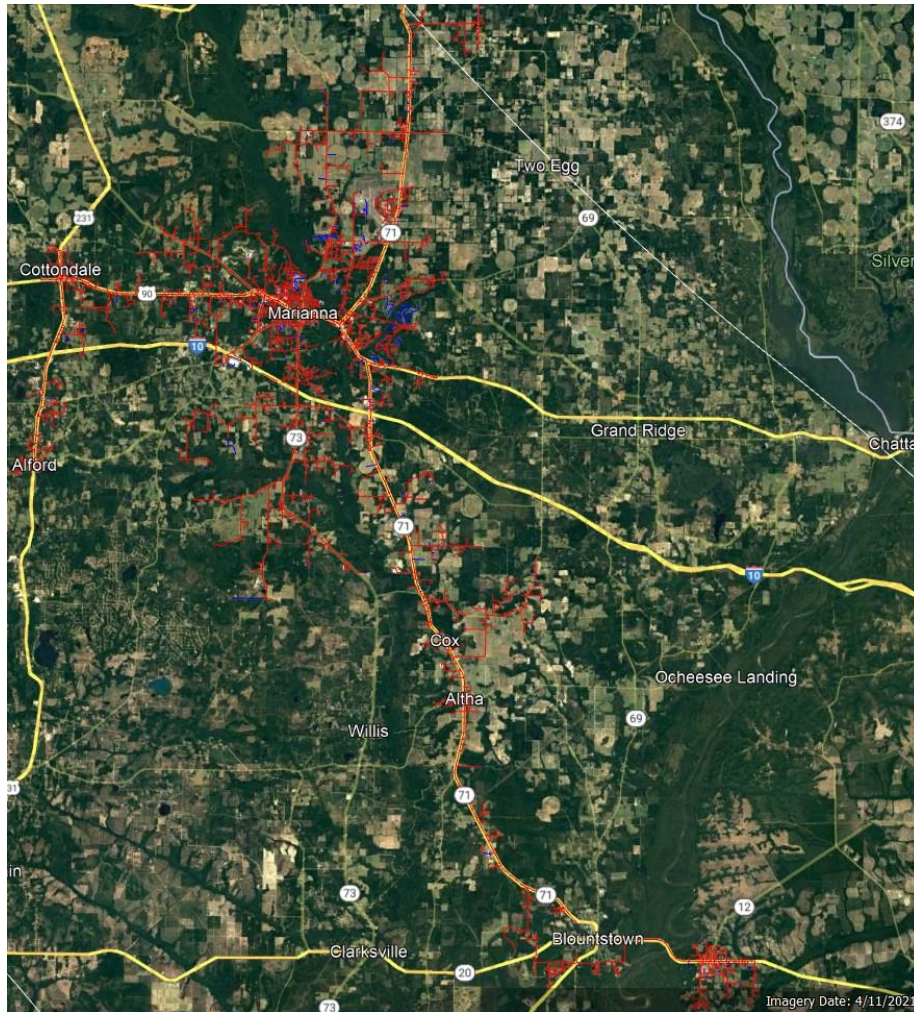


Figure 8 - FPUC NW Division service area

As a result of the differences in their electrical characteristics, the strategy, method, and tactics (Programs) that are required to strengthen the electric grid differ. These differences will drive year to year variances in investment allocation, project selections, and ultimately construction completion.

1.2 PROGRAM DEVELOPMENT

FPUC and Pike Engineering analyzed the Company’s historical reliability performance, both during extreme and non-extreme weather conditions. The analysis of the data provided both parties with insight into the various drivers (causes) of the outages impacting the FPUC system along with the frequency and relative geographical location.

FPUC Staff, in collaboration with Pike Engineering, leveraged this information to develop three Distribution SPP Programs to address the requirements of the FPSC Rule and thus reduce storm restoration costs associated with extreme weather events and improve the overall service reliability for customers. All distribution areas of the FPUC system were analyzed and determined to be able to benefit from one or more of these programs.

- Overhead Feeder Hardening
 - The Overhead Feeder Hardening program will upgrade backbone overhead lines to extreme winds requirements outlined in the National Electric Safety Code (NESC)⁵. The backbone of a feeder resembles the major arteries of the distribution circuit that services a particular community. When a fault occurs on a backbone, upwards of 2,500 customers can be immediately impacted.
- Overhead Lateral Hardening
 - Like the Overhead Feeder Hardening program, the Overhead Lateral Hardening program will upgrade existing overhead facilities along key lateral lines off the feeder to withstand extreme wind requirements outlined in the NESC. Laterals are separately protected sections of the feeder providing service to upwards of 200 to 300 customers.
- Overhead Lateral Undergrounding
 - The Overhead Lateral Undergrounding program will address undergrounding laterals in place or the relocation and undergrounding of these overhead electric facilities, many of which are in heavily vegetated areas, environmentally sensitive areas, or in areas where upgrading the overhead construction to NESC extreme wind standards is not practical or consistent with industry design standards.

Additionally, FPUC identified incremental investments in certain Legacy programs previously proven to improve overall system resiliency during extreme weather events.

- Distribution Pole Inspections & Replacements
 - Enhancements to the Distribution Pole Inspection & Replacement program will accelerate the replacement of wood Distribution poles that have been targeted for replacement following their cyclical inspection. Depending on the location of the pole, a failure on it could have an impact anywhere from a single customer to upwards of 2,500 customers.
- Transmission System Inspection and Hardening
 - The Transmission System Inspection and Hardening will consolidate the legacy Six Year Transmission Structure Inspection Program and the Storm Hardening of Existing Transmission Structures. The program will initially accelerate the full replacement of existing wood poles on FPUC's 69kV system with concrete structures proven more resilient to extreme weather conditions. Outages to Transmission lines have the potential to impact thousands of customers at a time and prolong the restoration time during extreme weather events.

⁵ For all designs, FPUC leverages the most current version of the NESC in place - currently C2-2017.

- **Transmission & Vegetation Management**
 - Proposed enhancements to the Transmission & Vegetation Management program adjust the cyclical frequency of FPUC’s vegetation management trim cycle from a 3-year main feeder / 6-year lateral trim cycle to a 4-year cycle for each. The majority of outages on overhead systems are the result of falling vegetation. This program minimizes the impact of such vegetation from within the utility’s right of way.

These Programs are discussed in detail in section 3 of this report.

Finally, FPUC has included SPP Program Management. This is a Full Time Equivalent (FTE) position that will be responsible for continued development, monitoring and administration of FPUC’s SPP. This position will be responsible for the SPP projects, scheduling, and cost control/data collection necessary for the success of the overall SPP as well as documentation necessary for cost recovery.

1.3 INVESTMENT PLAN

FPUC’s 10-year SPP investment is a \$143.2M recommendation that includes a mix of new programs targeting Distribution construction types and standards, legacy programs that target the strength and condition of Transmission and Distribution assets.

The breakdown of investments across these three classes is shown below:

- **New SPP Programs - \$110.5M**
 - *Overhead Feeder Hardening*
 - *Overhead Lateral Hardening*
 - *Overhead Lateral Undergrounding*
 - *SPP Program Management*
- **Legacy Programs - \$32.7M**
 - *Distribution Wood Pole Inspections and Replacement*
 - *Transmission & Distribution Vegetation Management*
 - *Transmission System Inspection and Hardening*

FPUC’s full 10-year estimated investment plan is shown in Figure 9 below and outlines the methodical ramp-up in investments over the first three years of the plan. This ramp-up ensures the alignment of materials and resources as well as facilitates the capturing of lessons learned from the rollout of these new programs and the implementation of these lessons learned into later years for added program execution efficiencies. A detailed breakdown for the first three years of the plan is subsequently shown in Figure 10 and Table 1.

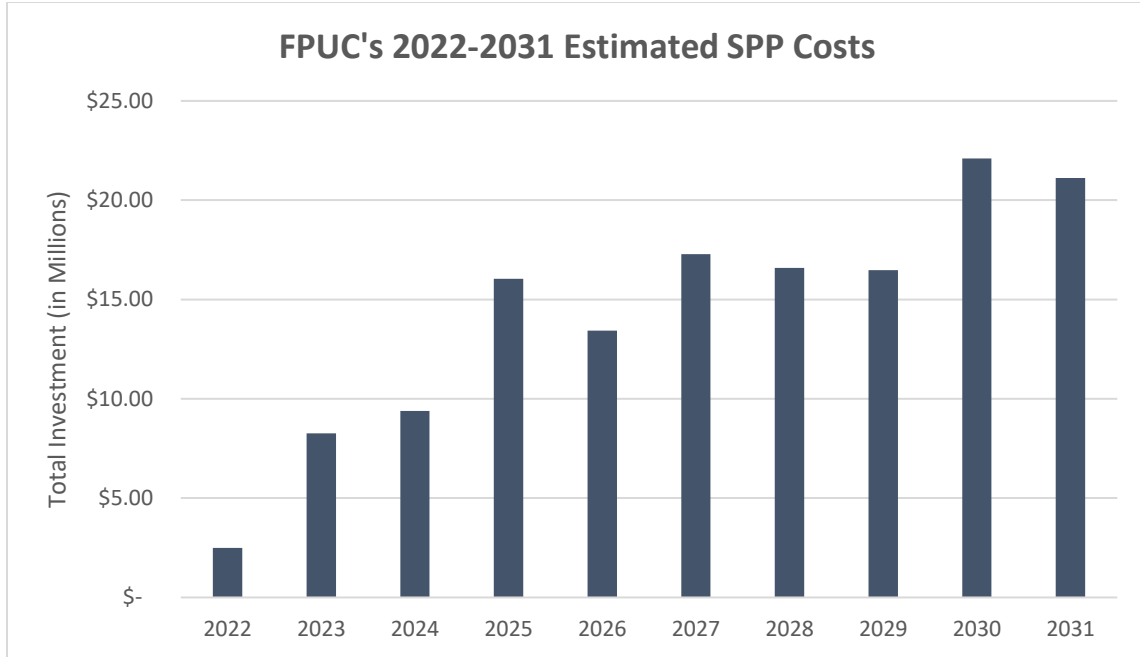


Figure 9 - Ten-year estimated investment profile for SPP Programs

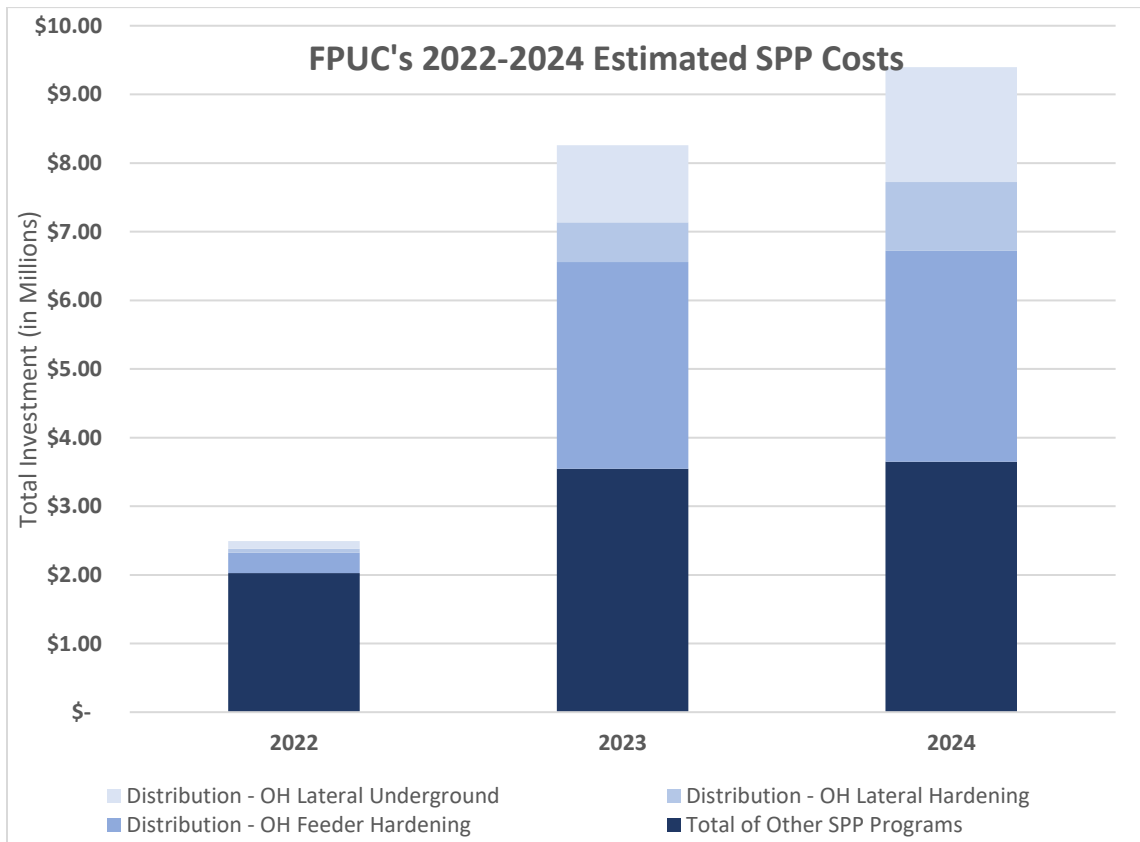


Figure 10 - Three-year estimated investment profile for SPP Programs

FPUC STORM PROTECTION PLAN

STORM PROTECTION PROGRAM INVESTMENTS (IN MILLIONS)		2022	2023	2024
NEW SPP PROGRAMS	OVERHEAD FEEDER HARDENING	\$ 0.30	\$ 3.01	\$ 3.07
	LATERAL FEEDER HARDENING	\$ 0.06	\$ 0.58	\$ 1.01
	LATERAL UNDERGROUNDING	\$ 0.11	\$ 1.12	\$ 1.67
	SPP PROGRAM MANAGEMENT	\$ -	\$0.21	\$0.21
LEGACY PROGRAMS	DISTRIBUTION WOOD POLE INSPECTION AND REPLACEMENT	\$0.81	\$ 1.52	\$ 1.62
	T&D VEGETATION MANAGEMENT	\$0.80	\$1.20	\$1.20
	TRANSMISSION SYSTEM INSPECTION AND HARDENING	\$0.41	\$0.62	\$0.62
TOTALS		\$ 2.49	\$8.26	\$9.40

Table 1 - Three-year estimated investment details for SPP Programs


2.0 RESILIENCY RISK MODEL

Pike Engineering leveraged the use of its proprietary Resiliency Risk Model to evaluate the FPUC distribution system and develop a prioritized list of investment projects.


2.1 STRUCTURE

This Resiliency Risk Model evaluates risks and an electric system's resiliency against such risk by leveraging an algorithm that assesses a balanced approach between probability, response, and impact.

- Probability
 - o The probability or likelihood that an extreme weather condition event will cause damage to existing utility infrastructure.
- Response
 - o The utility's ability to appropriately respond to and recover from infrastructure damage caused by an extreme weather condition.
- Impact
 - o The societal impact of the extreme weather condition caused electrical outage to the community being affected.

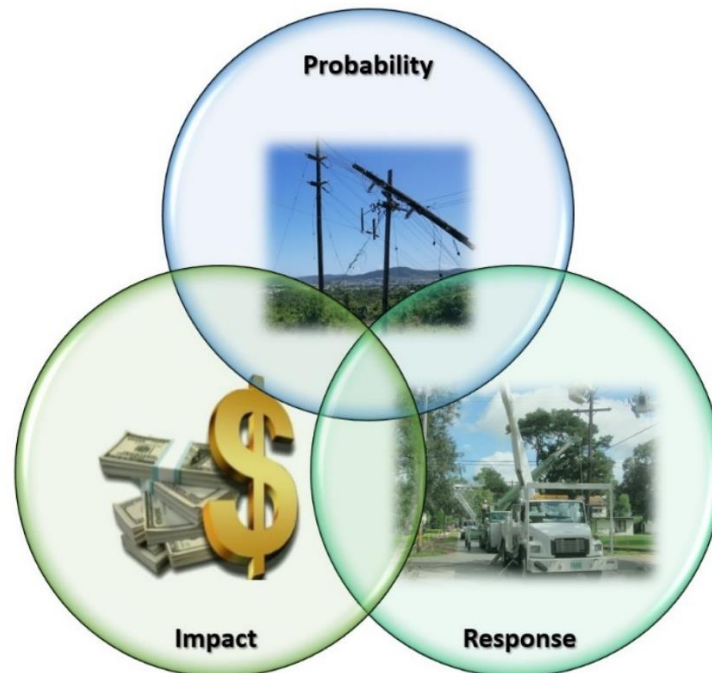

When assessing risk, and ultimately developing a prioritized list of investments based on risk, it is important to account for these three focused categories. Focus on one or two of these categories with complete disregard to the other may lead to unintended consequences such as increased costs or degrading reliability performance.

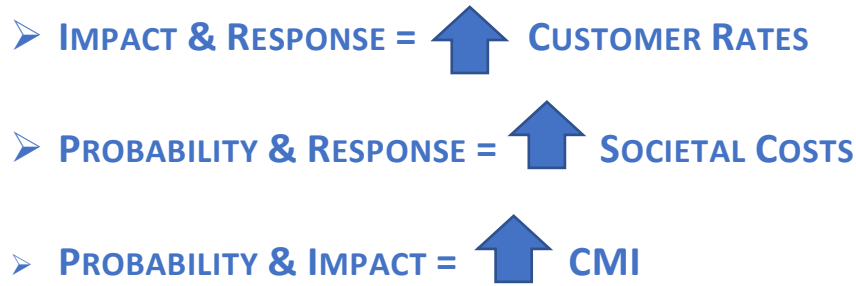

If a utility places focus on the impact of a severe weather event and their ability to respond to those events but disregards the probability of the event occurring in the first place, it can lead them to over-invest in infrastructure upgrades that will ultimately impact customer rates. Conversely, a focus on probability and response with disregard to the societal costs from a single event may lead a utility to under-invest in infrastructure strengthening and upgrade initiatives. Finally, a focus on the probability of an event to occur and the societal impact of such event without accounting for the utility’s ability to respond to such event can lead to decreased reliability performance (increase in Customer Minutes of Interruption (CMI)) resulting from investments in other tactics and methods that do not promote a faster utility response or for which a utility may not be as adequately prepared to respond to.

This Risk Resiliency Model leverages data from several publicly available sources as well as FPUC specific data, into each of these categories to provide a balanced, systematic, and repeatable method to address extreme wind resiliency.

2.2 INPUTS

The Risk Resiliency Model applies quantitative data as inputs into an algorithm that calculates risk based on a balanced approach against Probability, Response, and Impact. The model leverages inputs from several public available sources in combination with FPUC specific system data. When quantitative data was not available, approximations were used based on experience and collaboration between FPUC and Pike Engineering.

Wind probability

Wind probability calculations for the model are derived from Extreme Wind loading zones outlined in NESC 250C (Figure 11 below). The zones were developed by the American Society of Civil Engineers (ASCE) in their 74 standards that and were adopted by the NESC as design standards for structures greater than 60 feet in height. FPUC applies this standard (along with NESC Grade B) in the construction of overhead distribution facilities less than 60 feet in height when building to or strengthening existing facilities to extreme wind standards such as those in Feeder Hardening projects. Consistent with NESC 250C, FPUC has applied the 130mph zone to all facilities in the NE Division and the 120mph standard to all facilities located in the NW Division as the extreme wind loading criteria for each respective division.

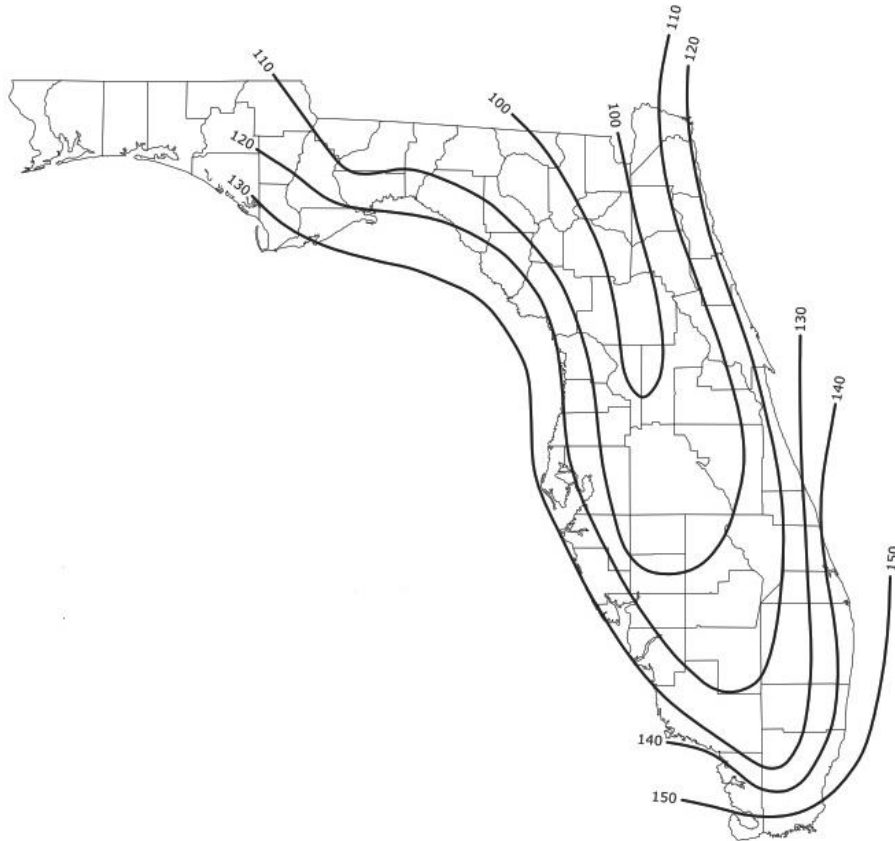


Figure 11 - Florida NESC extreme wind zones

Flood/Storm Surge Potential

NOAA has developed Flood and Storm Surge potential hazard maps⁶ for coastal and non-coastal regions across the United States. Pike Engineering overlaid FPUC Geographical Information System (GIS) system specific data containing asset locations across the NOAA maps to determine the Flood and Storm Surge Potential hazards for each evaluated scenario.

As shown in Figure 12, FPUC’s NW Division has minimal flood hazard potential across most of the territory except for facilities serving communities located near the Apalachicola River (Blountstown and Bristol). Storm Surge and Flood Hazard potential varies greatly in the NE Division as shown in Figure 13.

⁶ <https://coast.noaa.gov/floodexposure/#-9476264,3599408,11z/eyJljoic3RyZWV0In0=>

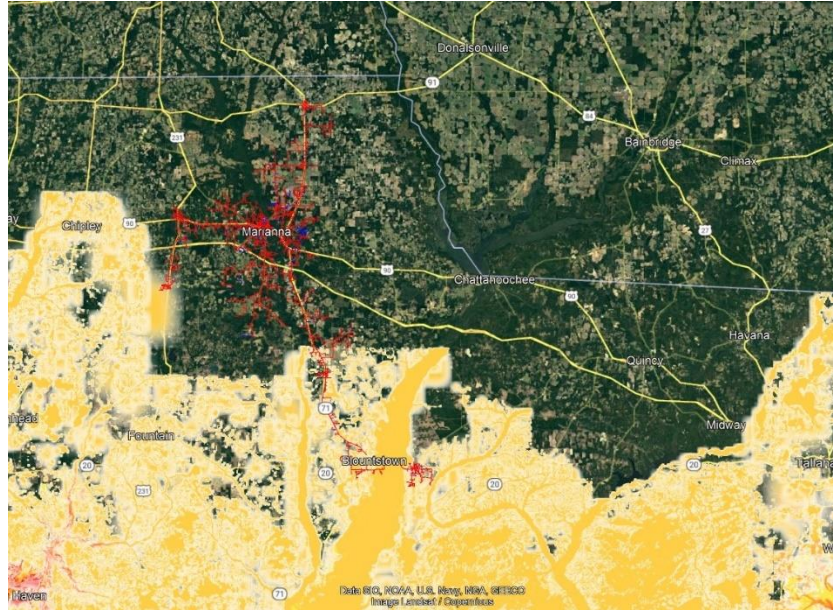


Figure 12- NOAA Coastal Flood Exposure Map - NW Division



Figure 13 – NOAA Coastal Flood Exposure Map – NE Division

Past Performance

The historical reliability performance of FPUC’s system during extreme and non-extreme weather conditions was analyzed and leveraged as the best indicator of future system performance during extreme weather events in a status quo (“do nothing”) scenario.

Accessibility

FPUC system-specific GIS data was overlaid on top of aerial/satellite imagery as shown in Figures 14 and 15 to determine their accessibility (ability for FPUC to easily access utility assets with standard trucks and tools). Inaccessible areas, such as those shown in Figure 15, take longer to restore due to the inability to leverage truck and tools specially designed to provide efficiencies in the construction and maintenance of electric grids.



Figure 14 - Accessible Areas - NW Division

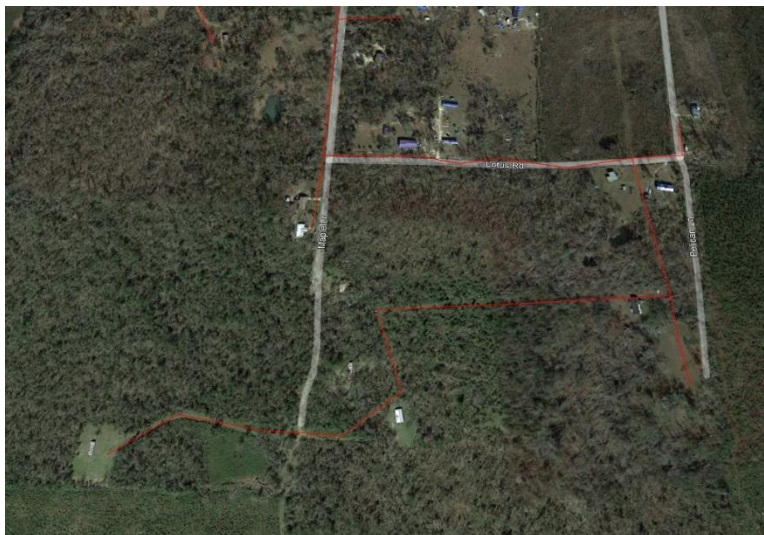


Figure 15 - Inaccessible Area - NW Division

Contingency

As mentioned earlier, it is practically and prudently impossible to eliminate all outages associated with extreme weather events. The ability to restore and recover unaffected areas of the distribution grid is essential in minimizing the customer impact associated with these events. This can prove to be problematic in more rural areas of a utility’s service territory, particularly at the tail end of a distribution circuit. FPUC’s service to customers in Liberty County, Florida is an example of this scenario where customers are served from a single overhead feeder that spans across the Apalachicola River. FPUC GIS data, electrical connectivity models, and discussions with FPUC personnel were leveraged to identify areas of the FPUC territory with this type of risk (Figure 16).



Figure 16 - Radial service to Liberty County customers

Vegetation Exposure

In late 2019, FPUC enlisted the assistance of Davey Resource Group to conduct a study⁷ “to review their present line clearance operation, vegetation maintenance cycles, and vegetation workload throughout the electric system.” The study was limited to the NW Division. As part of the findings, Davey Resource Group presented a “tree interference” calculation for each feeder circuit in the Division. The “tree interference” (vegetation exposure), expressed as a percentage of total overhead circuit miles, was leveraged for each analyzed scenario in the NW Division.

In the NE Division, an overlay of FPUC GIS system specific data against aerial/satellite imagery was used to determine approximate vegetation exposure for each analyzed scenario as shown in Figure 17 along Fernandina Beach’s Historic District.

⁷ [Appendix C](#) – Davey Resource Group - Trim Cycle and System Assessment; Florida Public Utilities - Mariana

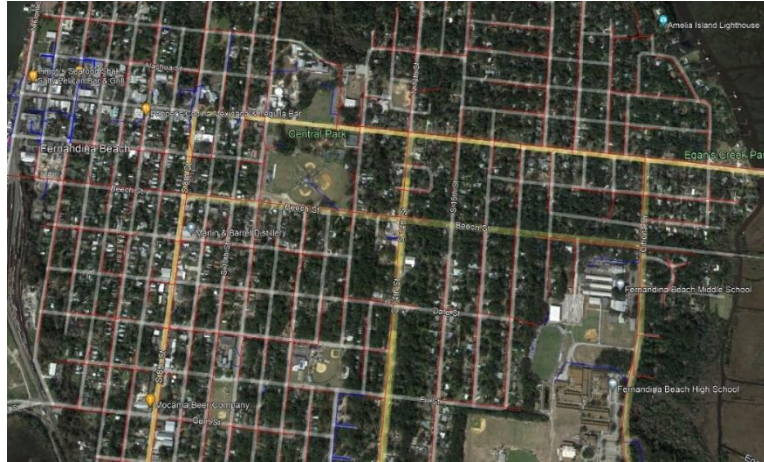


Figure 17 - Fernandina Beach Historic District - NE Division

Critical Load

FPUC’s customer base was categorized into three tiers; Tier 1 – dedicated to scenarios containing hospitals or first responders, Tier 2 – dedicated to scenarios containing storm shelters, major commercial retail centers, or large industrial customers, and Tier 3 – all others. These categories align with FPUC’s prioritized methods of post major storm event restoration priority.

Customers Served

The total customers served by the analyzed circuit or line segment was used to estimate the impact of an electric outage for each analyzed scenario.

Interruption Cost Estimate

The Interruption Cost Estimate (ICE)⁸ calculator is an electric reliability planning tool developed by Lawrence Berkeley National Laboratory (LBNL) and Nexant, Inc. This tool is designed for electric reliability planners at utilities, government organizations, and other entities that are interested in estimating interruption costs and/or the benefits associated with reliability improvements in the United States. The ICE Calculator is funded by the Energy Resilience Division of the U.S. Department of Energy’s Office of Electricity (OE). This publicly available tool was leveraged to estimate the financial societal impact of each analyzed scenario.

2.3 PRIORITIZATION

The Risk Resiliency Model leverages data inputs to evaluate and risk rank scenarios based on a balance of Probability, Response, and Impact. Results are presented in a quantitative format with projects representing the highest risk amongst the analyzed scenarios, represented with a higher risk resiliency score. The results of the model provide FPUC with a recommended portfolio of prioritized projects that

⁸ <https://icecalculator.com/home>

when executed, will reduce restoration costs associated with future extreme weather events and improve overall service reliability to the impacted customers. While the model provides a prioritized portfolio, it is important to note that the prioritization is based on the above referenced inputs to the model and does not account for other factors that may influence FPUC's decision regarding the order of execution of these projects such as the availability of resources, external influences such as pending Department of Transportation (DOT) projects, material availability, prudent balance of investments across Divisions, etc.

3.0 PROGRAM DESCRIPTIONS & BENEFITS

The following section outlines the detailed descriptions, costs, and benefits of the new SPP Transmission and Distribution Programs, the legacy programs with proposed incremental expenditures, and the planned Transmission and Distribution Vegetation Management program.

3.1 OVERHEAD FEEDER HARDENING

Description

The FPUC system contains approximately 141 miles of overhead feeder backbone lines across 29 feeders. The Overhead Feeder Hardening Program will systematically upgrade all 141 miles to NESC 250C Extreme wind standards outlined in section 2.2 of this report.

As referenced in section 1.2, the backbone of a feeder resembles the major arteries of the distribution circuit that services a particular community. When a fault occurs on a backbone, upwards of 2,500 customers can be immediately impacted. Thus, the strengthening of these critical sections of the electric distribution grid to withstand damage during extreme weather conditions, can significantly reduce the impact these weather events can have.

As part of the hardening of the overhead lines, each line segment will be analyzed leveraging specialized software to ensure adherence to current NESC standards in place at the time of analysis. Applicable upgrades associated with this analysis such as upgrading of pole class or adding intermediate poles will be included as part of the design in addition to other upgrades that further strengthen the resiliency of the line against direct damage or ancillary damage that can be caused by extreme weather events. Such upgrades include:

- Replacement of previously identified deteriorated poles.
- Relocation of facilities to utility truck accessible areas, areas less prone to damage, or areas which can facilitate the restoration process.
- Upgrading the conductor size to one of higher tensile strength to better withstand damage from airborne debris or higher ampacity allowing for the re-route of power to and from alternate sources as part of the restoration process.
- Ensuring ancillary equipment and framing equipment on the pole has the adequate Basic Insulation Level (BIL) to withstand inadvertent faults from an increase in contamination such as wind induced salt spray.
- Adding additional guying to existing structures as necessary.
- Environmental upgrades such as avian protection, animal mitigation, and lightning protection.

Cost

The expected 10-year cost for this Program is approximately \$17.6M covering approximately 44 miles of high priority overhead feeder improvements.

OH Feeder Hardening	2022	2023	2024
Capital (\$MM)	\$0.29	\$2.92	\$2.98
O&M (\$MM)	\$0.01	\$0.09	\$0.09
Units (miles) ⁹	0	7.46	8.20
Total	\$0.30	\$3.01	\$3.07

Table 2 - Overhead Feeder Hardening estimated 3-year costs

Cost/Benefit Comparison

Beginning in 2022, the Overhead Feeder Hardening Program will take approximately 30 years to complete. At its conclusion, the program is projected to have hardened approximately 141 miles of overhead feeder at a cost of approximately \$56M¹⁰.

Projected benefits associated with the Overhead Feeder Hardening program include a reduction in storm restoration costs and increase in service reliability; associated with a reduction in outage events during both extreme and non-extreme weather conditions. FPUC’s data previously reported¹¹ to the Commission following Hurricanes Hermine, Matthew, and Irma, found no damage to hardened facilities. Additionally, post-storm data for Hurricane Michael found that hardened structures performed significantly better than non-hardened structures. A review¹² conducted by the Commission following Hurricanes Hermine, Matthew, Irma, and Nate found that the “Florida’s aggressive hardening programs are working”, “The length of outages was reduced markedly from the 2004-2005 storm season”, and “Hardened overhead distribution facilities performed better than non-hardened facilities.” FPUC believes the Overhead Feeder Hardening program will achieve the desired objectives outlined in Rule 25-6.030 of “reducing restoration costs and outage times associated with extreme weather events and enhancing reliability.” FPUC also agrees with the Commission’s findings that “no amount of preparation can eliminate outages in extreme weather events” however, the utility can play a part in implementing programs that reduce outages and subsequent outage durations.

⁹ Reflected units exclude design only units and is strictly projected construction units in noted calendar year.

¹⁰ Represents 2022 dollars and does not account for increase in material costs or inflation over projected 30-year span.

¹¹ <http://www.floridapsc.com/library/filings/2018/00499-2018/00499-2018.pdf>

¹² <http://www.floridapsc.com/library/filings/2018/04847-2018/04847-2018.pdf>

3.2 OVERHEAD LATERAL HARDENING

Description

The FPUC systems contain approximately 575 miles of overhead lateral lines across 29 feeders. The Overhead Lateral Hardening Program will systematically upgrade key laterals to NESC 250C Extreme wind standards outlined in section 2.2 of this report.

As referenced in section 1.2, a typical overhead lateral can have upwards of 200 to 300 customers. Thus, the strengthening of these critical sections of the electric distribution grid to withstand damage during extreme weather conditions, can significantly reduce the impact these weather events can have.

As part of the hardening of the overhead lines, each line segment will be analyzed leveraging specialized software to ensure adherence to NESC standards. Applicable upgrades associated with this analysis such as upgrading of pole class or adding intermediate poles will be included as part of the design in addition to other upgrades that further strengthen the resiliency of the line against direct damage or ancillary damage that can be caused by extreme weather events. Such upgrades include:

- Replacement of previously identified deteriorated poles.
- Relocation of facilities to utility truck accessible areas, areas less prone to damage, or areas which can facilitate the restoration process.
- Upgrading the conductor size to one of higher tensile strength to better withstand damage from airborne debris or higher ampacity allowing for the re-route of power to and from alternate sources as part of the restoration process.
- Ensuring ancillary equipment and framing equipment on the pole has the adequate Basic Insulation Level (BIL) to withstand inadvertent faults from an increase in contamination such as wind induced salt spray.
- Adding additional guying to existing structures as necessary.
- Environmental upgrades such as avian protection, animal mitigation, and lightning protection.
- Upgrading traditional fusing to cut-out mounted reclosers intended to minimize the number of outages associated with temporary or transient fault conditions.

Cost

The expected 10-year cost for this Program is approximately \$25.5M covering approximately 51 miles of high priority overhead lateral improvements.

OH Lateral Hardening	2022	2023	2024
Capital (\$MM)	\$0.06	\$0.56	\$.98
O&M (\$MM)	\$0.00	\$.02	\$.03
Units (miles) ¹³	0	1.16	1.16
Total	\$0.06	\$0.58	\$1.01

Table 3 - Overhead Lateral Hardening estimated 3-year costs

¹³ Reflected units exclude design only units and is strictly projected construction units in noted calendar year.

Cost/Benefit Comparison

Beginning in 2022, the Overhead Lateral Hardening Program will take approximately 30 years to complete. At its conclusion, the program is projected to have hardened approximately 142 miles of multi-phase overhead laterals at a cost of approximately \$71M¹⁴ which represents 100% of the multi-phase overhead laterals in the FPUC overhead system.

Projected benefits associated with the Overhead Lateral Hardening program include a reduction in storm restoration costs and increase in service reliability; associated with a reduction in outage events during both extreme and non-extreme weather conditions. FPUC's data previously reported¹⁵ to the Commission following Hurricanes Hermine, Matthew, and Irma, found no damage to hardened facilities. Additionally, post-storm data for Hurricane Michael found that hardened structures performed significantly better than non-hardened structures. A review¹⁶ conducted by the Commission following Hurricanes Hermine, Matthew, Irma, and Nate found that the "Florida's aggressive hardening programs are working", "The length of outages was reduced markedly from the 2004-2005 storm season", and "Hardened overhead distribution facilities performed better than non-hardened facilities." FPUC believes the Overhead Lateral Hardening program will achieve the desired objectives outlined in Rule 25-6.030 of "reducing restoration costs and outage times associated with extreme weather events and enhancing reliability." FPUC also agrees with the Commission's findings that "no amount of preparation can eliminate outages in extreme weather events" however, the utility can play a part in implementing programs that reduce outages and subsequent outage durations.

3.3 OVERHEAD LATERAL UNDERGROUNDING

Description

As noted previously, FPUC's system contains approximately 575 miles of overhead lateral lines across 29 feeders; 433 miles of which are single phase. The Overhead Lateral Undergrounding Program will address the systematic undergrounding in place or relocation and undergrounding of the single phase overhead electric facilities, many of which are located in heavily vegetated areas, environmentally sensitive areas, or in areas where upgrading the overhead construction to NESC extreme wind standards is not practical or consistent with industry design standards.

As referenced in section 1.2, a typical overhead lateral can have upwards of 200 to 300 customers. Thus, the strengthening of these critical sections of the electric distribution grid to withstand damage during extreme weather conditions can significantly reduce the impact these weather events can have.

As part of the undergrounding of the overhead lines, each line segment will be relocated to utility truck accessible areas in the front of the premise as necessary to facilitate restoration and maintenance activities. Additionally, FPUC will be installing meter base adaptors to minimize the customer impact associated with the conversion. These adaptors allow customers to retain their existing meter and meter

¹⁴ Represents 2022 dollars and does not account for increase in material costs or inflation over 30-year span.

¹⁵ <http://www.floridapsc.com/library/filings/2018/00499-2018/00499-2018.pdf>

¹⁶ <http://www.floridapsc.com/library/filings/2018/04847-2018/04847-2018.pdf>

enclosure, minimizing the need for costly permits and inspections associated with electrical panel upgrades that may otherwise be necessary.

Cost

The expected 10-year cost for this Program is approximately \$65.3M covering approximately 59 miles of high priority overhead lateral improvements.

OH Lateral Undergrounding	2022	2023	2024
Capital (\$MM)	\$0.11	\$1.09	\$1.62
O&M (\$MM)	\$0.00	\$0.03	\$0.05
Units (miles) ¹⁷	0	1.02	1.02
Total	\$0.11	\$1.12	\$1.67

Table 4 - Overhead Lateral Undergrounding estimated 3-year costs

Cost/Benefit Comparison

The Overhead Lateral Undergrounding Program will begin in 2022 and take approximately 30 years to complete. At its conclusion, the program is projected to have undergrounded approximately 200 miles of single-phase overhead laterals at a cost of approximately \$220M.¹⁸

Projected benefits associated with lateral undergrounding program include a reduction in storm restoration costs and increase in service reliability associated with a reduction in outage events during both extreme and non-extreme weather conditions. FPUC’s data previously reported¹⁹ to the Commission following Hurricanes Hermine, Matthew, Maria, and Nate, found no repairs or replacements of underground facilities. Additionally, damage to underground facilities associated with Hurricane Michael was less than 1%, with one transformer and three switchgears replaced. The reliability performance of underground systems routinely outperforms that of overhead facilities as noted annually²⁰ on FPUC’s Overhead to Underground comparison on both an “Actual” (inclusive of extreme weather events) and “Adjusted” basis. This finding was also substantiated by a review²¹ conducted by the Commission following Hurricanes Hermine, Matthew, Irma, and Nate found which found that “Underground facilities performed much better compared to overhead facilities.”

¹⁷ Reflected units excludes design only units and is strictly projected construction units in noted calendar year.

¹⁸ Represents 2022 dollars and does not account for increase in material costs or inflation over 30-year span.

¹⁹ <http://www.floridapsc.com/library/filings/2018/00499-2018/00499-2018.pdf>

²⁰ <http://www.floridapsc.com/ElectricNaturalGas/ElectricDistributionReliability>

²¹ <http://www.floridapsc.com/library/filings/2018/04847-2018/04847-2018.pdf>

3.4 DISTRIBUTION POLE INSPECTION AND REPLACEMENTS

Description

In alignment with FPSC Order No. PSC-06-0144, FPUC implemented an 8-year cycle wood pole inspection program. The most current edition of the National Electric Safety Code (NESC) serves as a basis for the design of replacement poles that fail inspection. Grade 'B' construction, as described in Section 24 of the NESC, has been adopted as the standard of construction for designing new pole installations and the replacement of reject poles in each FPUC Electric Division (NE & NW). Extreme wind loading, as specified in rule 250C and figure 250-2(d) of the NESC, has been adopted for replacement poles.

Wood pole inspections are performed by a qualified wood pole inspection contractor. The inspection process is a multi-step process that may involve one or more of visual inspection techniques, sound and bores, and excavations with treatments. Inspection results are summarized for each division by the contractor and include bar charts and tables that show inspection results summary, failure rates, and pole ages. The number of inspections may vary from year-to-year based upon a variety of factors however, FPUC completes all required wood pole inspections during the eight-year wood pole inspection cycle. In 2016 FPUC began the first year of the second cycle for both divisions.

Beginning in 2014, the inspections were performed with modified criteria for chromated copper arsenate (CCA) treated pole inspections. CCA poles less than 21 years of age are visually inspected, sounded, and selectively bored. Boring is performed only if internal decay is suspected. Unless a pole failed sound and bore, a full excavation is not performed on these poles.

The contractor performs Strength Assessment tests on selected poles to compare the current measured circumference to the original circumference of the pole. The effective circumference of the pole is determined to ensure that the current condition of the pole meets the requirements of NESC Section 26 "Strength Requirements". Beginning in 2010, pole inspection criteria were enhanced to include LoadCalc, a program used by the contractor to determine pole loading, analysis on poles with remaining strength at or below 67%. Poles identified by the contractor as being loaded at or above 100% are re-evaluated by FPUC engineers using a program called PoleForeman. NESC Grade B construction & 60 mph winds provide the basis for calculations. Poles loaded at or above 100% following re-evaluation are marked for replacement. If the 'required' remaining strength resulting from the combined strength and load analysis indicates that the pole is not suited for continued use, the contractor rejects the pole and reports it to FPUC for follow-up.

Poles marked for replacement are re-inspected by FPUC employees and assigned a priority based upon potential hazard to public and employee safety. Repairs are then made in order of priority. FPUC policy is to replace all reject poles in lieu of bracing "restorable" reject poles. Poles are prioritized for replacement using the reject severity level awarded by the inspector as the basis. Poles are analyzed by FPUC engineers who leverage PoleForeman software to ensure the new poles meet the storm hardening criteria discussed in the first paragraph of this section.

FPUC has approximately 31,700 wood distribution poles and annually invests approximately \$1.22 in their inspection & replacement.²²

Cost

The expected 10-year cost for this Program is approximately \$14.02M covering approximately 2,300 high priority pole replacements.

Dist. Pole Insp. & Replace	2022	2023	2024
Capital (\$MM)	\$0.71	\$1.33	\$1.42
O&M (\$MM)	\$0.10	\$0.19	\$0.20
Units (poles)	119	203	278
Total	\$0.81	\$1.52	\$1.62

Table 5 – Distribution Pole Inspection and Replacements estimated 3-year costs

Cost/Benefit Comparison

Continuing since 2008, the Distribution Pole Inspection and Replacement program is an on-going program that assures the structural integrity of wood distribution poles.

Projected benefits associated with the Distribution Pole Inspection and Replacement program include a reduction in storm restoration costs and increase in service reliability; associated with a reduction in outage events during both extreme and non-extreme weather conditions. FPUC’s data previously reported²³ to the Commission following Hurricanes Hermine, Matthew, and Irma, found no damage to hardened facilities. Additionally, post-storm data for Hurricane Michael found that hardened structures performed significantly better than non-hardened structures. A review²⁴ conducted by the Commission following Hurricanes Hermine, Matthew, Irma, and Nate found that the “Florida’s aggressive hardening programs are working”, “The length of outages was reduced markedly from the 2004-2005 storm season”, and “Hardened overhead distribution facilities performed better than non-hardened facilities.” FPUC believes the continuation of the Distribution Pole Inspection and Replacement program will achieve the desired objectives outlined in Rule 25-6.030 of “reducing restoration costs and outage times associated with extreme weather events and enhancing reliability.” FPUC also agrees with the Commission’s findings that “no amount of preparation can eliminate outages in extreme weather events” however, the utility can play a part in implementing programs that reduce outages and subsequent outage durations.

²² Based on average blended rate of historical 3rd party pole inspection and replacement costs.

²³ <http://www.floridapsc.com/library/filings/2018/00499-2018/00499-2018.pdf>

²⁴ <http://www.floridapsc.com/library/filings/2018/04847-2018/04847-2018.pdf>

3.5 TRANSMISSION SYSTEM INSPECTION AND HARDENING

Description

The 138kV Transmission system in the NE Division was constructed using concrete poles, steel poles, and steel towers. The construction generally complies with storm hardening requirements. Transmission inspections are performed on all transmission facilities and include patrols of the 138kV and 69kV transmission lines owned by FPUC. This inspection ensures that all structures have a detailed inspection performed at a minimum of every six years. The inspection includes fifty (50) 138kV structures and two hundred seventeen (217) 69kV structures. The inspections ensure that all transmission towers and other transmission line supporting equipment such as insulators, guying, grounding, conductor splicing, cross-braces, cross-arms, bolts, etc. are structurally sound and firmly attached.

Substation equipment is also inspected annually to document the integrity of the facility and identify any deficiencies that require action. Substations are inspected to ensure that all structures, buss work, insulators, grounding, bracing, bolts, etc. are structurally sound and firmly attached.

The 69kV transmission system consists of a total of 217 poles of which 122 are concrete and 95 are wood structures. All installations met the NESC code requirements in effect at the time of construction. A policy of replacing existing wood poles with concrete structures has been in place for some time. This policy requires that when it becomes necessary to replace a wood pole, due to construction requirements or concerns with the integrity of the pole, a concrete pole that meets current NESC codes and storm hardening requirements will be utilized. FPUC’s budgeted projections for wood pole replacements versus actuals achieved varies from year to year due to several factors inclusive of resource allocation, material availability, external constraints, and others. This program is projected to accelerate the full replacement of the Commission-approved 69kV wood poles for completion within the 2022-2031 SPP plan.

FPUC has 267 Transmission structures in the NE Division and none in the NW Division annually investing approximately \$0.62M in their inspection & replacement.

Cost

The expected 10-year cost for this Program is approximately \$7.09M accelerating the replacement of all remaining 69kV wooden poles.

Trans. Wood Pole Replace	2022	2023	2024
Capital (\$MM)	\$0.40	\$0.60	\$0.60
O&M (\$MM)	\$0.01	\$0.02	\$0.02
Units (poles)	5	8	8
Total	\$0.41	\$0.62	\$0.62

Table 6 – Transmission SYSTEM INSPECTION AND HARDENING estimated 3-year costs

Cost/Benefit Comparison

FPUC plans on continuing this Commissioned-approved initiative and accelerate the completion of the Transmission Wood Pole Replacement program. The program assures the structural integrity of wood transmission poles. At its conclusion, all 69kV wood poles within FPUC's Transmission system will have been replaced with concrete and the cyclical inspections will continue.

Projected benefits associated with the Transmission Wood Pole Replacement program include a reduction in storm restoration costs and increase in service reliability; associated with a reduction in outage events during both extreme and non-extreme weather conditions. Transmission lines are the main supply lines between generating stations and the local substations that connect to the distribution grid. An outage to a Transmission line can affect tens of thousands of customers at one time. FPUC's data previously reported²⁵ to the Commission following Hurricanes Hermine, Matthew, and Irma, found no damage to hardened facilities. Additionally, post-storm data for Hurricane Michael found that hardened structures performed significantly better than non-hardened structures. A review²⁶ conducted by the Commission following Hurricanes Hermine, Matthew, Irma, and Nate found that the "Florida's aggressive hardening programs are working", "The length of outages was reduced markedly from the 2004-2005 storm season", and "Hardened overhead distribution facilities performed better than non-hardened facilities." FPUC believes the continuation of the Transmission Wood Pole Replacement program will achieve the desired objectives outlined in Rule 25-6.030 of "reducing restoration costs and outage times associated with extreme weather events and enhancing reliability." FPUC also agrees with the Commission's findings that "no amount of preparation can eliminate outages in extreme weather events;" however, the utility can play a part in implementing programs that reduce outages and subsequent outage durations.

3.6 TRANSMISSION & DISTRIBUTION (T&D) VEGETATION MANAGEMENT

Description

The T&D Vegetation Management program has historically worked towards the accomplishment of a three-year vegetation management cycle on main its approximately 141 miles of feeders and a six-year vegetation management cycle on its approximately 575 miles of laterals on the system.

The program includes the following:

1. Three-year vegetation management cycle on all main feeders.
2. Six-year vegetation management cycle on all laterals.
3. Increased participation with local governments to address improved overall reliability due to tree related outages.
4. Information made available to customers regarding the maintenance and placement of trees.

²⁵ <http://www.floridapsc.com/library/filings/2018/00499-2018/00499-2018.pdf>

²⁶ <http://www.floridapsc.com/library/filings/2018/04847-2018/04847-2018.pdf>

Based upon current tree trimming crew levels, FPUC also makes reasonable efforts to address the annual inspection of main feeders to critical infrastructure prior to the storm season to identify & perform the necessary trimming and addresses danger trees located outside the normal trim zone and located near main feeders as reported.

The plan also manages the cyclical trimming along the approximately 3.6 miles and 12 miles of 138kV and 69kV Transmission lines respectively. These Transmission lines have historically been included with the distribution main feeders’ 3-year trim cycle.

In 2014, FPUC initiated a new cycle of its 3-year feeder and 6-year lateral vegetation management program. Data from this and the preceding cycles was analyzed for opportunities for improvements. In late 2019, FPUC enlisted the assistance of Davey Resource Group to conduct a study²⁷ “to review their present line clearance operation, vegetation maintenance cycles, and vegetation workload throughout the electric system.” The study was limited to the NW Division but can be extrapolated to the NE Division which followed the same standards. As part of the findings, Davey Resource Group found that it was in “FPUC’s best interest to convert to a 4-year, cyclical, circuit-based vegetation management plan.”

FPUC proposes to align with the recommended 4-year cycle. This approach would allow FPUC to achieve and maintain a designated cycle for each circuit. The prioritization of each circuit will be determined based on a customer count, critical infrastructure and vegetation-related customer interruptions.

Cost

The costs associated with a four-year vegetation management cycle as recommended by the Davey Resource Group study, is approximately \$1.2M annually associated with seven (7) external (contracted) vegetation management crews. The expected 10-year cost for this Program is approximately \$11.6M to align the trim cycle from the current 3-year backbone / 6-year lateral to a 4-year cycle for all transmission lines, main feeders, and laterals.

Vegetation Management	2022	2023	2024
Capital (\$MM)	\$ -	\$ -	\$ -
O&M (\$MM)	\$ 0.80	\$ 1.20	\$ 1.20
Units (miles)	122	183	183
Total	\$0.80	\$1.20	\$1.20

Table 7 - Transmission and Distribution Vegetation Management estimated 3-year costs

²⁷ [Appendix B](#) – Davey Resource Group - Trim Cycle and System Assessment; Florida Public Utilities - Mariana

Cost/Benefit Comparison

Projected benefits associated with the T&D Vegetation Management program include a reduction in storm restoration costs and increase in service reliability; associated with a reduction in outage events during both extreme and non-extreme weather conditions. FPUC’s data previously reported to the Commission following Hurricanes Hermine, Matthew, and Irma, found that the number one driver for protracted restoration times during Hurricanes Matthew, Hermine, and Irma was the clearing of vegetation. Additionally, damage reported during these same storms was the result of falling trees and limbs.²⁸ A review²⁹ conducted by the Commission following Hurricanes Hermine, Matthew, Irma, and Nate also found that “the primary causes of power outages came from outside the utilities’ rights of way including falling trees, displaced vegetation, and other debris.” Together, these findings highlight the importance of cyclical vegetation management programs as well as the efficacy of FPUC’s vegetation management program in limiting vegetation-related outages from within the right-of-way or utility easement. FPUC believes the continuation of the T&D Vegetation Management program will achieve the desired objectives outlined in Rule 25-6.030 of “reducing restoration costs and outage times associated with extreme weather events and enhancing reliability.”

²⁸ <http://www.floridapsc.com/library/filings/2018/00499-2018/00499-2018.pdf>

²⁹ <http://www.floridapsc.com/library/filings/2018/04847-2018/04847-2018.pdf>

4.0 ESTIMATE OF ANNUAL JURISDICTIONAL REVENUE REQUIREMENTS

Pursuant to Rule 25-6.030(3)(g), F.A.C., the table below provides the estimated annual jurisdictional revenue requirements for each year of the SPP.

Year	Estimated Annual Revenue Requirements (\$MM)
2022	\$0.331
2023	\$1.138
2024	\$2.113
2025	\$3.615
2026	\$5.095
2027	\$6.636
2028	\$8.105
2029	\$9.389
2030	\$10.890
2031	\$12.247

Table 8 – Estimated Annual Revenue Requirements

The above estimated revenue requirements are consistent with the program cost estimates provided as of the time of this filing. Actual program costs and subsequent program costs submitted for cost recovery through the Storm Protection Plan Cost Recovery Clause as outlined in Rule 25-6.031, F.A.C., could vary from the estimates above. A true up of estimated versus actual costs for these programs will be performed at the time of the cost recovery filing consistent with the Commission’s rule.

5.0 ESTIMATE OF RATE IMPACTS FOR FIRST THREE YEARS OF SPP

Pursuant to Rule 25-6.030(3)(h), F.A.C., the table below provides the rate impacts for each year of the first three years of the SPP for FPUC’s typical residential, commercial, and industrial customers.

Estimated SPP Rate Impacts per 1,000kWh Residential	2023	2024	2025
Total SPP Estimate	\$2.50	\$3.68	\$6.08
Typical Commercial bill Increase %	1.60%	2.26%	3.74%
Typical Industrial bill Increase %	0.82%	1.04%	1.71%

Table 9 – Estimated SPP Rate Impacts

FPUC has not identified any implementation alternatives that could mitigate the resulting rate impact for each of the first three years of the proposed SPP. As previously noted, FPUC intends to continue its legacy hardening activities that are already included in customer rates. As part of the proposed plan, FPUC has implemented a methodical ramp up of investments during the first three years of the SPP for the incremental expenditures proposed beyond the previously Commission-approved legacy investments. In addition to other logistical reasons mentioned earlier in this report, this methodical ramp up of investments mitigates the resulting rate impact in the first three years of the plan and allows for the Hurricane Michael cost recover surcharge to expire.³⁰

³⁰ <http://www.floridapsc.com/library/filings/2020/11003-2020/11003-2020.pdf>

6.0 PROJECT DETAILS

This section contains the specific project details for the first year of the plan. Future year project details will be provided as part of the annual plan updates and subsequent SPP filings.

6.1 OVERHEAD FEEDER HARDENING

All FPUC feeders were risk ranked in alignment with the Risk Resiliency Model discussed in Section 2 of this report. Circuits were analyzed and prioritized via an algorithm that balances Probability, Response, and Impact. Each feeder circuit was assigned a risk score based on the model’s calculation providing FPUC with a prioritized, holistic view of their system. FPUC leveraged the model’s recommendation and supplemented it with other variables to identify the Overhead Feeder Hardening projects for the first three years of the plan. Project details for year one (2022) of the plan are shown in the table 10 below.

As part of the project and investments ramp up strategy previously discussed, FPUC will focus on the hardening of a relatively short feeder in the initial ten-year plan of risk ranked feeders. Projects will begin with planned design activities in 2022 and continue with construction activities in 2023.

Project ID	Feeder ID	Units (Miles)	Total Cust	Start Date	Comp. Date	2022 Cost (\$M)	Prior Storm Impact
Bailey Phase 1 Feeder Design	311	2.62	2,530	7/22	9/22	\$0.10	Yes
South Fletcher A1A (Simmons to Amelia Parkway) Feeder Design	102	1.91	1,862	5/22	6/22	\$0.08	Yes
Cottdondale Phase 1 Feeder Design	9866	2.93	1,429	10/22	12/22	\$0.12	Yes

Table 10 – Overhead Feeder Hardening 2022 Project Details

6.2 OVERHEAD LATERAL HARDENING

All FPUC feeders were risk ranked in alignment with the Risk Resiliency Model discussed in Section 2 of this report. Circuits were analyzed and prioritized via an algorithm that balances Probability, Response, and Impact. Each feeder circuit was assigned a risk score based on the model’s calculation providing FPUC with a prioritized, holistic view of their system. FPUC leveraged the model’s recommendation and supplemented it with other variables at the circuit level to identify the specific Overhead Lateral Hardening projects for the first three years of the plan.

As part of the project and investments ramp up strategy previously discussed, FPUC will focus on the hardening of a relatively short feeder in the initial ten-year plan of risk ranked feeders. Prioritized laterals within the risk ranked feeders will be hardened to gain efficiency in resource allocations. Projects will begin with planned design activities in 2022 and continue with construction activities in 2023.

Project ID	Feeder ID	Units (Miles)	Total Cust	Start Date	Comp. Date	2022 Cost (\$k)	Prior Storm Impact
FS.2107 Lateral Hardening Design	311	.87	150	5/22	9/22	\$43.3	Yes
FS.2764 Lateral Hardening Design	311	.09	275	7/22	9/22	\$4.67	Yes
FS.1888 Lateral Hardening Design	311	.06	5	7/22	9/22	\$3.10	Yes
FS.2132 Lateral Hardening Design	311	.08	80	7/22	9/22	\$3.87	Yes

Table 11 – Overhead Lateral Hardening 2022 Project Details

6.3 OVERHEAD LATERAL UNDERGROUNDING

All FPUC feeders were risk ranked in alignment with the Risk Resiliency Model discussed in Section 2 of this report. Circuits were analyzed and prioritized via an algorithm that balances Probability, Response, and Impact. Each feeder circuit was assigned a risk score based on the model’s calculation providing FPUC with a prioritized, holistic view of their system. FPUC leveraged the model’s recommendation and supplemented it with other quantifiable and non-quantifiable variables of their system at the circuit level to identify the specific Overhead Lateral Undergrounding plan for the first three years of the plan. Project details for year one (2022) of the Plan are shown in the table 12 below.

As part of the project and investments ramp up strategy previously discussed, FPUC will focus on the hardening of a relatively short feeder in the initial ten-year plan of risk ranked feeders. Prioritized laterals within the risk ranked feeders will be hardened to gain efficiency in resource allocations. Projects will begin with planned design activities in 2022 and continue with construction activities in 2023.

Project ID	Feeder ID	Units (Miles)	Total Cust	Start Date	Comp. Date	2022 Cost (\$M)	Prior Storm Impact
FS.1894 Lateral Undergrounding Design	311	.09	7	6/22	9/22	\$0.01	Yes
FS.2130 Lateral Undergrounding Design	311	.85	43	6/22	9/22	\$0.09	Yes
FS.1895 Lateral Undergrounding Design	311	.11	9	6/22	9/22	\$0.01	Yes

Table 12 – Overhead Lateral Undergrounding 2022 Project Details

7.0 CONCLUSION

FPUC believes that its proposed initial SPP plan will achieve the desired benefits and objectives outlined in Rule 25-6.030 of “reducing restoration costs and outage times associated with extreme weather events and enhancing reliability” and is therefore in alignment with the Commission’s requirements.

FPUC is committed to ongoing fulfillment of the Legislature’s directive set forth in Section 366.96, F.S., as well as the Commission’s implementing Rule 25-6.030, F.A.C. and believes the aforementioned plan yields important benefits to the FPUC customers and to the State.

Appendix A


FPUC's 2022 – 2031 Estimated SPP Costs


FPUC STORM PROTECTION PLAN


FPUC's 2022-2031 Estimated Storm Protection Plan Costs by Program (in Millions)													
		2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	Total	
Distribution - OH Feeder	Capital	\$ 0.29	\$ 2.92	\$ 2.98	\$ 1.28	\$ 2.49	\$ 1.47	\$ 1.46	\$ 1.42	\$ 1.43	\$ 1.31	\$ 17.06	
	O&M	\$ 0.01	\$ 0.09	\$ 0.09	\$ 0.04	\$ 0.08	\$ 0.05	\$ 0.05	\$ 0.04	\$ 0.04	\$ 0.04	\$ 0.53	
	Total	\$ 0.30	\$ 3.01	\$ 3.07	\$ 1.32	\$ 2.57	\$ 1.51	\$ 1.51	\$ 1.47	\$ 1.47	\$ 1.35	\$ 17.58	
Distribution - OH Lateral	Capital	\$ 0.06	\$ 0.56	\$ 0.98	\$ 4.41	\$ 1.80	\$ 2.99	\$ 3.17	\$ 4.71	\$ 3.46	\$ 2.62	\$ 24.75	
	O&M	\$ 0.00	\$ 0.02	\$ 0.03	\$ 0.14	\$ 0.06	\$ 0.09	\$ 0.10	\$ 0.15	\$ 0.11	\$ 0.08	\$ 0.77	
	Total	\$ 0.06	\$ 0.58	\$ 1.01	\$ 4.54	\$ 1.85	\$ 3.08	\$ 3.27	\$ 4.86	\$ 3.57	\$ 2.70	\$ 25.51	
Distribution - OH Lateral	Capital	\$ 0.11	\$ 1.09	\$ 1.62	\$ 6.23	\$ 5.00	\$ 8.52	\$ 8.06	\$ 6.44	\$ 13.13	\$ 13.13	\$ 63.35	
	O&M	\$ 0.00	\$ 0.03	\$ 0.05	\$ 0.19	\$ 0.15	\$ 0.26	\$ 0.25	\$ 0.20	\$ 0.41	\$ 0.41	\$ 1.96	
	Total	\$ 0.11	\$ 1.12	\$ 1.67	\$ 6.42	\$ 5.15	\$ 8.79	\$ 8.31	\$ 6.64	\$ 13.54	\$ 13.54	\$ 65.30	
Underground Pole Insp. & Replace	Capital	\$ 0.71	\$ 1.33	\$ 1.42	\$ 1.51	\$ 1.60	\$ 1.43	\$ 1.07	\$ 1.07	\$ 1.07	\$ 1.07	\$ 12.28	
	O&M	\$ 0.10	\$ 0.19	\$ 0.20	\$ 0.21	\$ 0.23	\$ 0.20	\$ 0.15	\$ 0.15	\$ 0.15	\$ 0.15	\$ 1.74	
	Total	\$ 0.81	\$ 1.52	\$ 1.62	\$ 1.72	\$ 1.82	\$ 1.63	\$ 1.22	\$ 1.22	\$ 1.22	\$ 1.22	\$ 14.02	
T&D - Vegetation Management	Capital	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	\$ -	
	O&M	\$ 0.80	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 11.60	
	Total	\$ 0.80	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 1.20	\$ 11.60	
Transmission - Inspection and Hardening	Capital	\$ 0.40	\$ 0.60	\$ 0.60	\$ 0.60	\$ 0.60	\$ 0.82	\$ 0.82	\$ 0.82	\$ 0.82	\$ 0.82	\$ 6.89	
	O&M	\$ 0.01	\$ 0.02	\$ 0.02	\$ 0.02	\$ 0.02	\$ 0.02	\$ 0.02	\$ 0.02	\$ 0.02	\$ 0.02	\$ 0.20	
	Total	\$ 0.41	\$ 0.62	\$ 0.62	\$ 0.62	\$ 0.62	\$ 0.84	\$ 0.84	\$ 0.84	\$ 0.84	\$ 0.84	\$ 7.09	
SPP Program Management	Capital	\$ -	\$ 0.20	\$ 0.20	\$ 0.21	\$ 0.21	\$ 0.22	\$ 0.23	\$ 0.23	\$ 0.24	\$ 0.25	\$ 1.99	
	O&M	\$ -	\$ 0.01	\$ 0.01	\$ 0.01	\$ 0.01	\$ 0.01	\$ 0.01	\$ 0.01	\$ 0.01	\$ 0.01	\$ 0.10	
	Total	\$ -	\$ 0.21	\$ 0.21	\$ 0.22	\$ 0.23	\$ 0.23	\$ 0.24	\$ 0.25	\$ 0.25	\$ 0.26	\$ 2.09	
Totals	Capital	\$ 1.57	\$ 6.70	\$ 7.79	\$ 14.23	\$ 11.70	\$ 15.45	\$ 14.81	\$ 14.70	\$ 20.15	\$ 19.20	\$ 126.30	
	O&M	\$ 0.93	\$ 1.56	\$ 1.60	\$ 1.81	\$ 1.74	\$ 1.84	\$ 1.78	\$ 1.78	\$ 1.95	\$ 1.92	\$ 16.89	
	Total	\$ 2.49	\$ 8.26	\$ 9.40	\$ 16.04	\$ 13.44	\$ 17.29	\$ 16.59	\$ 16.47	\$ 22.10	\$ 21.11	\$ 143.20	

Appendix B

FPUC Service Area Map

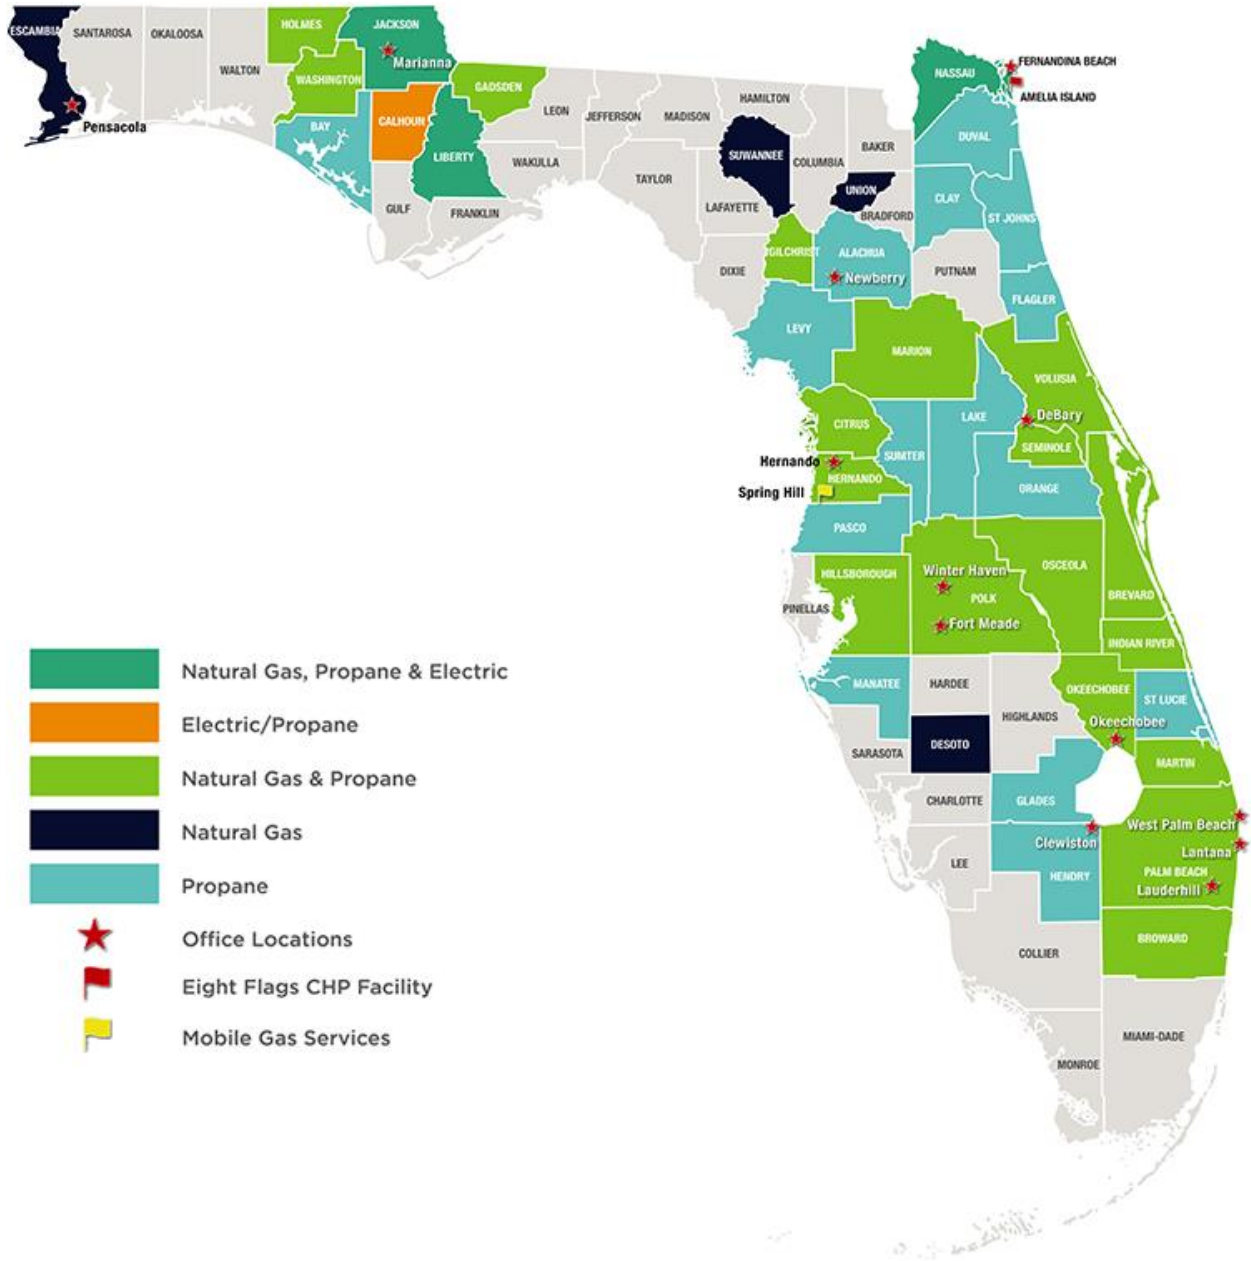

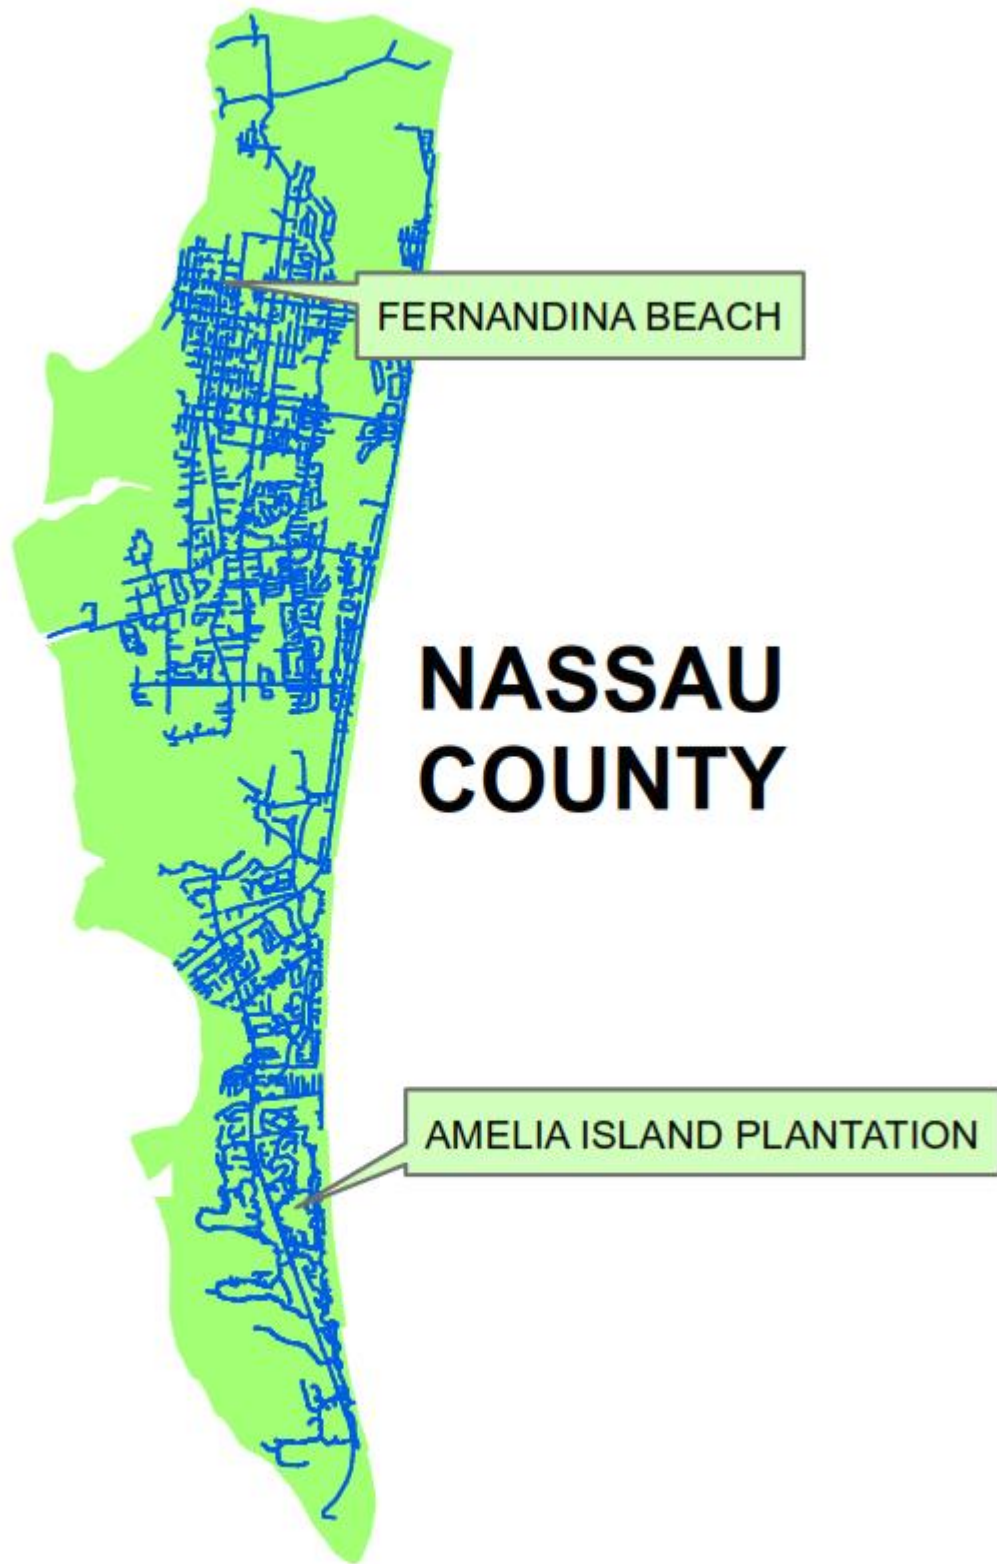

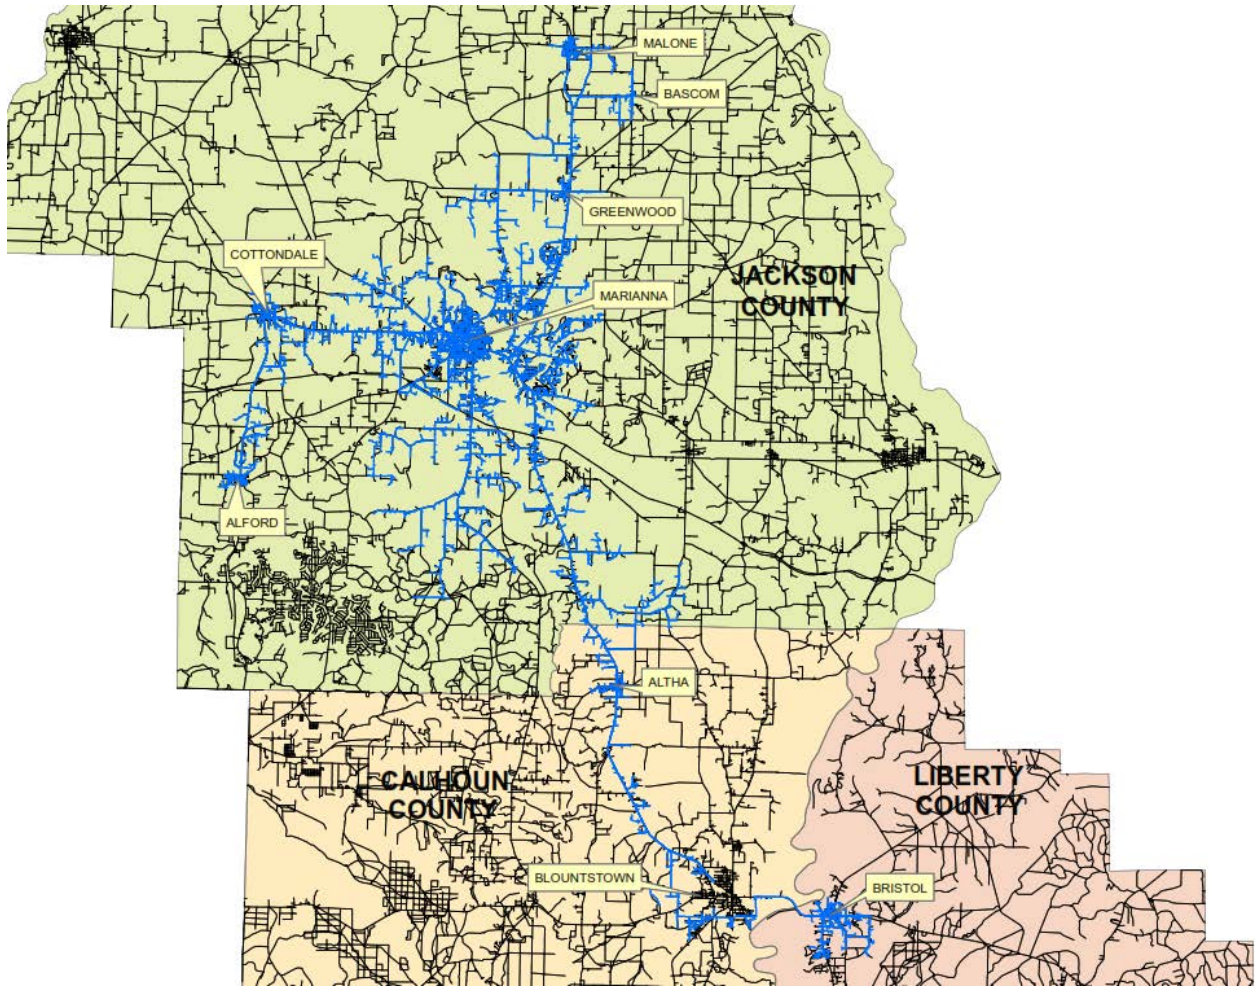

Appendix C

*Davey Resource Group - Trim Cycle and System Assessment;
Florida Public Utilities – Mariana*



Trim Cycle and System Assessment

Florida Public Utilities—Mariana

November 15, 2019



PROPOSAL:

TRIM CYCLE AND SYSTEM ASSESSMENT



CORPORATE OFFICE:
Davey Resource Group, Inc.
1500 North Mantua Street
Kent, OH 44240

TAX IDENTIFICATION NUMBER:
82-1948528

D&B NUMBER:
10-544-6632

CONTACT PERSON:
Lindon Deal

CONTACT PHONE:
904.445.0260

FAX:
330.673.0860

EMAIL:
Lindon.Deal@davey.com

Presented to:
Florida Public Utilities
780 Amelia Island Parkway
Fernandina Beach, FL 32034



ACKNOWLEDGEMENTS



The participation, cooperation, background data and current line clearance management information provided by Florida Public Utilities is greatly appreciated. These factors were essential to providing a comprehensive overview of the right-of-way management program.

The following Florida Public Utilities Employees and Davey Resource Group Assessment team and staff participated in or contributed information on this project:

Florida Public Utilities

Clinton Brown
Donnie Tew

Davey Resource Group


Lindon Deal
Geoffrey Etzel
Scott Anderson
Michael Gross



EXECUTIVE SUMMARY

A comprehensive review and analysis of the existing right-of-way maintenance program and vegetation workload has been conducted for Florida Public Utilities (FPU). This report and analysis are based on information and field observations pertaining to operating procedures for maintenance activities collected by Davey Resource Group's Utility Services personnel during August 2019.

This study was undertaken by FPU to review their present line clearance operation, Vegetation maintenance cycles, and vegetation workload throughout the electric system. This report will provide unbiased comment as to the overall efficiencies of the maintenance program, as well as provide recommendations to improve present operating procedures that will increase productivity, reduce future workloads, and increase reliability throughout the electric system.

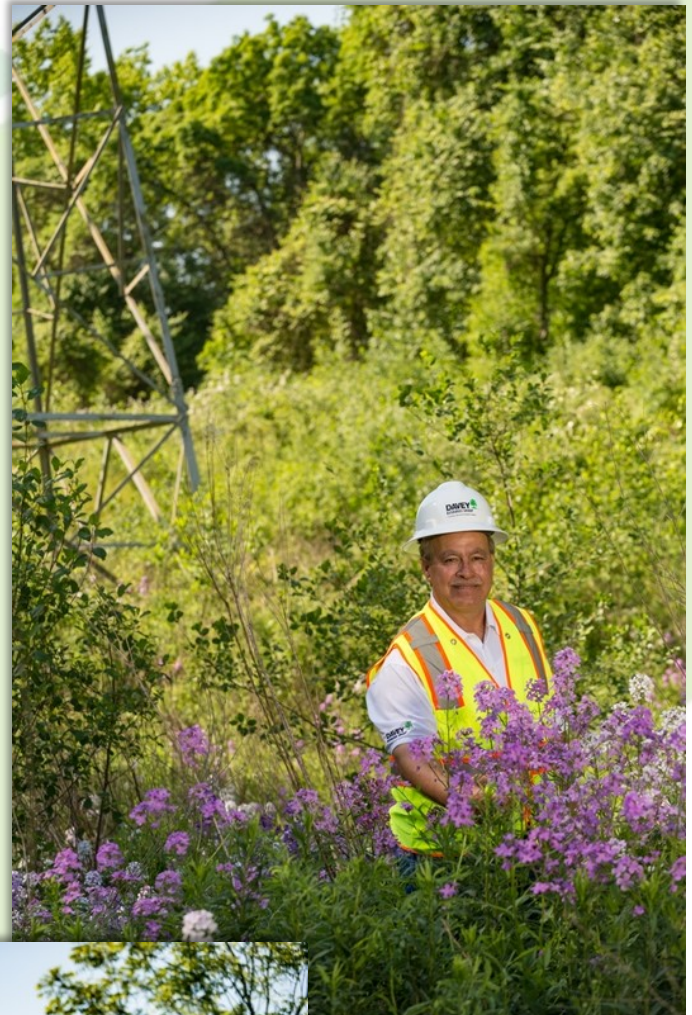

STUDY FINDINGS

- Hurricane Michael, in September, 2018, has caused lasting impacts to the FPU system
- It is in FPU's best interest to convert to a 4-year, cyclical, circuit based vegetation management plan
- Many Hazard trees exist on the system most of which were created by Hurricane Michael .
- FPU would benefit from additions and clarifications to its Trimming specifications
- A defined herbicide program would assist in maintaining the current workload efficiencies and reduce the occurrence of vine poles

SUMMARY OF PROGRAM RECOMMENDATIONS

- Initiate the implementation of line clearance specifications that will be the foundation for all acceptable line clearance activities.
- Develop a right-of-way post auditing (a Best Management Practice) and inspection process that initiates formal documentation of all acceptable work completed. This process will solidify the responsibility of FPU's vegetation management and ensure entire circuits are maintained appropriately to FPU specifications.
- Implement a complete right-of-way herbicide program that addresses stump treatment as well as species-selective, low-volume application on all right-of-way floors and edge lines.
- Modify the present crew configuration and equipment types to meet the needs of the right-of-way program and deliver cost-effective results
- Move vegetation management program to a 4-year trim cycle

INTRODUCTION

Florida Public Utilities is committed to maintaining uninterrupted service to customers in a safe and environmentally sound manner. This requires compliance with line clearance regulations to ensure public safety, while taking into consideration the best arboricultural practices for managing vegetation. FPU is in a unique situation recovering from Hurricane Michael that occurred one year prior to this review. This event has been catastrophic to the community and to the trees in the area, severely reducing the Tree wire Interface on the FPU system.

METHODOLOGY

Information Gathering

DRG collected information on Florida Public Utilities line clearance program during the month of August 2019. This process included a review of written information which included Line clearance Specifications and last trim dates. Field data was collected by DRG field personnel using the Rover Data collection system, after a two day training period. Quality audits were performed on all work collected in the first week, with a follow up of 10% of the remaining sample sites. Collection protocols were developed prior to training (Appendix A).

Field Assessment

DRG collected detailed information on 62 sample plots of FPU's distribution system in Marianna, Florida. All samples were randomly located across the system. These samples equate to a 10% sampling of the entire 615 FPU circuit miles to ensure a complete sample size. The DRG GIS department used geospatial analytics and remote sensing to determine the actual Tree wire interface on the FPU system to determine actual miles of vegetation workload and ensure DRG did not sample areas with no existing vegetation.

The tree interface is where vegetation is mature enough to cause reliability issues to the FPU system. Currently the overhead electric system has 210 miles of tree interface. DRG ran 62 one mile plots and were able to sample 34% of the actual tree interface in the field during August 2019. A complete listing of tree interface mileage by circuit and phasing can be found in Appendix B.

Sampling Methodology for the Workload Survey

- **Step 1** – Using FPU provided shape files our DRG GIS team used an ARC GIS randomizing tool to ensure non biased random sampling. All sample plots were located on system maps by the GIS team prior to beginning field work.
- **Step 2** – Davey’s GIS Department selected consecutive spans segments from the line and pole data, using remote sensing analysis to identify areas of tree wire interface to create 62 sample plots.
- **Step 3** - Inspection began upstream on the segment and work towards the designated endpoint.
- **Step 4** - Attributes were collected for each sample plot. Attribute definitions are located below in Table 1.
- **Step 5** - Using our Data collection and reporting system, tallies were run for each specific data set and were exported to Excel for further analysis.

Definitions of Data Fields

Average Distance to Conductor	Overall average clearance of vegetation in the sample area	#
Closest to Conductor	Distance to the closest tree in the sample area	# in feet
Species	Species of the tree closes to conductor	Name
Accessibility	Is the work area accessible by a bucket truck or climbing crew? <ul style="list-style-type: none"> • Accessible as if a truck can be utilized without special permission from property owner • Driveways or areas requiring permission from property owner would be considere4d if inaccessible • If site was 75% accessible and 25% inaccessible, site was considered accessible. 	Accessible / Inaccessible
Potential Hazards	Dead, dying or leaning trees. Broken branches over conductors that can be consider a risk to reliability	Yes / No per span
Vine Poles	Any fine that is currently growing on an electric facility (includes poles and guide wires)	# of occurrences in sample
ANSI A300	Were ANSI standards followed during the last trim cycle?	Yes / no by sample area
Land Use	Includes row crops and forested areas	Residential / Commercial / Agricultural
Trapped Trees	Defined as any small tree or brush that has the potential to contact conductors and has its upward growth pushed toward conductors	Yes / no by sample area
Overhang	Trees with canopy or limbs growing over facilities which is less than the minimum specifications. Only overhang that is not compliant with FPU specifications will be documented.	Yes / no by each span
Tree Growth Regulator (TGR)	Are there any trees in the sample area the proper clearance cannot be achieved due to the location of tree? Would it be beneficial for a TGR application?	# of trees in sample area


The data fields that were chosen to be collected are strategically designed to capture data relevant to reliability, vegetation workloads, and trim cycle efficacy. To determine the average clearances maintained over time DRG collected the average distance to conductor which represents the bulk of the Tree Interface maintained clearances.

- Pruning trees on a cycle basis (pruning an entire circuit from Substation to last transformer) is efficient, practical and manageable, but leaves the door open for cycle buster trees which grow too fast to maintain clearance throughout the cycle time frame. To identify these “cycle busters” DRG used the data field, Closest to conductor, which identified the significant difference in clearances over time if all trees were trimmed to the same distance from conductor at the same time.
- The data field “species” was collected to identify the actual tree types that can provide a potential reliability challenge in maintaining clearances over time. This data would be used to determine a range of tree species that may be outside of the norm.
- To assist in identifying actual workloads and types of work loads, DRG collected accessibility and land use types to assist in determining the best crew complement to complete the work in the most efficient and cost-effective manner.
- Hazardous Vegetation conditions were documented during the field assessment as well as during the Tree/Wire Interface evaluation. Hazardous vegetation consists of any dead, dying, diseased, or leaning tree that could cause an interruption to electrical service to FPU customers. Overhanging vegetation is also considered a hazardous condition. Removal of all overhang is recommended when possible.
- Trapped tree data (any brush or small trees that are directly under or are growing directed towards the electric facilities) was collected to determine potential reliability concerns and future work considerations. Most all of these trapped trees are volunteers growing in hedgerows or fence lines. The removal of these trees will reduce future workloads by eliminating trees now rather than pruning them in the future.
- Tree Growth Regulator (TGR) data was collected to determine if its application would be a viable option for maintaining vegetation that proper pruning could not achieve clearance for the given cycle length or removal of vegetation was not an option, and due to the 2018 Hurricane Michael and the devastation to the trees we found that there is not enough candidates available to be a cost effective and efficient way to manage any of your tree load.
- Vines growing on any pole or guide wire pose a threat to electric facilities. Removal of vines can be accomplished manually but a combination of manual and chemical remove is advised for longer term control.
- ANSI A300 is the National Standard utilized by Utilities for proper pruning techniques. Adherence to these standards will assist in maintaining proper clearance of vegetation for the length of the cycle and promote the long term health of the trees.

Distribution of Data Collected

Data Sampling Transects

This map provides an overview of the sample areas and their even distribution across the FPU system. Tree/Wire interface data was used in excluding areas that do not require line clearance activities. Sample plots are placed randomly across the system in location with Tree/Wire Interface without bias to accessibility or work type.

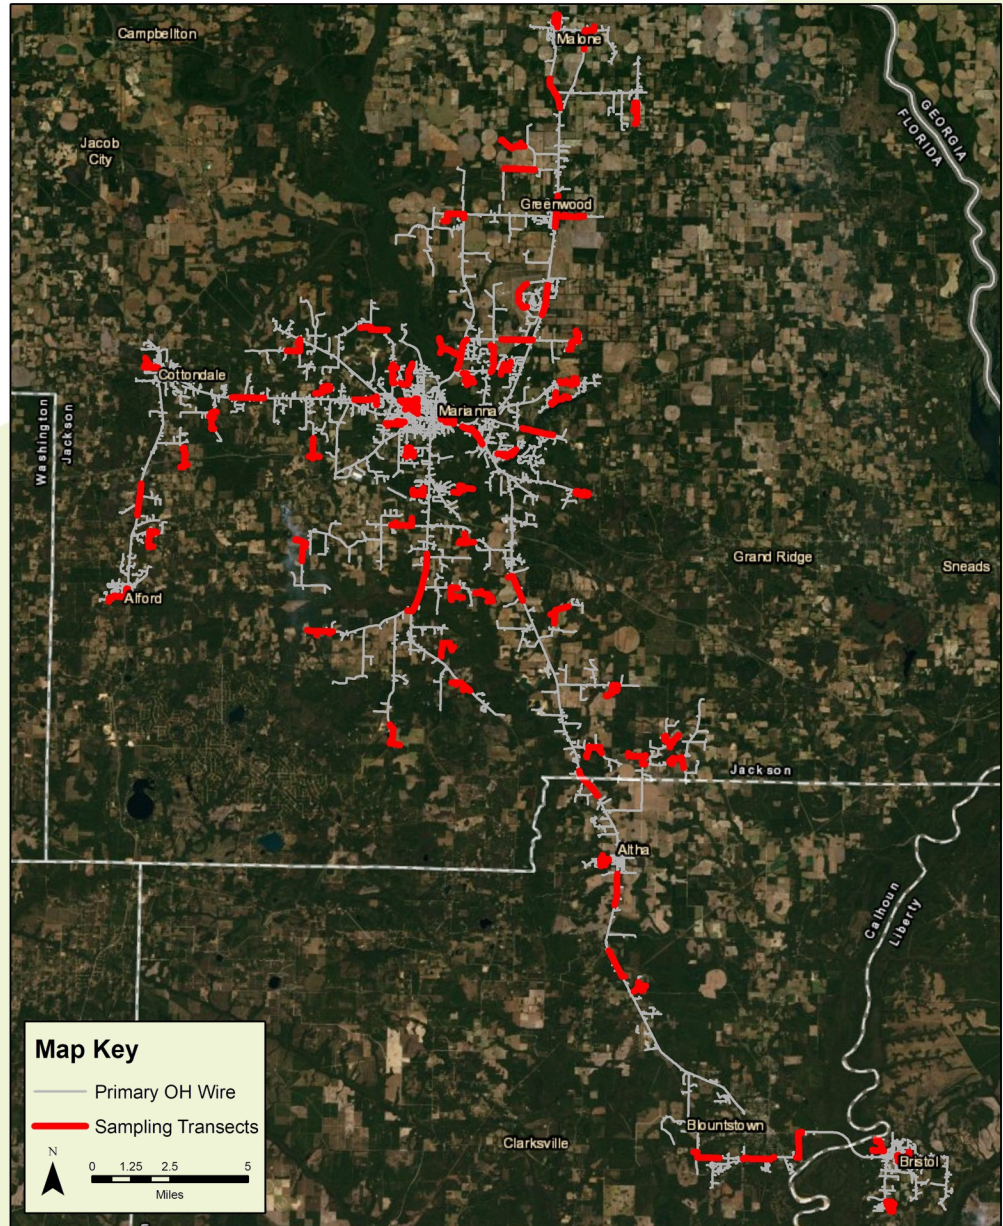

Tree Interface and Hurricane Michael

Tree interface is described as areas that will require routine maintenance of vegetation on one or both sides of the conductor by line clearing contractors. Through geospatial analytics, remote sensing and field verification it is determined that of the 615 FPU overhead conductor miles, 210 miles or 34% have tree interface. The small percent of tree interface on the FPU system can be accounted for, in some degree, by the effects of the 2018 Hurricane. This storm has leveled many forested acres in the FPU territory and reduced the remaining standing healthy trees considerably. One of the lasting effects of this storm is the existence of still standing Hazard trees that have been weakened or damaged.

Most utility vegetation management programs evaluate workload using circuit mileage; however, this fails to account for urban, agricultural, or industrial areas that do not present tree interface with utility assets. While these locations require continuing floor maintenance to address incompatible vegetation, they do not pose a current risk to utility assets.

Tree interface mileage, often a fraction of the total circuit miles, is a far more reliable source of information on which to inform data-driven forecasting, decision making, and resource management.

Tree interface miles does not include low undergrowth or brush under the conductors or facilities. This number would exclude any herbicide or mowing activities.

Substation	Circuit	Status	Total OH Miles	Tree Interface Miles	Tree Interface %
Altha	9952	STANDING	51.04	15.18	30%
Altha	9972	STANDING	13.75	2.85	21%
B-Town	9882	STANDING	54.12	17.21	32%
Caverns	9722	STANDING	13.94	4.46	32%
Caverns	9732	STANDING	6.3	2.46	39%
Caverns	9742	STANDING	61.06	19.83	32%
Caverns	9752	STANDING	4.21	0.24	6%
Marianna	9782	STANDING	3.85	1.45	38%
Chipola	9932	STANDING	32.14	14.81	46%
Chipola	9942	STANDING	62.13	15.6	25%
Chipola	9982	STANDING	52.366	19.43	37%
Chipola	9992	STANDING	15.63	5.69	36%
Marianna	9512	STANDING	18.08	6.3	35%
Marianna	9854	STANDING	107.02	33.8	32%
Marianna	9866	STANDING	79.7	30.1	38%
Marianna	9872	STANDING	39.65	19.8	50%
		STANDING	614.98	209.23	34%

Tree Wire Interface Miles by Phasing

		TWI Miles	Total Miles	% TIF
Single Phase	Bucket	92.52		
	Manual	55.83		
		148.35	390.45	37.99%
Two Phase	Bucket	8.8		
	Manual	2.81		
		11.61	30.32	38.29%
Three Phase	Bucket	34		
	Manual	16.1		
		50.1	194.24	25.79%
	Totals	210.06	615.01	34.16%

Tree Wire Interface Miles by work type

Based on the data from sample plots shown in the table below, FPUC has approximately 210 tree interface miles. 135.32 are accessible by bucket (64%) and 74.74 is non-accessible or climbing work(36%). Knowledge of the amount of manual and bucket accessible work will assist in determining the best crew complement to complete the work on a cyclical basis. It is best to normalize the contract crew complement from year to year. A normalize crew compliment will keep trained employees long term which will keep them engaged and take ownership in the line clearance program at FPUC.

	Miles	% of System
Manual	74.74	12%
Bucket	135.32	22%
Total Miles	210.06	34%

Accessibility of Vegetation Work

Accessibility by Sample Plot

Bucket Accessible areas across the sample area is at 87%. 83% single phase is accessible and approximately 100% of three phase. Accessibility was determined by majority of work in sample area. As discussed previously, this will assist in determining the appropriate crew complement to complete the assigned work in the most efficient and cost-effective manner. For Example, crew complement should be 2 - 3-man buckets, 1 manual crew, and a mechanical trimmer. In this case work group shall have the ability to complete designated work in inaccessible areas.

1Phase	Sample Plots	% of Accessibility
Acc	35	83%
Inaccessible	7	17%
3 Phase	20	
Acc	20	100%
Inaccessible	0	

Clearances

Average Distance All Phasing

Across the system, 68% have more than 6FT of clearance and of which 50% have over 10ft of clearance. As seen in table 4, an estimated 6% of vegetation has 5 to 6 ft clearance, 10% has 6 to 7 ft clearance, 8% has 8 to 9, and 50% has more than 10ft of clearance While only 26% (one quarter) have less than 4ft. The percentage of close trees can be potentially attributed to ANSI-A300 compliance and/or faster growing tree species known as “cycle busters”.

This shows that 74% of the vegetation is holding cycle, in compliance, and is an indicator of cycle length. Overall clearance across FPU system is acceptable. With only 26% averaging less than 4 ft of clearance, this indicates a 4-year cycle is obtainable.

Average Distance All Phasing	Locations	% of Clearance in Sample Areas	
1 to 2	8	13%	26%
3 to 4	8	13%	
5 to 6	4	6%	
6 to 7	6	10%	68%
8 to 9	5	8%	
10+	31	50%	
Total	62		

Average Distance by Phase

FPU is currently on a Three year cycle on 3 Phase and Six year on Single phase. As you can see from this data, the shorter cycle on three phase is maintaining the clearance over the duration of the cycle. While this is the case on three phase, conditions on single phase are much closer. The longer the cycle length, the greater risk for tree/wire contact and vegetation related outages. By moving the circuit bodies to a 4 year cycle and better adherence to line clearance specifications, FPU will be better able to maintain proper clearances and reduce the number of preventable outages due to vegetation.

Average Distance by Phase

Phase	Counts	% of Counts	1 to 2	3 to 4	5 to 6	6 to 7	8-9	10+	Total Occurrence Per Phase
Single phase	42	68%	6	8	2	6	3	17	42
Single All Samples %			10%	13%	3%	10%	5%	27%	
Single Only %			14%	19%	5%	14%	7%	40%	
Three Phase	20	32%	2	0	2	0	2	14	20
Three All Samples %			3%	0%	3%	0%	3%	23%	
Three Only %			10%	0	10%	0%	10%	70%	

Closest Vegetation to Facility by Distance

Average clearance across the FPU system is generally considered acceptable. However, 50 of the 62 samples have vegetation within 2 ft of energized conductors. This was due mainly to trees that had not been trimmed and not regrowth from previous trimming. Complete circuit trimming would significantly reduce the occurrences of trees within 2 foot of conductors.

The closest tree species in 23 of the 50 locations with vegetation within 2 ft of conductors have been identified as Oaks. Oak trees are generally a species with a slower growth rate and maintain clearances for the duration of the trim cycle when trimmed properly and to FPU line clearance specifications. Adherence to line clearance specifications would significantly reduce the frequency of Oaks as closest to conductors.

The FPU system has equal diversity of rural and residential/commercial locations in the sample areas. Of the sample locations, 55% are located in agricultural areas while 35% and 10% and in residential and commercial areas respectively. Estimated over the system this equates to 338 miles in Agricultural areas, 215 residential and 62 in commercial. Agricultural areas allow for higher usage of mechanical equipment and implementation of a robust herbicide program.

Closest Clearances	
0	20
1 to 2	30
3 to 4	7
5 to 6	1
6 to 7	1
8+	3
	62

All phase	Clearance	Count	Species
	0	20	9 -oak
	1-2	30	14 -Oak

Land Use		
Total records	62	
Ag	34	55%
Commercial	6	10%
Residential	22	35%

Occurrences of Vines by Phasing and Land Use

190 vine locations have been identified in the 62 sample areas. Of these locations, 148 are located on single phase and 42 are on three phase. Vine locations are spread evenly across the system. Residential areas account for 91 occurrences (48%), Agriculture account for 84 (44%) and commercial had 15 (8%).

FPU system has an average of 3.06 vines per mile or estimated 1882 locations. This data shows the importance of the implementation of a Vine program on FPU System. A vine program can be easily integrated into a robust herbicide program.



Vines	
1Phase	148
Ag	66
Res	82
Com	0
3 Phase	42
Ag	18
Res	9
Com	15
Total	190

Scheduling for Cycle

As discussed, there are 210 miles of existing tree interface on the FPU system. On a four-year cycle this would require vegetation trimming/removals on 52.5 miles of tree interface per year. In the table below (Table?) the tree interface is broken down into years, months, weeks then days to assist in determining actual workload and manpower requirements. This chart further breaks down the tree interface into bucket and manual to determine the number of tree crew requirements.

	System	Miles	Miles	Miles	Miles	Linear	Estimated Trees	Man Hours	Tree Crew
	Tree Miles	Per 4-year Cycle	Per Month	Per Week	Per Day	Feet Per Day	Average 20 ft Width	1 Hour Per Tree	Personnel
Bucket	135.32	33.83	2.82	0.68	0.14	714.49	35.72	35.72	4.5
Manual	74.74	18.69	1.56	0.37	0.07	394.63	19.73	19.73	2.5
Totals	210.06	52.52	4.38	1.05	0.21	1109.12	55.46	55.46	6.9

* Based on a 50 week work year

ANSI A300 Compliance

Ansi-A300 is the National Standard for proper trimming techniques. Compliance with ANSI-A300 is essential. 77% of samples are compliant while 23% is not. Ansi-A300 standards do not state any clearance specification but proper pruning techniques. If proper pruning techniques are used, they will assist in maintaining trim cycles and not adversely affect the health of the trees being maintained. Compliance with this standard should be improved if moving to a 4-year cycle. To assure compliance, Auditing of completed line clearing activities is recommended.

ANSI compliance		
No	14	23%
Yes	48	77%

Overhang

Documented overhang is vegetation directly above conductors that is not in compliance with FPU line clearance specifications. Thirty-two of the 40 single phase samples (76%) and 8 of the twenty 3-phase (40%) had at least one occurrence in the sample area.

Overhang	62	Miles Inspected	
Total	40		
1 phase	32	42	76.19%
3 phase	8	20	40.00%

Compliance with ANSI-A300 standards and cycle-based trimming would result in a reduction in occurrences and vegetation related outages.





Hazards

Identified hazards are identified as any dead, dying, leaning tree that could make contact with conductors and cause an interruption to electrical service. 73% of the single phase and 60% of the 3

phase samples have at least one occurrence of a hazard in the sample area. The high amount of hazards is impart but not solely due to Hurricane Michael in September, 2018. Implementation of a hazard tree program is recommended to reduce the probability of an interruption in electrical service due to identified hazards.

Hazards	Site	Occurrences		% with Haz	
		Acc	In-Acc		
Locations	62	43			
1 Phase	42	31	26	5	73.81%
3 Phase	20	12	12	0	60.00%

Storm Damage

While conducting the Tree/Wire Interface assessment, The DRG GIS dept has identified additional areas with storm damage have been identified from aerial photography. An additional 58.46 miles have been determined to have “storm damage”. Storm Damage areas is defined as areas with trees that have broken tops, leaning or damaged in other ways.

While this mileage is in addition to the TIF miles, It represents the damage caused by Hurricane Michael in 2018. While all of the areas may not have vegetation deemed hazardous to the electrical system, It represents the widespread damage due to Hurricane Michael in 2018.



Substation	Circuit	Status	Total Feet	Total Miles
Altha	9952	STORM DAMAGE	7725	1.46
Altha	9972	STORM DAMAGE	889	0.17
B-Town	9882	STORM DAMAGE	13259	2.51
Caverns	9722	STORM DAMAGE	4866	0.92
Caverns	9732	STORM DAMAGE	112	0.02
Caverns	9742	STORM DAMAGE	3804	0.72
Caverns	9752	STORM DAMAGE	550	0.1
Chipola	9782	STORM DAMAGE	30	0.01
Chipola	9932	STORM DAMAGE	12186	2.31
Chipola	9942	STORM DAMAGE	60918	11.54
Chipola	9982	STORM DAMAGE	32805	6.21
Chipola	9992	STORM DAMAGE	2126	0.4
Marianna	9512	STORM DAMAGE	3653	0.69
Marianna	9854	STORM DAMAGE	120005	22.73
Marianna	9866	STORM DAMAGE	36749	6.96
Marianna	9872	STORM DAMAGE	8972	1.7
			STORM DAMAGE	58.46

Tree Growth Regulators (TGR)

Tree growth regulators (TGR) are a way to reduce the growth rates in vegetation. TGR's are an option whenever a tree cannot be maintained to specifications and removal is not an option. Of the 62 miles on the assessment, only 5 trees were identified as TGR candidates. All five locations are on lower priority 1 phase lines in Residential and Agricultural areas.

Totals	Locations
1 Phase	5
3 phase	0


It is estimated that there would be only 20 TRG candidates across the system. The addition of a TGR program is not a cost-effective option for FPU due to low number of locations, set up and equipment and labor intensive.

Trapped Trees

Trapped trees are any small tree or brush that has the potential to contact conductors and has its upward growth pushed toward conductors. Trapped trees are excellent candidates for removal. Removal of trapped trees can reduce future workloads by number of trees to trim and disposal of debris generated for trimming activities. Trapped trees can be addressed by manual removal, mowing operations or herbicide application. If trapped trees are removed manually or by mowing operation, it is recommended to follow up with an herbicide stump treatment to minimize future regrowth and future workloads.

Most occurrences with Trapped Trees are mainly concentrated in Residential (27%) and Agricultural (31%) areas. Most occurrences of trapped trees have not been planted by property owners. They are volunteers that have been naturally seeded. With proper notification of residential customer, most all would be removed. In agricultural areas, many are located along fence lines and edge of right of ways and should be removed during routine maintenance.

Trapped Trees	TOTALS	Res	Com	Ag
Total Locations	40	17	4	19
All Phasing	62	27.42%	6.45%	30.65%
3 Phase	11	3	4	4
1 phase	29	14	0	15

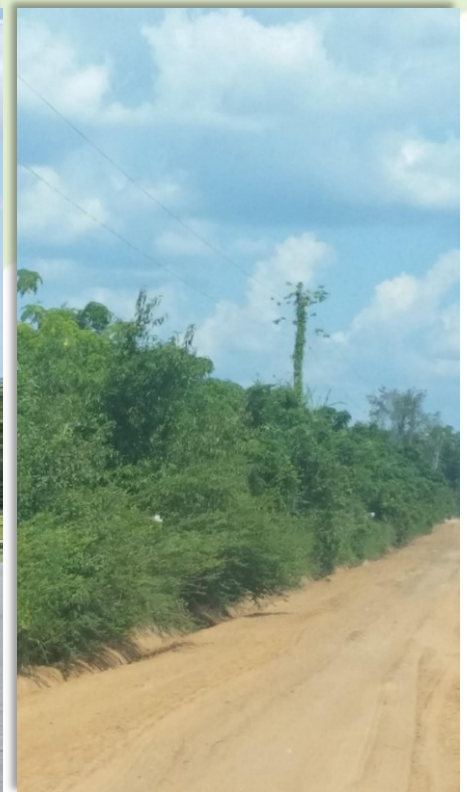

A strong post work audit should be completed to assure all trapped trees have been addressed.

Findings

Due to Hurricane Michael, FPUC has the opportunity to move to a 4 year cycle on all facilities. With moving to a 4 year cycle, we recommend the following:

Implementation of a Hazard tree Program. Michael was a category 5 hurricane when it made landfall on October 10, 2018. At landfall, Michael had sustained wind speeds of 160 mph. The path of the storm crossed directly over FPU service territory in Marianna, Florida.

Sustained winds at Marianna airport recorded at 102 mph, gusting to 122 mph. Due to Hurricane Michael, the FPU service territory has many potential hazardous trees across the system. Of the 62 sample areas, 43 have potential hazards. 73% of the 1 phase plots and 60% of the 3 phase have hazards.

In creating a hazard tree program, it must be determined what is the acceptable risk and redesign of these specifications.

Reduction of mowing program and increase in herbicide application. Mowing creates more incompatible vegetation with higher densities prior to mowing. The implementation of an expanded herbicide program will promote grasses instead.

An herbicide program will also assist with control of vines across the system. Of the 62 sample plots, 190 pole locations have been identified with vine conditions.

Circuit Based Trimming. Overall clearance across the FPU system is acceptable. While the average clearance is acceptable, 80% of the sample areas have vegetation within 2ft of conductors. Many of the sample areas had recent trimming activities but not fully completed. It is recommended to move to a circuit based approach to line clearance. This would be the assignment of complete circuits to the line clearing contractor. This approach would allow FPU to achieve and maintain a designated cycle for each circuit. Determining the order of each circuit would be determined based on a matrix of customer count, critical infrastructure and vegetation caused customer interruptions.

Tree/ Wire Interface findings. Of the 615 miles of OH conductors, only 210 miles require routine tree trimming. If wanting to move to a 4 year cycle, FPU will only need to trim an average of 52.5 miles per year. That is roughly 12 miles of 3 phase and 40 miles of laterals annually.

TRIM CYCLE RECOMMENDATIONS

DRG recommends FPU Marianna moving to a 4 year vegetation maintenance cycle. This recommendation is based on the current mileage needed to be maintained annually according to the Tree/Wire interface data.

DRG recommends the trim cycle laid out in Chart below. The trim cycle is based on the normalization of miles, customers affected and critical customers determined by FPUC.

Substation	Circuit	1 Ph	2Ph	3Ph	Total OH Miles	Tree Interface	Cycle	Cust Count	% OF System
Marianna	9512 Railroad	6.82	1.16	10.11	18.09	6.3	1	609	
Caverns	9722 Dogwood Height	10.53	0	3.4	13.93	4.85	1	290	
Caverns	9742 Greenwood	34.83	1.63	24.59	61.05	20.21	1	1113	
Marianna	9782 Family Dollar	0.72	0	3.13	3.85	1.45	1	23	
Marianna	9872 Hospital	30.02	2.76	6.87	39.65	19.8	1	767	
					136.57	52.61		2802	22.20%
Caverns	9732 Prison	0.55	0	5.75	6.3	2.46	2	51	
Caverns	9752 Industrial Park	0.28	0	3.94	4.22	0.24	2	43	
Marianna	9866 Cottondale	54.11	2.89	22.7	79.7	30.1	2	1424	
Chipola	9982 College	23.95	6.47	21.95	52.37	19.58	2	1132	
					142.59	52.38		2650	23.20%
Chipola	9942 Hwy 90e	40.15	2.65	19.34	62.14	15.6	3	726	
Altha	9972 Blountstown	5.96	0.19	7.61	13.76	2.85	3	192	
Marianna	9854 South Street	85.16	4.02	17.84	107.02	33.8	3	1908	
					182.92	52.25		2826	29.70%
B-Town	9882 Bristol	34.4	3.39	16.34	54.13	17.21	4	1034	
Chipola	9932 Indian Springs	17.43	3.9	10.81	32.14	14.81	4	931	
Altha	9952 Altha	39.45	0.29	11.3	51.04	15.18	4	859	
Chipola	9992 Hwy 90w	6.1	0.96	8.57	15.63	5.69	4	921	
					152.94	52.89		3745	24.70%
Totals					615.02	210.13		12023	

To complete the annual trim cycle, it is recommended the utilization of three aerial lift trucks with chippers. Of the three, two shall have the crews with the capabilities of climbing trees as needed.

For the completion of customer tickets and emergency work, it is recommended a fourth aerial truck be utilized until the first four year cycle has been completed.